

- GENERAL
 - This drawing is not to be scaled, work to figured dimensions only, confirmed on site.
 - This drawing is to be read in conjunction with all relevant architectural drawings, detailed specifications where applicable and all associated drawings in this series.
 - Any discrepancy on this drawing is to be reported immediately to the partnership for clarification.
 - The contractor is responsible for all temporary works and for the stability of the works in progress.
- DRAINAGE GENERAL
 - All foul and storm water drains which are not to be adopted as public sewers under a section 104 Agreement must be constructed in accordance with the Building Regulations, BS EN 752 and where appropriate the relevant agreement certificates.
 - Manholes, gullies, gully connections, sewers and other sewerage structures intended to convey surface water are to be constructed in accordance with the Water Authorities Association Specification 'Sewers for Adoption' 7th Edition and relevant Council Design Guide.
 - All concrete used in drainage works to comply with BRE Digest 363 for Class 2 sulphate conditions.
- BELOW GROUND DRAINAGE
 - Pipework to be UPVC-U pipes to BS 4660 : 2000 and Inspection Chambers to BS 7158 : 2001.
 - All adoptable drainage to be constructed in accordance with 'Sewers for Adoption' 7th Edition and the relevant Council Design Guide.
 - All private surface water sewers to be laid at 1 in 80 unless otherwise stated on the drawing.
 - All private foul water sewers to be laid at 1 in 40 at the head of pipe runs and 1 in 80 elsewhere unless otherwise stated.
 - All private foul sewer pipes to be 100mm diameter unless otherwise stated on the drawing. All private surface water sewer pipes to be 100mm diameter from downpipes and 150mm diameter elsewhere unless otherwise stated on the drawing.
 - Allow for rodding access above ground where rainwater downpipes do not have a direct connection to an inspection chamber.
 - Existing sewer pipe to be re-used to be surveyed and levelled prior to commencement of the drainage works and refurbished if necessary.
 - Connections to an adopted sewer only to be made following approval from the relevant adopting Authority.
 - All drains, sewer pipes and manholes to be cleaned and tested for watertightness on completion of construction.
- MANHOLE COVERS & FRAMES
 - Manhole covers to be class D400 in highways, class B125 in footways and verges, class C250 in external maintenance vehicle access areas and verges, and class A15 in non-trafficked areas.
 - Manhole covers and frames to be bedded and surrounded in 1:3 mortar.
- PIPES
 - Plastic pipes shall be of unplasticised polyvinyl chloride (UPVC) complying with the requirements of BS EN 1401-1:2009.
 - Concrete pipes shall be spun by a centrifugal process or be vertically pressed. They shall possess self inverting sockets and shall comply with the requirements of and be tested in accordance with BS 5911:2002.

NOTES

LAYOUT BASED ON PLANNING LAYOUT.

FOUNDATION ARRANGEMENT TBC.

DEPTH OF DRAINAGE FEATURES TBC PENDING FURTHER TOPOGRAPHICAL INFORMATION.

DETAILS OF EXISTING SEWERS TBC.

FINISHED FLOOR LEVEL TBC.

CULVERTED WATERCOURSE DIVERSION PENDING APPROVAL FROM RELEVANT AUTHORITIES.

SURFACE WATER DISCHARGE CONNECTION SUBJECT TO APPROVAL FROM RELEVANT AUTHORITIES.

SUB-BASE DEPTH TBC PENDING SITE INVESTIGATION.

SITE LEVELS TO ARBITRARY DATUM.

ROOT BARRIER ADDED TO SECTIONS AND DETAIL	MB AK	22.05.20	P5
CONNECTION DETAIL UPDATED TO COMMENTS	MB AK	06.04.20	P4
UPDATED TO DRAINAGE OFFICER COMMENTS	MB AK	03.04.20	P3
CONNECTION DETAIL ADDED, JOINT DETAIL AMENDED	MB AK	31.03.20	P2
UPDATED TO DRAINAGE OFFICER COMMENTS	MB AK	16.03.20	P1
MANHOLE AND PIPE BEDDING DETAILS ADDED	MB AK		
FIRST ISSUE	MB AK		

PRELIMINARY DRAWING

NOT FOR CONSTRUCTION

Title
PROPOSED DRAINAGE STRATEGY
WATERCOURSE SECTIONS


Project
74-76 CANADA ROAD, ARUNDEL

Client
BARRATT HOMES


HOP
CONSULTING CIVIL AND
STRUCTURAL ENGINEERS

HOP House, 41 Church Road
Hove, East Sussex BN3 2BE
www.hop.uk.com
ask@hop.uk.com
+44 (0)1273 223900


Drawing No.	15718-HOP-ZZ-XX-DR-C-10002	Status	S0
Rev.	P5		

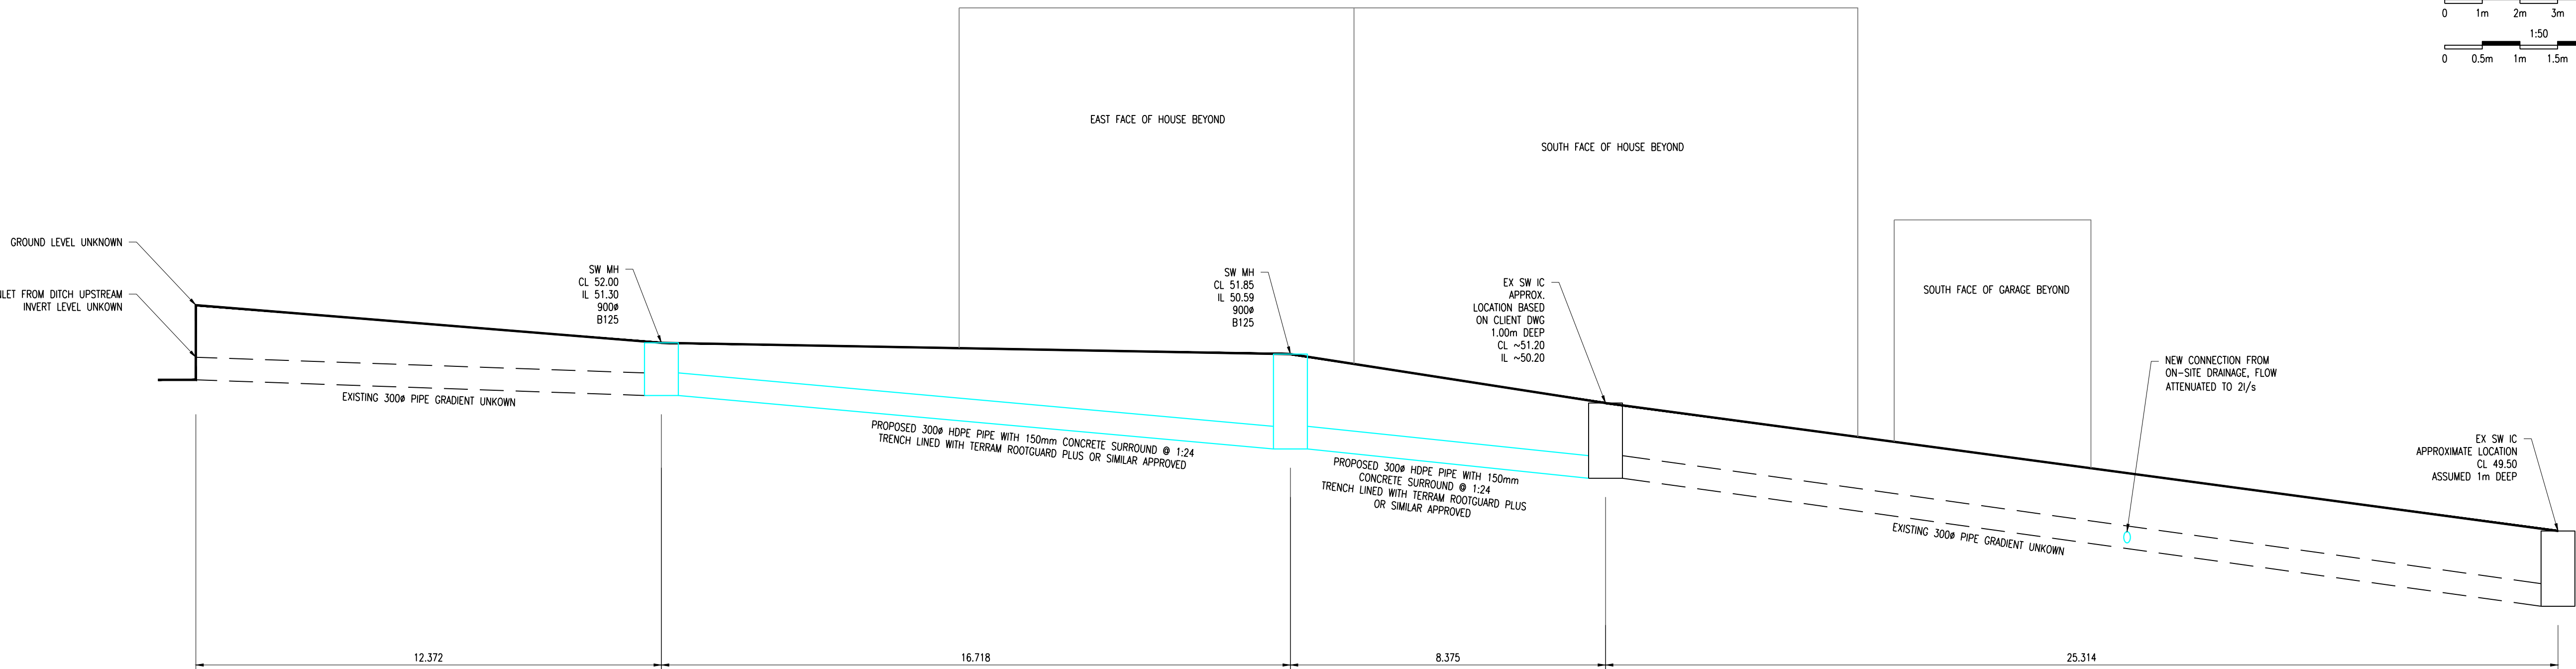


PROPOSED WATERCOURSE LONG-SECTION
(2x VERTICAL EXAGGERATION)
(1:100)

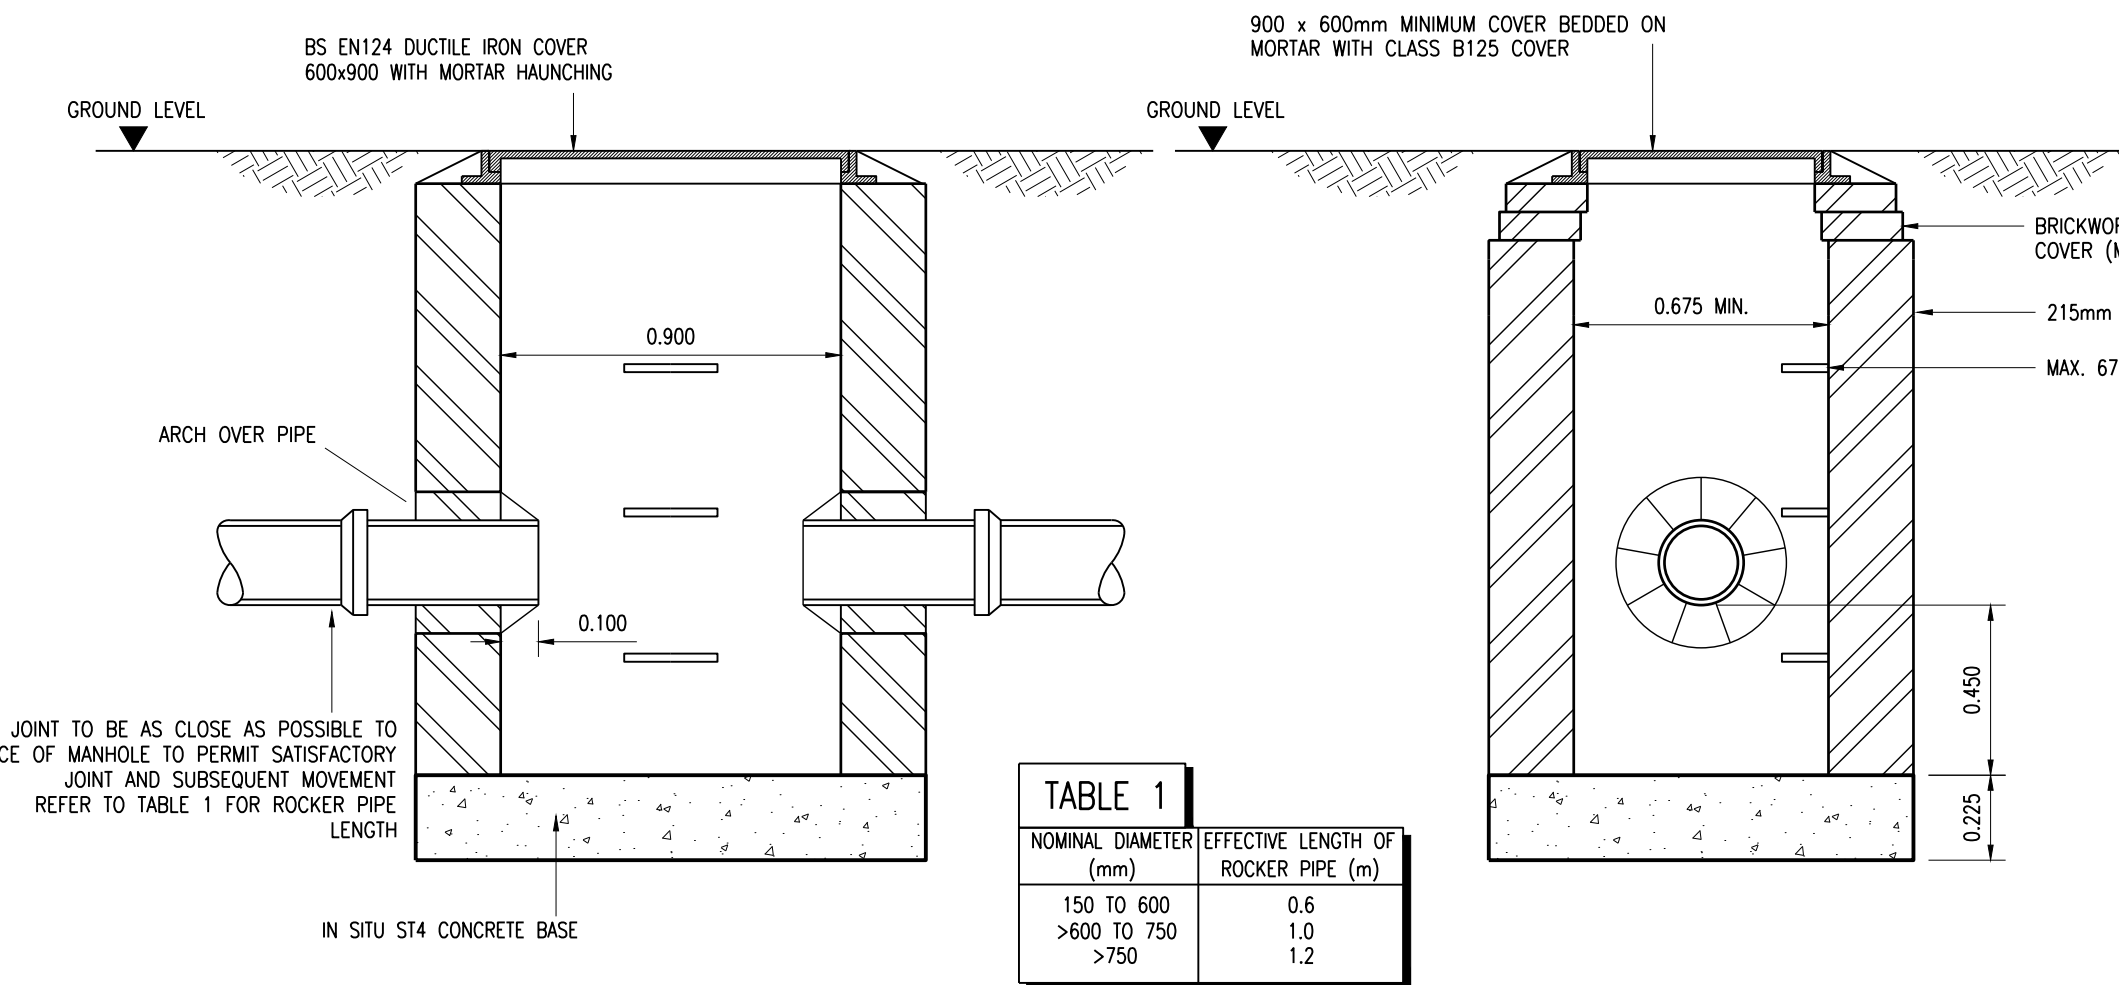


TYPICAL TYPE 4 MANHOLE
<1.5m TO PIPE SOFFIT
(REFER TO ARUN DISTRICT COUNCIL
DRAWING 80000502 rev.B)
(1:20)

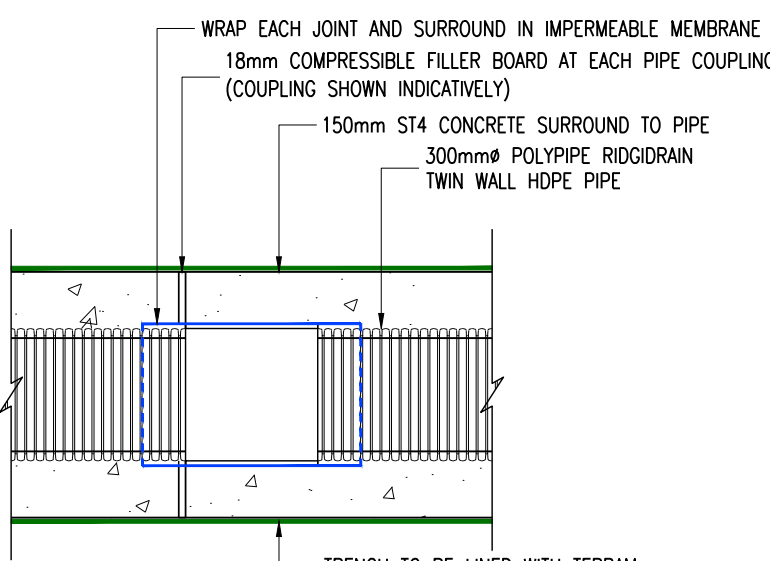


PIPE DIVERSION BEDDING DETAIL
(1:20)

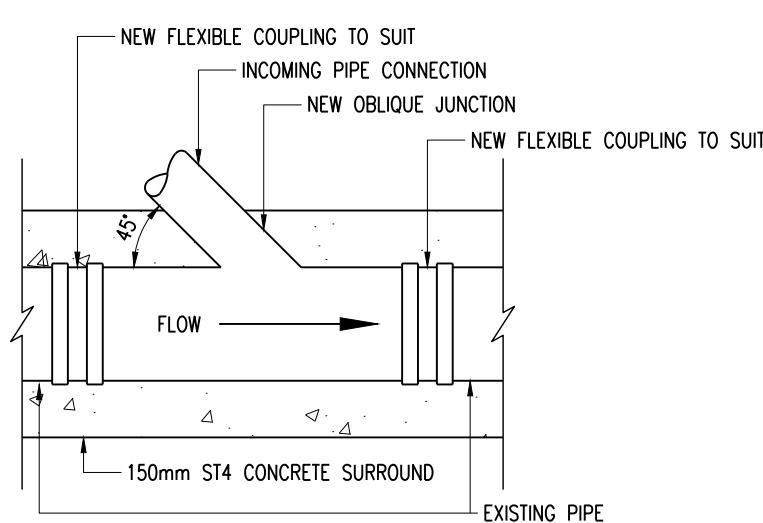

PRIVATE STORM DRAINAGE CONNECTION DETAIL
(CONNECTION TO BE MADE AT 10 OR 2 O'CLOCK IN SECTION)
(1:20)

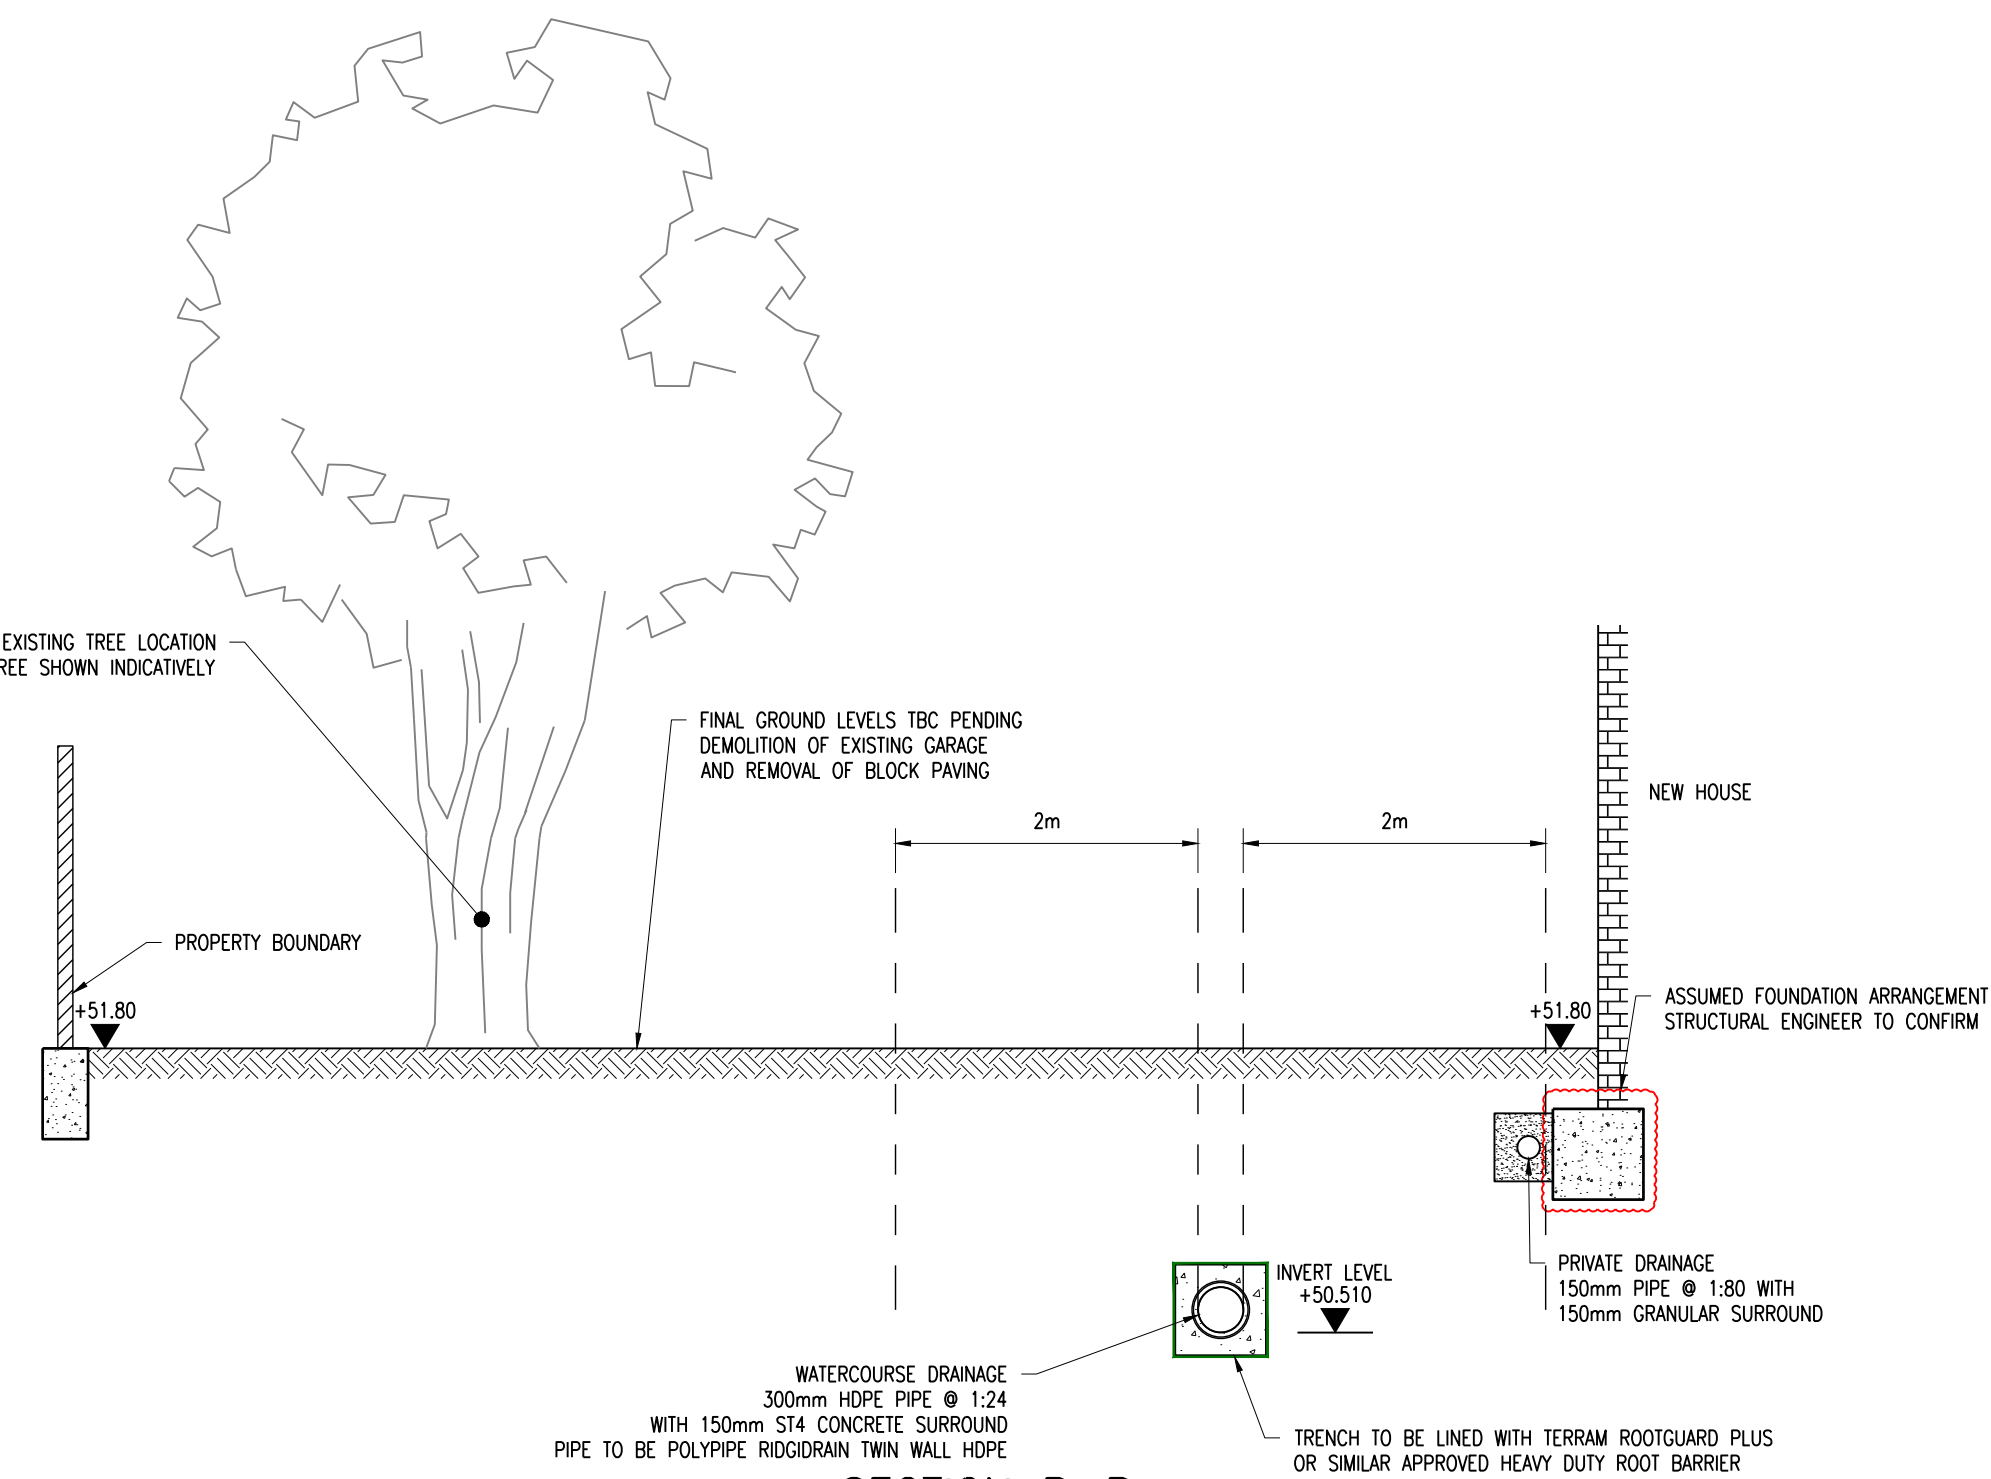

SECTION B-B
(1:50)

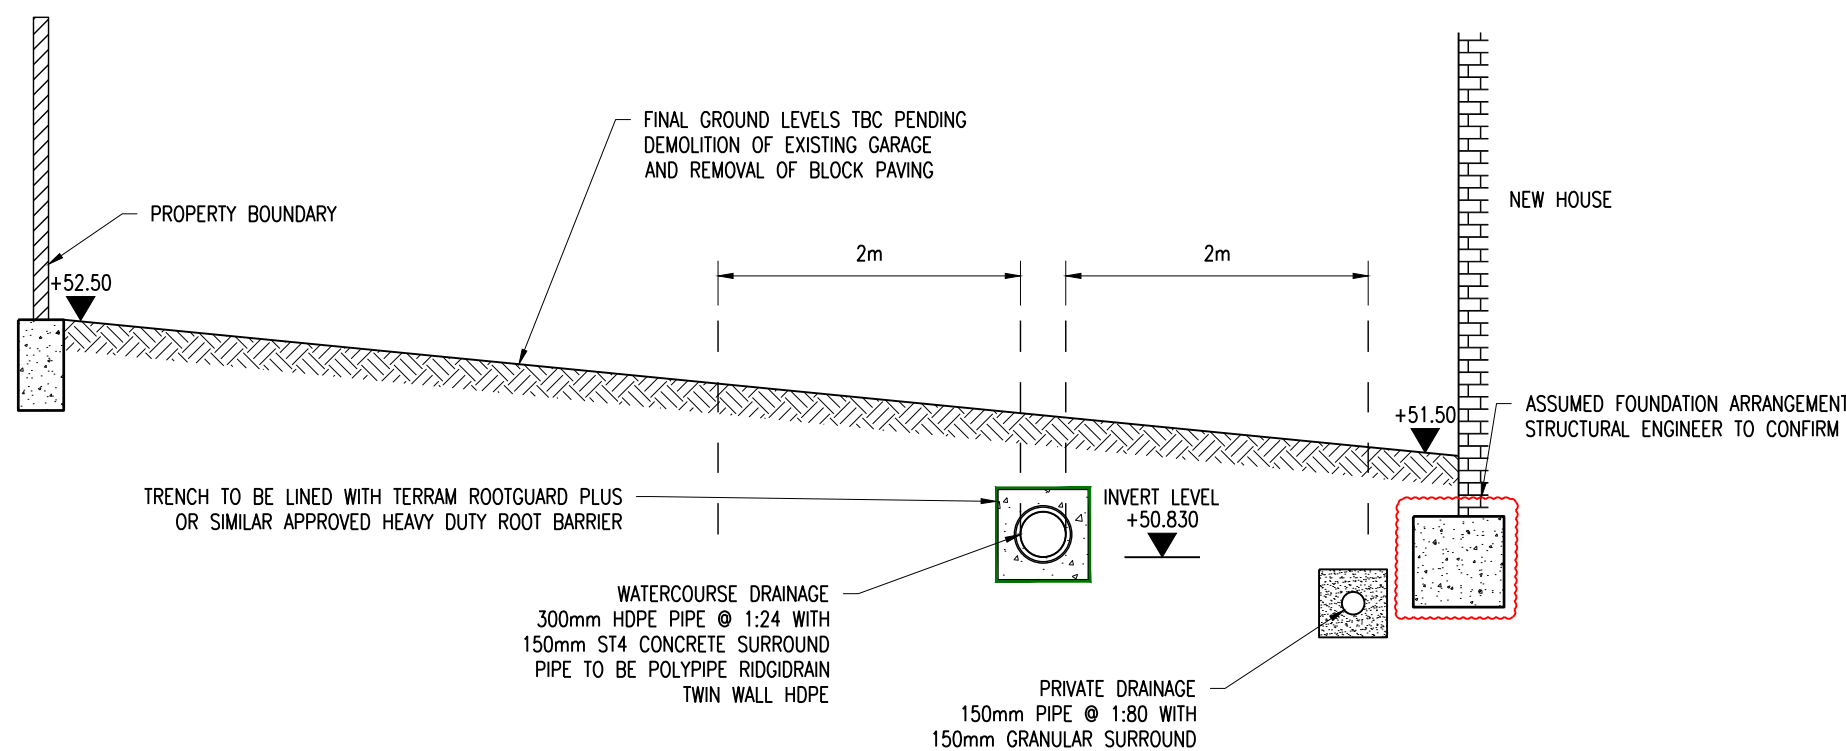

SECTION A-A
(1:50)