


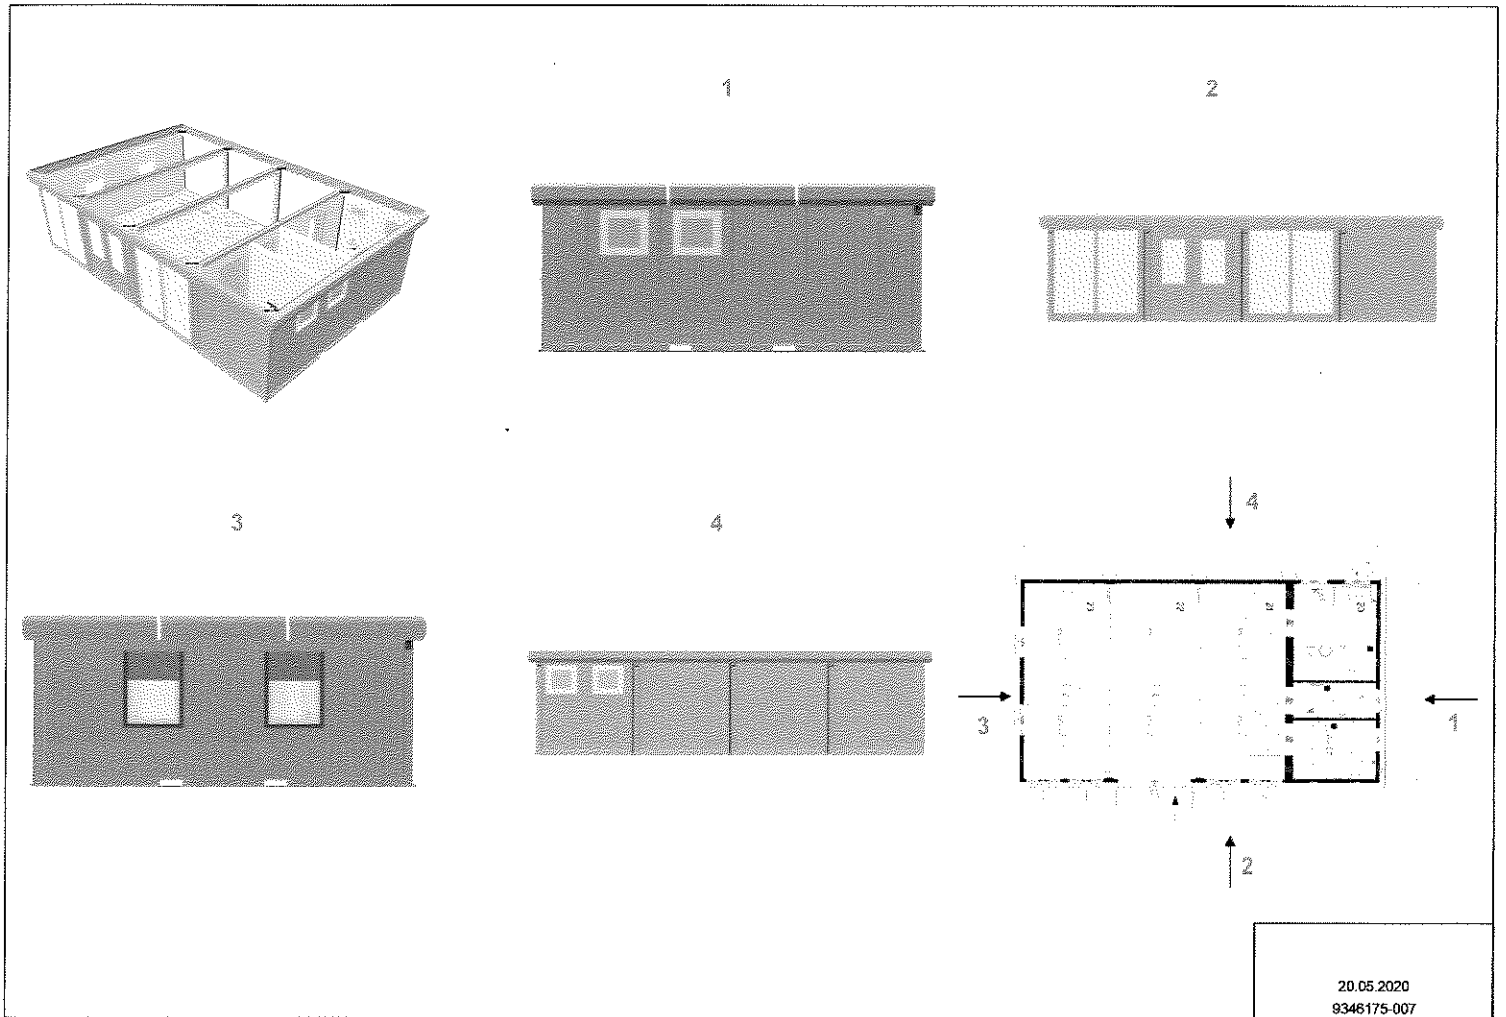

FIRE ALARM CALL POINTS TO BE INCLUDED + EXTINGUISHERS
LOCATIONS SUBJECT TO CONSULTATION WITH W.S.F.B.