


Appendix A Existing Services Records - Affected



openreach

Our Ref: Ref shown on map

Date of issue: shown on map



Dear Customer,

NR & SW ACT 1991 – PROPOSED WORKS AT: **SITE LOCATION**

Prior to commencement of work: For free onsite guidance and accurate up to date location of BT Apparatus please contact our Plant Protection Service by the following methods:-

Email the Click Before You Dig Team 

Visit the Click Before You Dig Website 


Thank you for your request of **/**/** describing the above proposals.

Enclosed are copies of our drawings marked up to show the approximate locations of BT apparatus in the immediate vicinity of your works. It is intended for general guidance only. No guarantee is given of its accuracy.

The drawings are valid for 90 days from the date of issue and should not be relied upon after this time period has expired.

When planning excavation work or other works near to BT apparatus, please be mindful our apparatus may exist at various depths and may deviate from the marked route.


To avoid damage it is recommended that mechanical excavators or borers are not used within 600mm of BT apparatus. If scaffolding is erected, please ensure that our equipment is not enclosed, blocked, covered or otherwise obstructed by the scaffolding.

In the event of BT apparatus being in the area of your works we recommend that your plant/vehicle crossing is either resited, or apply for a budget estimate by submitting detailed plans to our Network Relocation Team at 

Yours faithfully,

Jason Carrington
NNHC & MBE Manager

Maps by email Plant Information Reply

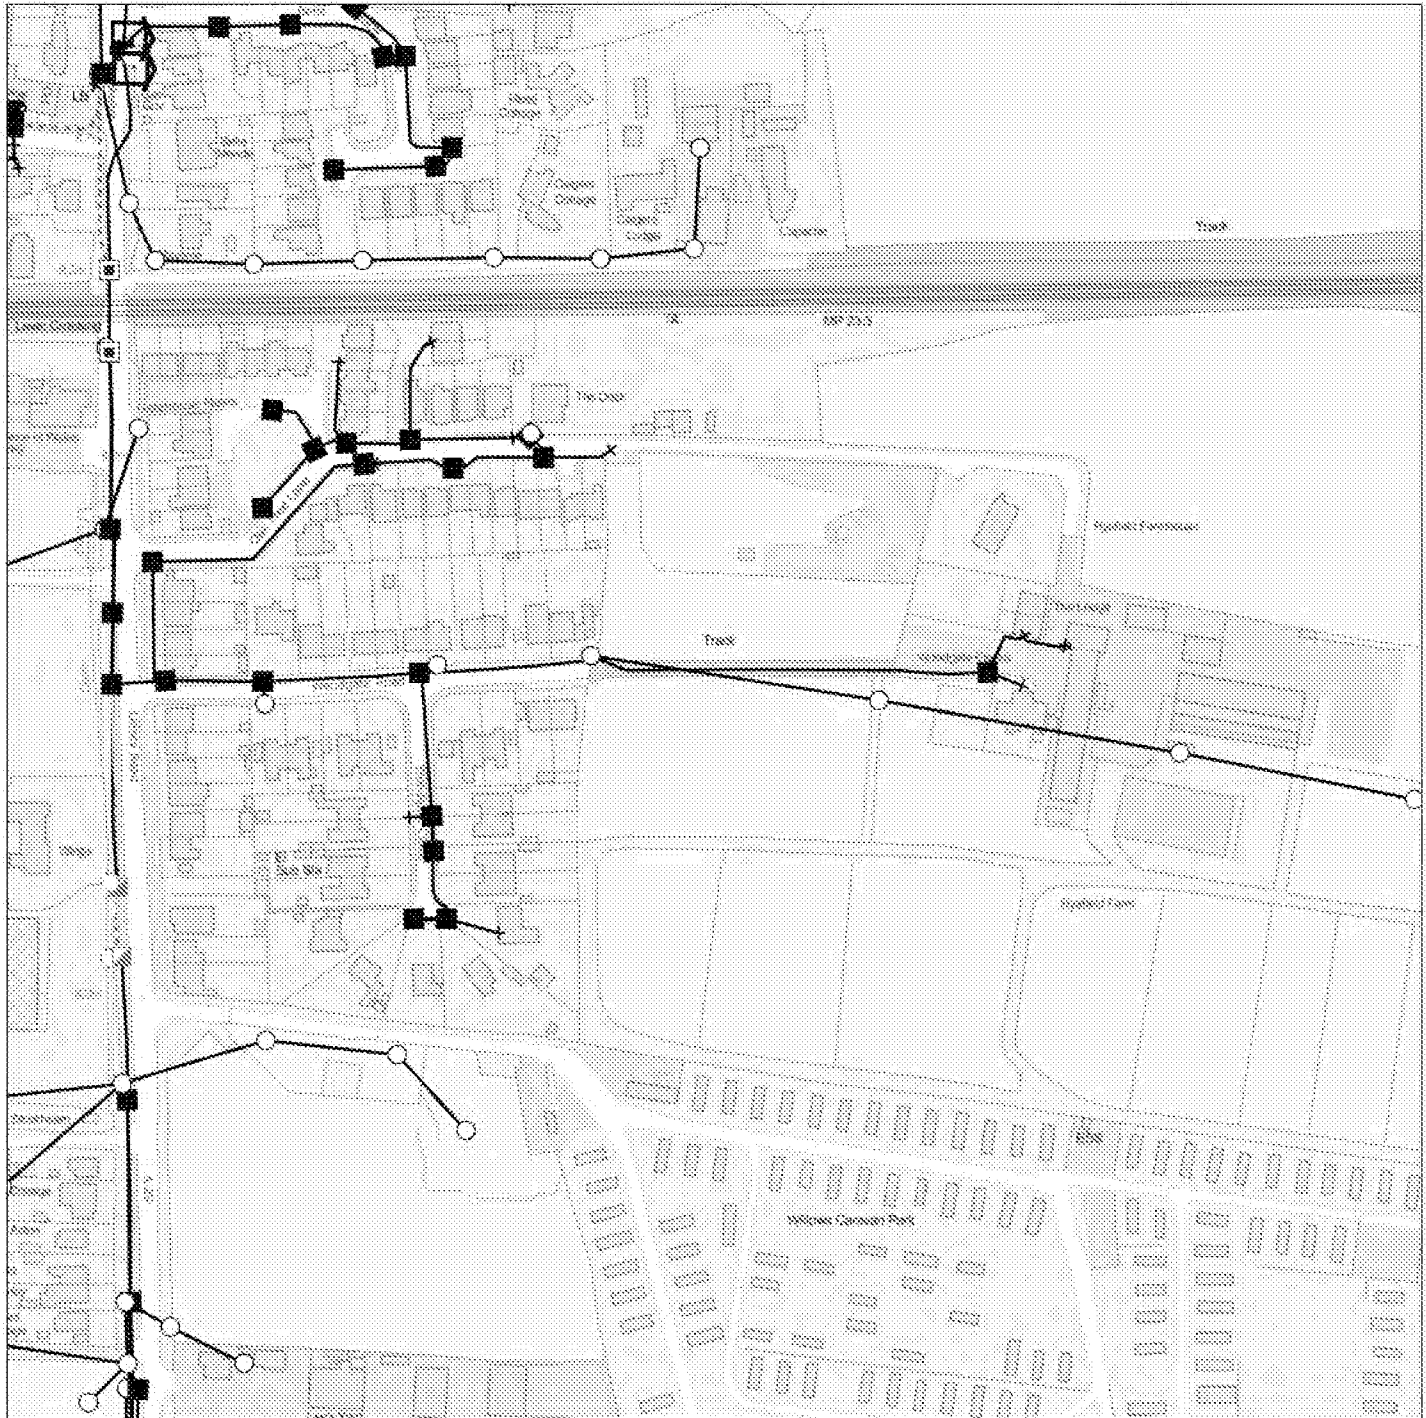

IMPORTANT WARNING

Information regarding the location of BT apparatus is given for your assistance and is intended for general guidance only. No guarantee is given of its accuracy. It should not be relied upon in the event of excavations or other works being made near to BT apparatus which may exist at various depths and may deviate from the marked route.



openreach

CLICK BEFORE YOU DIG

FOR PROFESSIONAL FREE ON SITE ASSISTANCE PRIOR TO COMMENCEMENT OF EXCAVATION WORKS INCLUDING LOCATE AND MARKING SERVICE

email chyd@openreach.co.uk

ADVANCE NOTICE REQUIRED
(Office hours: Monday - Friday 08.00 to 17.00)
www.openreach.co.uk/click

Accidents happen

If you do damage any Openreach equipment please let us know by calling 0800 023 2023 (opt 1 + opt 1) and we can get it fixed ASAP

KEY TO BT SYMBOLS

	Planned	Live	Change Of State	+	Hatchings	
PCP			Split Coupling		Built	
Pole			Duct Tee		Planned	
Box			Building		Inferred	
Manhole			Kiosk		Duct	
Cabinet			Other proposed plant is shown using dashed lines. BT Symbols not listed above may be disregarded. Existing BT Plant may not be recorded. Information valid at time of preparation. Maps are only valid for 90 days after the date of publication.			
	Pending Add	In Place	Pending Remove	Not to Use		
Power Cable						
Power Duct				N/A		

Reproduced from the Ordnance Survey map by BT
by permission of Ordnance Survey on behalf of the
Controller of Her Majesty's Stationary Office
(C) Crown Copyright British Telecommunications plc 100028040

BT Ref : ELH06471K

Map Reference : (centre) SU9400504179

Easting/Northing : (centre) 494005,104179

Issued : 24/11/2020 18:48:03

WARNING: IF PLANNED WORKS FALL INSIDE HATCHED AREA IT IS ESSENTIAL BEFORE PROCEEDING THAT YOU CONTACT THE NATIONAL NOTICE HANDLING CENTRE. PLEASE SEND E-MAIL TO: nnhc@openreach.co.uk

Maps by email Plant Information Reply



IMPORTANT WARNING

Information regarding the location of BT apparatus is given for your assistance and is intended for general guidance only. No guarantee is given of its accuracy. It should not be relied upon in the event of excavations or other works being made near to BT apparatus which may exist at various depths and may deviate from the marked route.



openreach

CLICK BEFORE YOU DIG

FOR PROFESSIONAL FREE ON SITE ASSISTANCE PRIOR TO COMMENCEMENT OF EXCAVATION WORKS INCLUDING LOCATE AND MARKING SERVICE

email chyd@openreach.co.uk

ADVANCE NOTICE REQUIRED
(Office hours: Monday - Friday 08.00 to 17.00)
www.openreach.co.uk/locate

Accidents happen

If you do damage any Openreach equipment please let us know by calling 0800 023 2023 (opt 1 + opt 1) and we can get it fixed ASAP.

KEY TO BT SYMBOLS

	Planned	Live	Change Of State	+	Hatchings	
PCP			Split Coupling		Built	
Pole			Duct Tee		Planned	
Box			Building		Inferred	
Manhole			Kiosk		Duct	
Cabinet			Other proposed plant is shown using dashed lines. BT Symbols not listed above may be disregarded. Existing BT Plant may not be recorded. Information valid at time of preparation. Maps are only valid for 90 days after the date of publication.			
	Pending Add	In Place	Pending Remove	Not to Use		
Power Cable						
Power Duct				N/A		

Reproduced from the Ordnance Survey map by BT
by permission of Ordnance Survey on behalf of the
Controller of Her Majesty's Stationary Office
(C) Crown Copyright British Telecommunications plc 100028040


BT Ref : UKD06478J


Map Reference : (centre) SU9446904179

Easting/Northing : (centre) 494469,104179

Issued : 24/11/2020 18:48:14

WARNING: IF PLANNED WORKS FALL INSIDE HATCHED AREA IT IS ESSENTIAL BEFORE PROCEEDING THAT YOU CONTACT THE NATIONAL NOTICE HANDLING CENTRE. PLEASE SEND E-MAIL TO: nnhc@openreach.co.uk

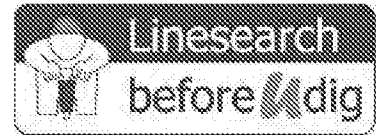

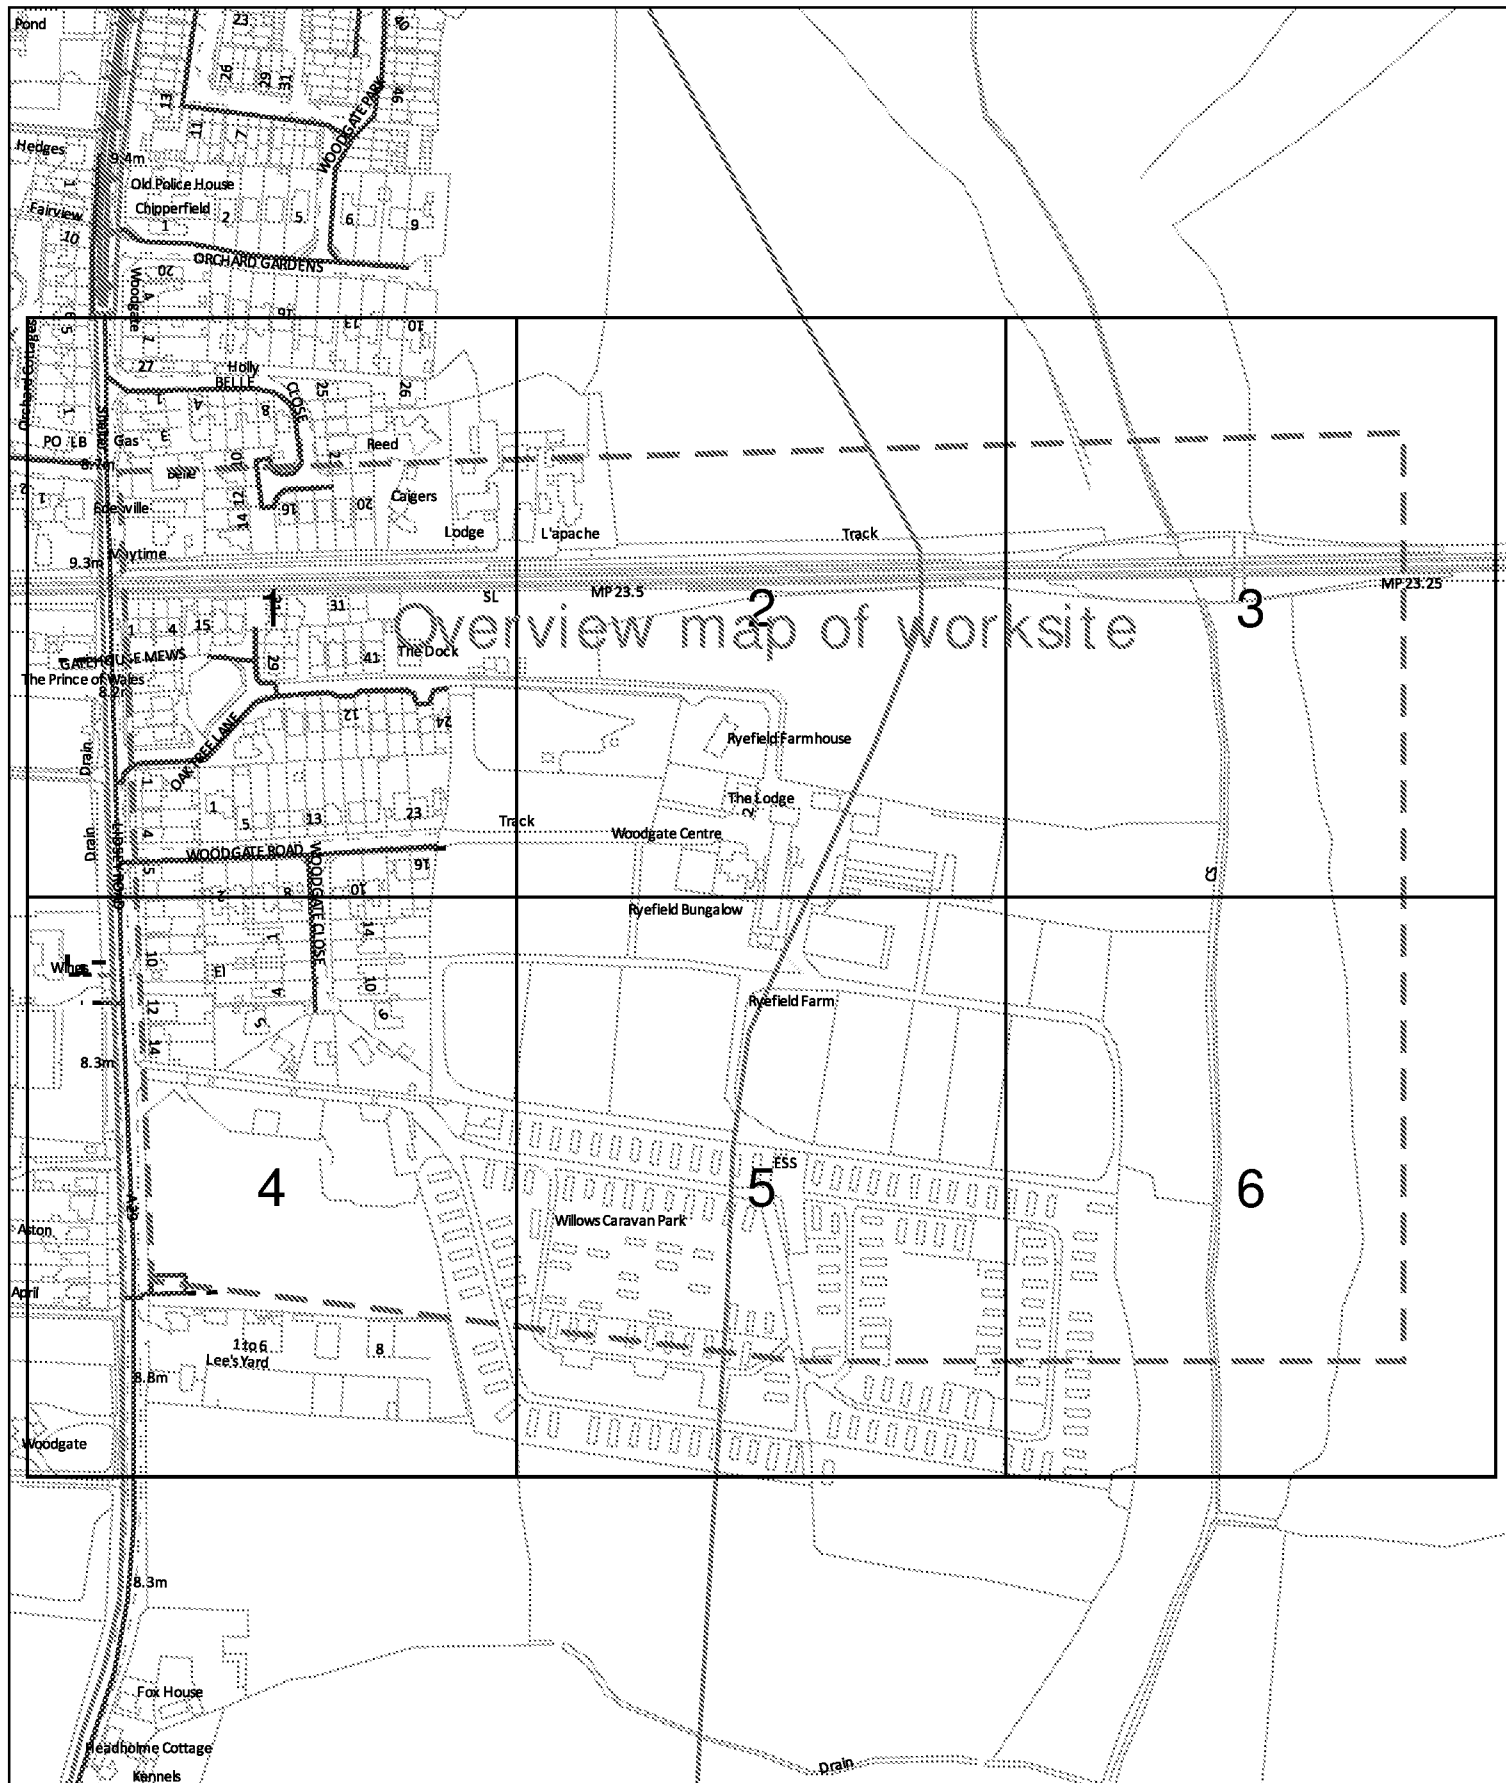

Dig Sites Area: Line: Measurements scaled from this plan may not match measurements between the same points on the ground.

Date Requested: 23/ 11/ 2020
Job Reference: 20614304
Site Location: 494129 104180
Requested by: Ms Christina Elliott

Your Scheme/ Reference: LM
90619/ SBS


Scale: 1:3837 (When plotted at A4)

Distribution Mains Raw Water Main Fire Main Abandoned Mains
 Communication Pipe Trunk Main Private Mains Cable

The information supplied is given in good faith as a guide to locating underground apparatus. Its accuracy cannot be guaranteed, nor does it include comprehensive information about the existence or location of service pipes or cables to individual premises. The responsibility for locating and avoiding damage to apparatus on site shall be that of the person proposing to excavate in the street who shall be liable to the apparatus owner and any third party who may be affected in any way for any loss or damage caused by their failure to do so.



Registered Office
P.O. BOX NO. 8, West Street, Havant,
Hampshire. PO9 1LG.
Registered in England No. 2536455
Telephone: (023) 9249 9888
Fax: (023) 9245 3632
Website: www.portsmouthwater.co.uk

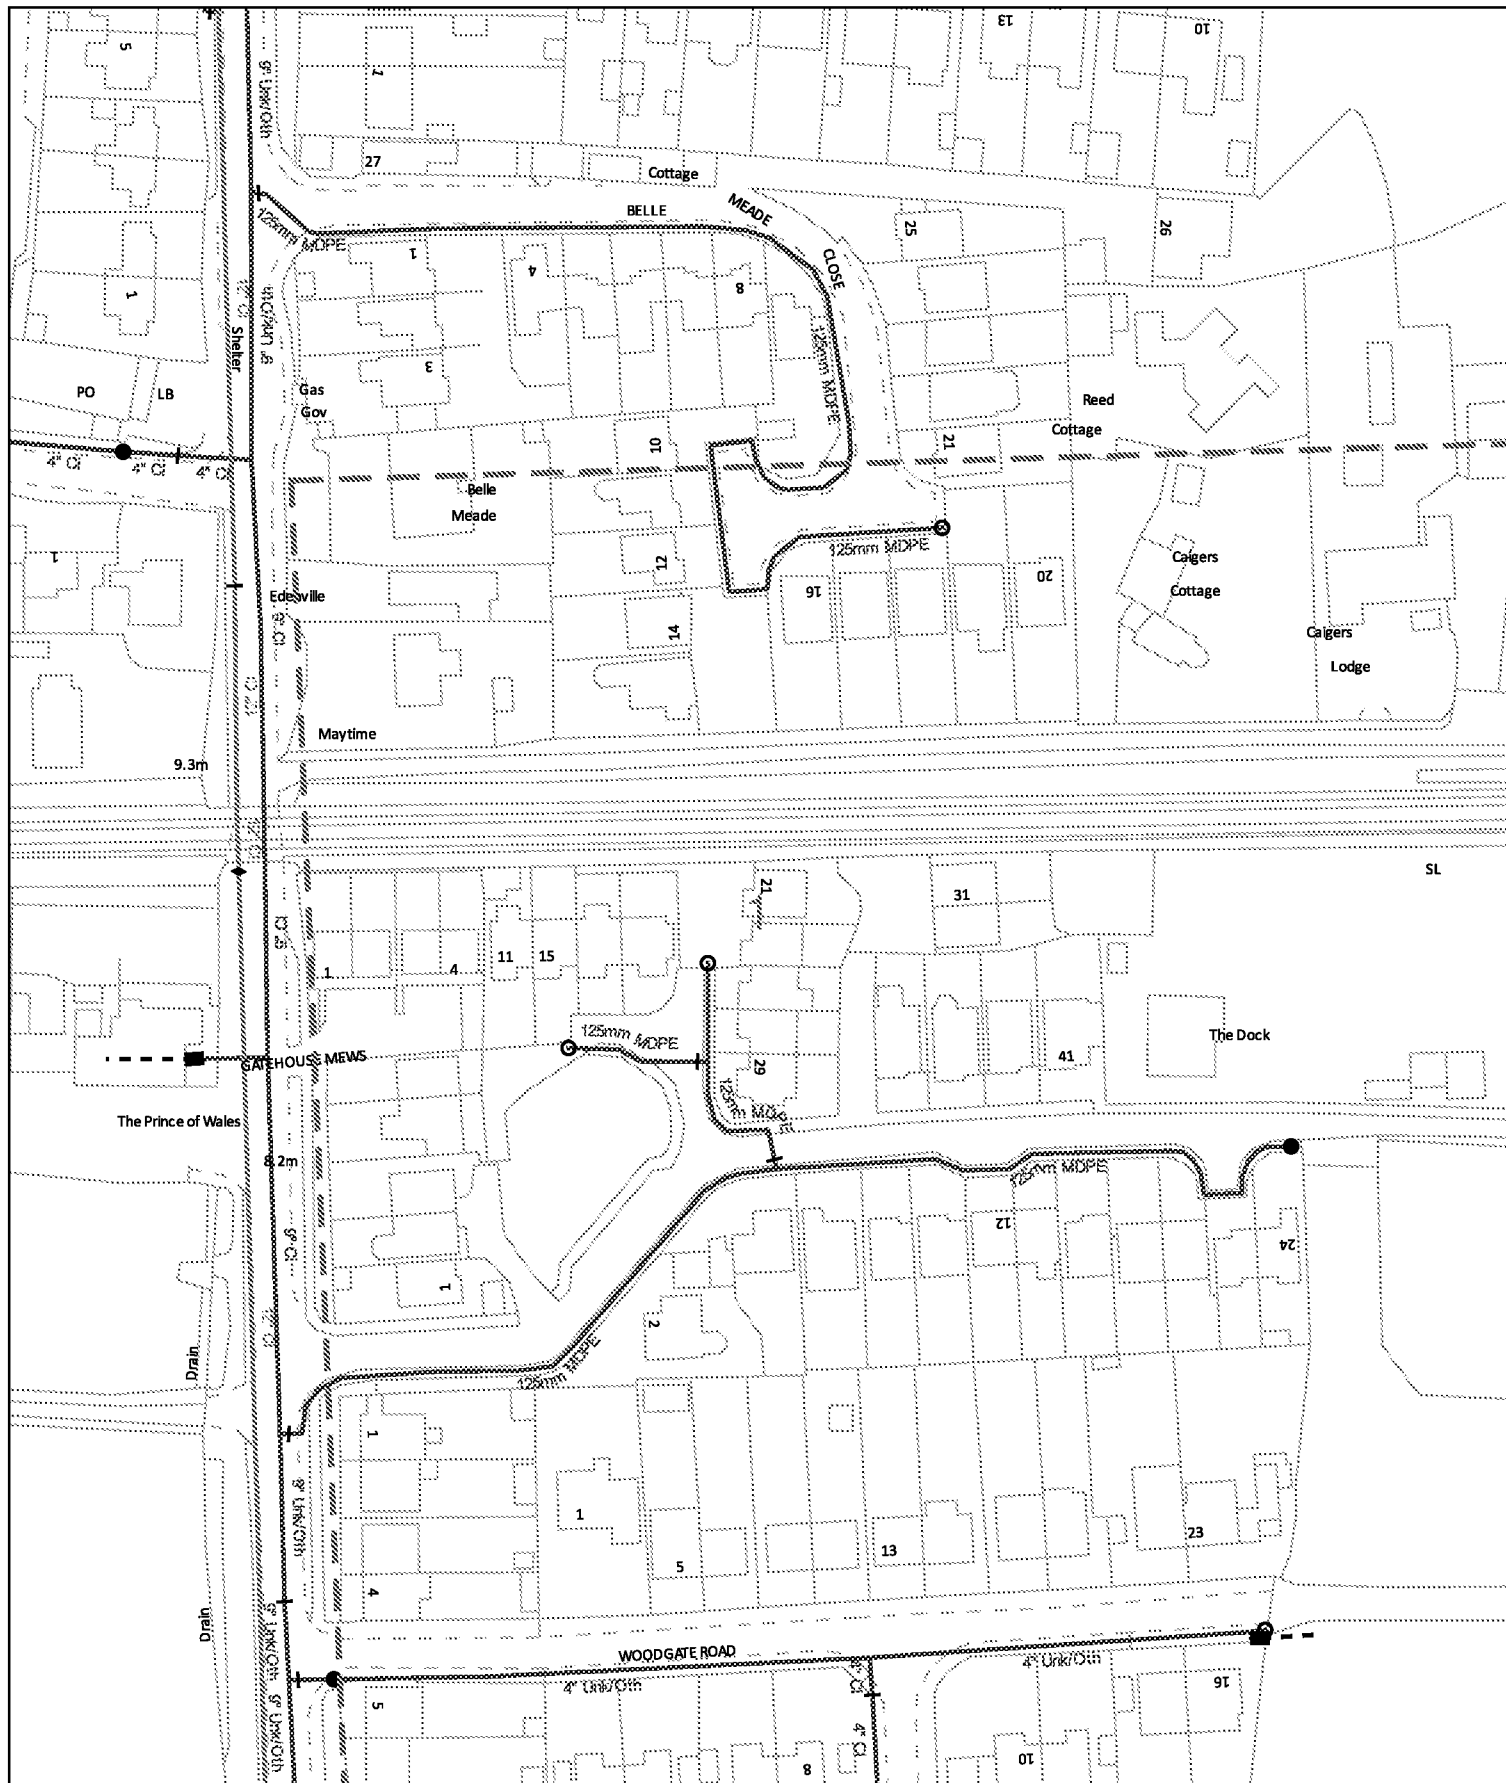

0 50m Dig Sites Area: Line: Measurements scaled from this plan may not match measurements between the same points on the ground.

Date Requested: 23/ 11/ 2020
 Job Reference: 20614304
 Site Location: 494129 104180
 Requested by: Ms Christina Elliott
 Your Scheme/ Reference: LM 90619/ SBS


- | | | | |
|--|--|--|---|
| <ul style="list-style-type: none"> Distribution Mains Communication Pipe Fire Main Private Mains Raw Water Main Trunk Main | <ul style="list-style-type: none"> Abandoned Mains Cable Company Washout Hydrant (Single) Company Washout Hydrant (Off set) Fire Brigade Hydrant (Single) Fire Brigade Washout Hydrant Fire Brigade Hydrant (Off set) | <ul style="list-style-type: none"> Reflux Valve Air Valve Open Valve Closed Valve Capped End Stop Cock | <ul style="list-style-type: none"> Butterfly Valve Pressure Flow Valve Meter New Appointments & Variations Assets within shaded area please contact Leap Utilities Email: water@leaputilities.co.uk Tel: 0345 122 6780 |
|--|--|--|---|

Scale: 1:1250 (When plotted at A4)

The information supplied is given in good faith as a guide to locating underground apparatus. Its accuracy cannot be guaranteed, nor does it include comprehensive information about the existence or location of service pipes or cables to individual premises. The responsibility for locating and avoiding damage to apparatus on site shall be that of the person proposing to excavate in the street who shall be liable to the apparatus owner and any third party who may be affected in any way for any loss or damage caused by their failure to do so.



Registered Office
 P.O. BOX NO. 8, West Street, Havant,
 Hampshire. PO9 1LG.
 Registered in England No. 2536455
 Telephone: (023) 9249 9888
 Fax: (023) 9245 3632
 Website: www.portsmouthwater.co.uk

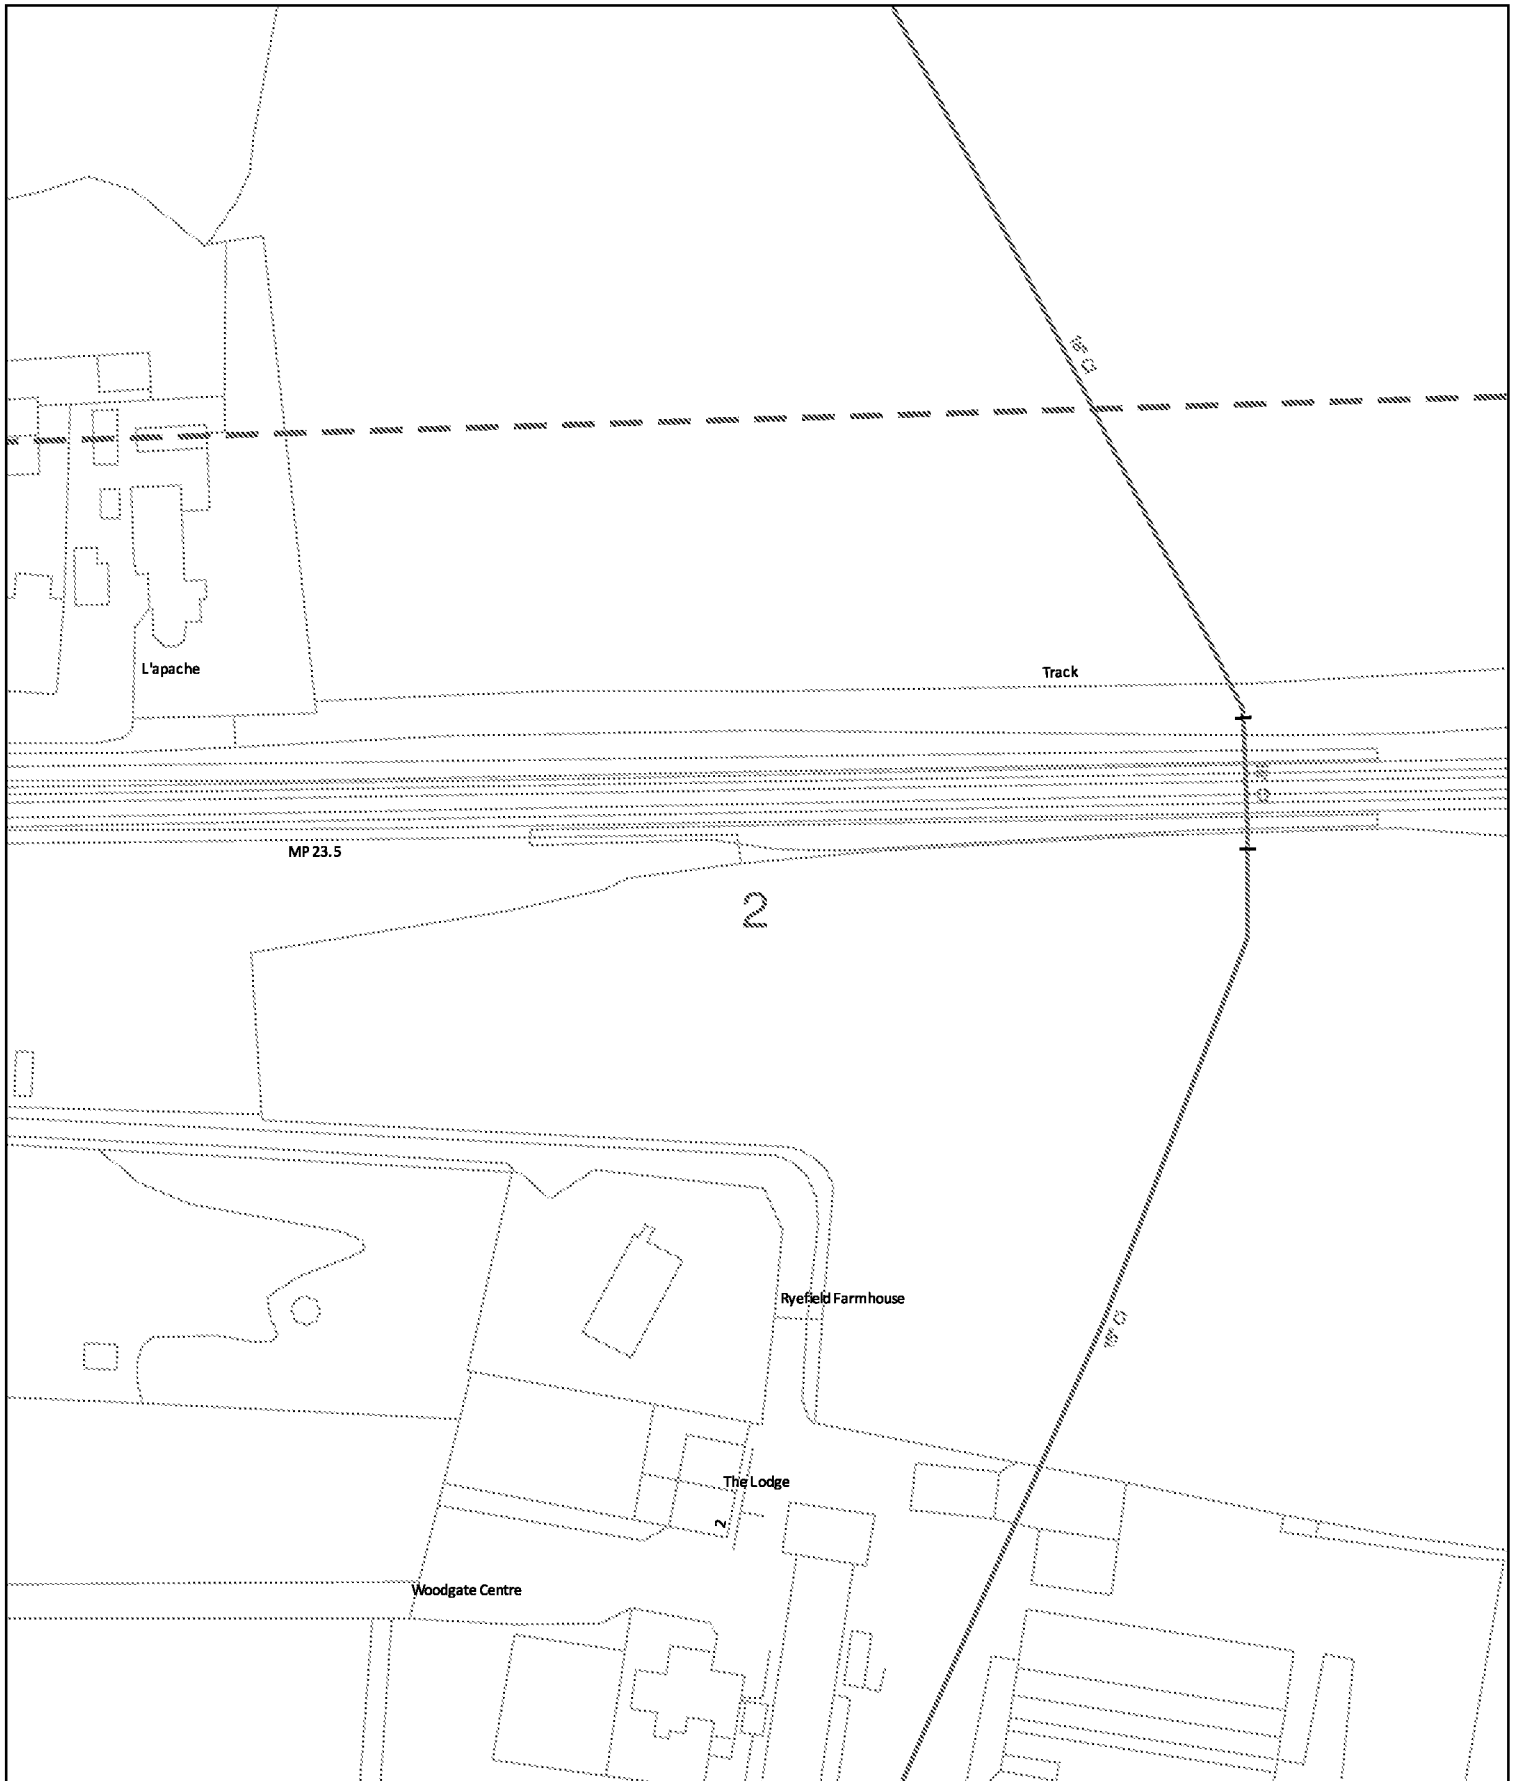

0 50m Dig Sites Area: Line: Measurements scaled from this plan may not match measurements between the same points on the ground.


Date Requested: 23/ 11/ 2020
Job Reference: 20614304
Site Location: 494129 104180
Requested by: Ms Christina Elliott
Your Scheme/ Reference: LM
90619/ SBS

Distribution Mains	Abandoned Mains	Reflux Valve	Butterfly Valve
Communication Pipe	Cable	Air Valve	Pressure Flow Valve
Fire Main	Company Washout Hydrant (Single)	Open Valve	Meter
Private Mains	Company Washout Hydrant (Off set)	Closed Valve	New Appointments & Variations
Raw Water Main	Fire Brigade Hydrant (Single)	Capped End	Assets within shaded area please contact: Leap Utilities
Trunk Main	Fire Brigade Washout Hydrant	Stop Cock	Email: water@leaputilities.co.uk
	Fire Brigade Hydrant (Off set)		Tel: 0345 122 6780

The information supplied is given in good faith as a guide to locating underground apparatus. Its accuracy cannot be guaranteed, nor does it include comprehensive information about the existence or location of service pipes or cables to individual premises. The responsibility for locating and avoiding damage to apparatus on site shall be that of the person proposing to excavate in the street who shall be liable to the apparatus owner and any third party who may be affected in any way for any loss or damage caused by their failure to do so.



Registered Office
P.O. BOX NO. 8, West Street, Havant,
Hampshire. PO9 1LG.
Registered in England No. 2536455
Telephone: (023) 9249 9888
Fax: (023) 9245 3632
Website: www.portsmouthwater.co.uk

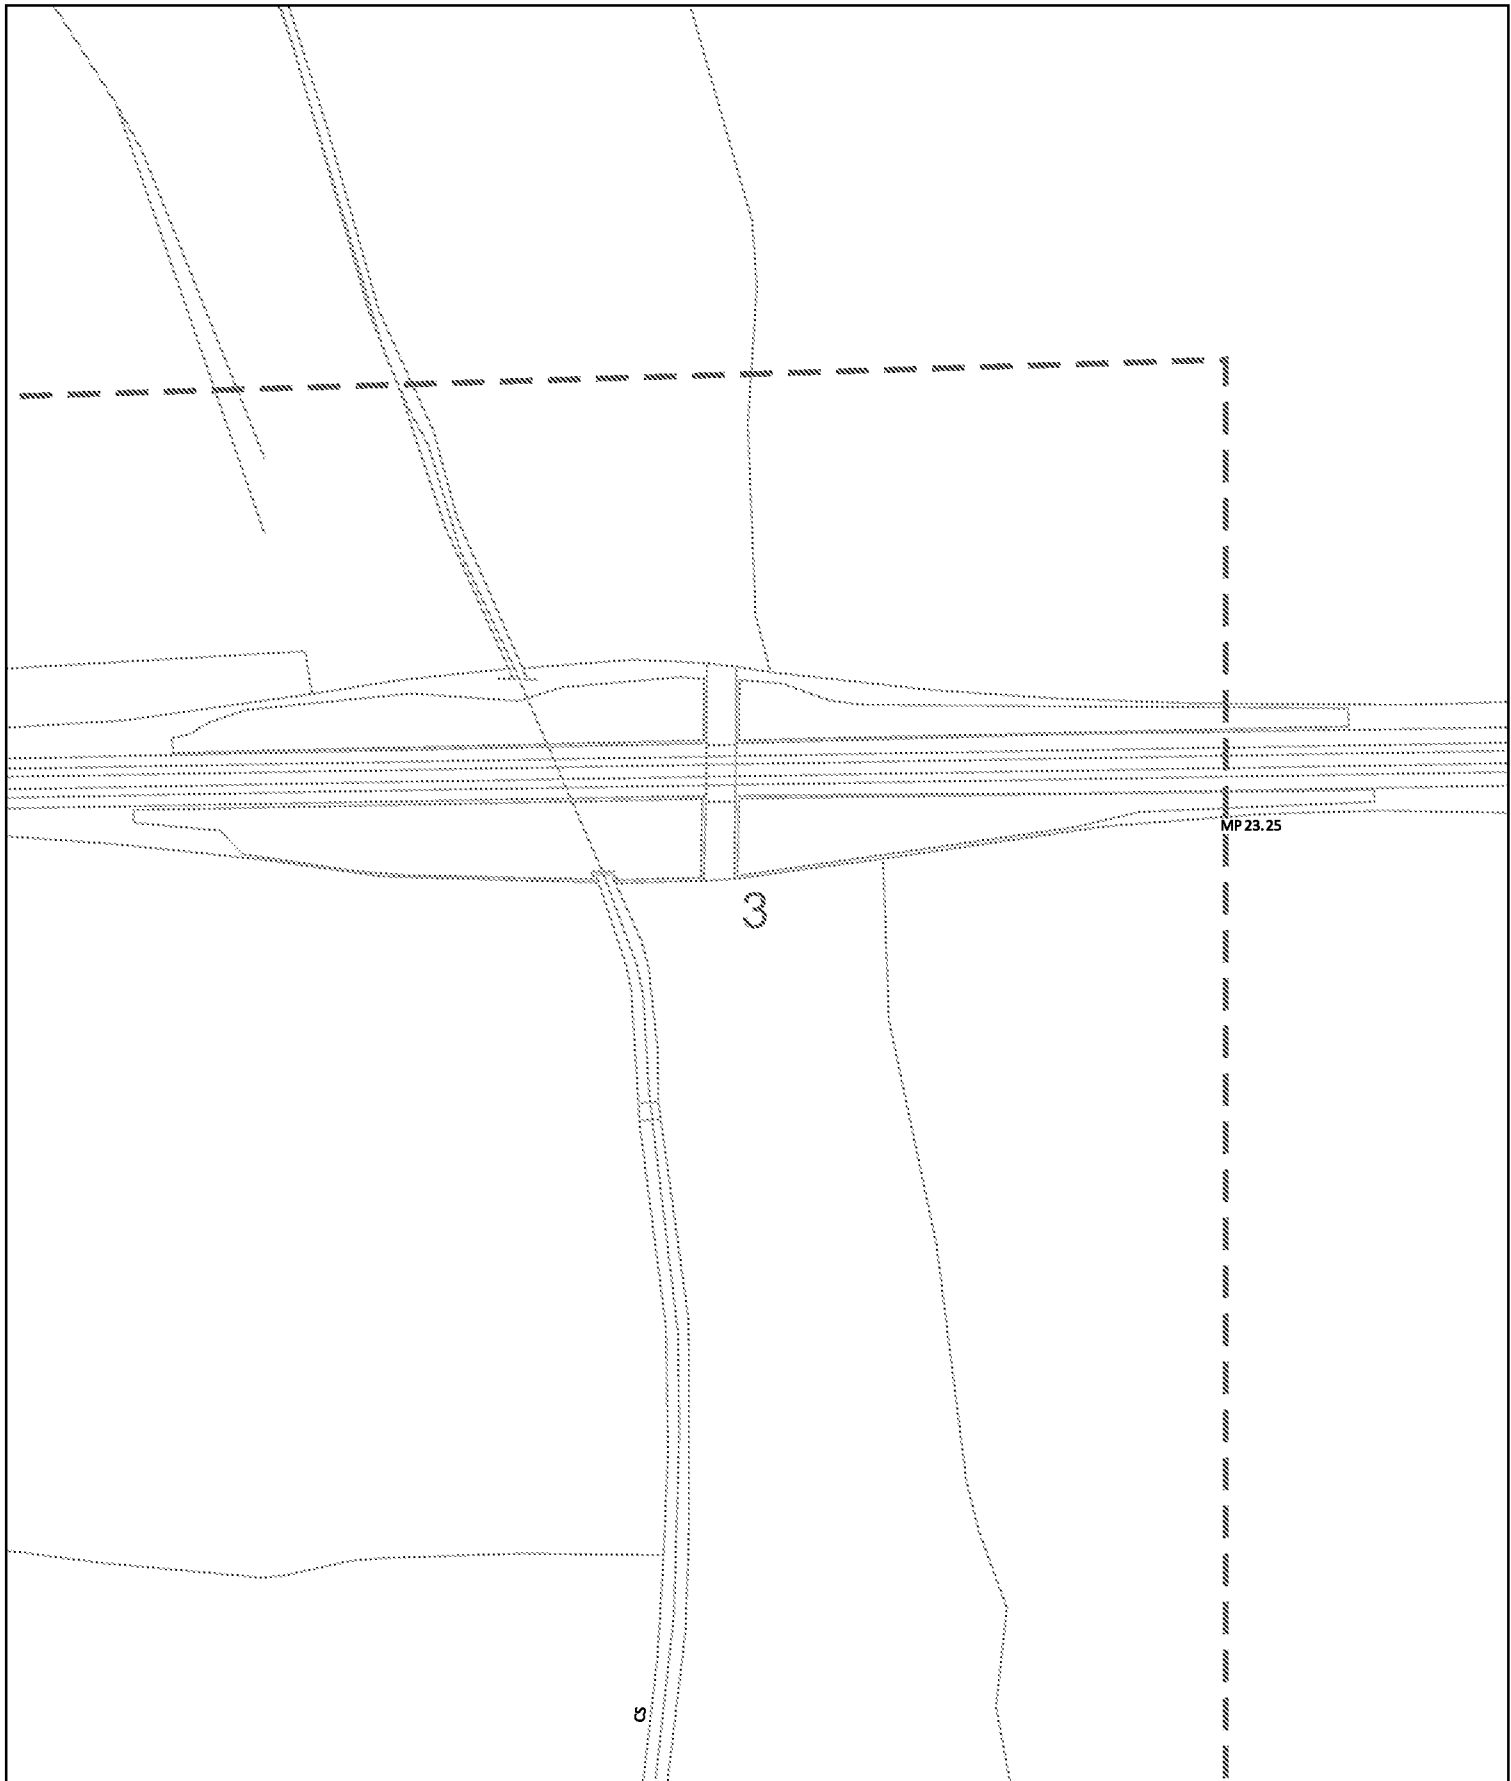

0 50m Dig Sites Area: Line: Measurements scaled from this plan may not match measurements between the same points on the ground.


Date Requested: 23/ 11/ 2020
Job Reference: 20614304
Site Location: 494129 104180
Requested by: Ms Christina Elliott
Your Scheme/ Reference: LM
90619/ SBS

- | | | | |
|--|--|--|--|
| <ul style="list-style-type: none"> Distribution Mains Communication Pipe Fire Main Private Mains Raw Water Main Trunk Main | <ul style="list-style-type: none"> Abandoned Mains Cable Company Washout Hydrant (Single) Company Washout Hydrant (Offset) Fire Brigade Hydrant (Single) Fire Brigade Washout Hydrant Fire Brigade Hydrant (Offset) | <ul style="list-style-type: none"> Reflex Valve Air Valve Open Valve Closed Valve Capped End Stop Cock | <ul style="list-style-type: none"> Butterfly Valve Pressure Flow Valve Meter New Appointments & Variations |
|--|--|--|--|

The information supplied is given in good faith as a guide to locating underground apparatus. Its accuracy cannot be guaranteed, nor does it include comprehensive information about the existence or location of service pipes or cables to individual premises. The responsibility for locating and avoiding damage to apparatus on site shall be that of the person proposing to excavate in the street who shall be liable to the apparatus owner and any third party who may be affected in any way for any loss or damage caused by their failure to do so.



Registered Office
P.O. BOX NO. 8, West Street, Havant,
Hampshire. PO9 1LG.
Registered in England No. 2536455
Telephone: (023) 9249 9888
Fax: (023) 9245 3632
Website: www.portsmouthwater.co.uk

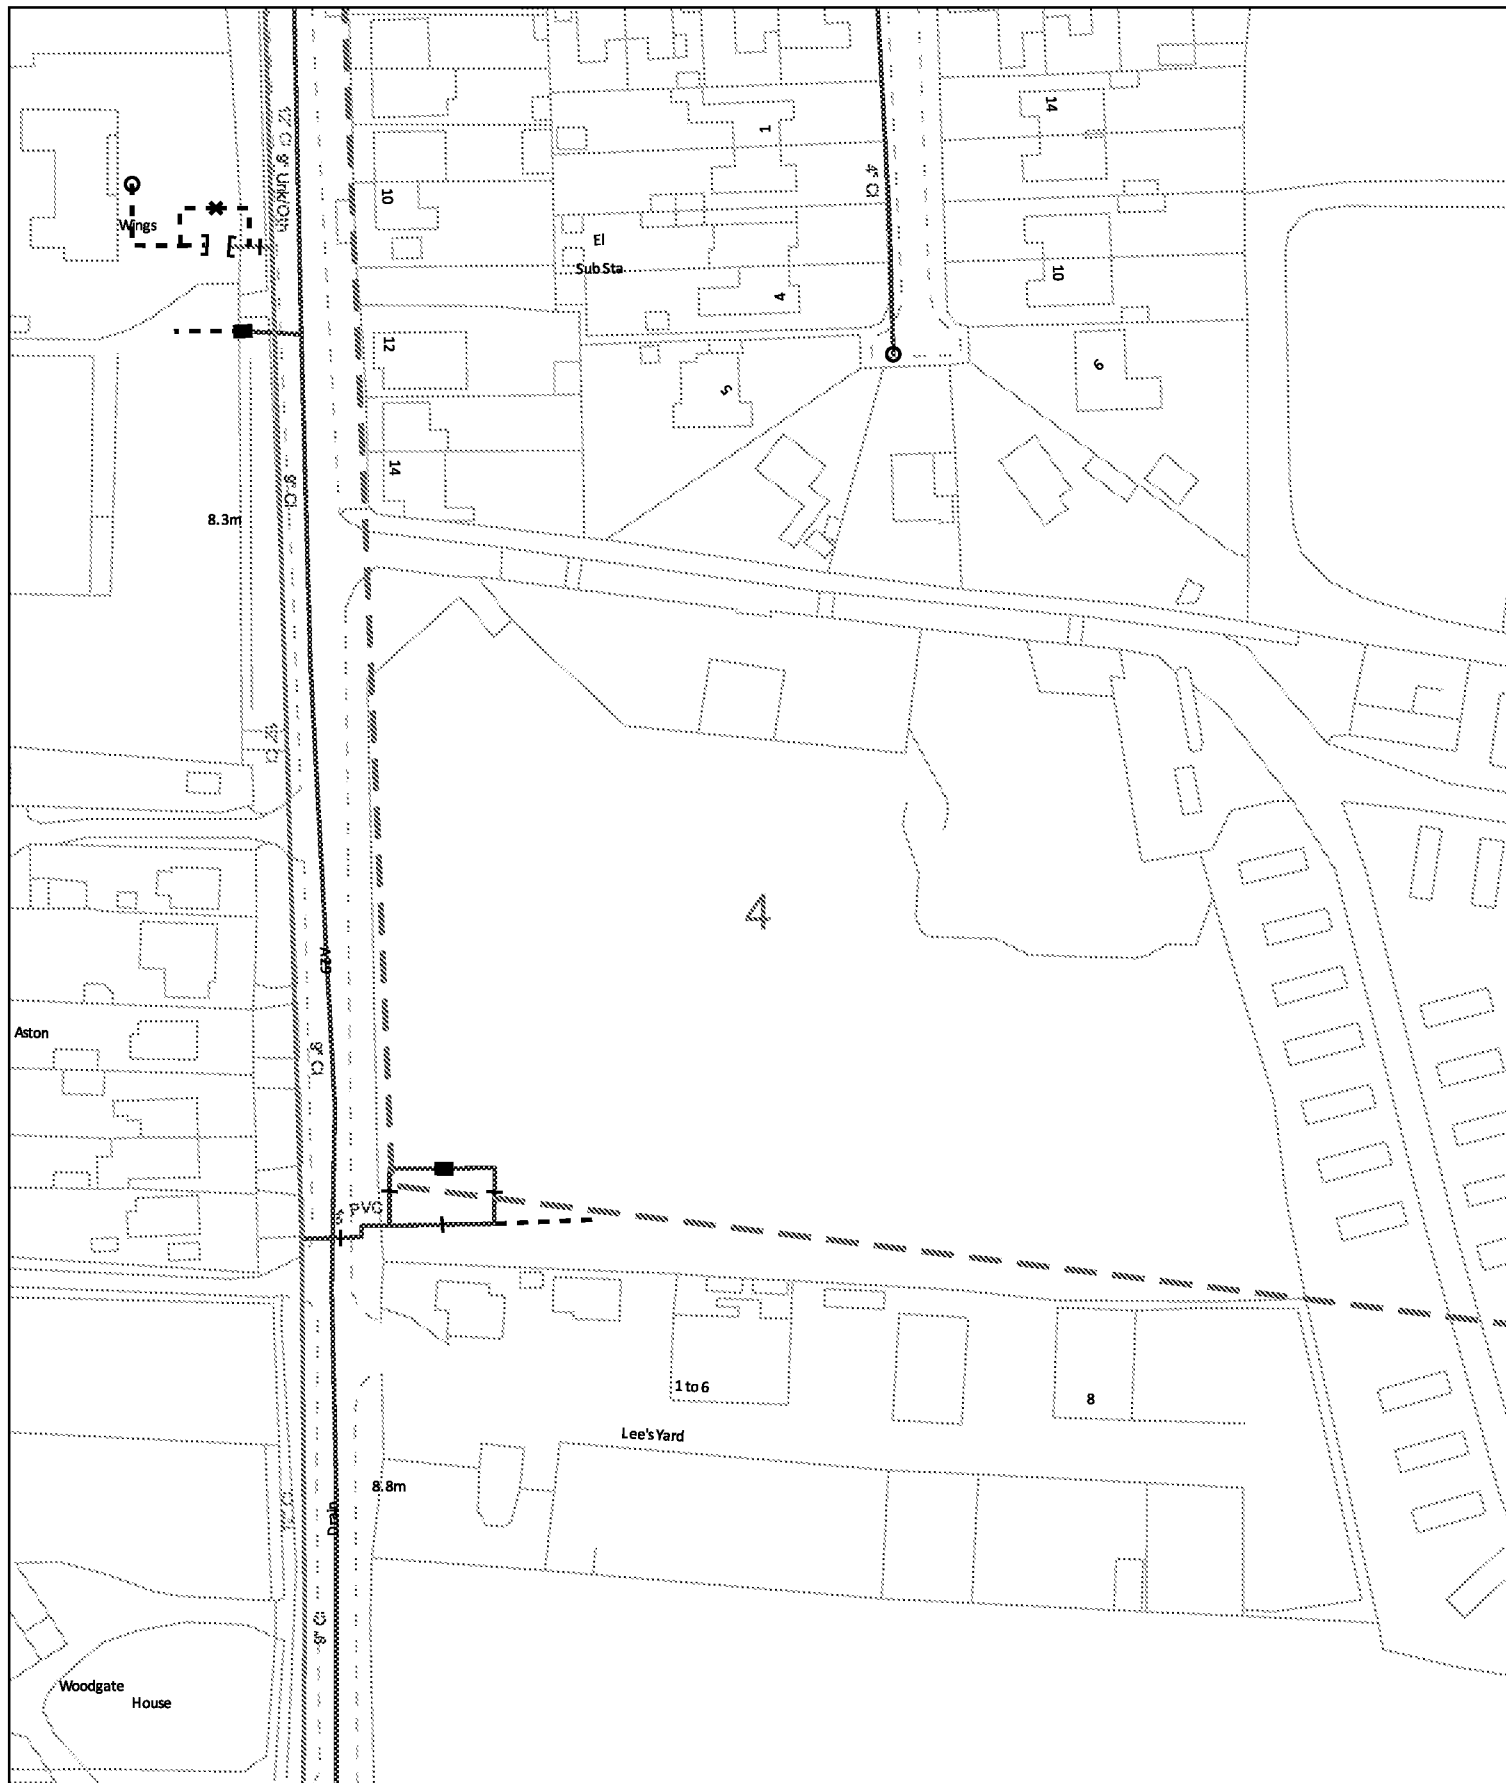

0 50m Dig Sites Area: Line: Measurements scaled from this plan may not match measurements between the same points on the ground.

Date Requested: 23/ 11/ 2020
Job Reference: 20614304
Site Location: 494129 104180
Requested by: Ms Christina Elliott
Your Scheme/ Reference: LM 90619/ SBS

- Distribution Mains - Communication Pipe - Fire Main - Private Mains - Raw Water Main - Trunk Main	- Abandoned Mains - Cable - Company Washout Hydrant (Single) - Company Washout Hydrant (Off set) - Fire Brigade Hydrant (Single) - Fire Brigade Washout Hydrant - Fire Brigade Hydrant (Off set)	- Reflex Valve - Air Valve - Open Valve - Closed Valve - Capped End - Stop Cock	- Butterfly Valve - Pressure Flow Valve - Meter - New Appointments & Variations
--	--	--	--

The information supplied is given in good faith as a guide to locating underground apparatus. Its accuracy cannot be guaranteed, nor does it include comprehensive information about the existence or location of service pipes or cables to individual premises. The responsibility for locating and avoiding damage to apparatus on site shall be that of the person proposing to excavate in the street who shall be liable to the apparatus owner and any third party who may be affected in any way for any loss or damage caused by their failure to do so.



Registered Office
P.O. BOX NO. 8, West Street, Havant,
Hampshire. PO9 1LG.
Registered in England No. 2536455
Telephone: (023) 9249 9888
Fax: (023) 9245 3632
Website: www.portsmouthwater.co.uk



0 50m Dig Sites Area: Line: Measurements scaled from this plan may not match measurements between the same points on the ground.


Date Requested: 23/ 11/ 2020
 Job Reference: 20614304
 Site Location: 494129 104180
 Requested by: Ms Christina Elliott
 Your Scheme/ Reference: LM
 90619/ SBS

- | | | | |
|--|--|--|--|
| <ul style="list-style-type: none"> Distribution Mains Communication Pipe Fire Main Private Mains Raw Water Main Trunk Main | <ul style="list-style-type: none"> Abandoned Mains Cable Company Washout Hydrant (Single) Company Washout Hydrant (Offset) Fire Brigade Hydrant (Single) Fire Brigade Washout Hydrant Fire Brigade Hydrant (Offset) | <ul style="list-style-type: none"> Reflex Valve Air Valve Open Valve Closed Valve Capped End Stop Cock | <ul style="list-style-type: none"> Butterfly Valve Pressure Flow Valve Meter New Appointments & Variations |
|--|--|--|--|

The information supplied is given in good faith as a guide to locating underground apparatus. Its accuracy cannot be guaranteed, nor does it include comprehensive information about the existence or location of service pipes or cables to individual premises. The responsibility for locating and avoiding damage to apparatus on site shall be that of the person proposing to excavate in the street who shall be liable to the apparatus owner and any third party who may be affected in any way for any loss or damage caused by their failure to do so.



Registered Office
 P.O. BOX NO. 8, West Street, Havant,
 Hampshire. PO9 1LG.
 Registered in England No. 2536455
 Telephone: (023) 9249 9888
 Fax: (023) 9245 3632
 Website: www.portsmouthwater.co.uk

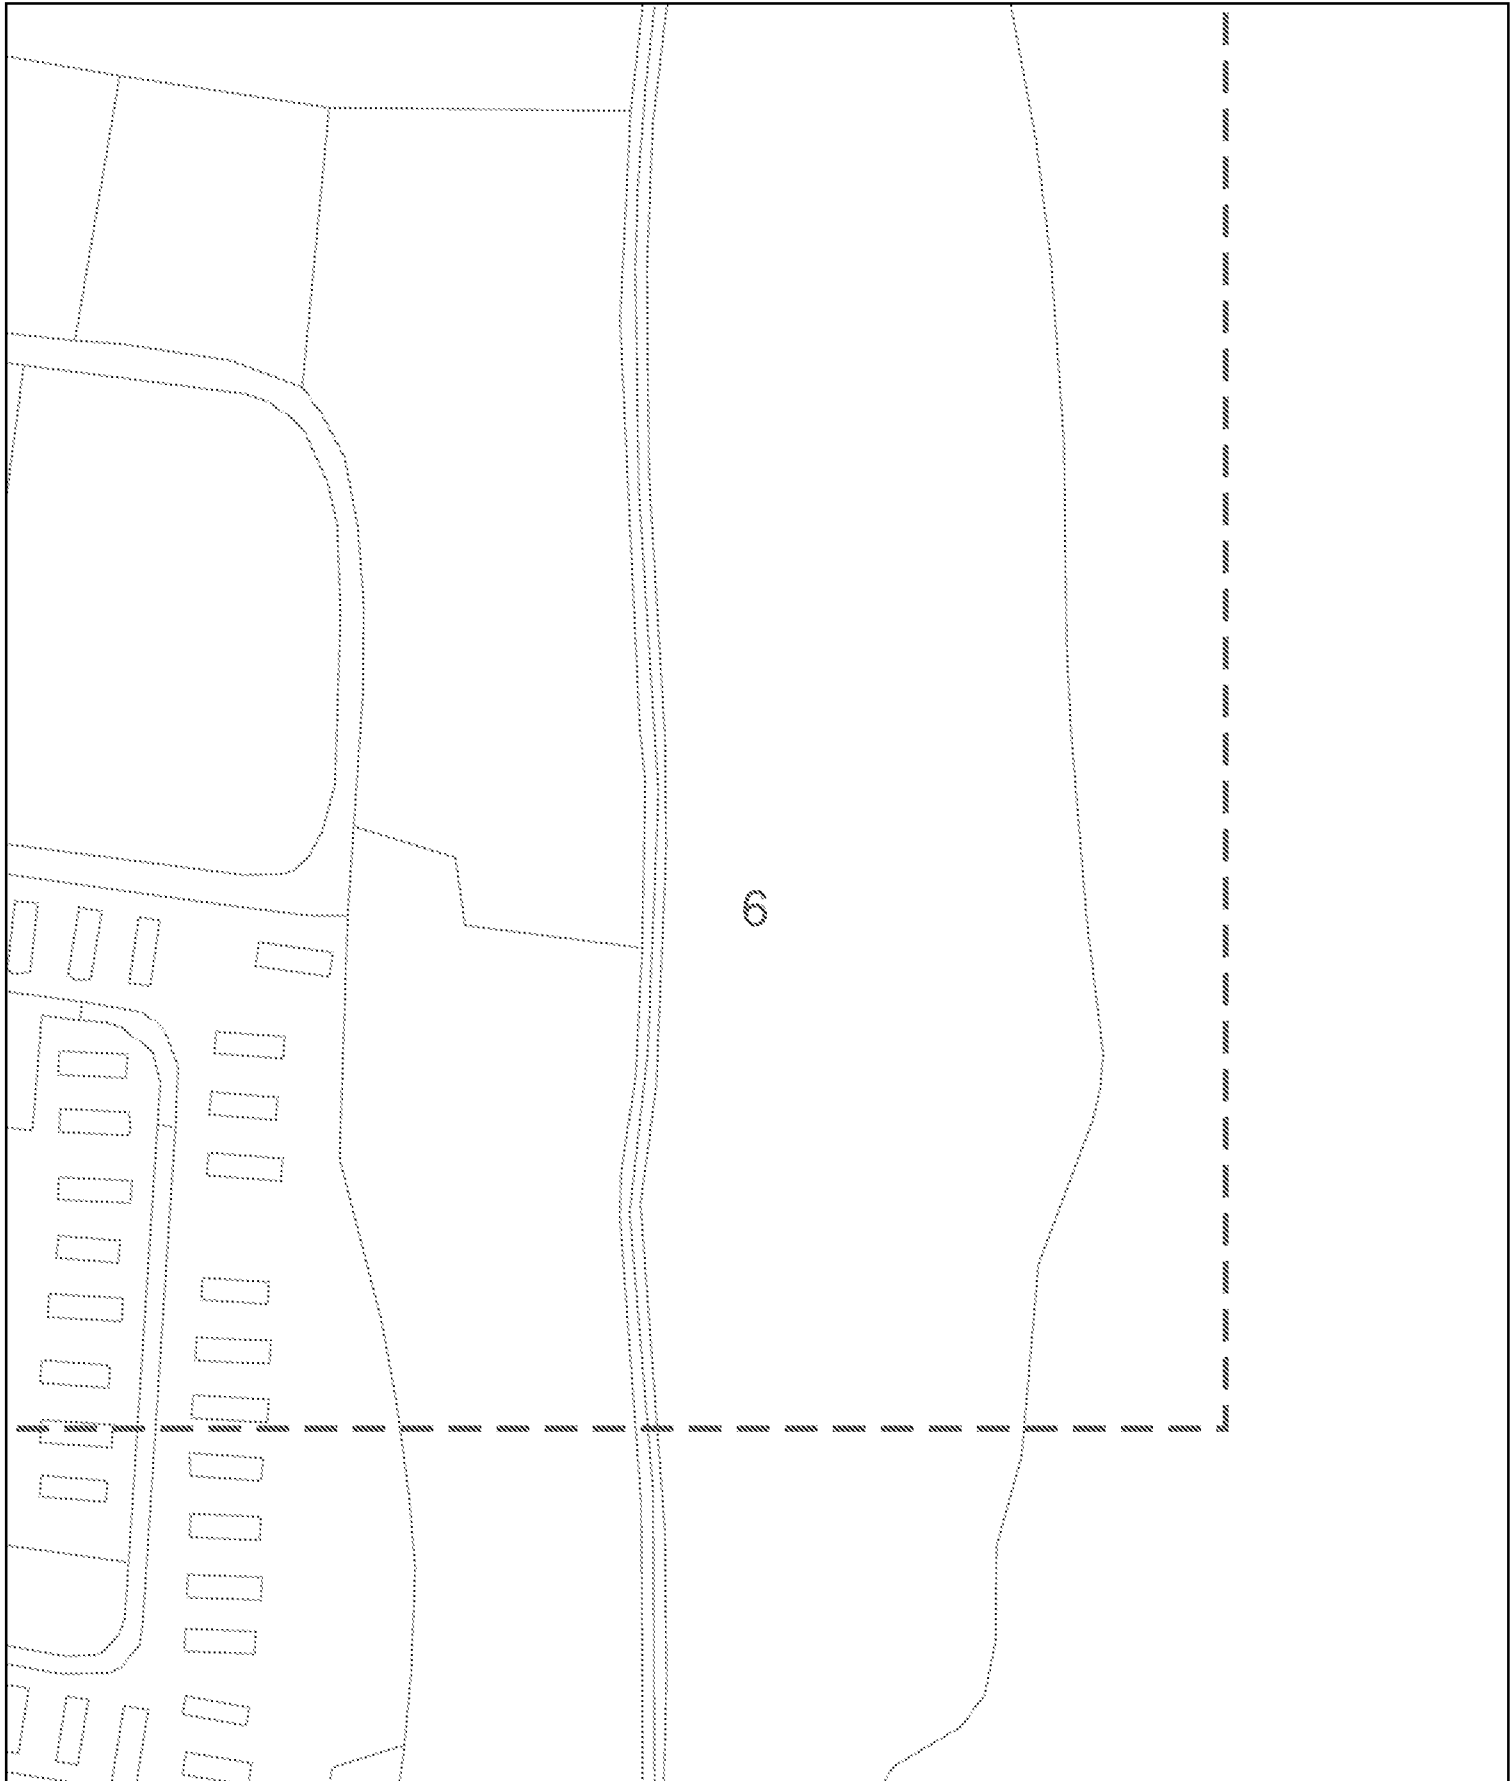

0 50m Dig Sites Area: Line: Measurements scaled from this plan may not match measurements between the same points on the ground.

Date Requested: 23/ 11/ 2020
Job Reference: 20614304
Site Location: 494129 104180
Requested by: Ms Christina Elliott
Your Scheme/ Reference: LM
90619/ SBS

- | | | | |
|--------------------|----------------------------------|--------------|--|
| Distribution Mains | Abandoned Mains | Reflex Valve | Butterfly Valve |
| Communication Pipe | Cable | Air Valve | Pressure Flow Valve |
| Fire Main | Company Washout Hydrant (Single) | Open Valve | Meter |
| Private Mains | Company Washout Hydrant (Offset) | Closed Valve | New Appointments & Variations Assets within shaded area please contact: Leap Utilities Email: water@leaputilities.co.uk Tel: 0345 122 6780 |
| Raw Water Main | Fire Brigade Hydrant (Single) | Capped End | |
| Trunk Main | Fire Brigade Washout Hydrant | Stop Cock | |
| | Fire Brigade Hydrant (Offset) | | |

The information supplied is given in good faith as a guide to locating underground apparatus. Its accuracy cannot be guaranteed, nor does it include comprehensive information about the existence or location of service pipes or cables to individual premises. The responsibility for locating and avoiding damage to apparatus on site shall be that of the person proposing to excavate in the street who shall be liable to the apparatus owner and any third party who may be affected in any way for any loss or damage caused by their failure to do so.



Registered Office
P.O. BOX NO. 8, West Street, Havant,
Hampshire. PO9 1LG.
Registered in England No. 2536455
Telephone: (023) 9249 9888
Fax: (023) 9245 3632
Website: www.portsmouthwater.co.uk

They don't replace or change any rights held by the Company by virtue of the Water Industry Act 1991 or any deed of grant of easement for the length concerned.

If requested Portsmouth Water will provide approximate locations of water mains according to our records. Our records do not usually show positions of water service pipes from the water main to properties. They may not be accurate or complete and no company or person will be given dispensation from liability for damaging our apparatus for the reason of the actual positions or depths being different from those indicated on plans. Portsmouth Water staff or contractors will visit any site, given reasonable notice to help in the location of our apparatus, and can offer advice on precautions that we may require to avoid any damage.

To satisfy safe working conditions adjacent to any of our apparatus you should comply with the following guidance:

All our water apparatus must be located by hand digging before the use of any mechanical plant to excavate.

- 2 As construction work progresses where heavy plant may have to cross the line of a water main, and that water main is not under an adequate standard of carriageway, crossing points should be sufficiently reinforced with sleepers or some other suitable material as necessary. All crossing points must be clearly indicated and other places where crossings could be made should be prevented. This is more apparent where our water mains cross rural areas.
- 2 If you propose to use piling within 20m of any water pipe, Portsmouth Water must be consulted so that we can survey the area.
- 2 Where any excavations adjacent to any water pipe affects the support, that pipe must be adequately supported to our satisfaction.
- 2 Any backfilled trenches parallel to or crossing a pipe must be compacted sufficiently to prevent any subsidence which could cause damage to the main. In some instances permanent support may be required to support a pipe exposed over an excessive length prior to backfilling. We do not allow concrete backfill to come into contact with any pipe.
- 2 A minimum clearance of 300mm must be provided between any plant being installed to allow repair and maintenance, whether the plant be parallel or crossing the water pipe. No manholes or chambers will be built over or round our apparatus or pipes.
- 2 Where Portsmouth Waters apparatus is damaged, even any special wrapping you must notify us so we are able to make the damage good, no matter how minor that damage is. All damage repairs will be charged to the person or company responsible. Leave the trench open so we are able to repair our apparatus speedily.
- 2 If leakage is found or caused you must inform Portsmouth Water immediately, leave the trench open so we may repair the damaged apparatus.
- 2 Where your proposed work will involve altering existing levels over our water mains you must inform us. We will require specific locations and details of the changes to ground levels. This may require a diversion of our apparatus for which there will be a charge. In some circumstances we may require that our apparatus remains where it is. Any surface boxes must be either lowered or raised accordingly. We may give you permission to compete this work. Under no circumstances are our boxes to be left buried or raised above the finished ground level. If any damage occurs as a result of your work, the repairs will be fully rechargeable back to you.

Tree planting near our Water Mains.

- ℳ Cherry, willow and popular trees have extensive tree root systems and must not be planted within 10m of any water main.
- ℳ Other various species of trees such as evergreen, ash, beech, birch, elm, horse chestnut, lime, oak, sycamore may be allowed to be planted slightly nearer, however they must not be planted within 5m of our apparatus. More general advice can be obtained from contacting us.
- ℳ We must have a clear path maintained for inspection, repairs and maintenance, therefore we do not recommend the planting of shrubs and bushes within one meter of the pipeline.
- ℳ In instances where plants are to be used for screening purposes you should contact our office for advice. Consideration will be given to shallow rooting species such as elder, hazel, privet etc. Soft fruit such as black currant, raspberries and gooseberries will also be considered.

Contact Us:

Portsmouth Water Limited, PO Box 8, West Street, Havant, Hampshire, PO9 1LG.
e-mail us at: asset.enquiries@portsmouthwater.co.uk
call us on: (023) 9249 9888 or (023) 9244 9082

Our normal hours of business Monday to Friday 8:30am - 4:30

In an emergency contact our 24 hour Emergency Operations Centre on 023 9247 7999.

They don't replace or change any rights held by the Company by virtue of the Water Industry Act 1991 or any deed of grant of easement for the length concerned.

No work whatsoever shall commence on or adjacent to any trunk water main before full consent has been granted by Portsmouth Water regarding the process in which the work shall be progressed and completed.

At least 10 working days ~notice will be given of any intention of such works.

Our normal hours of business Monday to Friday 8:30am - 4:30

In an emergency contact our 24 hour Emergency Operations Centre on 023 9247 7999.

No building of any description shall be erected on or adjacent to the pipeline. No materials including spoil shall be stored on or adjacent to the pipeline and access to and along the route of the pipeline shall be kept clear and unrestricted at all times. No trees shall be planted or allowed to grow on or adjacent to the route of the pipeline.

Any pipes, drains or sewers crossing over the pipeline shall be laid in steel or ductile iron (or other suitable material) and shall cross as near as possible to 90° to the line of the main. A minimum of 300mm (12") of clearance must be given to any crossing above or below the pipeline.

Excavation around or beneath the conduit or pipeline must be completed by hand and great care exercised to ensure that any protective wrapping is not damaged. Excavations shall be fully supported and shall be backfilled to the satisfaction of Portsmouth Water. The Company reserves the right to stop all work on or adjacent to the pipeline which, in the opinion of its Officers, places the main or its employees at risk. As a consequence of such action, the Company will not accept any claims for damage.

Fences crossing the route of the pipeline should be as near as possible to 90° to the line of the main. Proposals for new fence crossings shall be submitted to the Company for approval, any such work shall not commence until approval granted.

Any proposed alterations to existing ground levels on or adjacent to the pipeline must be agreed and approved by Portsmouth Water.

The movement of vehicles and plant of a total weight exceeding 6 tonnes across the unprotected pipeline is forbidden. The repetitive movement of vehicles or plant of any weight over the unprotected main is forbidden. Where access is required at agreed positions the following protection shall be provided:

For axle loads exceeding 3 tonnes but not exceeding 10 tonnes

Vehicle crossing points over the route of the pipeline shall consist of substantial timber baulks 200mm (8) minimum section capable of spanning the pipeline, supported on timber baulks laid parallel with the aqueduct and placed not less than 2.5 metres (8ft) on each side of the centreline. (Other agreed protection may be considered). In the case of multiple pipelines, the timber baulks shall be additionally supported on timbers 300mm (12) minimum section laid in parallel to and between each pipeline. (Other agreed suitable protection may be considered).

For axle loads exceeding 10 tonnes,

Where heavy plant or vehicles with axle loads exceeding 10 tonnes require to cross the pipeline, special consideration must be given to the circumstances of each individual case. Where necessary, a single span bridge of the Bailey type will be required to span the pipeline.

All crossings must be securely fenced on each side so that access is limited to the protected areas.

Any permanent access crossing the pipeline shall be in a position approved by the Company and shall be adequately reinforced to prevent any damage.

Persons or their contractors working on or adjacent to the pipeline will be required to indemnify the Company for the full cost of any damage caused to its installations and for any costs, charges and expenses resulting from these operations.

Contact Us:


Portsmouth Water Limited, PO Box 8, West Street, Havant, Hampshire, PO9 1LG.

Our normal hours of business Monday to Friday 8:30am - 4:30

Our Ref: 20614304 Your Ref: LM 90619/SBS

Tuesday, 24 November 2020

Christina Elliott
500 Park Avenue Aztec West
Almondsbury
Bristol
BS32 4RZ



Dear Christina Elliott

SSE Networks - Asset Network Plans

We have sent you the plans of our network records within the area requested. You will shortly receive responses each of the following; any High Voltage Mains cables and Low Voltage Mains cables.


Attached to this email is the 'Guide to Interpreting' which includes the legends for the plans on pages 7-9.


If a Service Cable is not shown on our maps sent, and you require the Cable to be Traced, please contact the General Enquiries Department on 0800 048 3516 (option 3) or via email, ge@ssen.co.uk

If you need further information on our network in this area or a quotation for any required works, please contact the Connections & Engineering Department on 0800 048 3516 or via email, connections@sse.com

Kind Regards,

Asset Data Team

A large black rectangular box redacting the signature of the Asset Data Team.

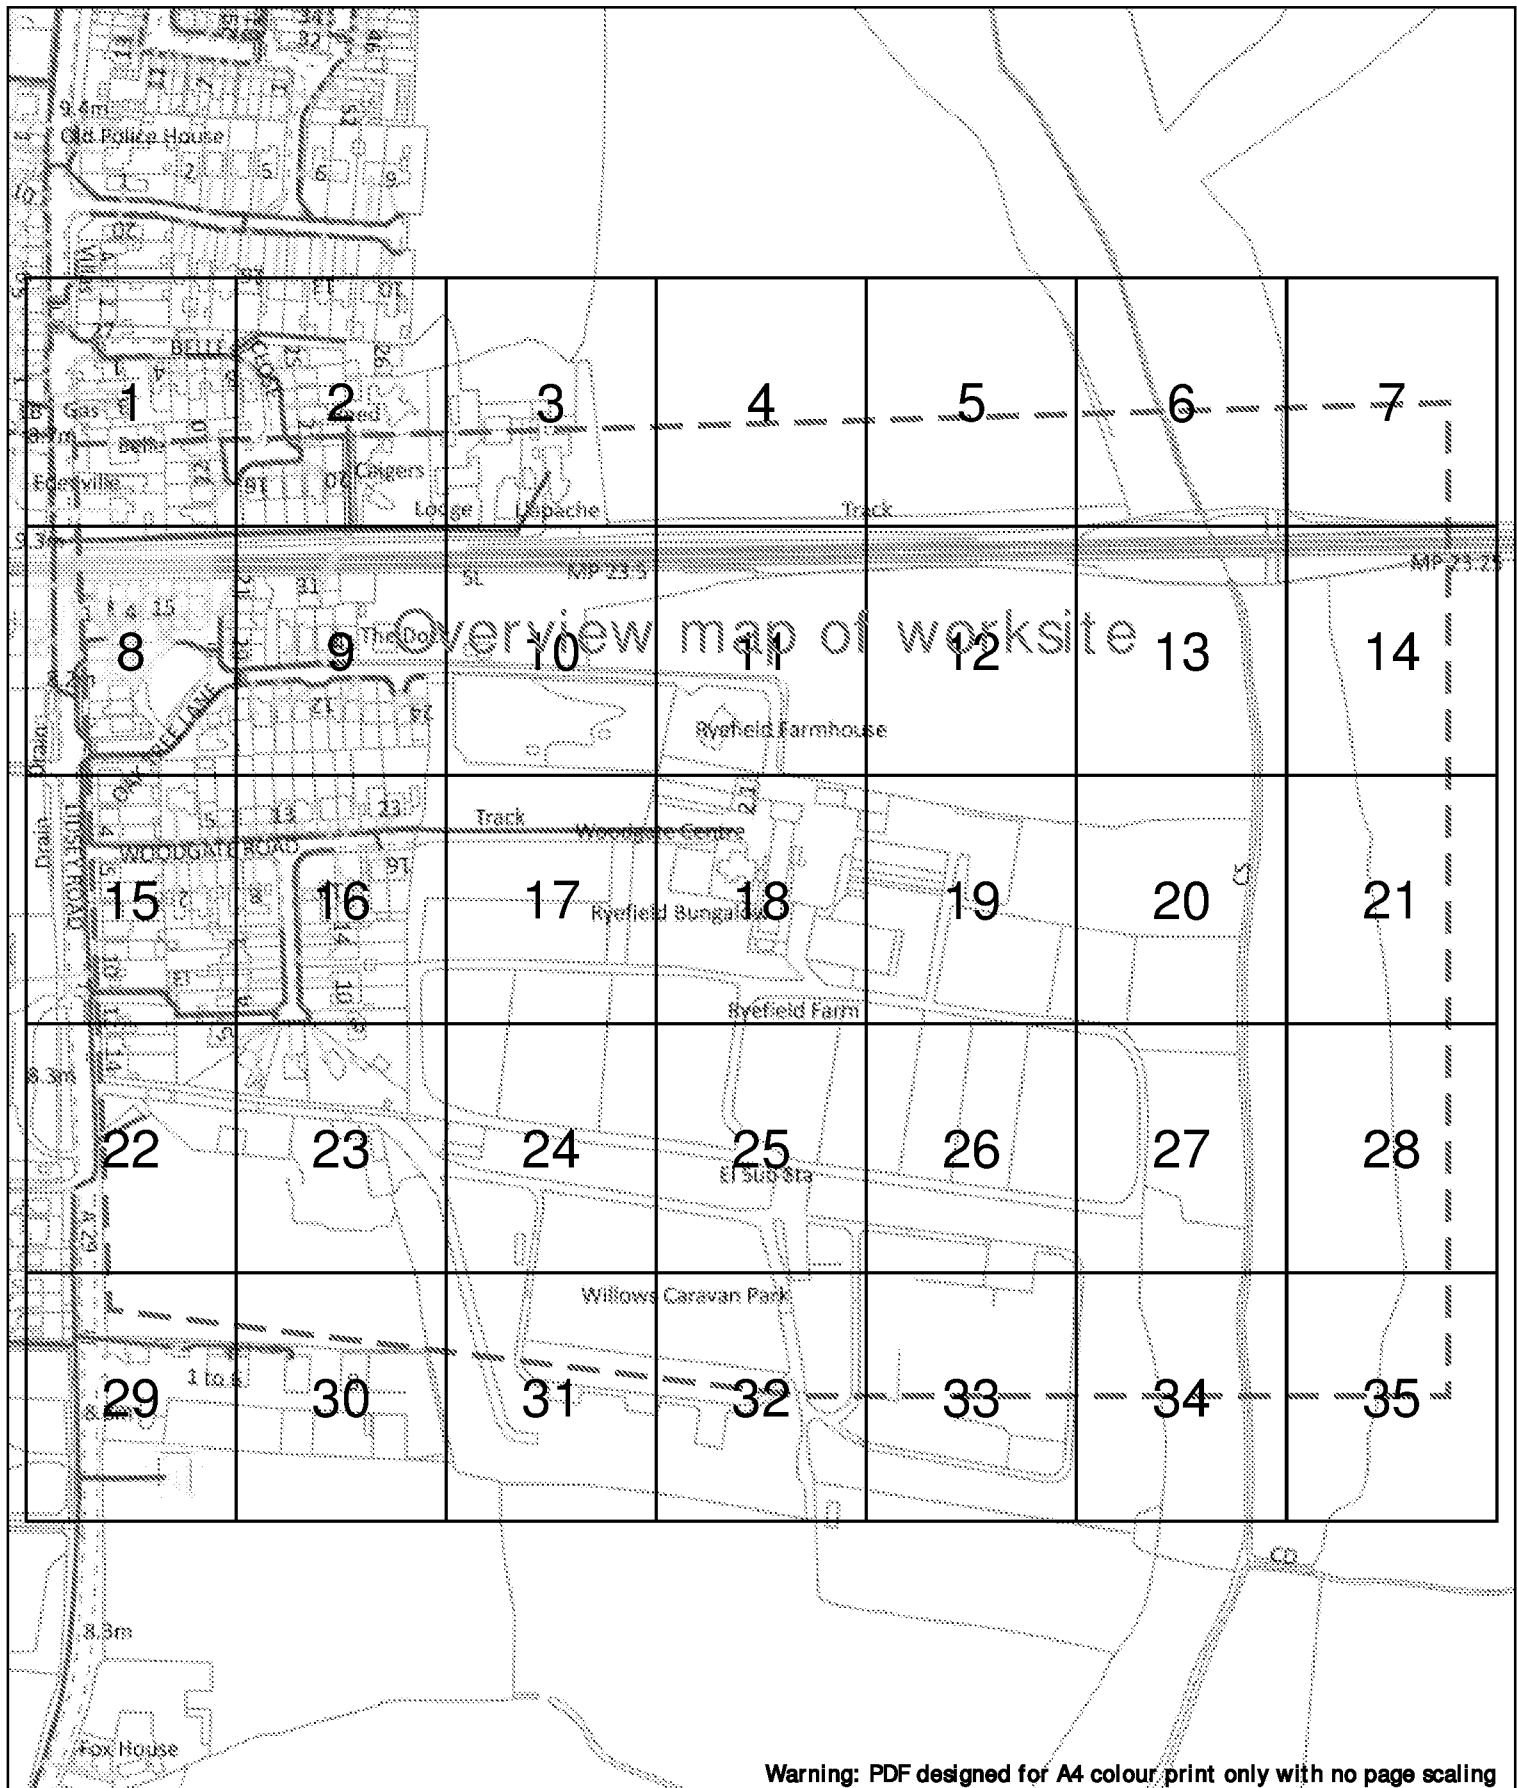

Warning: PDF designed for A4 colour print only with no page scaling

Dig Sites Area: Line:

Date Requested: 23/ 11/ 2020
 Job Reference: 20614304
 Site Location: 494129 104180
 Requested by: Ms Christina Elliott
 Your Scheme/ Reference: LM
 90619/ SBS

Voltages (V)				
LV (Low Voltage) and Services	Up to 1,000V			
HV (High Voltage)	Over 1,000V to 11,000V			
EHV (Extra High Voltage)	22,000V to 132,000V			
Transmission	275,000V and 400,000V			
NORMAL DEPTH TO THE TOP OF THE CABLE WHEN LAID				
	Services	LV	HV	EHV
Footpath/unmade	0.45m	0.45m	0.6m	0.8m
Road Crossing	0.6m	0.6m	0.75m	0.9m
Agricultural	1m	1m	1m	1.1m

Legend	
	Dig Site
	Area
	Line
	Boundary
	Road
	Track
	Water
	Building
	Tree
	Fence
	Wall
	Gate
	Post
	Pole
	Mast
	Tower
	Substation
	Transformer
	Cable
	Conduit
	Manhole
	Junction Box
	Control Cabinet
	Meter
	Switch
	Fuse
	Isolator
	Circuit Breaker
	Reactor
	Capacitor
	Inductor
	Resistor
	Diode
	Triode
	Tetraode
	Pentaode
	Hexaode
	Heptaode
	Octaode
	Nonaode
	Decaode
	Undecaode
	Duodecaode

WARNING


From inspection based on aerial photography, the station level, cable route and depth of cable are not shown on the map and safety certificates. Avoiding things like manholes - should be considered before commencing excavation work.

WHICH MAY BE USED FOR THE PURPOSES OF THE WORKS. THE USER SHALL BE RESPONSIBLE FOR THE ACCURACY OF THE INFORMATION.

BASED UPON THE ORDNANCE SURVEY MAP WITH THE SANCTION OF THE CONTROLLER OF HER MAJESTY'S STATIONERY OFFICE. CROWN COPYRIGHT RESERVED.

Produced by the Scottish and Southern Energy Power Distribution Ltd. Pursuant to section 47 of the Copyright, Designs and Patents Act 1988 (The Act). Unless the Act provides a relevant exception to copyright the copy must not be copied without prior permission of the copyright owner.


Plans generated by DigSafe Pro™ software provided by Lineworkers.co.uk



Scottish and Southern Energy Power Distribution Ltd.
 Registered Office: Inverlaimond House,
 200 Dunkeld Road, Perth, PH1 3AQ
 Registered In Scotland No. SC213459


If you're unsure & need to seek advice before commencing excavations, please contact:
 General Enquiries: 0800 048 3516

Subject to revision – Master held by SSEN Asset Data Team:
asset.data@sse.com
 01256 337 294

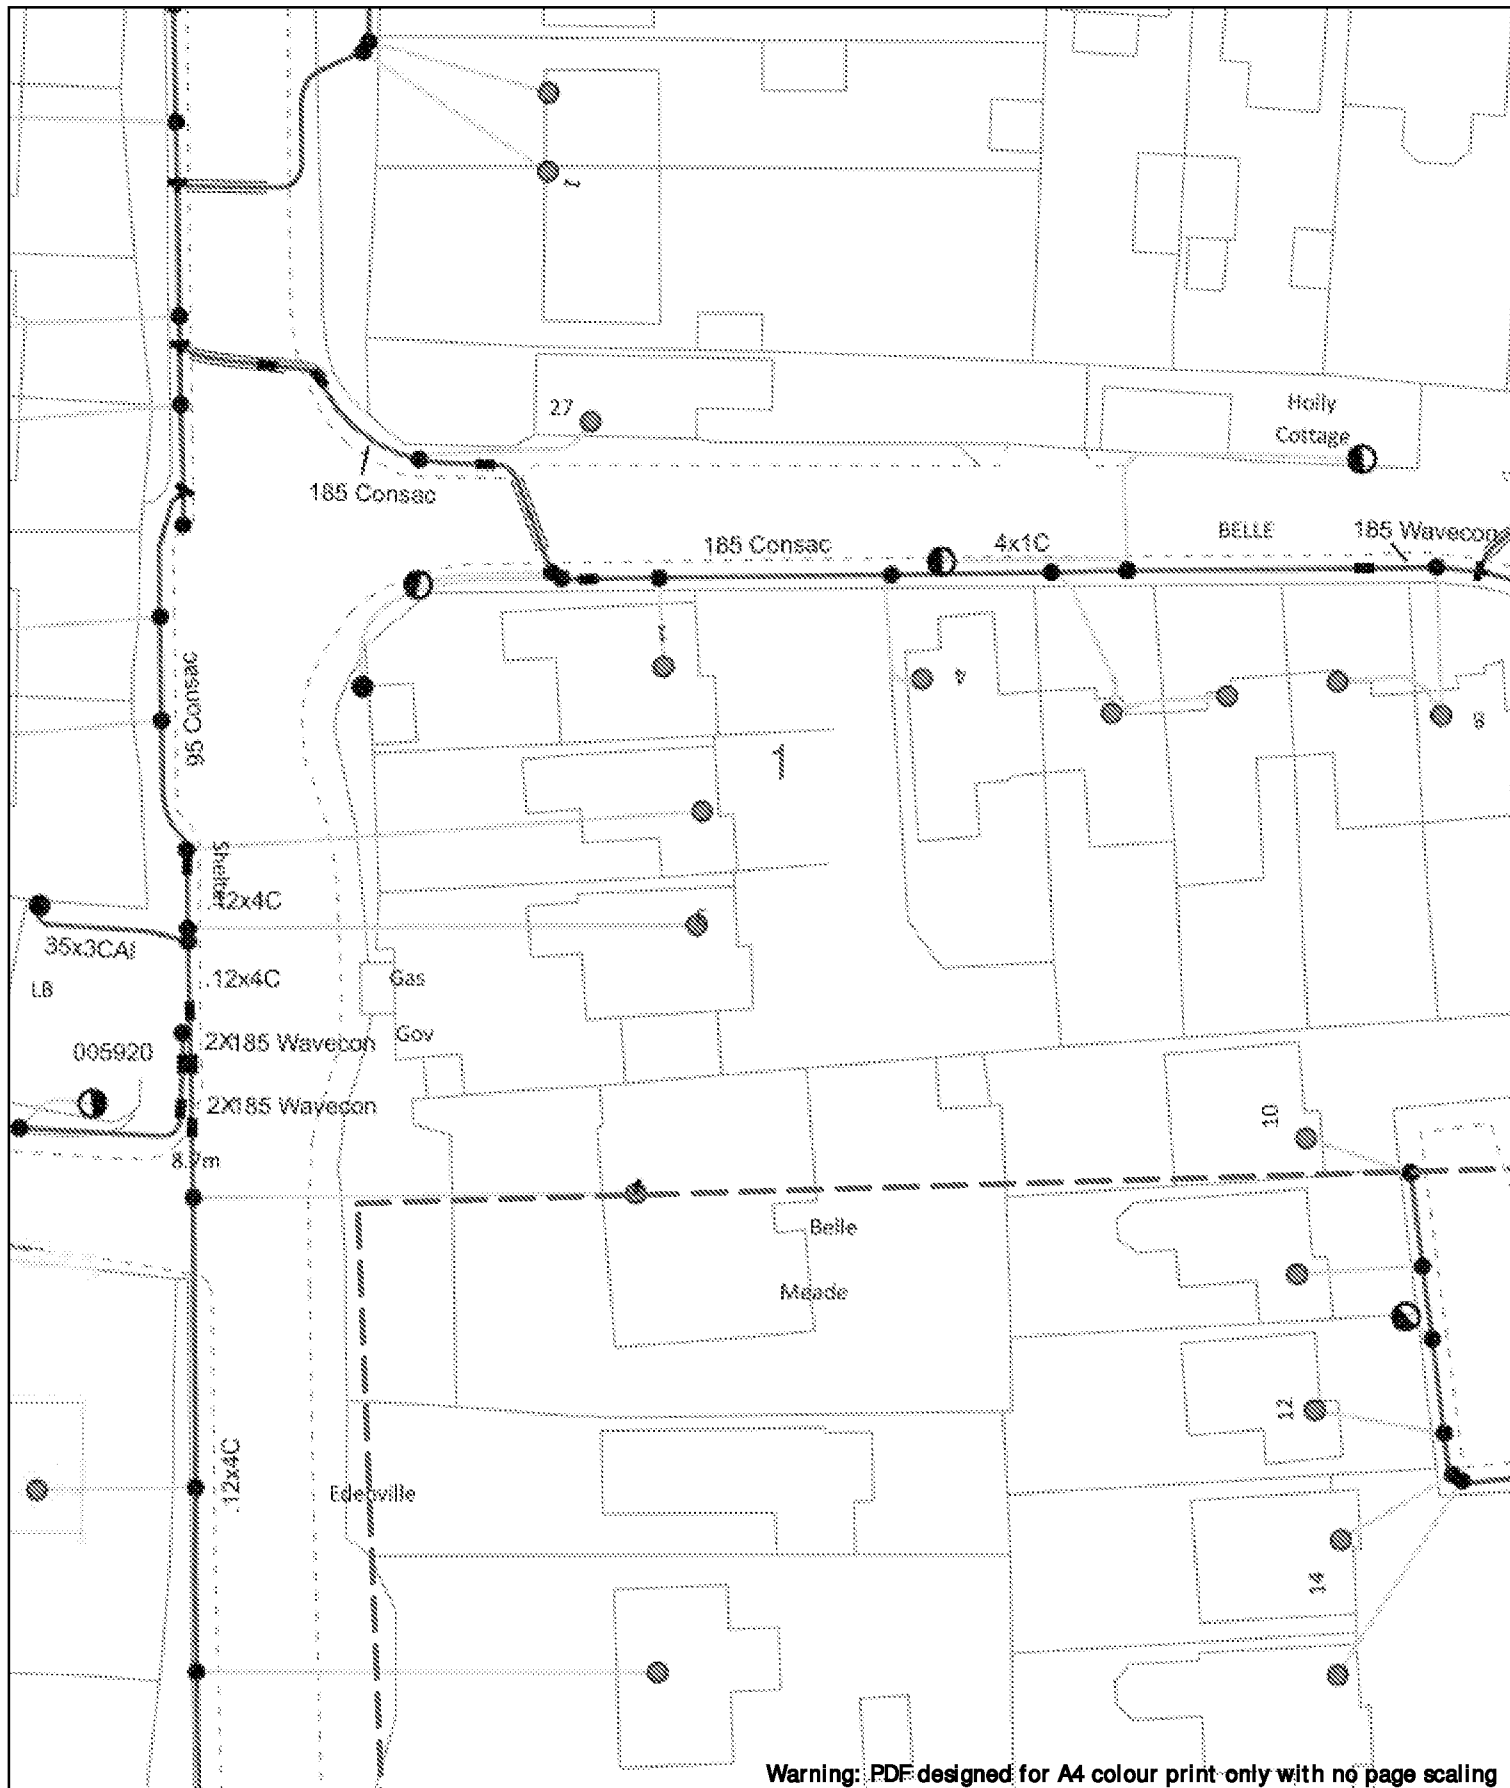


Warning: PDF designed for A4 colour print only with no page scaling

0 20m Dig Sites Area: Line:																																																									
Date Requested: 23/ 11/ 2020 Job Reference: 20614304 Site Location: 494129 104180 Requested by: Ms Christina Elliott		Scottish and Southern Energy Networks																																																							
Your Scheme/ Reference: LM 90619/ SBS		Scottish and Southern Energy Power Distribution Ltd. Registered Office: Inverlorn Road, Perth, PH1 3AQ Registered in Scotland No. SC213459																																																							
Scale: 1:500 (When plotted at A4)		If you're unsure & need to seek advice before commencing excavations, please contact: General Enquiries: 0800 048 3516																																																							
Voltages (V) <table border="1"> <thead> <tr> <th>Services</th> <th>LV</th> <th>HV</th> <th>EHV</th> </tr> </thead> <tbody> <tr> <td>Footpath/unmade</td> <td>0.45m</td> <td>0.45m</td> <td>0.8m</td> </tr> <tr> <td>Road Crossing</td> <td>0.6m</td> <td>0.6m</td> <td>0.9m</td> </tr> <tr> <td>Agricultural</td> <td>1m</td> <td>1m</td> <td>1.1m</td> </tr> </tbody> </table>		Services	LV	HV	EHV	Footpath/unmade	0.45m	0.45m	0.8m	Road Crossing	0.6m	0.6m	0.9m	Agricultural	1m	1m	1.1m	Legend <table border="1"> <thead> <tr> <th>Symbol</th> <th>Description</th> </tr> </thead> <tbody> <tr> <td>-----</td> <td>185 Consac</td> </tr> <tr> <td>-----</td> <td>95 Consac</td> </tr> <tr> <td>-----</td> <td>12x4C</td> </tr> <tr> <td>-----</td> <td>35x3CA/LB</td> </tr> <tr> <td>-----</td> <td>005920</td> </tr> <tr> <td>-----</td> <td>2X185 Wavecon</td> </tr> <tr> <td>-----</td> <td>8.7m</td> </tr> <tr> <td>-----</td> <td>Gas</td> </tr> <tr> <td>-----</td> <td>Gov</td> </tr> <tr> <td>-----</td> <td>Belle Meade</td> </tr> <tr> <td>-----</td> <td>Edgewille</td> </tr> <tr> <td>-----</td> <td>Holly Cottage</td> </tr> <tr> <td>-----</td> <td>Belle</td> </tr> <tr> <td>-----</td> <td>185 Wavecon</td> </tr> <tr> <td>-----</td> <td>4x1C</td> </tr> <tr> <td>-----</td> <td>10</td> </tr> <tr> <td>-----</td> <td>12</td> </tr> <tr> <td>-----</td> <td>14</td> </tr> </tbody> </table>		Symbol	Description	-----	185 Consac	-----	95 Consac	-----	12x4C	-----	35x3CA/LB	-----	005920	-----	2X185 Wavecon	-----	8.7m	-----	Gas	-----	Gov	-----	Belle Meade	-----	Edgewille	-----	Holly Cottage	-----	Belle	-----	185 Wavecon	-----	4x1C	-----	10	-----	12	-----	14
Services	LV	HV	EHV																																																						
Footpath/unmade	0.45m	0.45m	0.8m																																																						
Road Crossing	0.6m	0.6m	0.9m																																																						
Agricultural	1m	1m	1.1m																																																						
Symbol	Description																																																								
-----	185 Consac																																																								
-----	95 Consac																																																								
-----	12x4C																																																								
-----	35x3CA/LB																																																								
-----	005920																																																								
-----	2X185 Wavecon																																																								
-----	8.7m																																																								
-----	Gas																																																								
-----	Gov																																																								
-----	Belle Meade																																																								
-----	Edgewille																																																								
-----	Holly Cottage																																																								
-----	Belle																																																								
-----	185 Wavecon																																																								
-----	4x1C																																																								
-----	10																																																								
-----	12																																																								
-----	14																																																								
BASED UPON THE ORDNANCE SURVEY MAP WITH THE SANCTION OF THE CONTROLLER OF HM STATIONERY OFFICE. CROWN COPYRIGHT RESERVED. This map is made by or with the authority of Scottish and Southern Energy Power Distribution Ltd. Pursuant to section 47 of the Copyright, Designs and Patents Act 1988 (The Act). Unless the Act provides a relevant exception to copyright the copy must not be copied without prior permission of the copyright owner. Plans generated by DigSafe Pro™ software provided by Lineworksolutions Ltd.																																																									

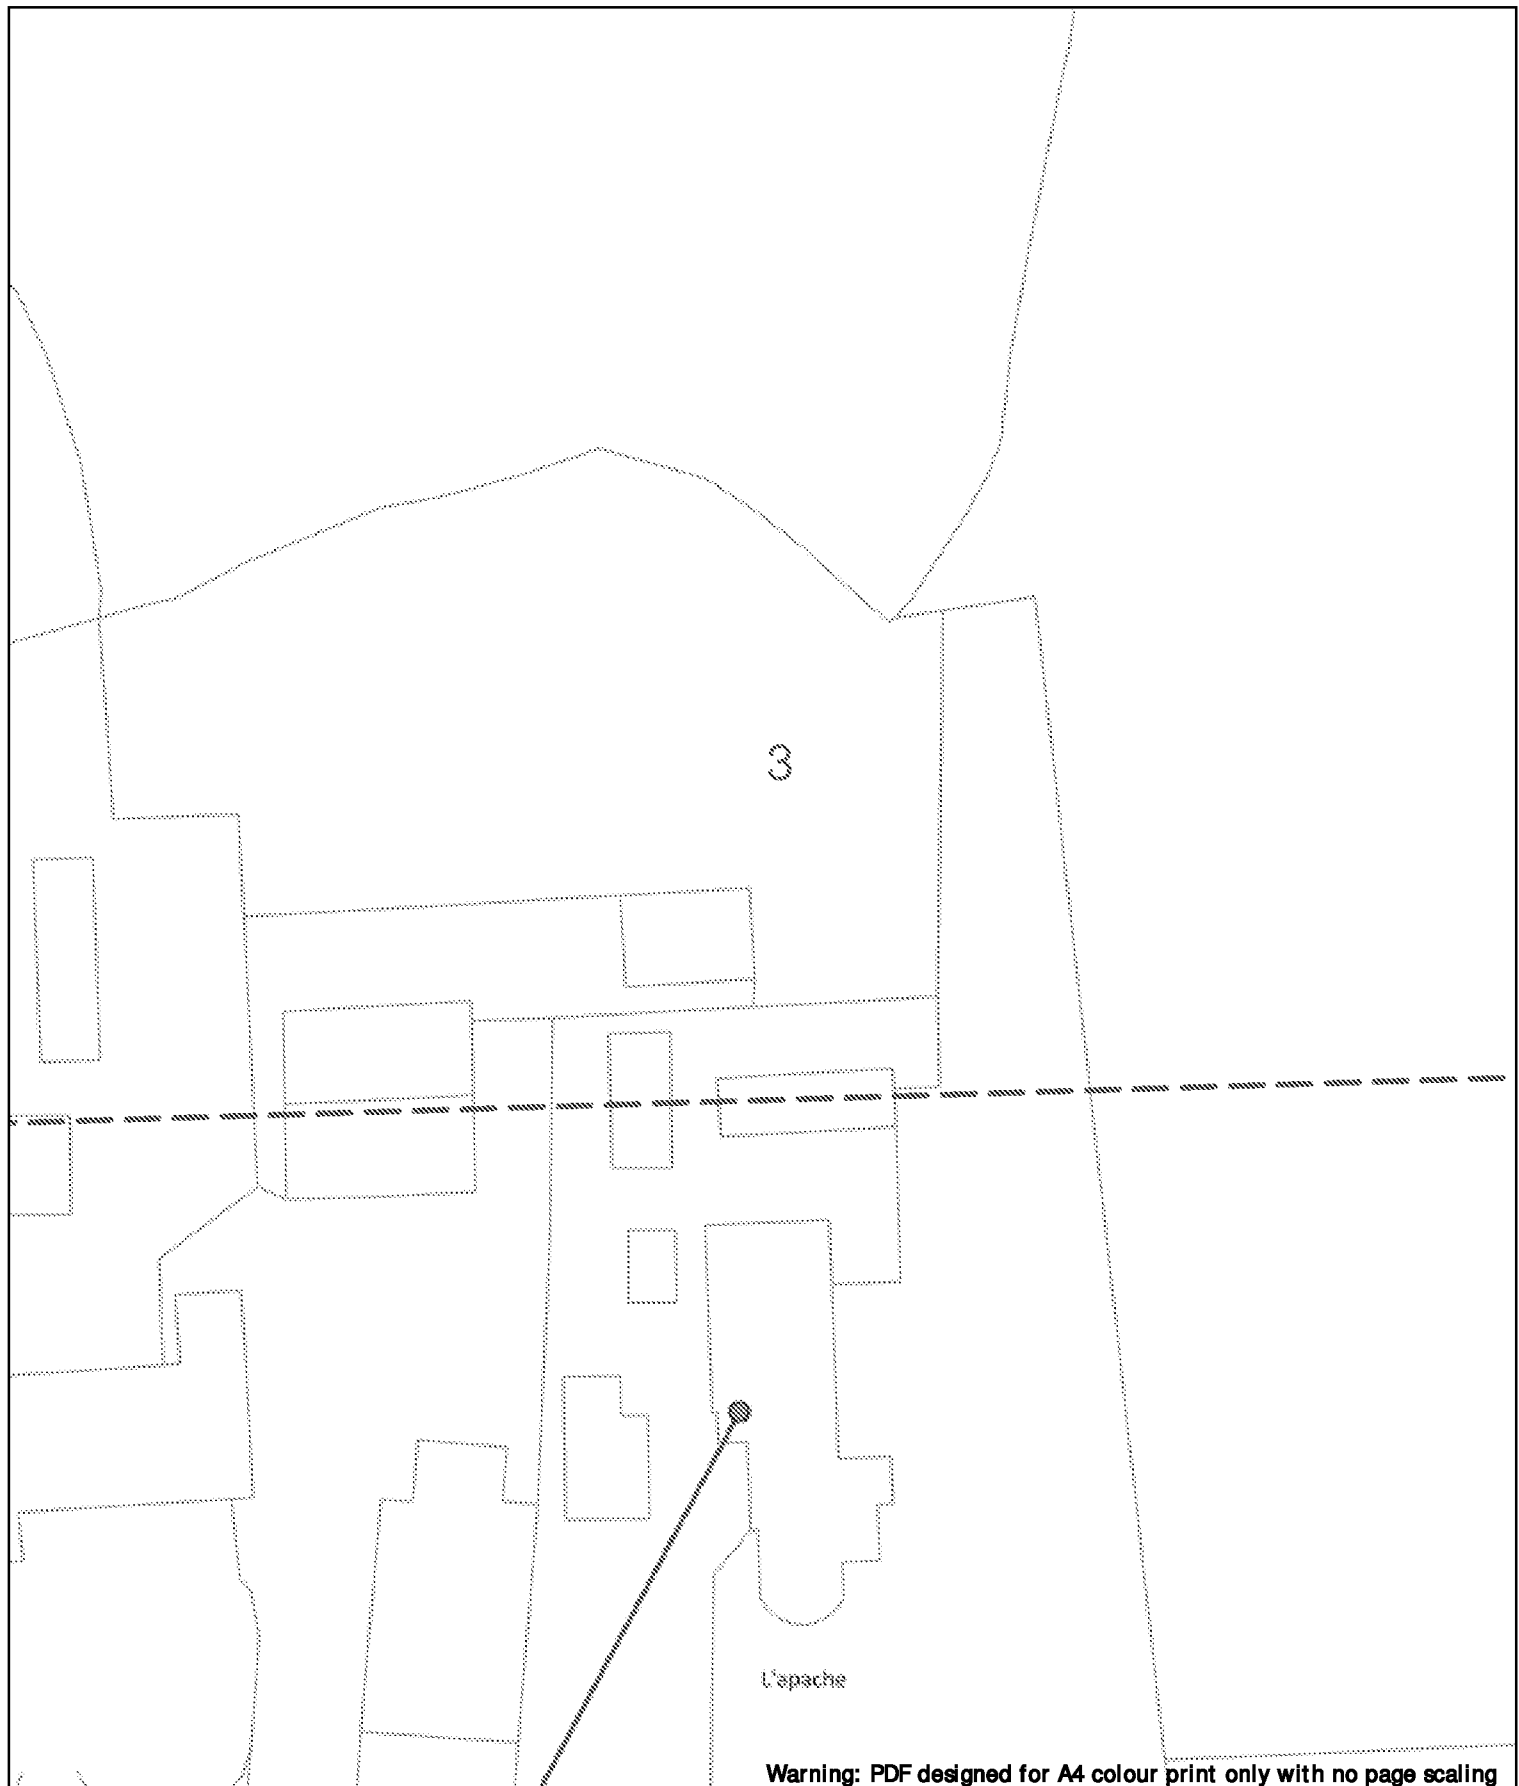

Warning: PDF designed for A4 colour print only with no page scaling



Date Requested: 23/ 11/ 2020
Job Reference: 20614304
Site Location: 494129 104180
Requested by: Ms Christina Elliott
Your Scheme/ Reference: LM
90619/ SBS


Voltages (V)				
LV (Low Voltage) and Services	Up to 1,000V			
HV (High Voltage)	Over 1,000V to 11,000V			
EHV (Extra High Voltage)	22,000V to 132,000V			
Transmission	275,000V and 400,000V			
NORMAL DEPTH TO THE TOP OF THE CABLE WHEN LAID				
	Services	LV	HV	EHV
Footpath/Unmade	0.45m	0.45m	0.6m	0.8m
Road Crossing	0.6m	0.6m	0.75m	0.9m
Agricultural	1m	1m	1m	1.1m

[illegible]

WANNING

From sections above, we can see that the following must be undertaken to determine location and depth of a water leak at 47' from the main and forty feet below – finding changes in water tables – should be considered before commencing excavation work.

BASED UPON THE ORDNANCE SURVEY MAP WITH THE SANCTION OF THE CONTROLLER OF H.M. STATIONERY OFFICE. CROWN COPYRIGHT RESERVED.
 or Distribution Ltd. Pursuant to section 47 of the Copyright, Designs and Patents Act 1988 ('The Act'). Unless the Act provides a relevant exception.
 Plane generated by DInSAFF Pro™ software provided by I (www.researchbillion.com)



Scottish & Southern

Scottish and Southern Energy Power Distribution Ltd.
Registered Office: Inveralmond House,
200 Dunkeld Road, Perth, PH1 3AQ
Registered in Scotland No. SC213459

If you're unsure & need to seek advice before commencing excavations, please contact:
General Enquiries: 0800 048 3516


Subject to revision – Master held by SSEN Asset Data Team:
Asset.Data@sse.com
 01256 337 294

Scale: 1:500 (When plotted at A4)



Warning: PDF designed for A4 colour print only with no page scaling

0 20m Dig Sites Area: Line:



Scottish and Southern Energy Power Distribution Ltd.
Registered Office: Inveralmond House,
200 Dunkeld Road, Perth, PH1 3AQ
Registered In Scotland No.SC213459

If you're unsure & need to seek advice before commencing excavations, please contact:
General Enquiries: 0800 048 3516


Subject to revision – Master held by SSEN Asset Data Team:
AssetData@sse.com
 01256 337 294

Date Requested: 23/ 11/ 2020
Job Reference: 20614304
Site Location: 494129 104180
Requested by: Ms Christina Elliott
Your Scheme/ Reference: LM
90619/ SBS

[illegible]

Scale: 1:500 (When plotted at A4)

ARUN DISTRICT COUNCIL AL107/21/PL

[illegible]


If you're unsure & need to seek advice before commencing excavations, please contact:
General Enquiries: 0800 048 3516

Scale: 1:500 (When plotted at A4)


0 20m Dig Sites Area: Line:

[illegible]


WARNING
 If you have been diagnosed with a heart condition, you must be under the supervision of a physician before using any of the equipment in this manual. If you are unsure of your health status, consult your physician before using any of the equipment in this manual. If you are pregnant, do not use any of the equipment in this manual.



Subject to revision – Master held by SSEN Asset Data Team:
Asset.Data@sse.com
 01256 337 294

[illegible]

From now on, there shall be no divergent circulation in the station level. Total water must be understood, to determine width and depth of water. We'll get a model from the Health and Safety Institute. Avoiding things from Hazard Tables. Should be consider others concerning precaution work.




Subject to revision – Master held by SSEN Asset Data Team:



Warning: PDF designed for A4 colour print only with no page scaling

0 20m Dig Sites Area: Line:		 Scottish and Southern Energy Power Distribution Ltd. Registered Office: Inverlaid House, 200 Dunkeld Road, Perth, PH1 3AQ Registered In Scotland No. SC213459 If you're unsure & need to seek advice before commencing excavations, please contact: General Enquiries: 0800 048 3516 Subject to revision – Master held by SSEN Asset Data Team: Asset.Data@sse.com 01256 337 294																							
Date Requested: 23/ 11/ 2020 Job Reference: 20614304 Site Location: 494129 104180 Requested by: Ms Christina Elliott Your Scheme/ Reference: LM 90619/ SBS	Voltages (V) <table border="1"> <tr> <td>LV (Low Voltage) and Services</td> <td>Up to 1,000V</td> </tr> <tr> <td>HV (High Voltage)</td> <td>Over 1,000V to 11,000V</td> </tr> <tr> <td>EHV (Extra High Voltage)</td> <td>22,000V to 132,000V</td> </tr> <tr> <td>Transmission</td> <td>275,000V and 400,000V</td> </tr> </table> NORMAL DEPTH TO THE TOP OF THE CABLE WHEN LAID <table border="1"> <tr> <th>Services</th> <th>LV</th> <th>HV</th> <th>EHV</th> </tr> <tr> <td>Footpath/unmade</td> <td>0.45m</td> <td>0.45m</td> <td>0.8m</td> </tr> <tr> <td>Road Crossing</td> <td>0.6m</td> <td>0.6m</td> <td>0.75m</td> </tr> <tr> <td>Agricultural</td> <td>1m</td> <td>1m</td> <td>1.1m</td> </tr> </table> WARNING From inspection based on visual inspection of the surface level, cable route must be determined, to determine location and depth of cables. It is the responsibility of the user to ensure that the route is correct and that the depth is correct. The user should also ensure that the route is correct and that the depth is correct. The user should also ensure that the route is correct and that the depth is correct.		LV (Low Voltage) and Services	Up to 1,000V	HV (High Voltage)	Over 1,000V to 11,000V	EHV (Extra High Voltage)	22,000V to 132,000V	Transmission	275,000V and 400,000V	Services	LV	HV	EHV	Footpath/unmade	0.45m	0.45m	0.8m	Road Crossing	0.6m	0.6m	0.75m	Agricultural	1m	1m
LV (Low Voltage) and Services	Up to 1,000V																								
HV (High Voltage)	Over 1,000V to 11,000V																								
EHV (Extra High Voltage)	22,000V to 132,000V																								
Transmission	275,000V and 400,000V																								
Services	LV	HV	EHV																						
Footpath/unmade	0.45m	0.45m	0.8m																						
Road Crossing	0.6m	0.6m	0.75m																						
Agricultural	1m	1m	1.1m																						



Voltages (V)				
LV (Low Voltage) and Services	Up to 1,000V			
HV (High Voltage)	Over 1,000V to 11,000V			
EHV (Extra High Voltage)	22,000V to 132,000V			
Transmission	275,000V and 400,000V			
NORMAL DEPTH TO THE TOP OF THE CABLE WHEN LAID				
	Services	LV	HV	EHV
Footpath/Unmade	0.45m	0.45m	0.6m	0.8m
Road Crossing	0.6m	0.6m	0.75m	0.9m
Agricultural	1m	1m	1m	1.1m


[illegible]

If you're unsure & need to seek advice before commencing excavations, please contact:
General Enquiries: 0800 048 3516

Scale: 1:500 (When plotted at A4)


There may have been water-penetration in the surface level. Trial test must be undertaken, to determine width and depth of water. If 75% of 47 blocks from the Health and Safety Services – Accident Register from 2009-2010 – should be considered before commencing excavation work.

BASED UPON THE ORDNANCE SURVEY MAP WITH THE SANCTION OF THE CONTROLLER OF H.M. STATIONERY OFFICE. CROWN COPYRIGHT RESERVED.
 or Distribution Ltd. Pursuant to section 47 of the Copyright, Designs and Patents Act 1988 ('The Act'). Unless the Act provides a relevant exception
 Plane, demarcated by Disto® DFF. Profit software provided by Trimble surveying technologies.

[illegible]

Subject to revision – Master held by SSEN Asset Data Team:
Asset.Data@ssen.com
 01256 337 294

There may have been water-poor strata in the surface basin, but water must be understood to characterize width and depth of water. As 17' 47" thicker from the north and fairly uniform. Avoiding changes from these tables - should be considered either concerning processing work.

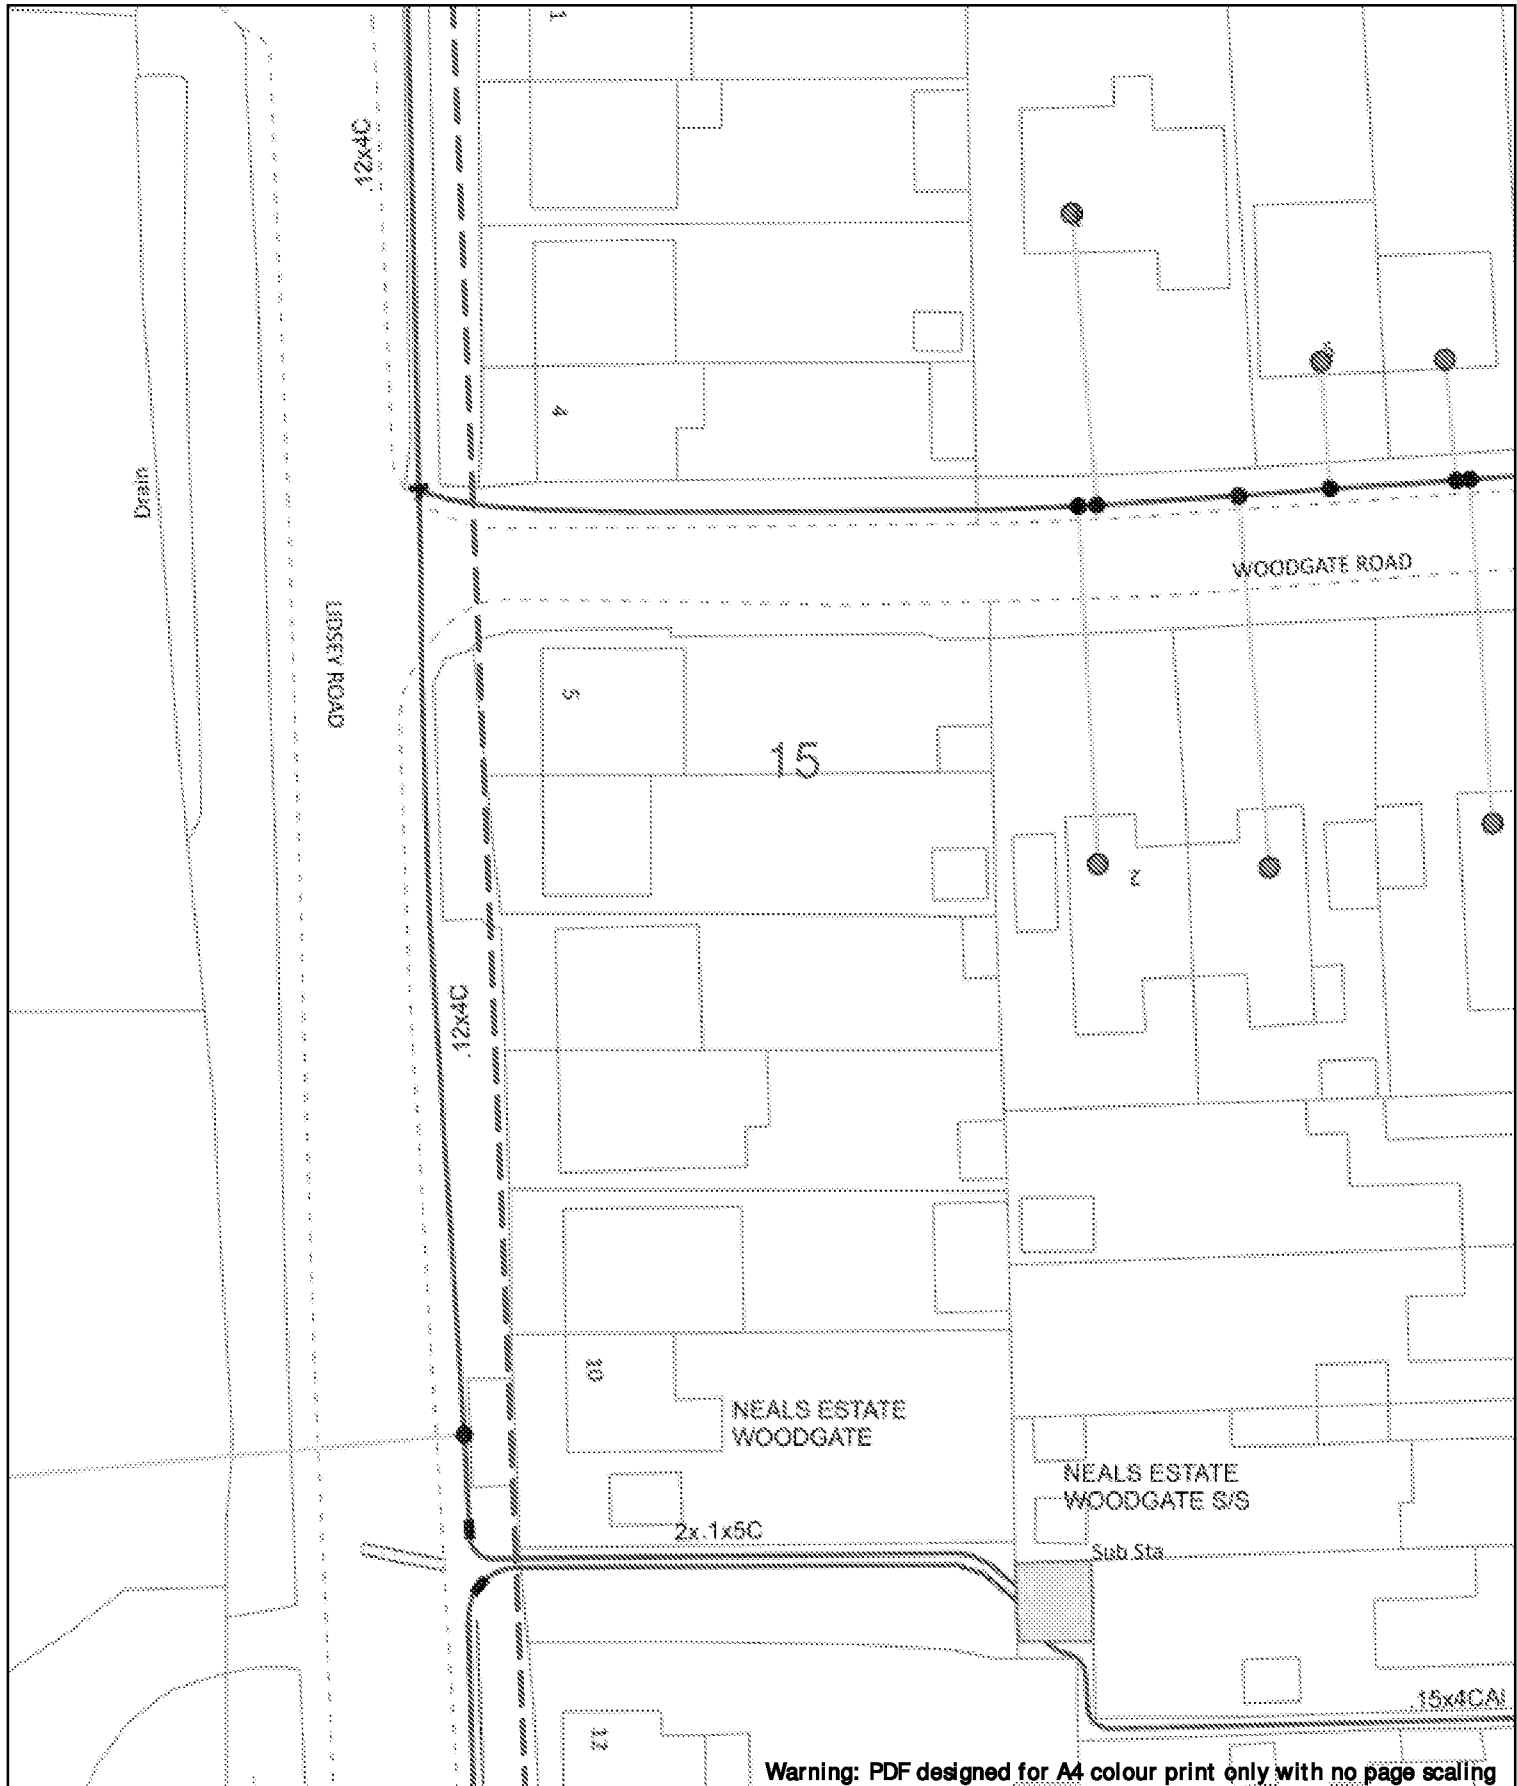

0 20m Dig Sites Area: Line:

Warning: PDF designed for A4 colour print only with no page scaling

Date Requested: 23/ 11/ 2020
 Job Reference: 20614304
 Site Location: 494129 104180
 Requested by: Ms Christina Elliott
 Your Scheme/ Reference: LM
 90619/ SBS


Voltages (V)			
LV (Low Voltage) and Services	Up to 1,000V		
HV (High Voltage)	Over 1,000V to 11,000V		
EHV (Extra High Voltage)	22,000V to 132,000V		
Transmission	275,000V and 400,000V		
NORMAL DEPTH TO THE TOP OF THE CABLE WHEN LAID			
Services	LV	HV	EHV
Footpath/unmade	0.45m	0.45m	0.8m
Road Crossing	0.6m	0.6m	0.9m
Agricultural	1m	1m	1.1m

Scottish and Southern Energy Power Distribution Ltd.
 Registered Office: Inverlaid House,
 200 Dunkeld Road, Perth, PH1 3AQ
 Registered in Scotland No. SC213459

If you're unsure & need to seek advice before commencing excavations, please contact:
 General Enquiries: 0800 048 3516

Subject to revision – Master held by SSEN Asset Data Team:
Asset.Data@sse.com
 01256 337 294

Scale: 1:500 (When plotted at A4)

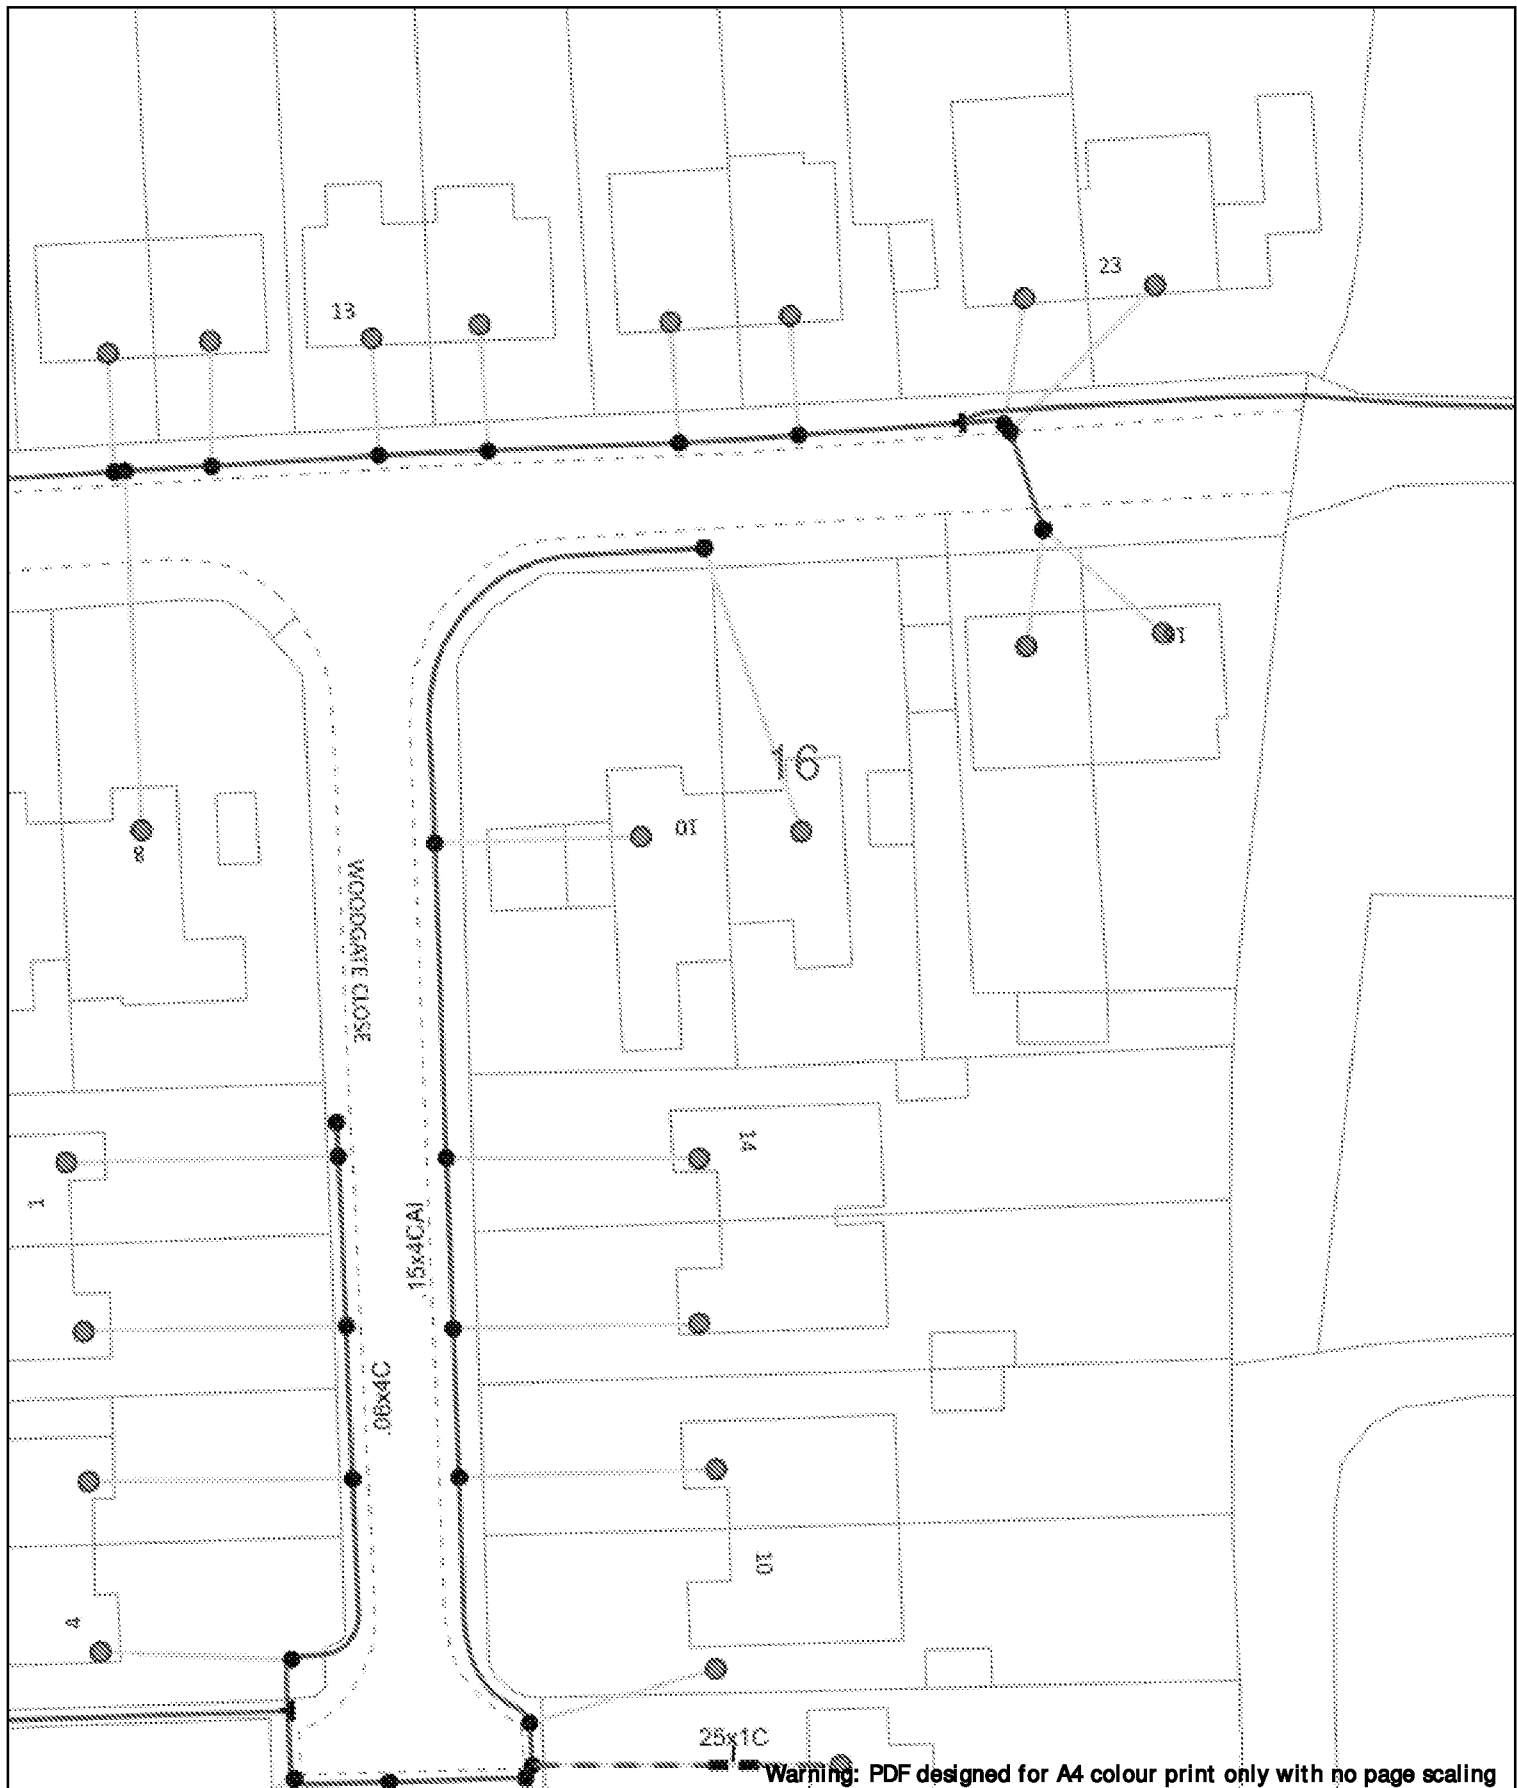


Warning: PDF designed for A4 colour print only with no page scaling

0 20m Dig Sites Area: Line:			Scottish and Southern Energy Power Distribution Ltd. Registered Office: Inverlaid House, 200 Dunkeld Road, Perth, PH1 3AQ Registered In Scotland No. SC213459																														
Date Requested: 23/ 11/ 2020 Job Reference: 20614304 Site Location: 494129 104180 Requested by: Ms Christina Elliott Your Scheme/ Reference: LM 90619/ SBS																																	
Voltages (V) <table border="1"> <thead> <tr> <th>Services</th> <th>LV</th> <th>HV</th> <th>EHV</th> </tr> </thead> <tbody> <tr> <td>Footpath/unmade</td> <td>0.45m</td> <td>0.45m</td> <td>0.6m</td> </tr> <tr> <td>Road Crossing</td> <td>0.6m</td> <td>0.6m</td> <td>0.75m</td> </tr> <tr> <td>Agricultural</td> <td>1m</td> <td>1m</td> <td>1.1m</td> </tr> </tbody> </table> NORMAL DEPTH TO THE TOP OF THE CABLE WHEN LAID		Services	LV	HV	EHV	Footpath/unmade	0.45m	0.45m	0.6m	Road Crossing	0.6m	0.6m	0.75m	Agricultural	1m	1m	1.1m	Legend <table border="1"> <thead> <tr> <th>Symbol</th> <th>Description</th> </tr> </thead> <tbody> <tr> <td></td> <td>Proposed Cable Route</td> </tr> <tr> <td></td> <td>Existing Cable Route</td> </tr> <tr> <td></td> <td>Dig Site</td> </tr> <tr> <td></td> <td>Manhole</td> </tr> <tr> <td></td> <td>Manhole with Cable</td> </tr> <tr> <td></td> <td>Manhole with Cable and Dig Site</td> </tr> </tbody> </table>	Symbol	Description		Proposed Cable Route		Existing Cable Route		Dig Site		Manhole		Manhole with Cable		Manhole with Cable and Dig Site	If you're unsure & need to seek advice before commencing excavations, please contact: General Enquiries: 0800 048 3516 Subject to revision – Master held by SSEN Asset Data Team: Asset.Data@sse.com 01256 337 294
Services	LV	HV	EHV																														
Footpath/unmade	0.45m	0.45m	0.6m																														
Road Crossing	0.6m	0.6m	0.75m																														
Agricultural	1m	1m	1.1m																														
Symbol	Description																																
	Proposed Cable Route																																
	Existing Cable Route																																
	Dig Site																																
	Manhole																																
	Manhole with Cable																																
	Manhole with Cable and Dig Site																																
Scale: 1:500 (When plotted at A4) BASED UPON THE ORDNANCE SURVEY MAP WITH THE SANCTION OF THE CONTROLLER OF HM STATIONERY OFFICE. CROWN COPYRIGHT RESERVED. This map is made by or with the authority of Scottish and Southern Energy Power Distribution Ltd. Pursuant to section 47 of the Copyright, Designs and Patents Act 1988 (The Act). Unless the Act provides a relevant exception to copyright the copy must not be copied without prior permission of the copyright owner. Plans generated by DigSAFE Pro™ software provided by Lineworksbedfordshire.																																	

185 Wavecon

17

0 20m Dig Sites Area: Line:



Subject to revision – Master held by SSEN Asset Data Team:
Asset.Data@sse.com
 01256 337 294

Voltages (V)				
LV (Low Voltage) and Services	Up to 1,000V			
HV (High Voltage)	Over 1,000V to 11,000V			
EHV (Extra High Voltage)	22,000V to 132,000V			
Transmission	275,000V and 400,000V			
NORMAL DEPTH TO THE TOP OF THE CABLE WHEN LAID				
	Services	LV	HV	EHV
Footpath/Unmade	0.45m	0.45m	0.6m	0.8m
Road Crossing	0.6m	0.6m	0.75m	0.9m
Agricultural	1m	1m	1m	1.1m

	Services	LV	HV	EHV
Footpath/Unmade	0.45m	0.45m	0.6m	0.8m
Road Crossing	0.6m	0.6m	0.75m	0.9m
Agricultural	1m	1m	1m	1.1m


[illegible]

WANNING

Please note there have been water-level alterations in the station basin; that water must be undertaken to determine depth and depth of water. It is 67' from the mouth and 70' from the head. Any change from these figures - should be considered before commencing excavation work.

BASED UPON THE ORDINANCE WHICH HAD WITH THE SANCTION OF THE CONTROLLER OF H.M. STATIONERY OFFICE. CROWN COPYRIGHT RESERVED

Section 47 of the Copyright, Designs and Patents Act 1988 ("The Act"). Unless the Act provides a relevant exception to copyright the copy must not be copied without prior permission of the copyright owner.

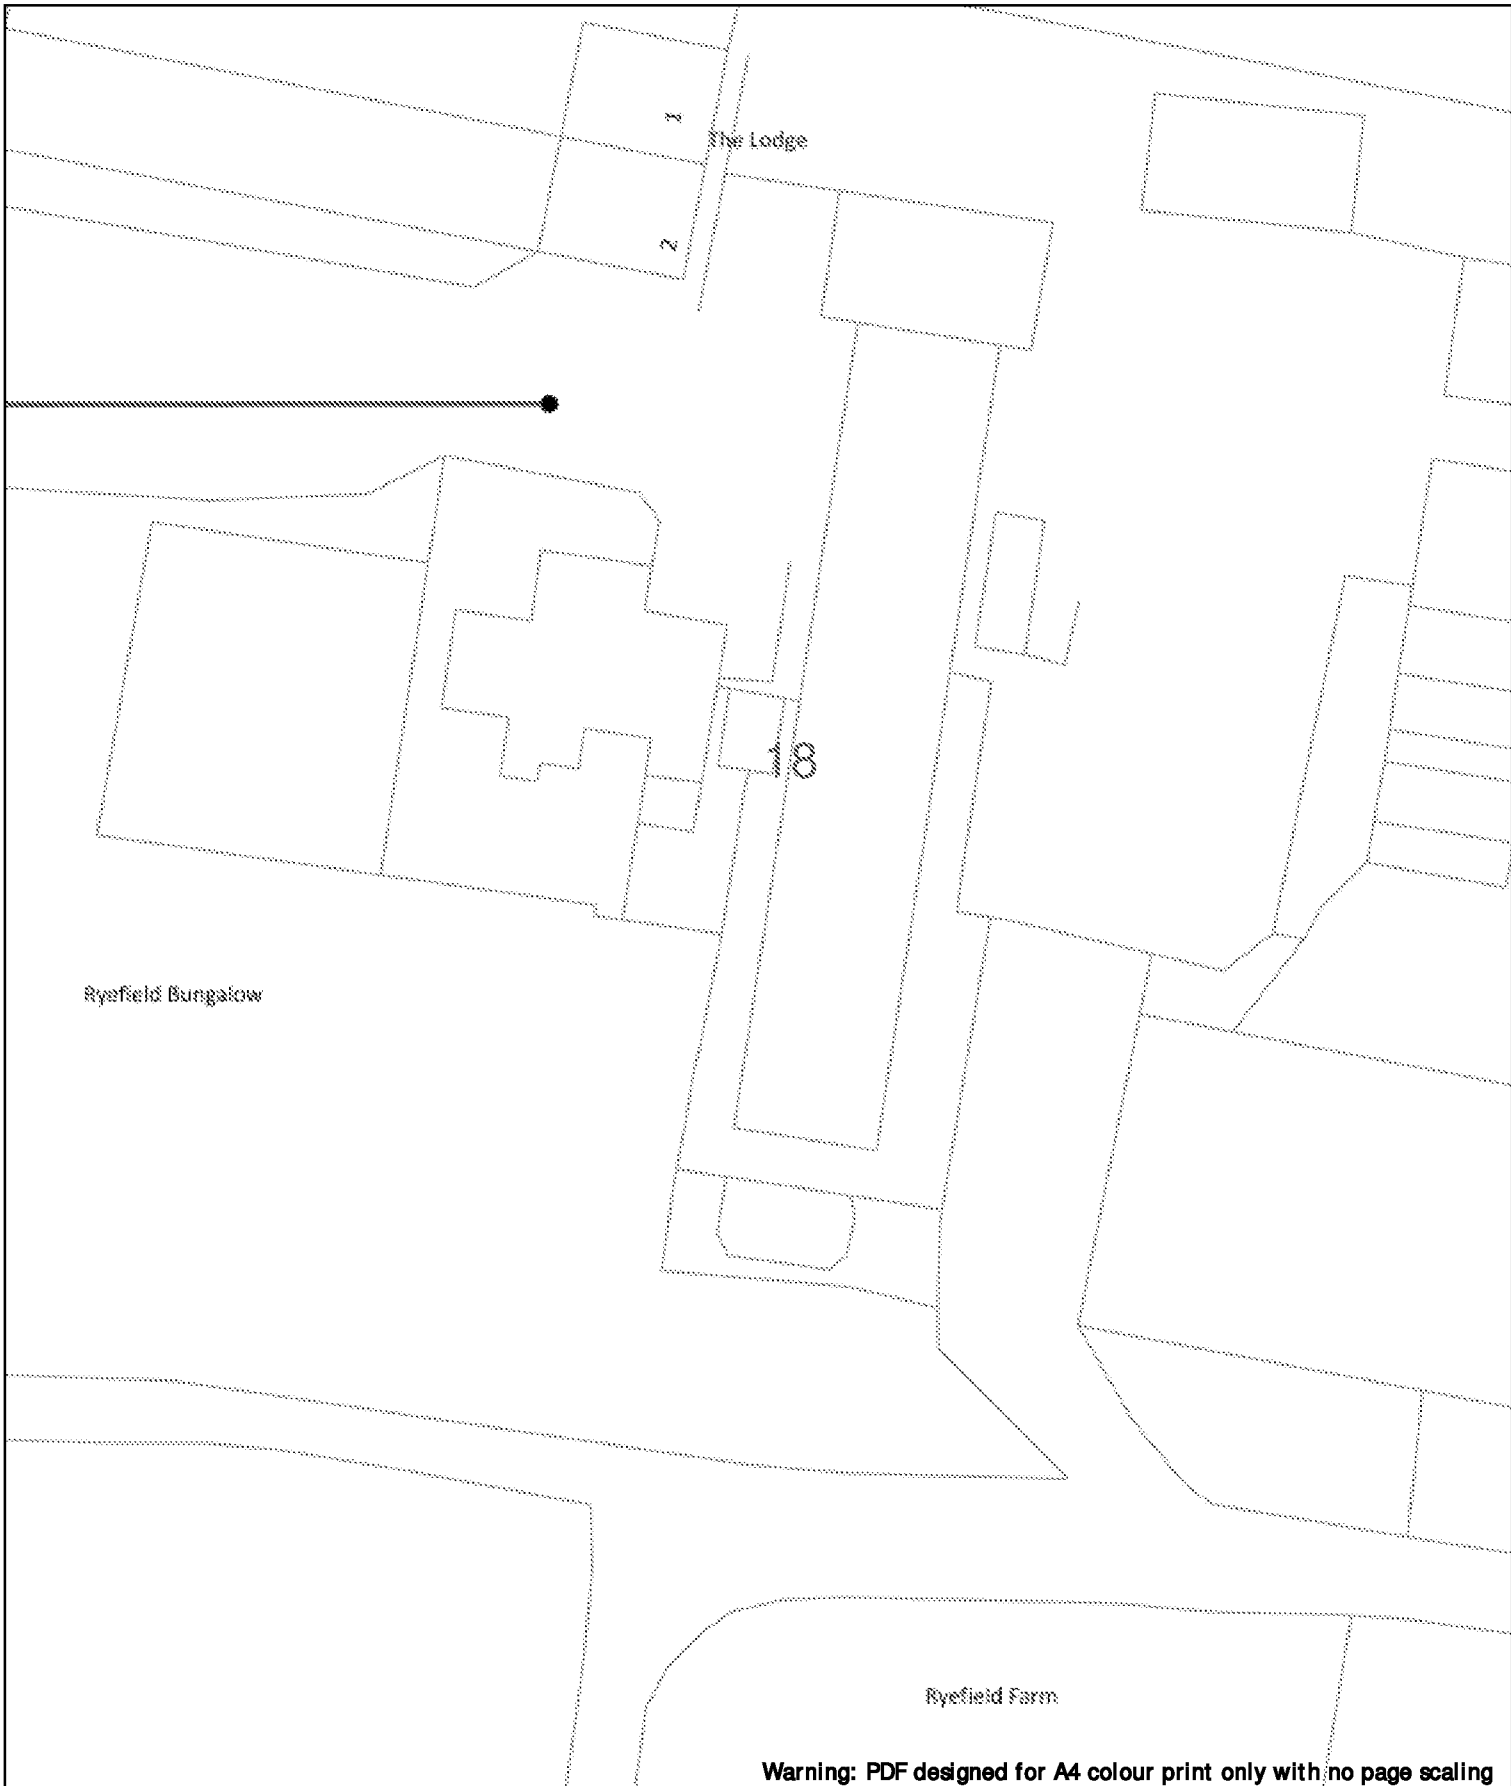

Warning: PDF designed for A4 colour print only with no page scaling

0 20m

Dig Sites Area: Line:

Line:

Date Requested: 23/ 11/ 2020
 Job Reference: 20614304
 Site Location: 494129 104180
 Requested by: Ms Christina Elliott
 Your Scheme/ Reference: LM
 90619/ SBS

Voltages (V)			
LV (Low Voltage) and Services	Up to 1,000V		
HV (High Voltage)	Over 1,000V to 11,000V		
EHV (Extra High Voltage)	22,000V to 132,000V		
Transmission	275,000V and 400,000V		
NORMAL DEPTH TO THE TOP OF THE CABLE WHEN LAID			
Services	LV	HV	EHV
Footpath/unmade	0.45m	0.45m	0.6m
Road Crossing	0.6m	0.6m	0.75m
Agricultural	1m	1m	1.1m

Scottish and Southern Energy Power Distribution Ltd.
 Registered Office: Inverlorn House,
 200 Dunkeld Road, Perth, PH1 3AQ
 Registered in Scotland No. SC213459

If you're unsure & need to seek advice before commencing excavations, please contact:
 General Enquiries: 0800 048 3516

Subject to revision – Master held by SSEN Asset Data Team:
asset.data@sse.com
 01256 337 294

Scale: 1:500 (When plotted at A4)



Warning: PDF designed for A4 colour print only with no page scaling

0 20m Dig Sites Area: Line:																																			
Date Requested: 23/ 11/ 2020 Job Reference: 20614304 Site Location: 494129 104180 Requested by: Ms Christina Elliott Your Scheme/ Reference: LM 90619/ SBS		<table border="1"> <thead> <tr> <th colspan="4">Voltages (V)</th> </tr> <tr> <th>LV (Low Voltage) and Services</th> <th>Up to 1,000V</th> <th>Over 1,000V to 11,000V</th> <th>EHV (Extra High Voltage)</th> </tr> <tr> <th>EHV (Extra High Voltage)</th> <th>22,000V to 132,000V</th> <th>275,000V and 400,000V</th> <th>Transmission</th> </tr> </thead> <tbody> <tr> <td colspan="4">NORMAL DEPTH TO THE TOP OF THE CABLE WHEN LAID</td> </tr> <tr> <td>Services</td> <td>LV</td> <td>HV</td> <td>EHV</td> </tr> <tr> <td>Footpath/unmade</td> <td>0.45m</td> <td>0.45m</td> <td>0.8m</td> </tr> <tr> <td>Road Crossing</td> <td>0.6m</td> <td>0.6m</td> <td>0.75m</td> </tr> <tr> <td>Agricultural</td> <td>1m</td> <td>1m</td> <td>1.1m</td> </tr> </tbody> </table>	Voltages (V)				LV (Low Voltage) and Services	Up to 1,000V	Over 1,000V to 11,000V	EHV (Extra High Voltage)	EHV (Extra High Voltage)	22,000V to 132,000V	275,000V and 400,000V	Transmission	NORMAL DEPTH TO THE TOP OF THE CABLE WHEN LAID				Services	LV	HV	EHV	Footpath/unmade	0.45m	0.45m	0.8m	Road Crossing	0.6m	0.6m	0.75m	Agricultural	1m	1m	1.1m	Scottish and Southern Energy Power Distribution Ltd. Registered Office: Inverlaimond House, 200 Dunkeld Road, Perth, PH1 3AQ Registered In Scotland No. SC213459 If you're unsure & need to seek advice before commencing excavations, please contact: General Enquiries: 0800 048 3516 Subject to revision – Master held by SSEN Asset Data Team: Asset.Data@sse.com 01256 337 294
Voltages (V)																																			
LV (Low Voltage) and Services	Up to 1,000V	Over 1,000V to 11,000V	EHV (Extra High Voltage)																																
EHV (Extra High Voltage)	22,000V to 132,000V	275,000V and 400,000V	Transmission																																
NORMAL DEPTH TO THE TOP OF THE CABLE WHEN LAID																																			
Services	LV	HV	EHV																																
Footpath/unmade	0.45m	0.45m	0.8m																																
Road Crossing	0.6m	0.6m	0.75m																																
Agricultural	1m	1m	1.1m																																



Warning: PDF designed for A4 colour print only with no page scaling

020m Dig Sites Area: Line:

Date Requested: 23/ 11/ 2020
Job Reference: 20614304
Site Location: 494129 104180
Requested by: Ms Christina Elliott

Your Scheme/ Reference: LM
90619/ SBS

Voltages (V)			
LV (Low Voltage) and Services	Up to 1,000V		
HV (High Voltage)	Over 1,000V to 11,000V		
EHV (Extra High Voltage)	22,000V to 132,000V		
Transmission	275,000V and 400,000V		

NORMAL DEPTH TO THE TOP OF THE CABLE WHEN LAID			
Services	LV	HV	EHV
Footpath/unmade	0.45m	0.45m	0.6m
Road Crossing	0.6m	0.6m	0.75m
Agricultural	1m	1m	1.1m

WARNING

From inspection based on visual inspection of the site, the following information is provided. It is not intended to be a substitute for a detailed site survey and should not be used for design purposes. It is the responsibility of the client to ensure that the information provided is accurate and to take appropriate precautions when working on the site.

Scottish and Southern Energy Power Distribution Ltd.
Registered Office: Inverlaid House,
200 Dunkeld Road, Perth, PH1 3AQ
Registered In Scotland No. SC213459

If you're unsure & need to seek advice before commencing excavations, please contact:
General Enquiries: 0800 048 3516

Subject to revision – Master held by SEN Asset Data Team:
asset_data@sen.com
01256 337 294

Scale: 1:500 (When plotted at A4)

BASED UPON THE ORDNANCE SURVEY MAP WITH THE SANCTION OF THE CONTROLLER OF HER MAJESTY'S STATIONERY OFFICE. CROWN COPYRIGHT RESERVED.

Not made by or with the authority of Scottish and Southern Energy Power Distribution Ltd. Pursuant to section 47 of the Copyright, Designs and Patents Act 1988 ("The Act"). Unless the Act provides a relevant exception to copyright, the copy must not be copied without the permission of the copyright owner.

Plans generated by DigSAFE Pro™ software provided by Linsearchbedford.org.

Warning: PDF designed for A4 colour print only with no page scaling

0 20m Dig Sites Area: Line:

Date Requested: 23/ 11/ 2020
 Job Reference: 20614304
 Site Location: 494129 104180
 Requested by: Ms Christina Elliott
 Your Scheme/ Reference: LM
 90619/ SBS

Voltages (V)				
LV (Low Voltage) and Services	Up to 1,000V			
HV (High Voltage)	Over 1,000V to 11,000V			
EHV (Extra High Voltage)	22,000V to 132,000V			
Transmission	275,000V and 400,000V			
NORMAL DEPTH TO THE TOP OF THE CABLE WHEN LAID				
	Services	LV	HV	EHV
Footpath/unmade	0.45m	0.45m	0.6m	0.8m
Road Crossing	0.6m	0.6m	0.75m	0.9m
Agricultural	1m	1m	1m	1.1m

WARNING

From positions based on aerial photography or other data, the position of cables may not be accurately shown. It is the responsibility of the user to ensure that the position of cables is checked before any excavation work is carried out. The user should also ensure that the position of cables is checked before any excavation work is carried out.

BASED UPON THE ORDNANCE SURVEY MAP WITH THE SANCTION OF THE CONTROLLER OF HER MAJESTY'S STATIONERY OFFICE. CROWN COPYRIGHT RESERVED.




Scottish and Southern Energy Power Distribution Ltd.
 Registered Office: Inverlamb House,
 200 Dunkeld Road, Perth, PH1 3AQ
 Registered in Scotland No. SC213459

If you're unsure & need to seek advice before commencing excavations, please contact:
 General Enquiries: 0800 048 3516

Subject to revision – Master held by SSEN Asset Data Team:
asset.data@sse.com
 01256 337 294



[illegible]

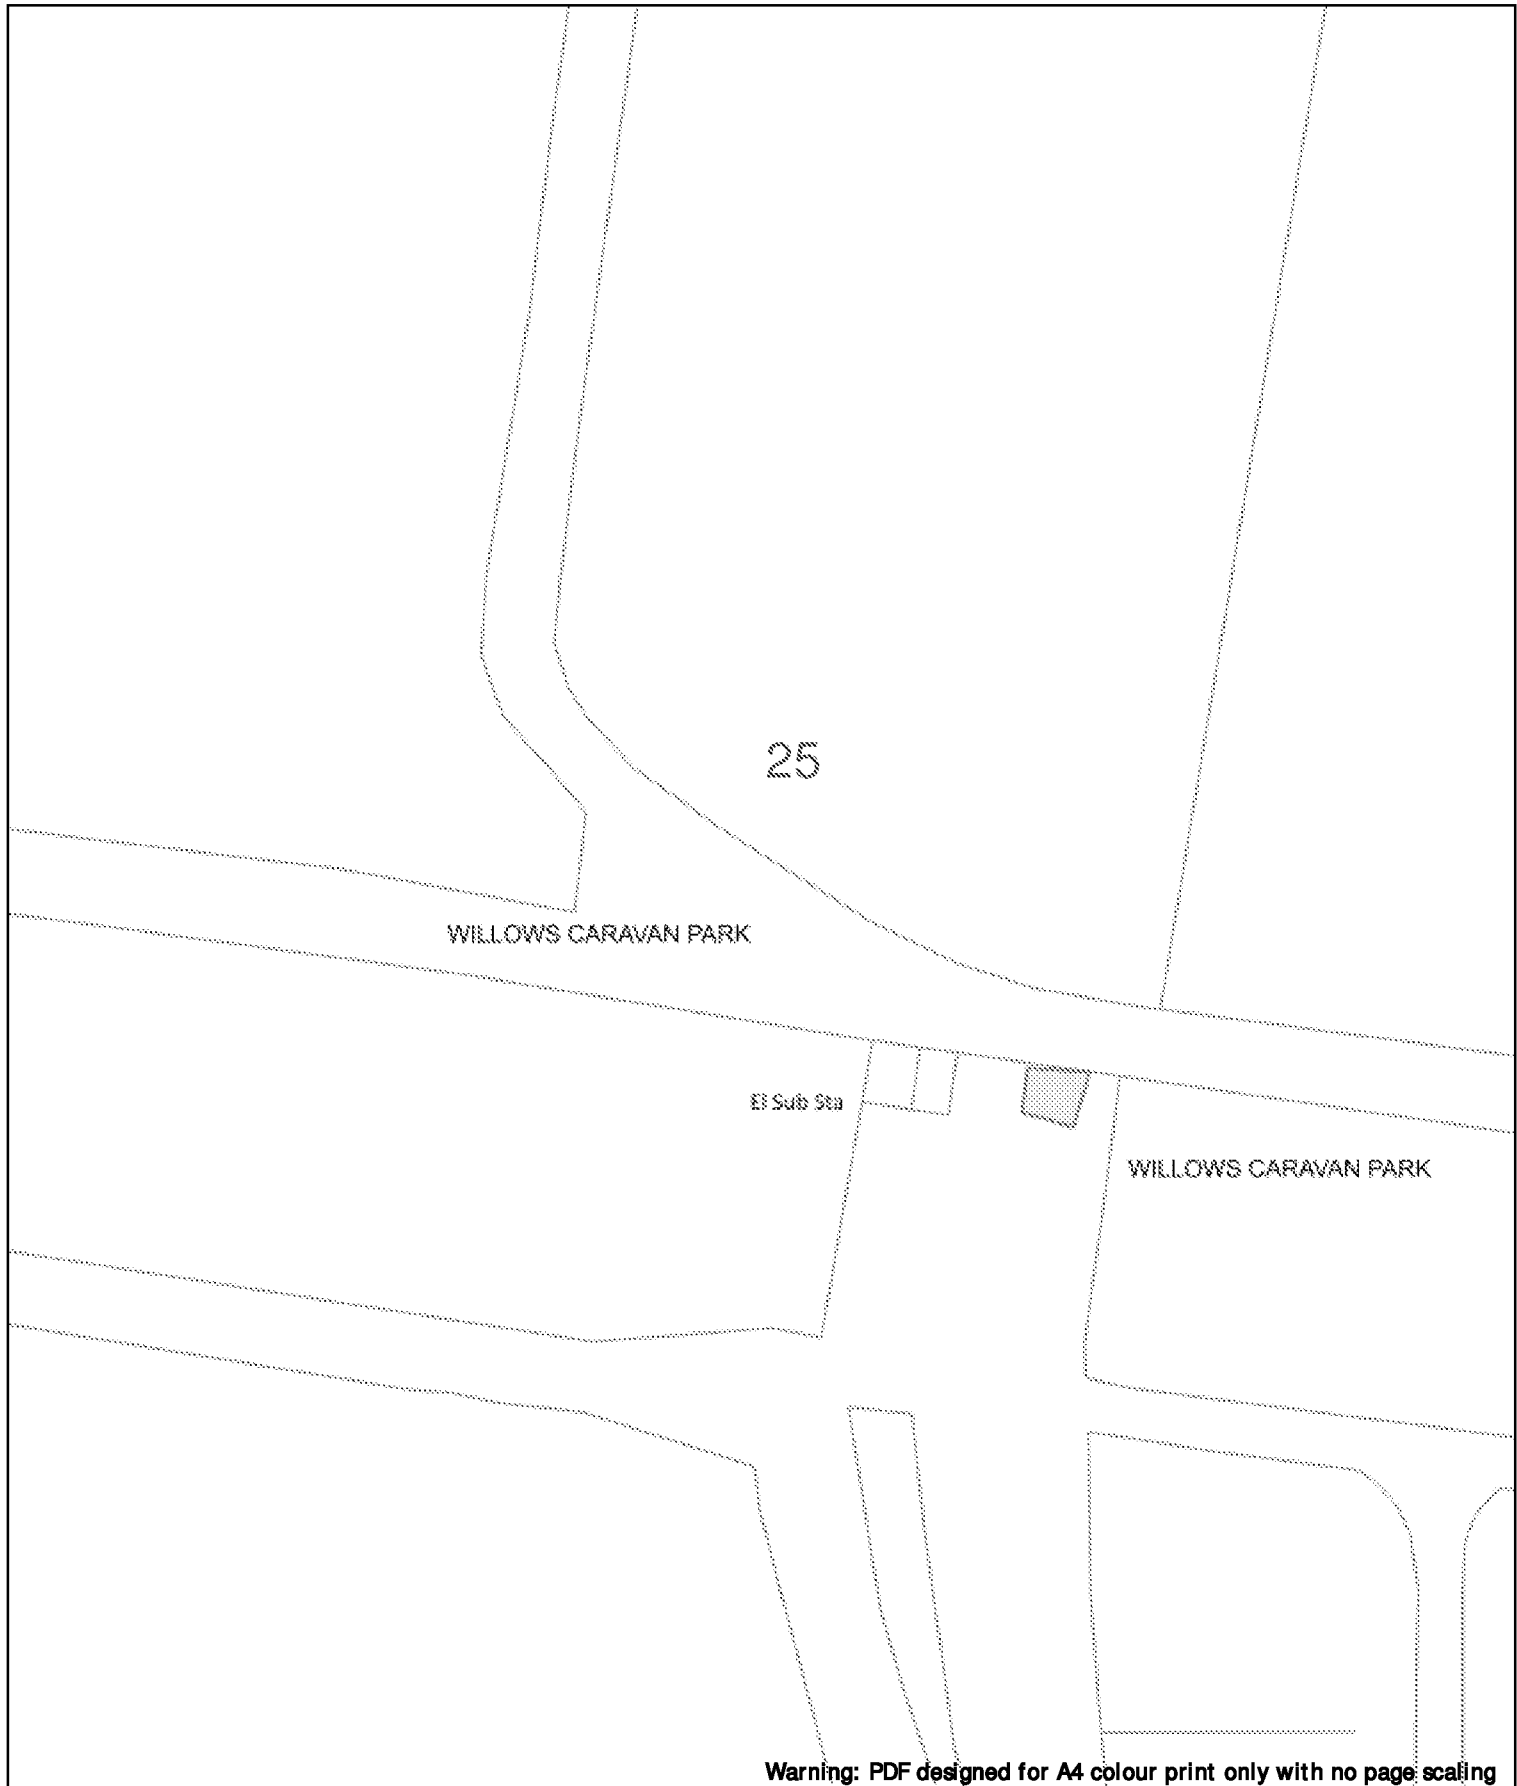

0 20m Dig Sites Area: Line:

Warning: PDF designed for A4 colour print only with no page scaling

Scottish & Southern
Electricity Distribution

Date Requested: 23/ 11/ 2020
Job Reference: 20614304
Site Location: 494129 104180
Requested by: Ms Christina Elliott

Your Scheme/ Reference: LM
90619/ SBS

Voltages (V)			
LV (Low Voltage) and Services	Up to 1,000V		
HV (High Voltage)	Over 1,000V to 11,000V		
EHV (Extra High Voltage)	22,000V to 132,000V		
Transmission	275,000V and 400,000V		
NORMAL DEPTH TO THE TOP OF THE CABLE WHEN LAID			
Services	LV	HV	EHV
Footpath/unmade	0.45m	0.45m	0.8m
Road Crossing	0.6m	0.6m	0.9m
Agricultural	1m	1m	1.1m

Legend

----- Dig Site

----- Area

----- Line

----- Warning

Scale: 1:500 (When plotted at A4)

Scottish and Southern Energy Power Distribution Ltd.
Registered Office: Inverlaimond House,
200 Dunkeld Road, Perth, PH1 3AQ
Registered In Scotland No. SC213459

If you're unsure & need to seek advice before commencing excavations, please contact:
General Enquiries: 0800 048 3516

Subject to revision – Master held by SSEN Asset Data Team:
Asset.Data@sse.com
01256 337 294

26

Warning: PDF designed for A4 colour print only with no page scaling

0 20m Dig Sites Area: Line:

Date Requested: 23/ 11/ 2020
Job Reference: 20614304
Site Location: 494129 104180
Requested by: Ms Christina Elliott
Your Scheme/ Reference: LM
90619/ SBS

Voltages (V)			
LV (Low Voltage) and Services	Up to 1,000V		
HV (High Voltage)	Over 1,000V to 11,000V		
EHV (Extra High Voltage)	22,000V to 132,000V		
Transmission	275,000V and 400,000V		
NORMAL DEPTH TO THE TOP OF THE CABLE WHEN LAID			
Services	LV	HV	EHV
Footpath/unmade	0.45m	0.45m	0.6m
Road Crossing	0.6m	0.6m	0.75m
Agricultural	1m	1m	1.1m

Symbol	Description
	Dig Site
	Area
	Line
	Cable
	Manhole
	Pole
	Transformer
	Substation
	Road
	Footpath
	Agricultural
	Boundary
	Water
	Fences
	Trees
	Buildings
	Other Structures

WARNING


From positions based on aerial photography, the station level, total water must be determined, to determine earth and depth of water. All dig sites must be marked with the depth and safety barriers. Avoiding danger from the cables - should be considered before commencing excavation work.

WHICH MAY BE USED FOR THE PURPOSES OF CONDUCTING THE WORK SHOULD BE USED TO DETERMINE THE LOCATION OF THE CABLES AND TO DETERMINE THE DEPTH OF THE CABLES.

BASED UPON THE ORDNANCE SURVEY MAP WITH THE SANCTION OF THE CONTROLLER OF HER MAJESTY'S STATIONERY OFFICE. CROWN COPYRIGHT RESERVED.

APUN DISTRICT COUNCIL AL10721/PL made by or with the authority of Scottish and Southern Energy Power Distribution Ltd. Pursuant to section 47 of the Copyright, Designs and Patents Act 1988 ("The Act"). Unless the Act provides a relevant exception to copyright the copy must not be copied without prior permission of the copyright owner.

Plans generated by DigSAFE Pro™ software provided by Linsearchbedford.org.



Scottish and Southern Energy Power Distribution Ltd.
Registered Office: Inverlamb House,
200 Dunkeld Road, Perth, PH1 3AQ
Registered In Scotland No. SC213459

If you're unsure & need to seek advice before commencing excavations, please contact:
General Enquiries: 0800 048 3516


Subject to revision – Master held by SSEN Asset Data Team:
Asset.Data@sse.com
01256 337 294

Warning: PDF designed for A4 colour print only with no page scaling

0 20m Dig Sites Area: Line:

Date Requested: 23/ 11/ 2020
 Job Reference: 20614304
 Site Location: 494129 104180
 Requested by: Ms Christina Elliott
 Your Scheme/ Reference: LM
 90619/ SBS

Voltages (V)				
LV (Low Voltage) and Services	Up to 1,000V			
HV (High Voltage)	Over 1,000V to 11,000V			
EHV (Extra High Voltage)	22,000V to 132,000V			
Transmission	275,000V and 400,000V			
NORMAL DEPTH TO THE TOP OF THE CABLE WHEN LAID				
	Services	LV	HV	EHV
Footpath/unmade	0.45m	0.45m	0.6m	0.8m
Road Crossing	0.6m	0.6m	0.75m	0.9m
Agricultural	1m	1m	1m	1.1m

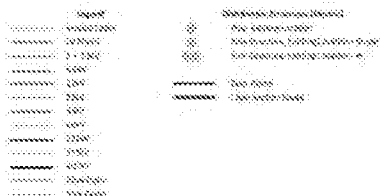

WARNING

From positions based on a vertical alignment in the station level, the level must be determined, to determine the depth of the cable. The depth of the cable must be determined from the station and safety certificates. Avoiding danger from the cables - should be considered before commencing excavation work.

WHICH MAY BE USED FOR THE PURPOSES OF CONDUCTING THE WORK, BUT NOT FOR THE PURPOSES OF CONDUCTING THE WORK, BUT NOT FOR THE PURPOSES OF CONDUCTING THE WORK.


BASED UPON THE ORDNANCE SURVEY MAP WITH THE SANCTION OF THE CONTROLLER OF HER MAJESTY'S STATIONERY OFFICE. CROWN COPYRIGHT RESERVED.



Scottish and Southern Energy Power Distribution Ltd.
 Registered Office: Inverlaid House,
 200 Dunkeld Road, Perth, PH1 3AQ
 Registered In Scotland No. SC213459


If you're unsure & need to seek advice before commencing excavations, please contact:
 General Enquiries: 0800 048 3516

Subject to revision – Master held by SSEN Asset Data Team:
Asset.Data@sse.com
 01256 337 294

[illegible]

Subject to revision – Master held by SSEN Asset Data Team:
Asset.Data@ssen.com
 01256 337 294

There have been wave-pool abrasion in the surface boric. Trial water must be underway, to determine width and depth of water. As it is a model from the field and safety surface. Avoiding danger from human falls. Should be consider other concerning excavation work.

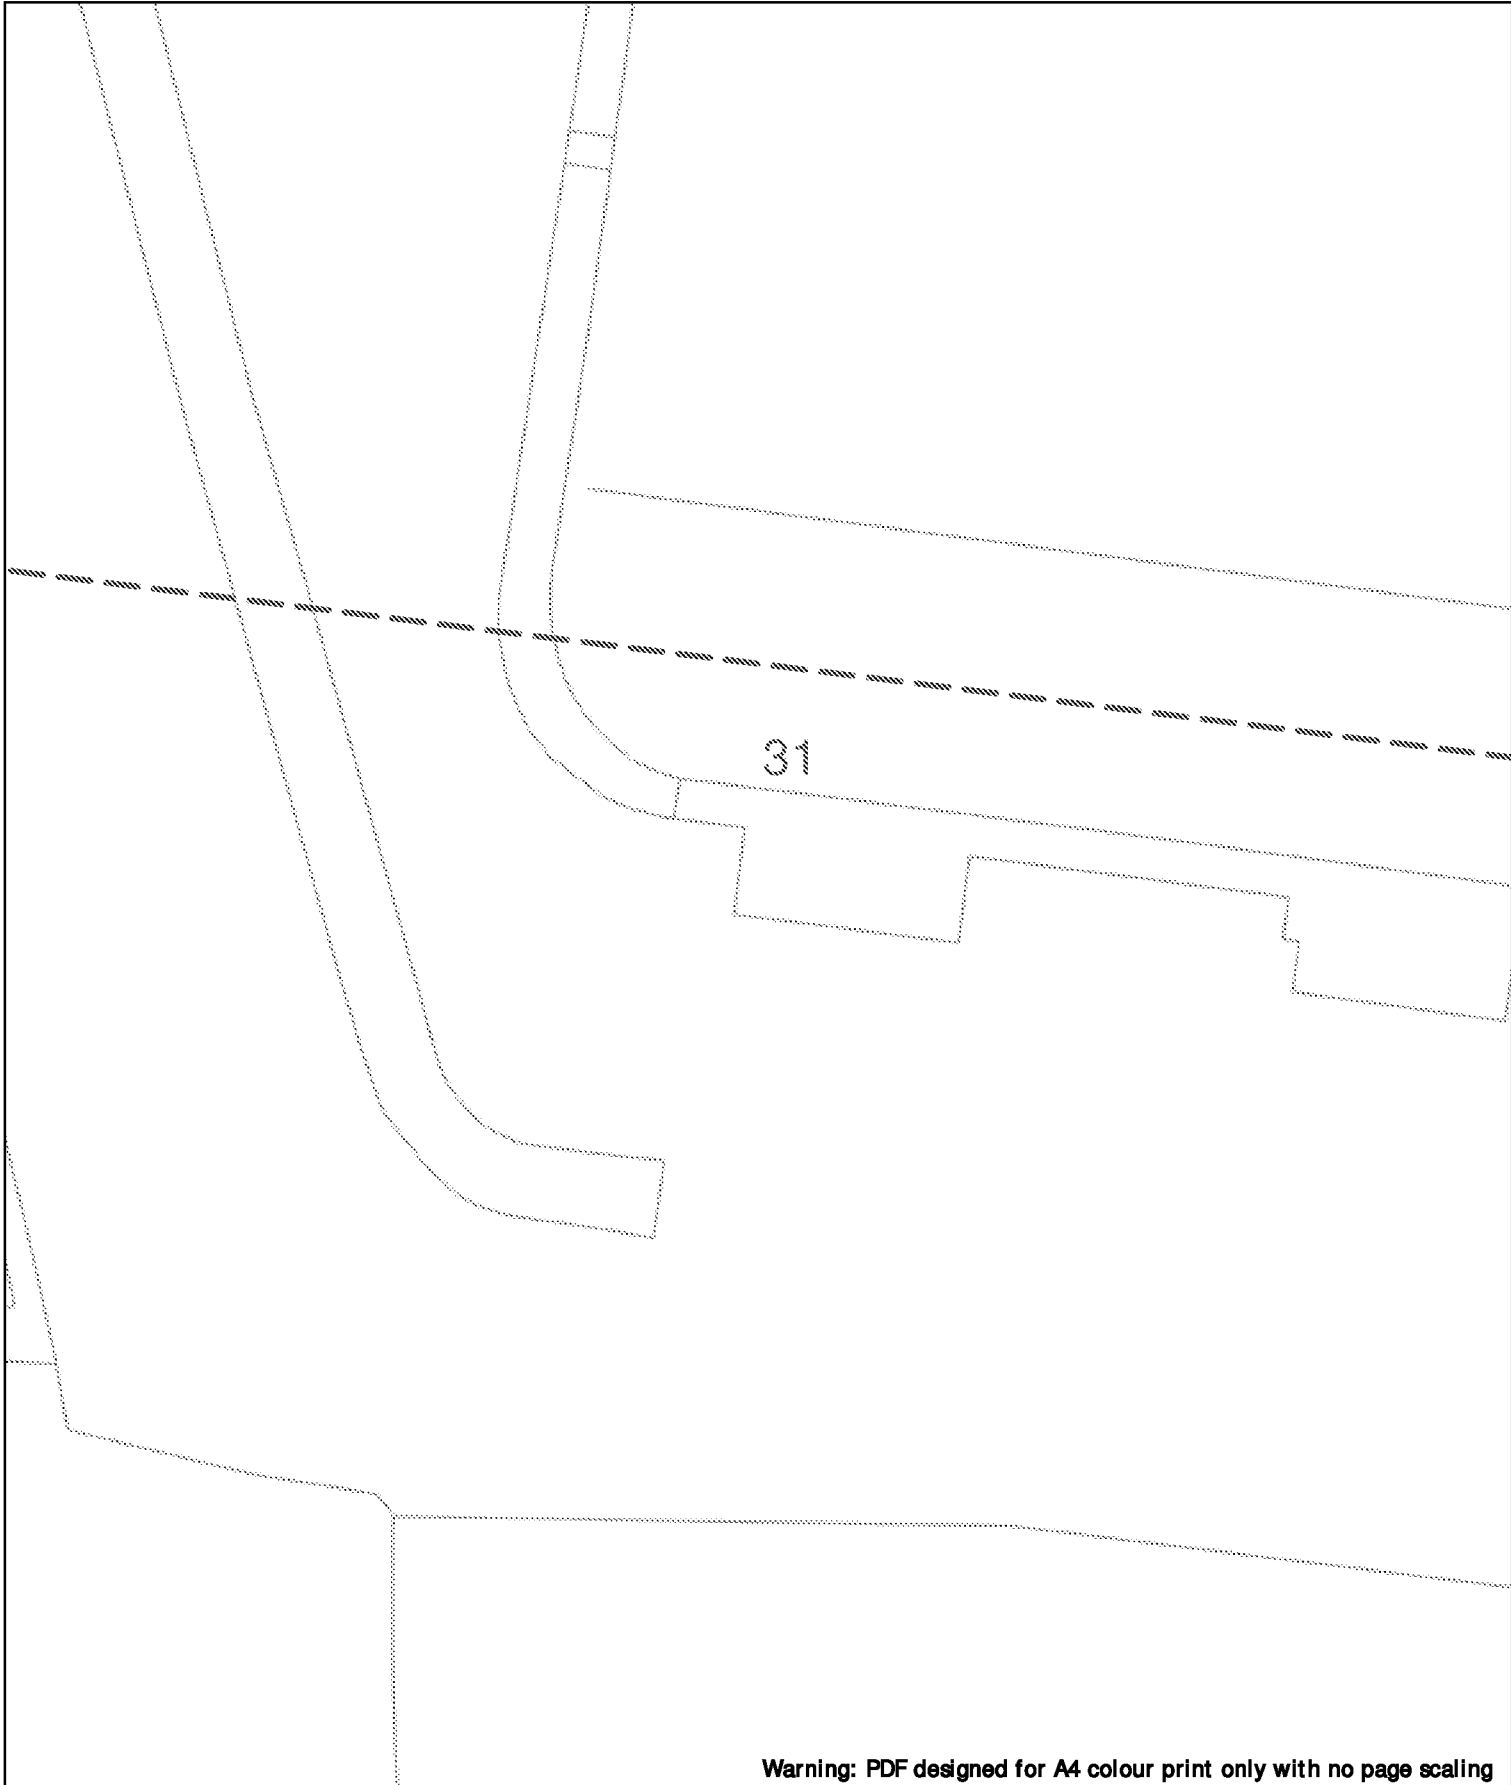

Warning: PDF designed for A4 colour print only with no page scaling

0 20m

Dig Sites Area: Line:

Date Requested: 23/ 11/ 2020
 Job Reference: 20614304
 Site Location: 494129 104180
 Requested by: Ms Christina Elliott
 Your Scheme/ Reference: LM
 90619/ SBS

Voltages (V)			
LV (Low Voltage) and Services	Up to 1,000V		
HV (High Voltage)	Over 1,000V to 11,000V		
EHV (Extra High Voltage)	22,000V to 132,000V		
Transmission	275,000V and 400,000V		
NORMAL DEPTH TO THE TOP OF THE CABLE WHEN LAID			
Services	LV	HV	EHV
Footpath/unmade	0.45m	0.45m	0.8m
Road Crossing	0.6m	0.6m	0.9m
Agricultural	1m	1m	1.1m

WARNING

From positions based on aerial photography, the station level, tide level must be determined, to determine accurate and depth of station. It is 47' from the station and safety barriers. Avoiding danger from these cables - should be considered before commencing excavation work.

WHICH MAY BE USED FOR CONDUIT AND CABLES WHICH SHOULD BE DIRECTLY SUPPORTED BY THE CABLES WHICH SHOULD BE USED FOR THE CABLES.

Scottish and Southern Energy Power Distribution Ltd.
 Registered Office: Inverlamb House,
 200 Dunkeld Road, Perth, PH1 3AQ.
 Registered In Scotland No. SC213459

If you're unsure & need to seek advice before commencing excavations, please contact:
 General Enquiries: 0800 048 3516

Subject to revision – Master held by SSEN Asset Data Team:
Asset.Data@sse.com
 01256 337 294

BASED UPON THE ORDNANCE SURVEY MAP WITH THE SANCTION OF THE CONTROLLER OF HER MAJESTY'S STATIONERY OFFICE. CROWN COPYRIGHT RESERVED.

Not made by or with the authority of Scottish and Southern Energy Power Distribution Ltd. Pursuant to section 47 of the Copyright, Designs and Patents Act 1988 ("The Act"). Unless the Act provides a relevant exception to copyright the copy must not be copied without prior permission of the copyright owner.

Plans generated by DigSAFE Pro™ software provided by Linsearchbedford.org.

Willows Caravan Park

32

Warning: PDF designed for A4 colour print only with no page scaling

0 20m Dig Sites Area: Line:

Date Requested: 23/ 11/ 2020
Job Reference: 20614304
Site Location: 494129 104180
Requested by: Ms Christina Elliott
Your Scheme/ Reference: LM
90619/ SBS

Voltages (V)				
LV (Low Voltage) and Services	Up to 1,000V			
HV (High Voltage)	Over 1,000V to 11,000V			
EHV (Extra High Voltage)	22,000V to 132,000V			
Transmission	275,000V and 400,000V			
NORMAL DEPTH TO THE TOP OF THE CABLE WHEN LAID				
	Services	LV	HV	EHV
Footpath/unmade	0.45m	0.45m	0.6m	0.8m
Road Crossing	0.6m	0.6m	0.75m	0.9m
Agricultural	1m	1m	1m	1.1m

Symbol	Description
	Dig Site
	Area
	Line
	Cable
	Road
	Footpath
	Agricultural
	Services
	HV
	EHV
	Transmission

WARNING


From excavations below water-levels shown on the station level, the water must be removed, to a suitable level and depth of water, to the health and safety of the workers. Avoiding danger from the water, the workers should be advised before commencing excavation work.

WHICH MAY BE USED FOR THE PURPOSES OF THE ACT, AND WHICH MAY BE USED FOR THE PURPOSES OF THE ACT, AND WHICH MAY BE USED FOR THE PURPOSES OF THE ACT.

BASED UPON THE ORDNANCE SURVEY MAP WITH THE SANCTION OF THE CONTROLLER OF HER MAJESTY'S STATIONERY OFFICE. CROWN COPYRIGHT RESERVED.

ARUN DISTRICT COUNCIL AL10721/PL made by or with the authority of Scottish and Southern Energy Power Distribution Ltd. Pursuant to section 47 of the Copyright, Designs and Patents Act 1988 ("The Act"). Unless the Act provides a relevant exception to copyright the copy must not be copied without prior permission of the copyright owner.

Plans generated by DigSAFE Pro™ software provided by Linesearchuk Limited.



Scottish and Southern Energy Power Distribution Ltd.
Registered Office: Inverlaimond House,
200 Dunkeld Road, Perth, PH1 3AQ.
Registered in Scotland No. SC213459

If you're unsure & need to seek advice before commencing excavations, please contact:
General Enquiries: 0800 048 3516

Subject to revision – Master held by SSEN Asset Data Team:
Asset.Data@sse.com
01256 337 294


33

Warning: PDF designed for A4 colour print only with no page scaling

0 20m Dig Sites Area: Line:

Date Requested: 23/ 11/ 2020
Job Reference: 20614304
Site Location: 494129 104180
Requested by: Ms Christina Elliott
Your Scheme/ Reference: LM
90619/ SBS

Voltages (V)				
LV (Low Voltage) and Services	Up to 1,000V			
HV (High Voltage)	Over 1,000V to 11,000V			
EHV (Extra High Voltage)	22,000V to 132,000V			
Transmission	275,000V and 400,000V			
NORMAL DEPTH TO THE TOP OF THE CABLE WHEN LAID				
	Services	LV	HV	EHV
Footpath/unmade	0.45m	0.45m	0.6m	0.8m
Road Crossing	0.6m	0.6m	0.75m	0.9m
Agricultural	1m	1m	1m	1.1m

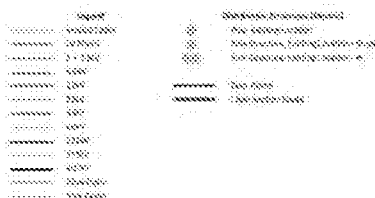

WARNING

From positions based on aerial photography, the station level, tide level must be determined, to determine earth and depth of water. It is the responsibility of the user to ensure that the depth of water is sufficient for the proposed work. The user should also ensure that the depth of water is sufficient for the proposed work.

BASED UPON THE ORDNANCE SURVEY MAP WITH THE SANCTION OF THE CONTROLLER OF HER MAJESTY'S STATIONERY OFFICE. CROWN COPYRIGHT RESERVED.
Plans generated by DigSAFE Pro™ software provided by Linesearchuk Limited.




Scottish and Southern Energy Power Distribution Ltd.
Registered Office: Inverlamb House,
200 Dunkeld Road, Perth, PH1 3AQ
Registered In Scotland No. SC213459

If you're unsure & need to seek advice before commencing excavations, please contact:
General Enquiries: 0800 048 3516

Subject to revision – Master held by SSEN Asset Data Team:
AssetData@sse.com
01256 337 294


Warning: PDF designed for A4 colour print only with no page scaling

[illegible]

If you're unsure & need to seek advice before commencing excavations, please contact:
General Enquiries: 0800 048 3516

Scale: 1:500 (When plotted at A4)

AFUN DISTRICT COUNCIL AL10721/PL

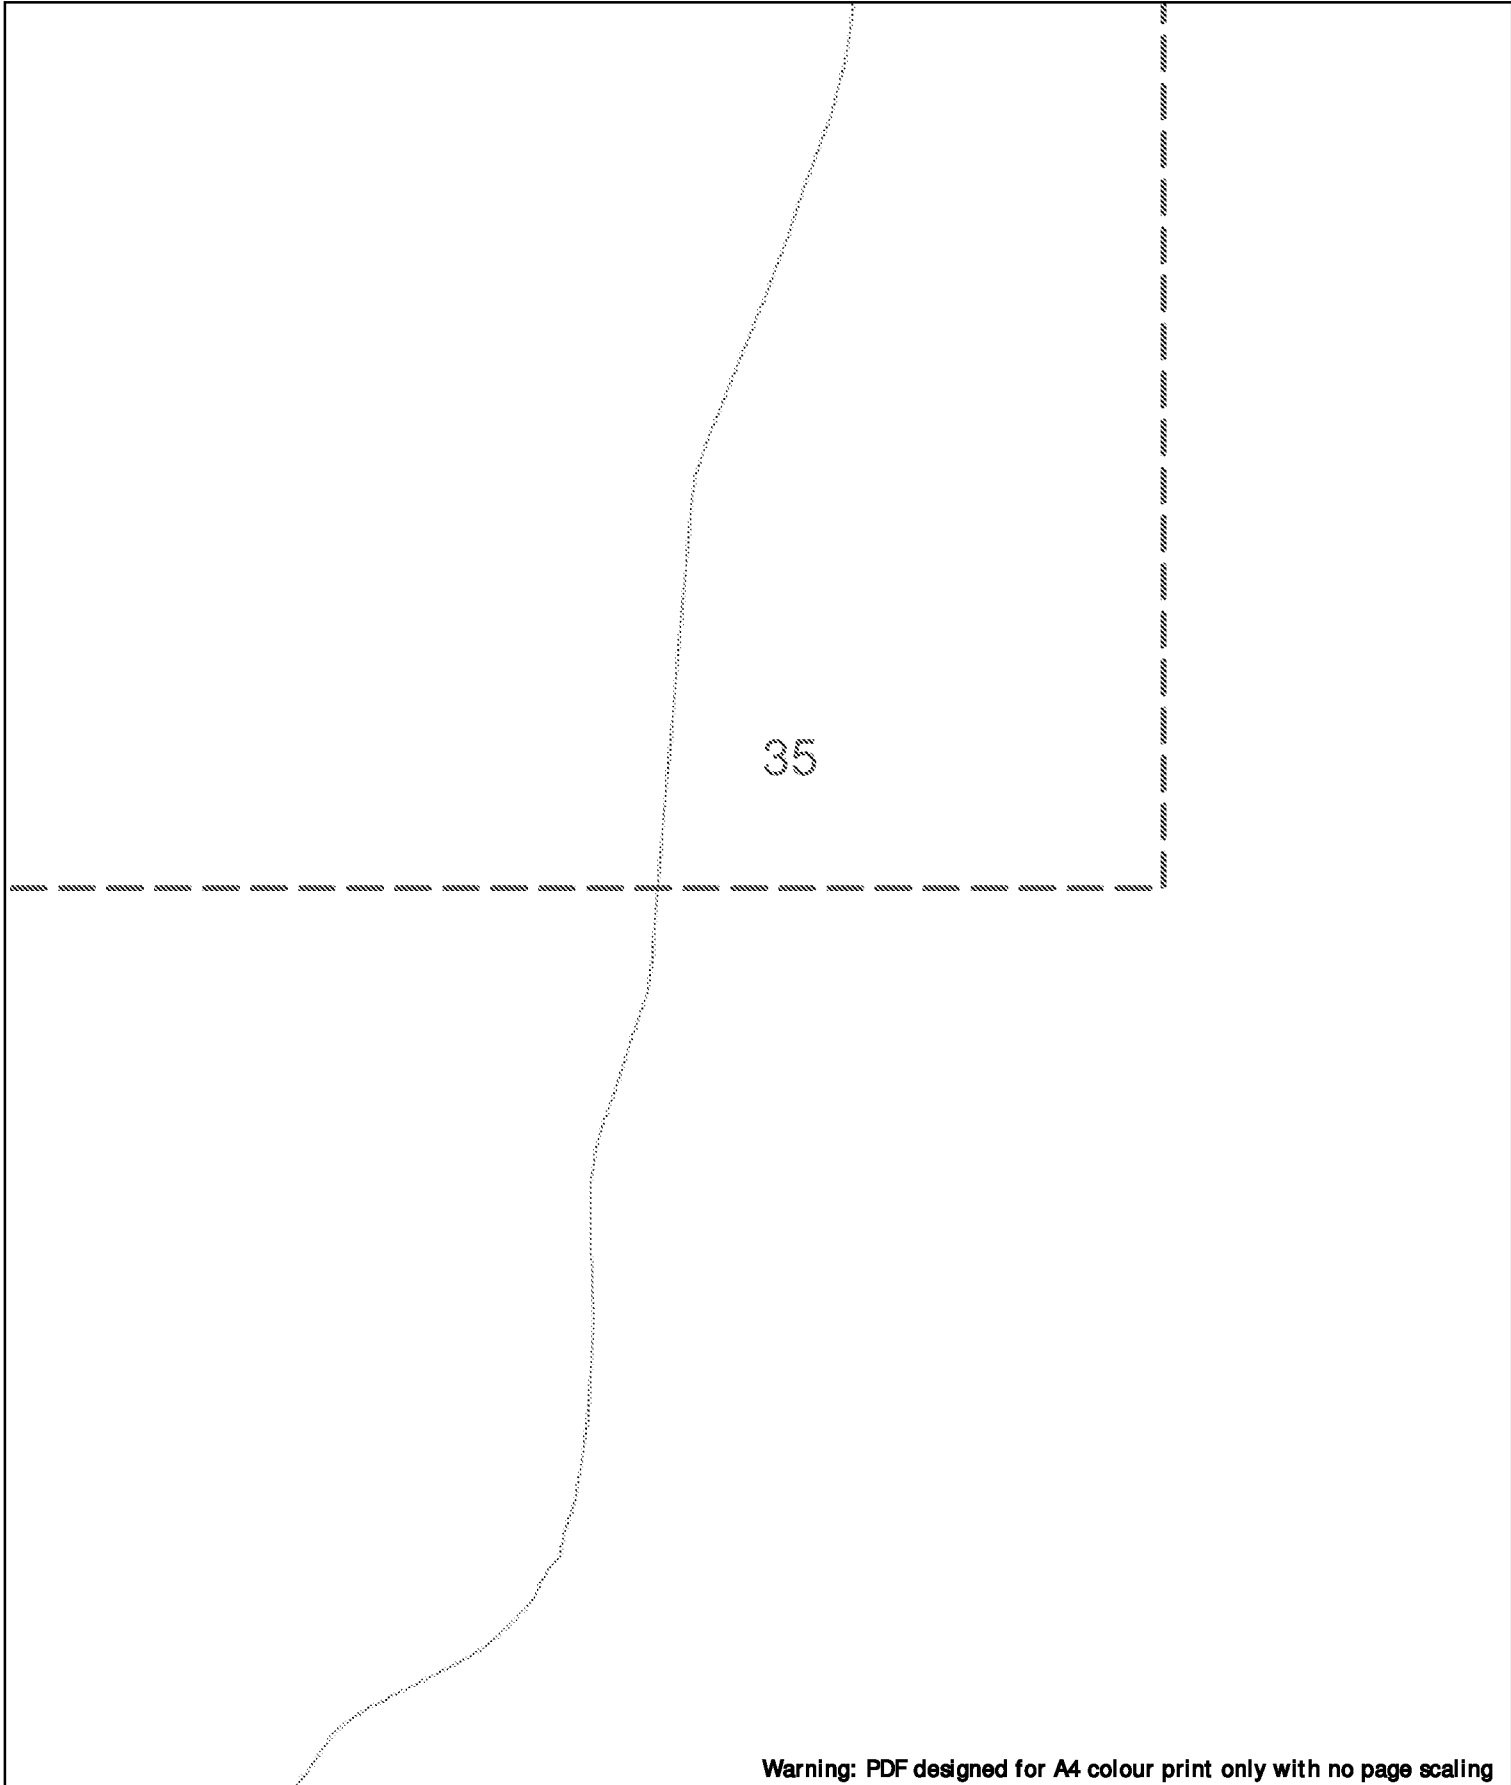

Warning: PDF designed for A4 colour print only with no page scaling

0 20m Dig Sites Area: Line:

Date Requested: 23/ 11/ 2020
Job Reference: 20614304
Site Location: 494129 104180
Requested by: Ms Christina Elliott

Your Scheme/ Reference: LM
90619/ SBS

Scale: 1:500 (When plotted at A4)

Voltages (V)			
LV (Low Voltage) and Services	Up to 1,000V		
HV (High Voltage)	Over 1,000V to 11,000V		
EHV (Extra High Voltage)	22,000V to 132,000V		
Transmission	275,000V and 400,000V		
NORMAL DEPTH TO THE TOP OF THE CABLE WHEN LAID			
Services	LV	HV	EHV
Footpath/unmade	0.45m	0.45m	0.6m
Road Crossing	0.6m	0.6m	0.75m
Agricultural	1m	1m	1.1m

WARNING

From positions based on aerial photography or the satellite based, total water must be considered, to determine width and depth of water. It is not to be used for the design and safety of the structure. It is not to be used for the design and safety of the structure. It is not to be used for the design and safety of the structure.

Scottish and Southern Energy Power Distribution Ltd.
Registered Office: Inverlaimond House,
200 Dunkeld Road, Perth, PH1 3AQ
Registered In Scotland No. SC213459

If you're unsure & need to seek advice before commencing excavations, please contact:
General Enquiries: 0800 048 3516

Subject to revision – Master held by SSEN Asset Data Team:
AssetData@ssen.com
01256 337 294

BASED UPON THE ORDNANCE SURVEY MAP WITH THE SANCTION OF THE CONTROLLER OF HER MAJESTY'S STATIONERY OFFICE. CROWN COPYRIGHT RESERVED.

Not made by or with the authority of Scottish and Southern Energy Power Distribution Ltd. Pursuant to section 47 of the Copyright, Designs and Patents Act 1988 ("The Act"). Unless the Act provides a relevant exception to copyright the copy must not be copied without prior permission of the copyright owner.

Plans generated by DigSAFE Pro™ software provided by Linsearchbedford.org.



Warning: PDF designed for A4 colour print only with no page scaling

0 20m

Dig Sites Area: Line:

Date Requested: 23/ 11/ 2020
 Job Reference: 20614304
 Site Location: 494129 104180
 Requested by: Ms Christina Elliott
 Your Scheme/ Reference: LM
 90619/ SBS

Voltages (V)			
Services	LV	HV	EHV
Footpath/unmade	0.45m	0.45m	0.6m
Road Crossing	0.6m	0.6m	0.75m
Agricultural	1m	1m	1.1m

Legend

Up to 1,000V Over 1,000V to 11,000V 22,000V to 132,000V 275,000V and 400,000V	Normal Depth to the Top of the Cable when Laid Services Footpath/unmade Road Crossing Agricultural
---	---

Scottish and Southern Energy Power Distribution Ltd.
 Registered Office: Inverlorn House,
 200 Dunkeld Road, Perth, PH1 3AQ
 Registered in Scotland No. SC213459

If you're unsure & need to seek advice before commencing excavations, please contact:
 General Enquiries: 0800 048 3516

Subject to revision – Master held by SSEN Asset Data Team:
AssetData@sse.com
 01256 337 294



020m Dig Sites Area: Line:

Date Requested: 23/ 11/ 2020

Job Reference: 20614304

Site Location: 494129 104180

Requested by: Ms Christina Elliott

Your Scheme/ Reference: LM 90619/ SBS

Scale: 1:500 (When plotted at A4)

Voltages (V)

LV (Low Voltage) and Services Up to 1,000V

HV (High Voltage) Over 1,000V to 11,000V

EHV (Extra High Voltage) 22,000V to 132,000V

Transmission 275,000V and 400,000V

NORMAL DEPTH TO THE TOP OF THE CABLE WHEN LAID

Services LV HV EHV

Footpath/unmade 0.45m 0.45m 0.6m 0.8m

Road Crossing 0.6m 0.6m 0.75m 0.9m

Agricultural 1m 1m 1m 1.1m

Legend

1000V

2000V

3000V

4000V

500V

600V

700V

800V

900V

1000V

1100V

1200V

1300V

1400V

1500V

1600V

1700V

1800V

1900V

2000V

2100V

2200V

2300V

2400V

2500V

2600V

2700V

2800V

2900V

3000V

3100V

3200V

3300V

3400V

3500V

3600V

3700V

3800V

3900V

4000V

4100V

4200V

4300V

4400V

4500V

4600V

4700V

4800V

4900V

5000V

5100V

5200V

5300V

5400V

5500V

5600V

5700V

5800V

5900V

6000V

6100V

6200V

6300V

6400V

6500V

6600V

6700V

6800V

6900V

7000V

7100V

7200V

7300V

7400V

7500V

7600V

7700V

7800V

7900V

8000V

8100V

8200V

8300V

8400V

8500V

8600V

8700V

8800V

8900V

9000V

9100V

9200V

9300V

9400V

9500V

9600V

9700V

9800V

9900V

10000V

10100V

10200V

10300V

10400V

10500V

10600V

10700V

10800V

10900V

11000V

11100V

11200V

11300V

11400V

11500V

11600V

11700V

11800V

11900V

12000V

12100V

12200V

12300V

12400V

12500V

12600V

12700V

12800V

12900V

13000V

13100V

13200V

13300V

13400V

13500V

13600V

13700V

13800V

13900V

14000V

14100V

14200V

14300V

14400V

14500V

14600V

14700V

14800V

14900V

15000V

15100V

15200V

15300V

15400V

15500V

15600V

15700V

15800V

15900V

16000V

16100V

16200V

16300V

16400V

16500V

16600V

16700V

16800V

16900V

17000V

17100V

17200V

17300V

17400V

17500V

17600V

17700V

17800V

17900V

18000V

18100V

18200V

18300V

18400V

18500V

18600V

18700V

18800V

18900V

19000V

19100V

19200V

19300V

19400V

19500V

19600V

19700V

19800V

19900V

20000V

20100V

20200V

20300V

20400V

20500V

20600V

20700V

20800V

20900V

21000V

21100V

21200V

21300V

21400V

21500V

21600V

21700V

21800V

21900V

22000V

22100V

22200V

22300V

22400V

22500V

22600V

22700V

22800V

22900V

23000V

23100V

23200V

23300V

23400V

23500V

23600V

23700V

23800V

23900V

24000V

24100V

24200V

24300V

24400V

24500V

24600V

24700V

24800V

24900V

25000V

25100V

25200V

25300V

25400V

25500V

25600V

25700V

25800V

25900V

26000V

26100V

26200V

26300V

26400V

26500V

26600V

26700V

26800V

26900V

27000V

27100V

27200V

27300V

27400V

27500V

27600V

27700V

27800V

27900V

28000V

28100V

28200V

28300V

28400V

28500V

28600V

28700V

28800V

28900V

29000V

29100V

29200V

29300V

29400V

29500V

29600V

29700V

29800V

29900V

30000V

30100V

30200V

30300V

30400V

30500V

30600V

30700V

30800V

30900V

31000V

31100V

31200V

31300V

31400V

31500V

31600V

31700V

31800V

31900V

32000V

32100V

32200V

32300V

32400V

32500V

32600V

32700V

32800V

32900V

33000V

33100V

33200V

33300V

33400V

33500V

33600V

33700V

33800V

33900V

34000V

34100V

34200V

34300V

34400V

34500V

34600V

34700V

34800V

34900V

35000V

35100V

35200V

35300V

35400V

35500V

35600V

35700V

35800V

35900V

36000V

36100V

36200V

36300V

36400V

36500V

36600V

36700V

36800V

36900V

37000V

37100V

37200V

37300V

37400V

37500V

37600V

37700V

37800V

37900V

38000V

38100V

38200V

38300V

38400V

38500V

38600V

38700V

38800V

38900V

39000V

39100V

39200V

39300V

39400V

39500V

39600V

39700V

39800V

39900V

40000V

40100V

40200V

40300V

40400V

40500V

40600V

40700V

40800V

40900V

41000V

41100V

41200V

41300V

41400V

41500V

41600V

41700V

41800V

41900V

42000V

42100V

42200V

42300V

42400V

42500V

42600V

42700V

42800V

42900V

43000V

43100V

43200V

43300V

43400V

43500V

43600V

43700V

43800V

43900V

44000V

44100V

44200V

44300V

44400V

44500V

44600V

44700V

44800V

44900V

45000V

45100V

45200V

45300V

45400V

45500V

45600V

45700V

45800V

45900V

46000V

46100V

46200V

46300V

46400V

46500V

46600V

46700V

46800V

46900V

47000V

47100V

47200V

47300V

47400V

47500V

47600V

47700V

47800V

47900V

48000V

48100V

48200V

48300V

48400V

48500V

48600V

48700V

48800V

48900V

49000V

49100V

49200V

49300V

49400V

49500V

49600V

49700V

49800V

49900V

50000V

50100V

50200V

50300V

50400V

50500V

50600V

50700V

50800V

50900V

51000V

51100V

51200V

51300V

51400V

51500V

51600V

51700V

51800V

51900V

52000V

52100V

52200V

52300V

52400V

52500V

52600V

52700V

52800V

52900V

53000V

53100V

53200V

53300V

53400V

53500V

53600V

53700V

53800V

53900V

54000V

54100V

54200V

54300V

54400V

54500V

54600V

54700V

54800V

54900V

55000V

55100V

55200V

55300V

55400V

55500V

55600V

55700V

55800V

55900V

56000V

56100V

56200V

56300V

56400V

56500V

56600V

56700V

56800V

56900V

57000V

57100V

57200V

57300V

57400V

57500V

57600V

57700V

57800V

57900V

58000V

58100V

58200V

58300V

58400V

58500V

58600V

58700V

58800V

58900V

59000V

59100V

59200V

59300V

59400V

59500V

59600V

59700V

59800V

59900V

60000V

60100V

60200V

60300V

60400V

60500V

60600V

60700V

60800V

60900V

61000V

61100V

61200V

61300V

61400V

61500V

61600V

61700V

61800V

61900V

62000V

62100V

62200V

62300V

62400V

62500V

62600V

62700V

62800V

62900V

63000V

63100V

63200V

63300V

63400V

63500V

63600V

63700V

63800V

63900V

64000V

64100V

64200V

64300V

64400V

64500V

64600V

64700V

64800V

64900V

65000V

65100V

65200V

65300V

65400V

65500V

65600V

65700V

65800V

65900V

66000V

66100V

66200V

66300V

66400V

66500V

66600V

66700V

66800V

66900V

67000V

67100V

67200V

67300V

67400V

67500V

67600V

67700V

67800V

67900V

68000V

68100V

68200V

68300V

68400V

68500V

68600V

68700V

68800V

68900V

69000V

69100V

69200V

69300V

69400V

69500V

69600V

69700V

69800V

69900V

70000V

70100V

70200V

70300V

70400V

70500V

70600V

70700V

70800V

70900V

71000V

71100V

71200V

71300V

71400V

71500V

71600V

71700V

71800V

71900V

72000V

72100V

72200V

72300V

72400V

72500V

72600V

72700V

72800V

72900V

73000V

73100V

73200V

73300V

73400V

73500V

73600V

73700V

73800V

73900V

74000V

74100V

74200V

74300V

74400V

74500V

74600V

74700V

74800V

74900V

75000V

75100V

75200V

75300V

75400V

75500V

75600V

75700V

75800V

75900V

76000V

76100V

76200V

76300V

76400V

76500V

76600V

76700V

76800V

76900V

77000V

77100V

77200V

77300V

77400V

77500V

77600V

77700V

77800V

77900V

78000V

78100V

78200V

78300V

78400V

78500V

78600V

78700V

78800V

78900V

79000V

79100V

79200V

79300V

79400V

79500V

79600V

79700V

79800V

79900V

80000V

80100V

80200V

80300V

80400V

80500V

80600V

80700V

80800V

80900V

81000V

81100V

81200V

81300V

81400V

81500V

81600V

81700V

81800V

81900V

82000V

82100V

82200V

82300V

82400V

82500V

82600V

82700V

82800V

82900V

83000V

83100V

83200V

83300V

83400V

83500V

83600V

83700V

83800V

83900V

84000V

84100V

84200V

84300V

84400V

84500V

84600V

84700V

84800V

84900V

85000V

85100V

85200V

85300V

85400V

85500V

85600V

85700V

85800V

85900V

86000V

86100V

86200V

86300V

86400V

86500V

86600V

86700V

86800V

86900V

87000V

87100V

87200V

87300V

87400V

87500V

87600V

87700V

87800V

87900V

88000V

88100V

88200V

88300V

88400V

88500V

88600V

88700V

88800V

88900V

89000V

89100V

89200V

89300V

89400V

89500V

89600V

89700V

89800V

89900V

90000V

90100V

90200V

90300V

90400V

90500V

90600V

90700V

90800V

90900V

91000V

91100V

91200V

91300V

91400V

91500V

91600V

91700V

91800V

91900V

92000V

92100V

92200V

92300V

92400V

92500V

92600V

92700V

92800V

92900V

93000V

93100V

93200V

93300V

93400V

93500V

93600V

93700V

93800V

93900V

94000V

94100V

94200V

94300V

94400V

94500V

94600V

94700V

94800V

94900V

95000V

95100V

95200V

95300V

95400V

95500V

95600V

95700V

95800V

95900V

96000V

96100V

96200V

96300V

96400V

96500V

96600V

96700V

96800V

96900V

97000V

97100V

97200V

97300V

97400V

97500V

97600V

97700V

97800V

97900V

98000V

98100V

98200V

98300V

98400V

98500V

98600V

98700V

98800V

98900V

99000V

99100V

99200V

99300V

99400V

99500V

99600V

99700V

99800V

99900V

100000V

Warning

From positions based on aerial photography, the station level, cable route, and depth of cable, may vary from the actual and safety conditions. Avoiding danger from the cables - should be considered before commencing excavation work.

When excavating, the depth of the cable should be checked by using a cable locator or by using a cable locator.

Warning

From positions based on aerial photography, the station level, cable route, and depth of cable, may vary from the actual and safety conditions. Avoiding danger from the cables - should be considered before commencing excavation work.

When excavating, the depth of the cable should be checked by using a cable locator or by using a cable locator.


Scottish and Southern Energy Power Distribution Ltd.

Registered Office: Inverlamb House,
200 Dunkeld Road, Perth, PH1 3AQ
Registered in Scotland No. SC213459

If you're unsure & need to seek advice before commencing excavations, please contact:
General Enquiries: 0800 048 3516

Subject to revision - Master held by SSEN Asset Data Team:
asset.data@sse.com
01256 337 294

ARUN DISTRICT COUNCIL AL107921/PL

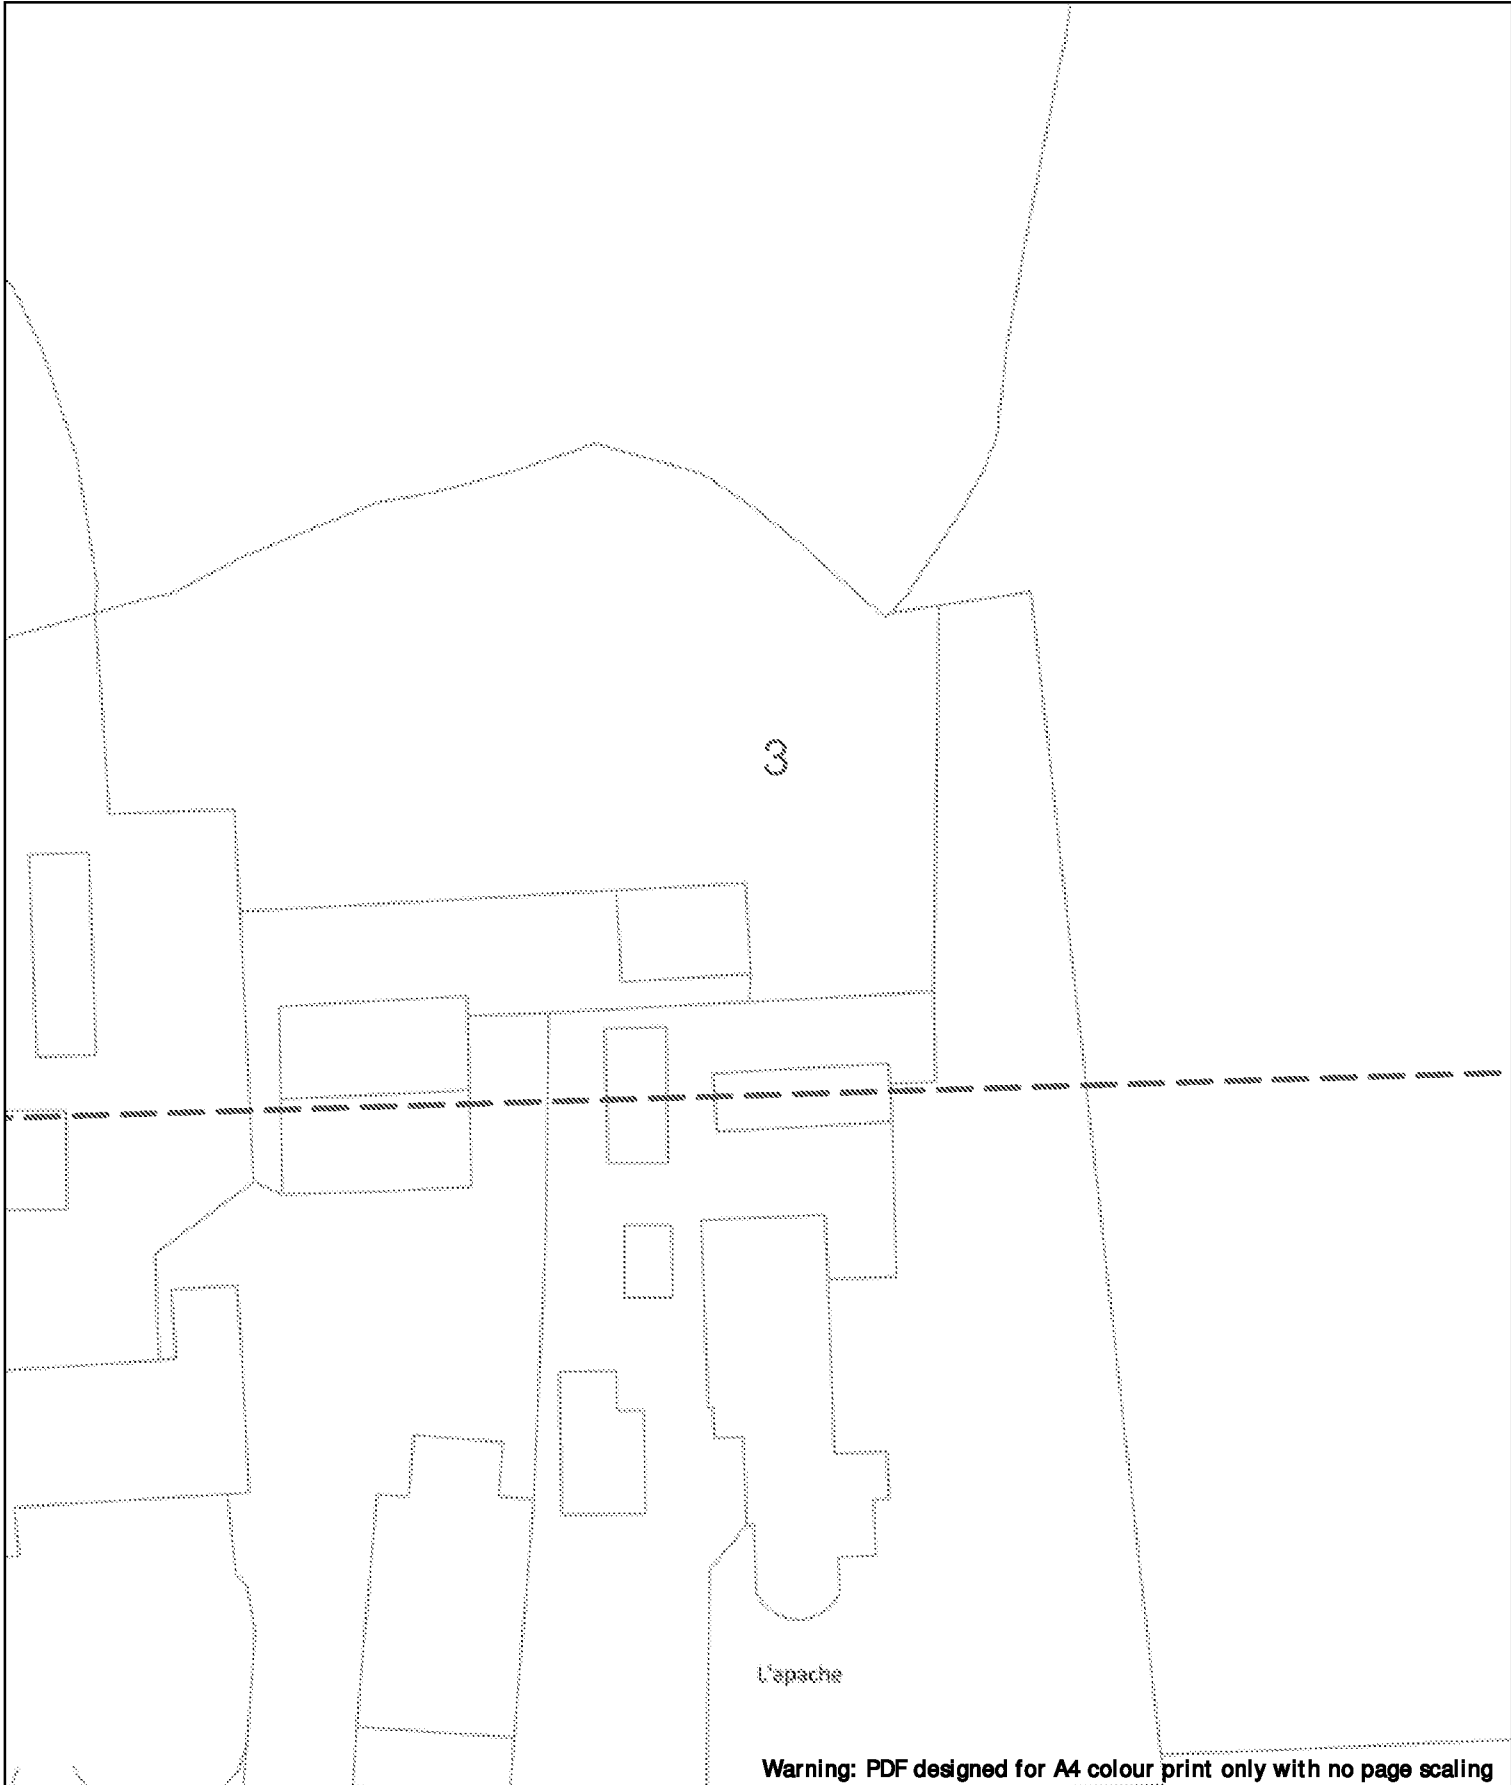

Warning: PDF designed for A4 colour print only with no page scaling

020m Dig Sites Area: Line:

Date Requested: 23/ 11/ 2020

Job Reference: 20614304

Site Location: 494129 104180

Requested by: Ms Christina Elliott

Your Scheme/ Reference: LM 90619/ SBS

Scale: 1:500 (When plotted at A4)

Voltages (V)

LV (Low Voltage) and Services Up to 1,000V

HV (High Voltage) Over 1,000V to 11,000V

EHV (Extra High Voltage) 22,000V to 132,000V

Transmission 275,000V and 400,000V

NORMAL DEPTH TO THE TOP OF THE CABLE WHEN LAID

Services LV HV EHV

Footpath/unmade 0.45m 0.45m 0.6m 0.8m

Road Crossing 0.6m 0.6m 0.75m 0.9m

Agricultural 1m 1m 1m 1.1m

WARNING

From positions based on aerial photography in the station level, cable routes must be determined, to determine earth and depth of cable, 45m (150 feet) from the road and safety barriers - avoiding danger from the cables - should be considered before commencing excavation work.

WHICH MAY BE USED FOR THE PURPOSES OF CONDUCTING THE WORK SHOULD BE USED TO DETERMINE THE DEPTH OF THE CABLES.

Legend

Station/Transformer/Box

Line

Two Point

Three Point

Scottish and Southern Energy Power Distribution Ltd.

Registered Office: Inverlaid House, 200 Dunkeld Road, Perth, PH1 3AQ. Registered In Scotland No. SC213459

If you're unsure & need to seek advice before commencing excavations, please contact: General Enquiries: 0800 048 3516

Subject to revision – Master held by SSEN Asset Data Team: Asset Data@ssen.com 01256 337 294



ARUN DISTRICT COUNCIL AL10721/PL

made by or with the authority of Scottish and Southern Energy Power Distribution Ltd. Pursuant to section 47 of the Copyright, Designs and Patents Act 1988 ("The Act"). Unless the Act provides a relevant exception to copyright the copy must not be copied without prior permission of the copyright owner.

Plans generated by DigSAFE Pro™ software provided by Linsearchbedford.co.uk.



Warning: PDF designed for A4 colour print only with no page scaling


0  20m Dig Sites Area:  Line: 

Date Requested: 23/ 11/ 2020
Job Reference: 20614304
Site Location: 494129 104180
Requested by: Ms Christina Elliott

Your Scheme/ Reference: LM
90619/ SBS

Scale: 1:500 (When plotted at A4)

Voltages (V)				
LV (Low Voltage) and Services	Up to 1,000V			
HV (High Voltage)	Over 1,000V to 11,000V			
EHV (Extra High Voltage)	22,000V to 132,000V			
Transmission	275,000V and 400,000V			
NORMAL DEPTH TO THE TOP OF THE CABLE WHEN LAID				
	Services	LV	HV	EHV
Footpath/unmade	0.45m	0.45m	0.6m	0.8m
Road Crossing	0.6m	0.6m	0.75m	0.9m
Agricultural	1m	1m	1m	1.1m

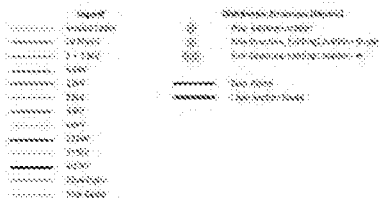

WARNING

From excavations below water-pipe level (i.e. the surface level), the water must be drawn down, to a suitable level, and depth of water must be noted from the depth and safety certificates. Avoiding danger from the water pipes - should be considered before commencing excavation work.


BASED UPON THE ORDNANCE SURVEY MAP WITH THE SANCTION OF THE CONTROLLER OF HER MAJESTY'S STATIONERY OFFICE. CROWN COPYRIGHT RESERVED.
Plans generated by DigSAFE Pro™ software provided by Linsearchbedford.org.



Scottish and Southern Energy Power Distribution Ltd.
Registered Office: Inverlamb House,
200 Dunkeld Road, Perth, PH1 3AQ
Registered In Scotland No. SC213459

If you're unsure & need to seek advice before commencing excavations, please contact:
General Enquiries: 0800 048 3516

Subject to revision – Master held by SEN Asset Data Team:
Asset.Data@sen.com
01256 337 294

[illegible]

Subject to revision – Master held by SSEN Asset Data Team:
Asset.Data@sse.com
 01256 337 294

[illegible]

6

Warning: PDF designed for A4 colour print only with no page scaling

0 20m Dig Sites Area: Line:

Date Requested: 23/ 11/ 2020
 Job Reference: 20614304
 Site Location: 494129 104180
 Requested by: Ms Christina Elliott

Your Scheme/ Reference: LM
 90619/ SBS

Scale: 1:500 (When plotted at A4)

Voltages (V)			
LV (Low Voltage) and Services	Up to 1,000V		
HV (High Voltage)	Over 1,000V to 11,000V		
EHV (Extra High Voltage)	22,000V to 132,000V		
Transmission	275,000V and 400,000V		
NORMAL DEPTH TO THE TOP OF THE CABLE WHEN LAID			
Services	LV	HV	EHV
Footpath/Unmade	0.45m	0.45m	0.6m
Road Crossing	0.6m	0.6m	0.75m
Agricultural	1m	1m	1.1m

Symbol	Description
	LV (Low Voltage) and Services
	HV (High Voltage)
	EHV (Extra High Voltage)
	Transmission
	Footpath/unmade
	Road Crossing
	Agricultural

WARNING

From positions based on aerial photography, the station level, tide level must be determined, to determine accurate and depth of water. It is the responsibility of the user to ensure that the depth of water is sufficient for the proposed work. The user should be aware that the depth of water may vary due to tides and weather conditions. The user should be aware that the depth of water may vary due to tides and weather conditions.

BASED UPON THE ORDNANCE SURVEY MAP WITH THE SANCTION OF THE CONTROLLER OF HER MAJESTY'S STATIONERY OFFICE. CROWN COPYRIGHT RESERVED.
 Plans generated by DigSAFE Pro™ software provided by Linesearchuk Limited.



Scottish and Southern Energy Power Distribution Ltd.
 Registered Office: Inverlaid House,
 200 Dunkeld Road, Perth, PH1 3AQ
 Registered In Scotland No. SC213459

If you're unsure & need to seek advice before commencing excavations, please contact:
 General Enquiries: 0800 048 3516

Subject to revision – Master held by SSEN Asset Data Team:
Asset.Data@sse.com
 01256 337 294

Warning: PDF designed for A4 colour print only with no page scaling

0 20m Dig Sites Area: Line:

Date Requested: 23/ 11/ 2020
 Job Reference: 20614304
 Site Location: 494129 104180
 Requested by: Ms Christina Elliott
 Your Scheme/ Reference: LM
 90619/ SBS

Voltages (V)				
LV (Low Voltage) and Services	Up to 1,000V			
HV (High Voltage)	Over 1,000V to 11,000V			
EHV (Extra High Voltage)	22,000V to 132,000V			
Transmission	275,000V and 400,000V			
NORMAL DEPTH TO THE TOP OF THE CABLE WHEN LAID				
	Services	LV	HV	EHV
Footpath/Unmade	0.45m	0.45m	0.6m	0.8m
Road Crossing	0.6m	0.6m	0.75m	0.9m
Agricultural	1m	1m	1m	1.1m

WARNING

From excavations below water-levels or below the surface level, the water must be drawn down, to a suitable level and depth of at least 450mm from the health and safety level. Excavations deeper than these depths - should be considered before commencing excavation work.

WHEN WORKING ON THE VOLTAGE OF CABLES AND LINES, THE WORKER MUST BE AWARE OF THE RISK OF ELECTRIC SHOCK AND MUST WEAR APPROPRIATE PROTECTIVE EQUIPMENT.

BASED UPON THE ORDNANCE SURVEY MAP WITH THE SANCTION OF THE CONTROLLER OF HER MAJESTY'S STATIONERY OFFICE. CROWN COPYRIGHT RESERVED.




Scottish and Southern Energy Power Distribution Ltd.
 Registered Office: Inverlaid House,
 200 Dunkeld Road, Perth, PH1 3AQ
 Registered In Scotland No. SC213459

If you're unsure & need to seek advice before commencing excavations, please contact:
 General Enquiries: 0800 048 3516


Subject to revision – Master held by SSEN Asset Data Team:

Asset.Data@sse.com
 01256 337 294

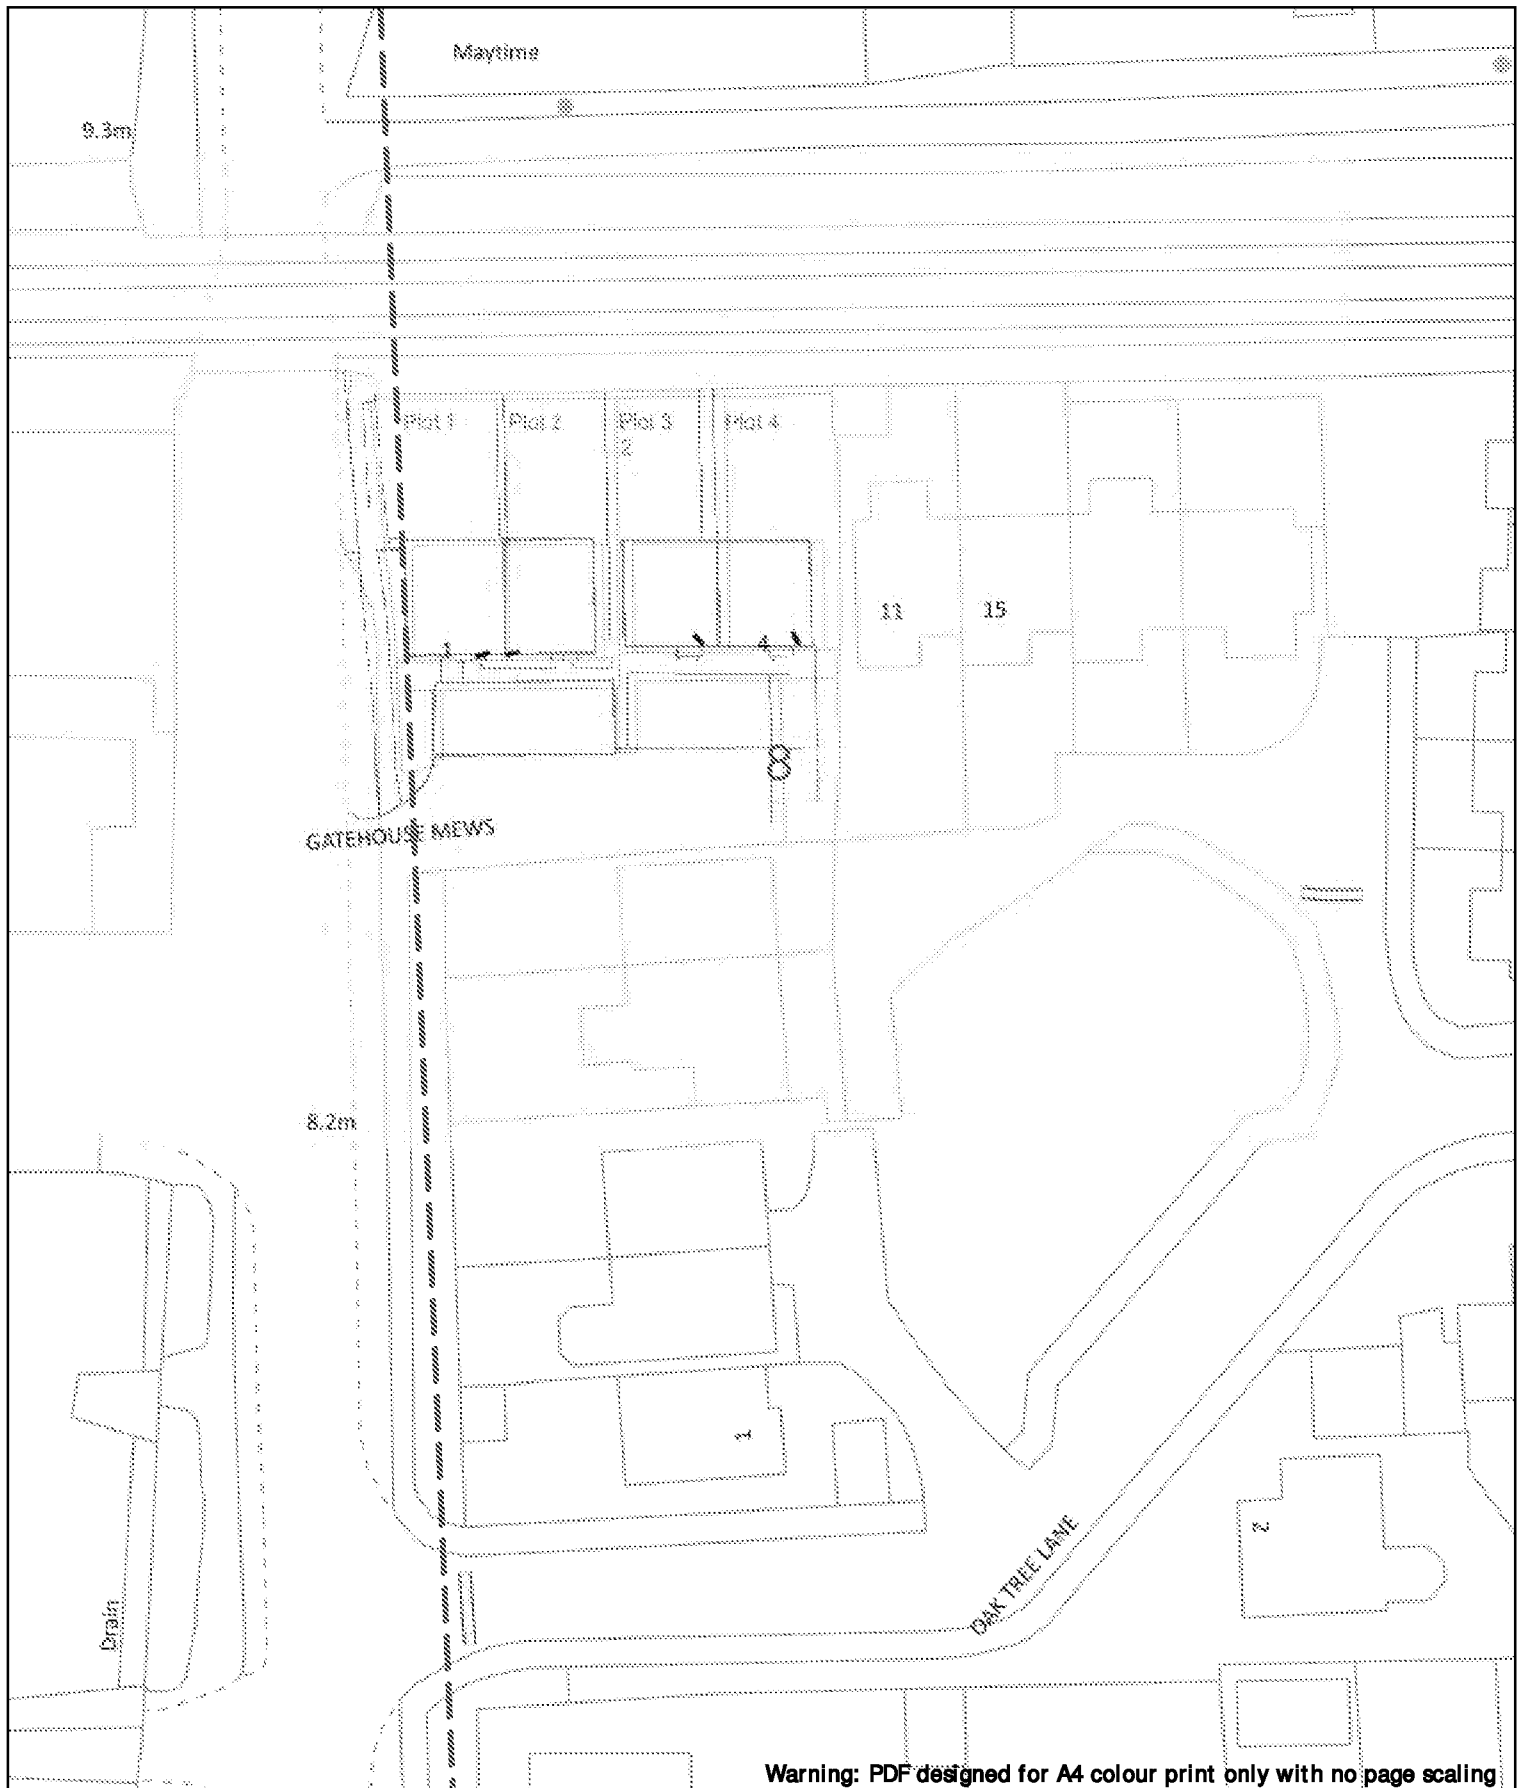

Warning: PDF designed for A4 colour print only with no page scaling

0 20m Dig Sites Area: Line:																			
Date Requested: 23/ 11/ 2020 Job Reference: 20614304 Site Location: 494129 104180 Requested by: Ms Christina Elliott		Scottish and Southern Energy Power Distribution Ltd. Registered Office: Inverlamb House, 200 Dunkeld Road, Perth, PH1 3AQ Registered In Scotland No. SC213459																	
Your Scheme/ Reference: LM 90619/ SBS		If you're unsure & need to seek advice before commencing excavations, please contact: General Enquiries: 0800 048 3516																	
Scale: 1:500 (When plotted at A4)		Subject to revision – Master held by SSEN Asset Data Team: Asset.Data@sse.com 01256 337 294																	
Voltages (V) <table border="1"> <thead> <tr> <th>Services</th> <th>LV</th> <th>HV</th> <th>EHV</th> </tr> </thead> <tbody> <tr> <td>Footpath/unmade</td> <td>0.45m</td> <td>0.45m</td> <td>0.8m</td> </tr> <tr> <td>Road Crossing</td> <td>0.6m</td> <td>0.6m</td> <td>0.75m</td> </tr> <tr> <td>Agricultural</td> <td>1m</td> <td>1m</td> <td>1.1m</td> </tr> </tbody> </table> NORMAL DEPTH TO THE TOP OF THE CABLE WHEN LAID From any other base water-pipe or other in the surface level, the water must be at least 1.5m above the top of the cable. For 47 kV and above, the water must be at least 1.5m above the top of the cable. For 110 kV and above, the water must be at least 1.5m above the top of the cable. For 220 kV and above, the water must be at least 1.5m above the top of the cable. For 400 kV and above, the water must be at least 1.5m above the top of the cable. WARNING: This drawing is a technical drawing and should be used as a guide only. It is not a contract. The contractor is responsible for checking the accuracy of the information provided and for ensuring that the work is carried out in accordance with the relevant standards and regulations.				Services	LV	HV	EHV	Footpath/unmade	0.45m	0.45m	0.8m	Road Crossing	0.6m	0.6m	0.75m	Agricultural	1m	1m	1.1m
Services	LV	HV	EHV																
Footpath/unmade	0.45m	0.45m	0.8m																
Road Crossing	0.6m	0.6m	0.75m																
Agricultural	1m	1m	1.1m																

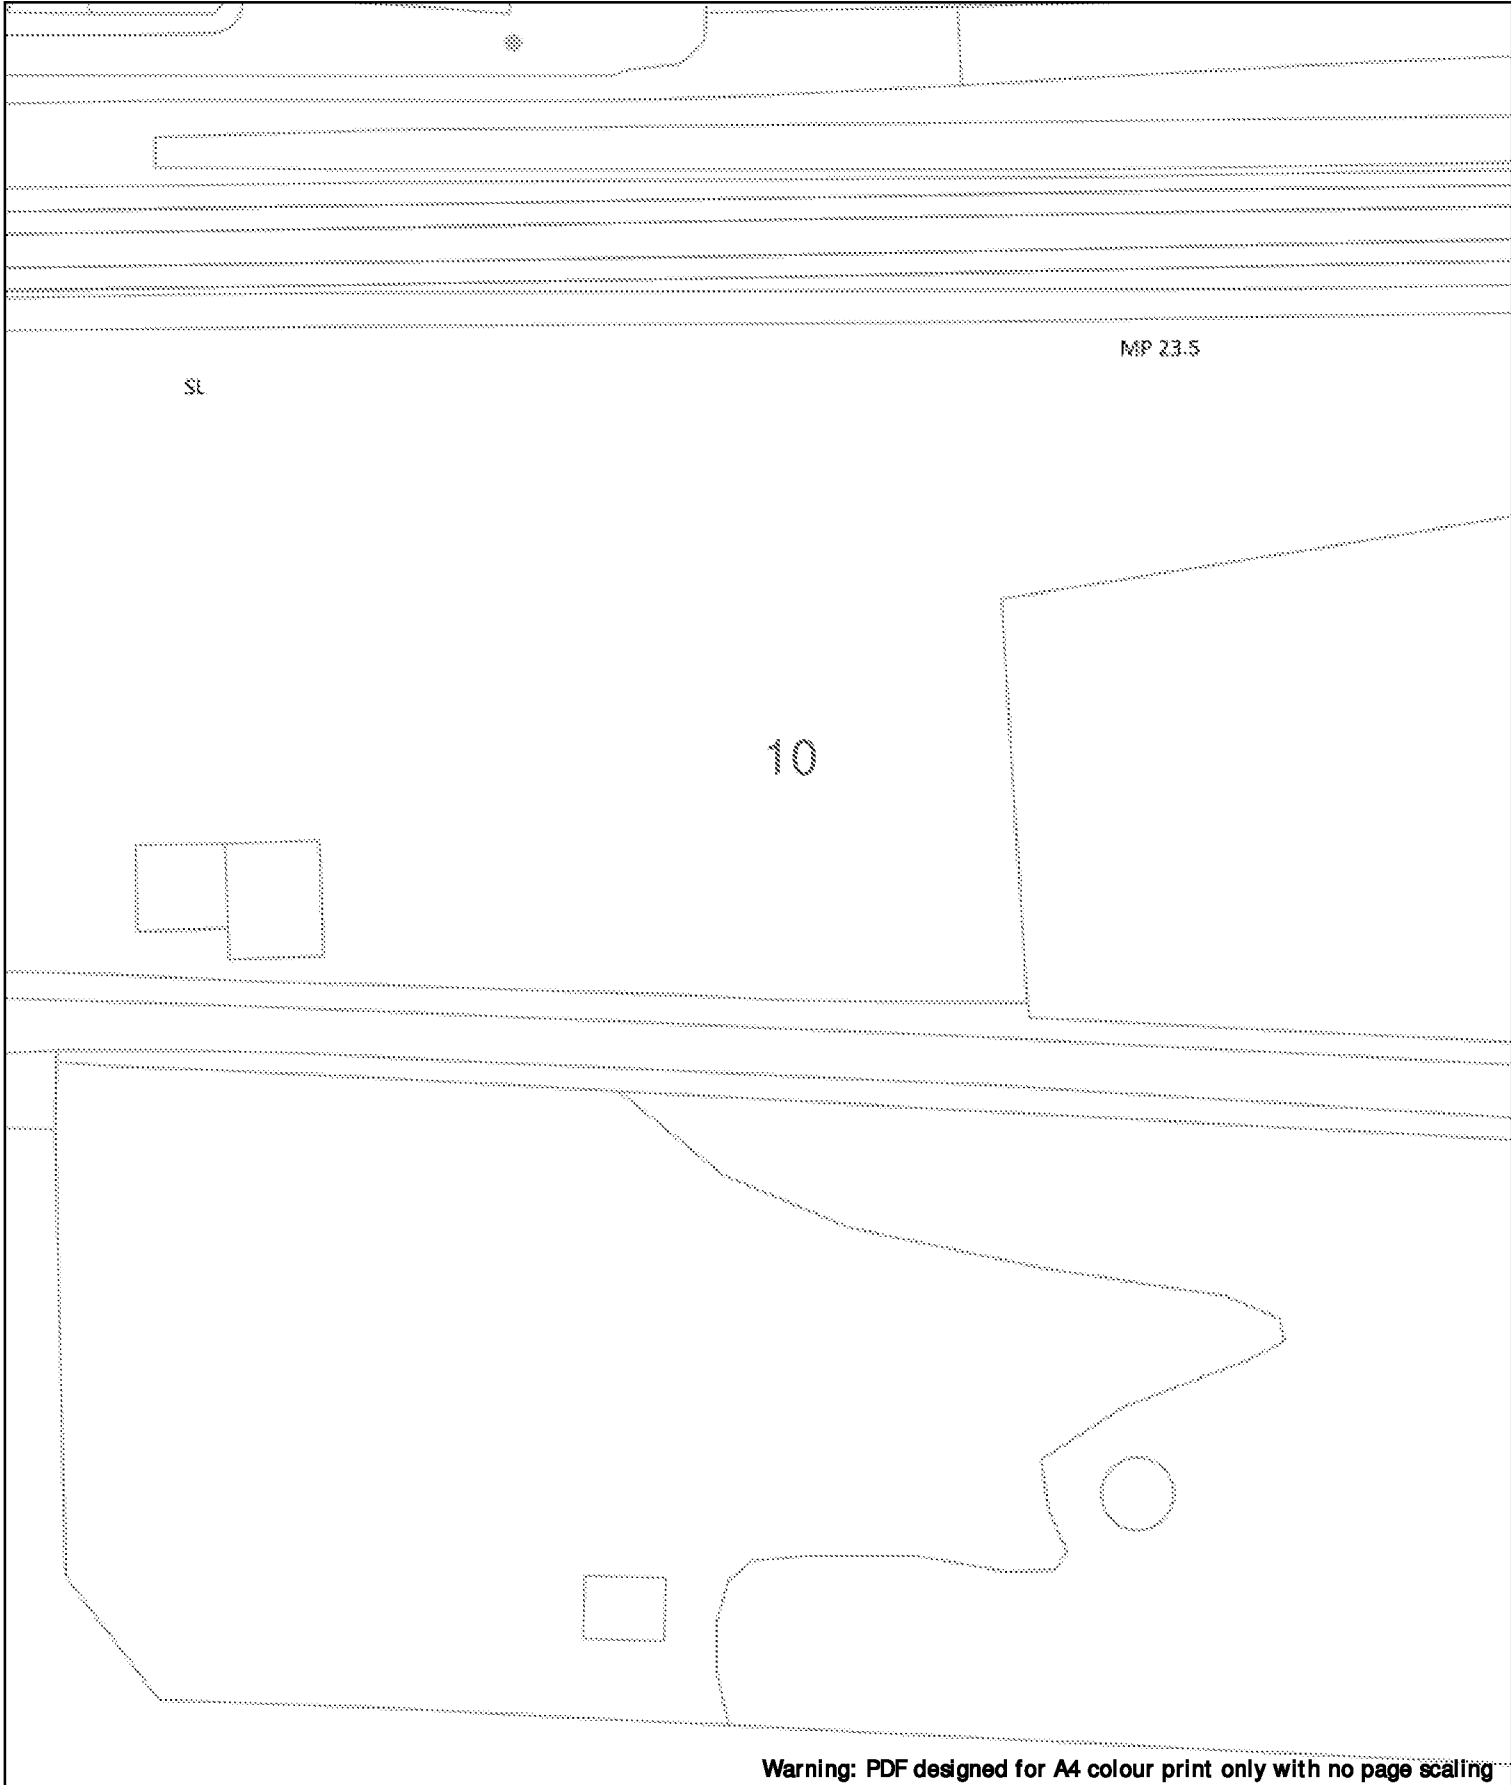

Warning: PDF designed for A4 colour print only with no page scaling

020m Dig Sites

Area: Line:

Date Requested: 23/ 11/ 2020

Job Reference: 20614304

Site Location: 494129 104180

Requested by: Ms Christina Elliott

Your Scheme/ Reference: LM 90619/ SBS

Scale: 1:500 (When plotted at A4)

Voltages (V)			
LV (Low Voltage) and Services	Up to 1,000V		
HV (High Voltage)	Over 1,000V to 11,000V		
EHV (Extra High Voltage)	22,000V to 132,000V		
Transmission	275,000V and 400,000V		
NORMAL DEPTH TO THE TOP OF THE CABLE WHEN LAID			
Services	LV	HV	EHV
Footpath/unmade	0.45m	0.45m	0.6m
Road Crossing	0.6m	0.6m	0.75m
Agricultural	1m	1m	1.1m

WARNING

From inspection based on visual inspection in the surface level, the water must be considered, to be present, and depth of water is not known from the health and safety certificate. Avoiding danger from the water must be considered before commencing excavation work.

WHICH MAY BE USED FOR THE PURPOSES OF CONDUCTING THE SURVEY AND THE SURVEYOR MUST BE AWARE OF THE DANGER OF COLLAPSE OF THE SURFACE.

Scottish and Southern Energy Power Distribution Ltd.



Registered Office: Inverlaimond House,
200 Dunkeld Road, Perth, PH1 3AQ
Registered In Scotland No. SC213459

If you're unsure & need to seek advice before commencing excavations, please contact:
General Enquiries: 0800 048 3516

Subject to revision – Master held by SSEN Asset Data Team:
Asset.Data@sse.com
01256 337 294

ARUN DISTRICT COUNCIL AL107921/PL10 made by or with the authority of Scottish and Southern Energy Power Distribution Ltd. Pursuant to section 47 of the Copyright, Designs and Patents Act 1988 ("The Act"). Unless the Act provides a relevant exception to copyright the copy must not be copied without prior permission of the copyright owner. Plans generated by DigSAFE Pro™ software provided by Linesearchuk Limited.

Warning: PDF designed for A4 colour print only with no page scaling


0  20m Dig Sites Area:  Line: 

Date Requested: 23/ 11/ 2020
 Job Reference: 20614304
 Site Location: 494129 104180
 Requested by: Ms Christina Elliott

Your Scheme/ Reference: LM
 90619/ SBS

Scale: 1:500 (When plotted at A4)

Voltages (V)			
LV (Low Voltage) and Services	Up to 1,000V		
HV (High Voltage)	Over 1,000V to 11,000V		
EHV (Extra High Voltage)	22,000V to 132,000V		
Transmission	275,000V and 400,000V		
NORMAL DEPTH TO THE TOP OF THE CABLE WHEN LAID			
Services	LV	HV	EHV
Footpath/Unmade	0.45m	0.45m	0.6m
Road Crossing	0.6m	0.6m	0.75m
Agricultural	1m	1m	1.1m

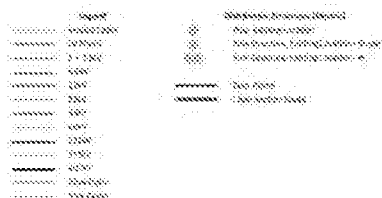


WARNING

From positions based on aerial photography, the station level, tide level must be determined, to determine accurate and depths of cables. All cables are shown from the north and safety direction. Avoiding danger from the cables - should be considered before commencing excavation work.

WHICH MAY BE USED FOR THE PURPOSES OF CONDUCTING WORKS SHOULD BE DIRECTLY SUPERVISED BY A PERSON WHO IS QUALIFIED TO DO SO.

BASED UPON THE ORDNANCE SURVEY MAP WITH THE SANCTION OF THE CONTROLLER OF HER MAJESTY'S STATIONERY OFFICE. CROWN COPYRIGHT RESERVED.



Scottish and Southern Energy Power Distribution Ltd.
 Registered Office: Inverlamb House,
 200 Dunkeld Road, Perth, PH1 3AQ
 Registered In Scotland No. SC213459

If you're unsure & need to seek advice before commencing excavations, please contact:
 General Enquiries: 0800 048 3516

Subject to revision – Master held by SSEN Asset Data Team:

Asset.Data@sse.com
 01256 337 294

Warning: PDF designed for A4 colour print only with no page scaling


0 20m Dig Sites Area: Line:

Date Requested: 23/ 11/ 2020
 Job Reference: 20614304
 Site Location: 494129 104180
 Requested by: Ms Christina Elliott

Your Scheme/ Reference: LM
 90619/ SBS

Scale: 1:500 (When plotted at A4)

Voltages (V)				
LV (Low Voltage) and Services	Up to 1,000V			
HV (High Voltage)	Over 1,000V to 11,000V			
EHV (Extra High Voltage)	22,000V to 132,000V			
Transmission	275,000V and 400,000V			
NORMAL DEPTH TO THE TOP OF THE CABLE WHEN LAID				
	Services	LV	HV	EHV
Footpath/Unmade	0.45m	0.45m	0.6m	0.8m
Road Crossing	0.6m	0.6m	0.75m	0.9m
Agricultural	1m	1m	1m	1.1m

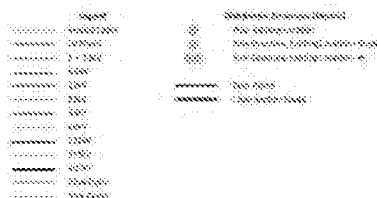


WARNING

From excavations below water-levels or below the surface level, the water must be drawn out, to the extent necessary, and depth of water must be noted from the health and safety authorities. Avoiding danger from the water must be considered before commencing excavation work.

WHICH MAY BE USED FOR THE PURPOSES OF THE ACT, AND WHICH MAY BE USED FOR THE PURPOSES OF THE ACT, AND WHICH MAY BE USED FOR THE PURPOSES OF THE ACT.


BASED UPON THE ORDNANCE SURVEY MAP WITH THE SANCTION OF THE CONTROLLER OF HER MAJESTY'S STATIONERY OFFICE. CROWN COPYRIGHT RESERVED.



Scottish and Southern Energy Power Distribution Ltd.
 Registered Office: Inverlaimond House,
 200 Dunkeld Road, Perth, PH1 3AQ
 Registered in Scotland No. SC213459

If you're unsure & need to seek advice before commencing excavations, please contact:
 General Enquiries: 0800 048 3516

Subject to revision – Master held by SSEN Asset Data Team:
Asset.Data@sse.com
 01256 337 294

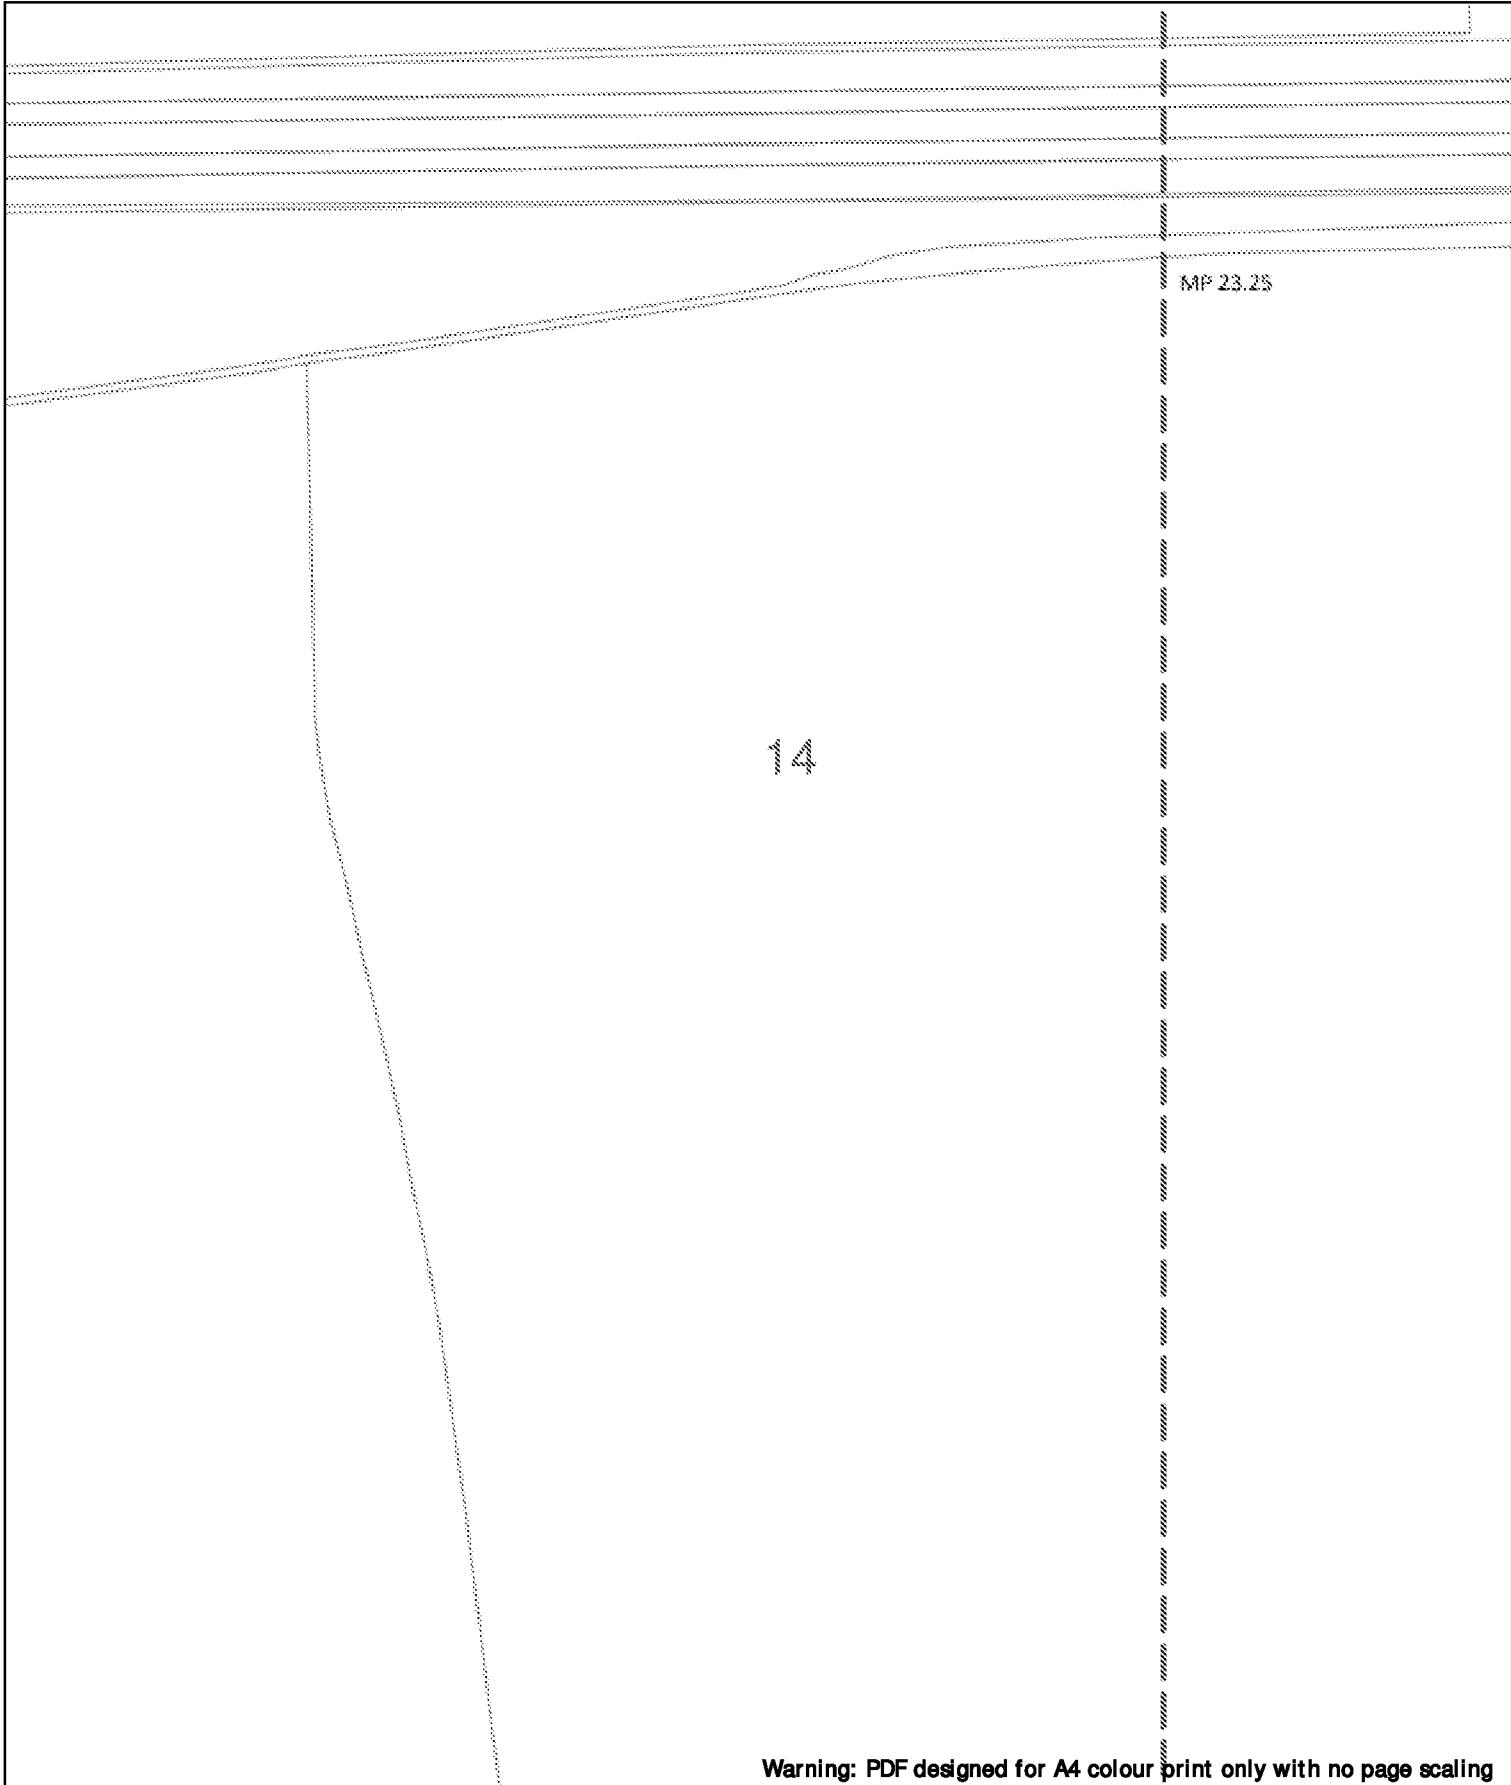

Warning: PDF designed for A4 colour print only with no page scaling

020m Dig Sites Area: Line:

Date Requested: 23/ 11/ 2020

Job Reference: 20614304

Site Location: 494129 104180

Requested by: Ms Christina Elliott

Your Scheme/ Reference: LM 90619/ SBS

Scale: 1:500 (When plotted at A4)

Voltages (V)			
LV (Low Voltage) and Services	Up to 1,000V		
HV (High Voltage)	Over 1,000V to 11,000V		
EHV (Extra High Voltage)	22,000V to 132,000V		
Transmission	275,000V and 400,000V		
NORMAL DEPTH TO THE TOP OF THE CABLE WHEN LAID			
Services	LV	HV	EHV
Footpath/unmade	0.45m	0.45m	0.6m
Road Crossing	0.6m	0.6m	0.75m
Agricultural	1m	1m	1.1m

WARNING

From inspection of the above ground situation in the station level, the route must be determined, to the extent, width and depth of the station, as shown from the sketch and safety certificate. Avoiding danger from the cables - should be considered before commencing excavation work.

WHICH MAY BE USED FOR THE PURPOSES OF CONDUIT AND CABLES, AND SHOULD BE USED TO PROTECT THE CABLES FROM DAMAGE TO THE CABLES.

Scottish and Southern Energy Power Distribution Ltd.

Registered Office: Inverlaid House,
200 Dunkeld Road, Perth, PH1 3AQ
Registered In Scotland No. SC213459

If you're unsure & need to seek advice before commencing excavations, please contact:
General Enquiries: 0800 048 3516


Subject to revision – Master held by SSEN Asset Data Team:
Asset.Data@sse.com
01256 337 294

ARUN DISTRICT COUNCIL AL10721/PL

BASED UPON THE ORDNANCE SURVEY MAP WITH THE SANCTION OF THE CONTROLLER OF HER MAJESTY'S STATIONERY OFFICE. CROWN COPYRIGHT RESERVED.

Not made by or with the authority of Scottish and Southern Energy Power Distribution Ltd. Pursuant to section 47 of the Copyright, Designs and Patents Act 1988 ("The Act"). Unless the Act provides a relevant exception to copyright the copy must not be copied without the permission of the copyright owner.

Plans generated by DigSAFE Pro™ software provided by Linsearchbedford.org.

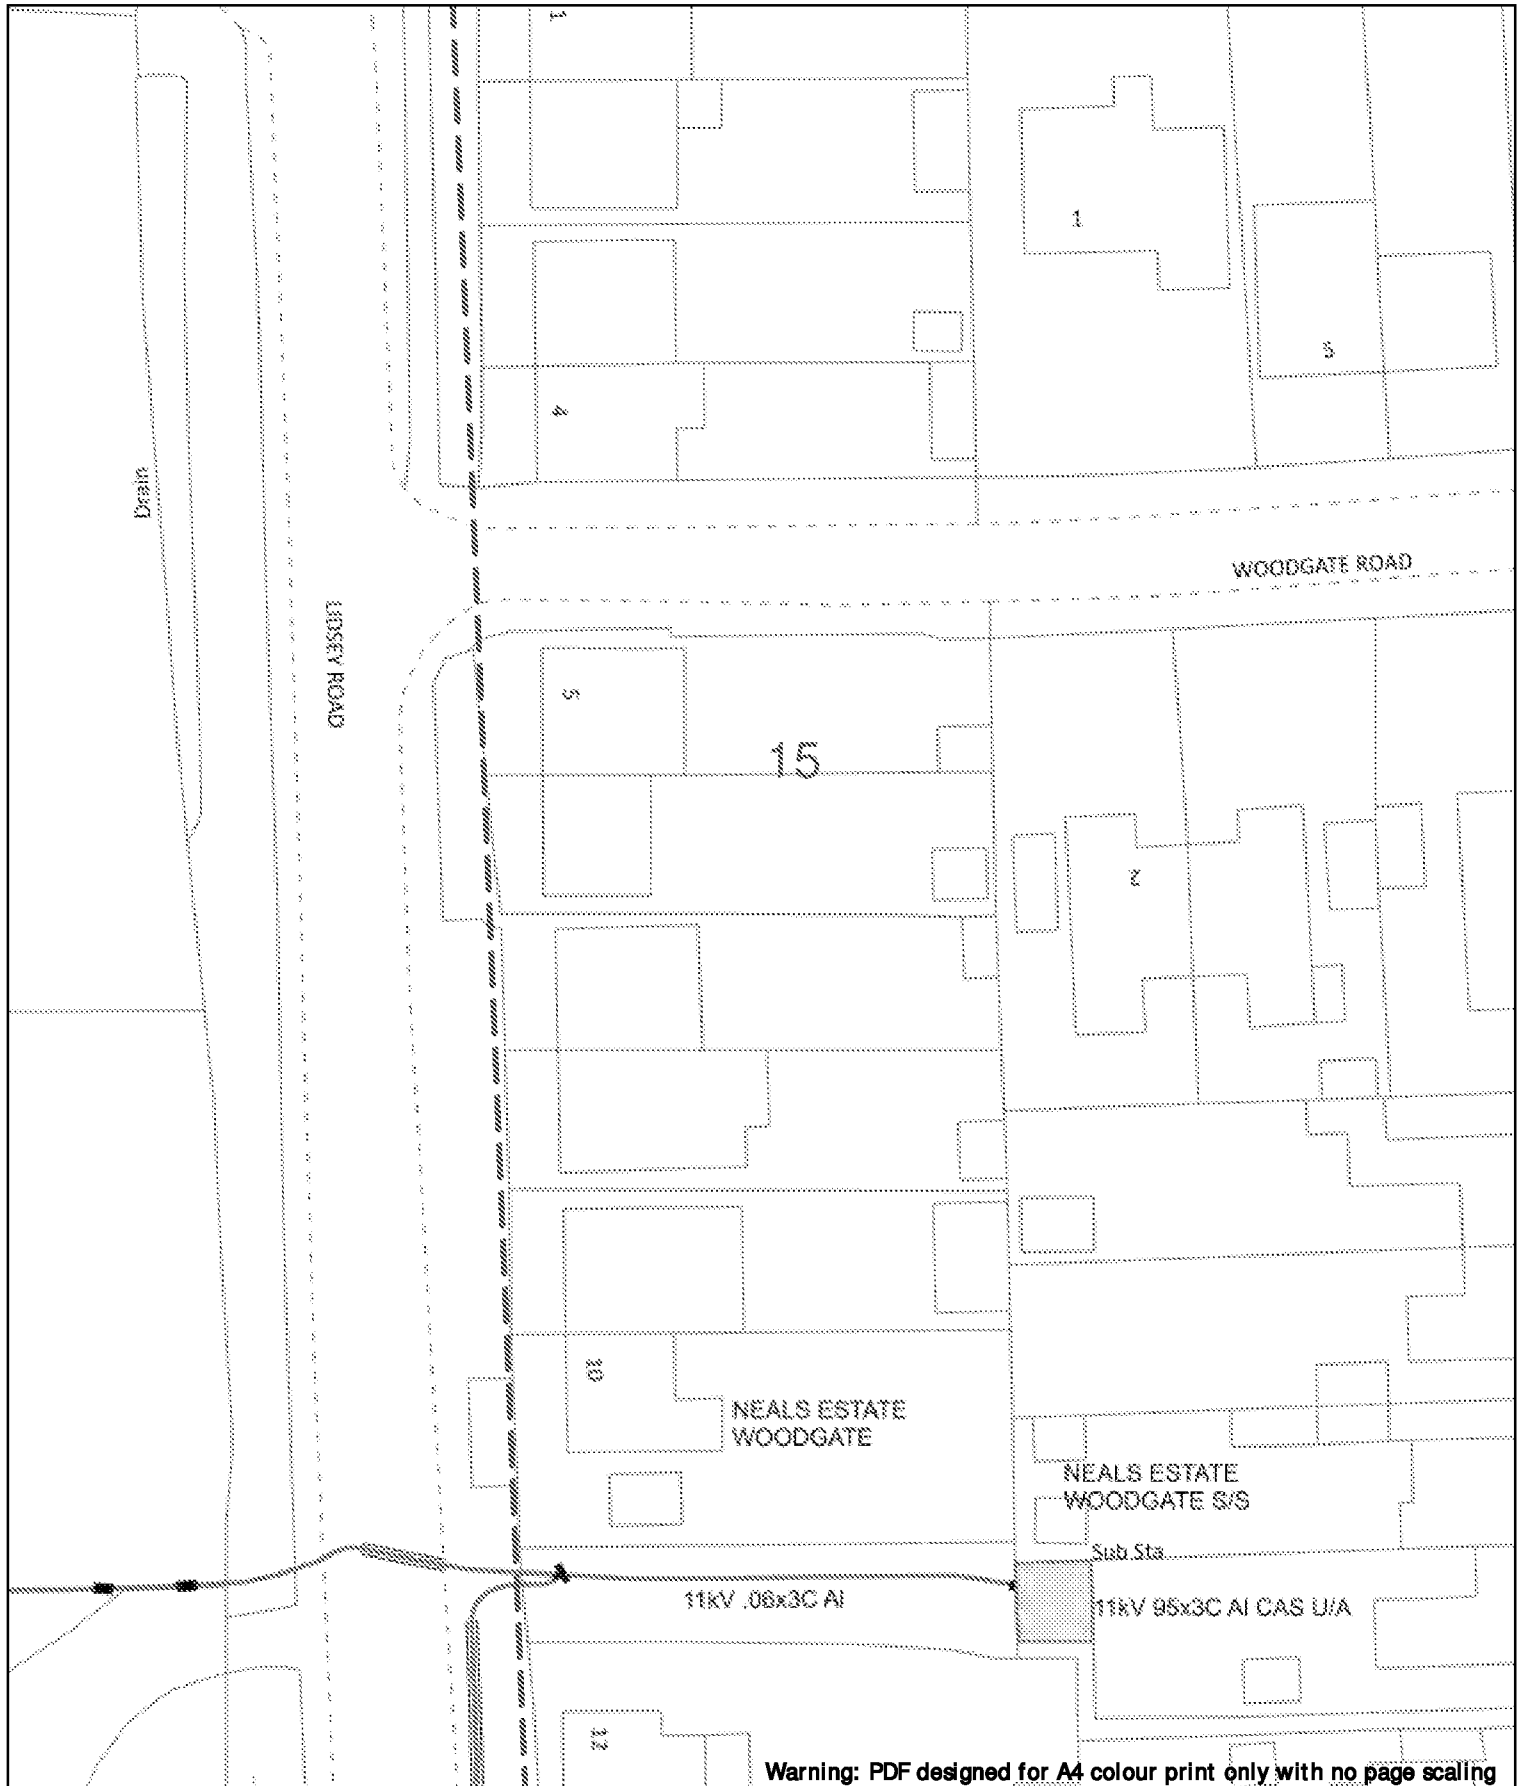

Warning: PDF designed for A4 colour print only with no page scaling

0 20m Dig Sites Area: Line:		Scottish & Southern Energy Networks																	
Date Requested: 23/ 11/ 2020 Job Reference: 20614304 Site Location: 494129 104180 Requested by: Ms Christina Elliott		Scottish and Southern Energy Power Distribution Ltd. Registered Office: Inverlaimond House, 200 Dunkeld Road, Perth, PH1 3AQ Registered in Scotland No. SC213459																	
Your Scheme/ Reference: LM 90619/ SBS		If you're unsure & need to seek advice before commencing excavations, please contact: General Enquiries: 0800 048 3516																	
Scale: 1:500 (When plotted at A4)		Subject to revision – Master held by SSEN Asset Data Team: Asset Data@ssen.com 01256 337 294																	
Voltages (V) LV (Low Voltage) and Services Up to 1,000V HV (High Voltage) Over 1,000V to 11,000V EHV (Extra High Voltage) 22,000V to 132,000V Transmission 275,000V and 400,000V NORMAL DEPTH TO THE TOP OF THE CABLE WHEN LAID <table border="1"> <thead> <tr> <th>Services</th> <th>LV</th> <th>HV</th> <th>EHV</th> </tr> </thead> <tbody> <tr> <td>Footpath/unmade</td> <td>0.45m</td> <td>0.45m</td> <td>0.8m</td> </tr> <tr> <td>Road Crossing</td> <td>0.6m</td> <td>0.6m</td> <td>0.75m</td> </tr> <tr> <td>Agricultural</td> <td>1m</td> <td>1m</td> <td>1.1m</td> </tr> </tbody> </table>		Services	LV	HV	EHV	Footpath/unmade	0.45m	0.45m	0.8m	Road Crossing	0.6m	0.6m	0.75m	Agricultural	1m	1m	1.1m	WARNING From any time these voltage potential differences in the surface level, cable must be unearthed, to be visible, earthed and depth of cable 45m (15) 47m (15) 49m (15) 51m (15) 53m (15) 55m (15) 57m (15) 59m (15) 61m (15) 63m (15) 65m (15) 67m (15) 69m (15) 71m (15) 73m (15) 75m (15) 77m (15) 79m (15) 81m (15) 83m (15) 85m (15) 87m (15) 89m (15) 91m (15) 93m (15) 95m (15) 97m (15) 99m (15) 101m (15) 103m (15) 105m (15) 107m (15) 109m (15) 111m (15) 113m (15) 115m (15) 117m (15) 119m (15) 121m (15) 123m (15) 125m (15) 127m (15) 129m (15) 131m (15) 133m (15) 135m (15) 137m (15) 139m (15) 141m (15) 143m (15) 145m (15) 147m (15) 149m (15) 151m (15) 153m (15) 155m (15) 157m (15) 159m (15) 161m (15) 163m (15) 165m (15) 167m (15) 169m (15) 171m (15) 173m (15) 175m (15) 177m (15) 179m (15) 181m (15) 183m (15) 185m (15) 187m (15) 189m (15) 191m (15) 193m (15) 195m (15) 197m (15) 199m (15) 201m (15) 203m (15) 205m (15) 207m (15) 209m (15) 211m (15) 213m (15) 215m (15) 217m (15) 219m (15) 221m (15) 223m (15) 225m (15) 227m (15) 229m (15) 231m (15) 233m (15) 235m (15) 237m (15) 239m (15) 241m (15) 243m (15) 245m (15) 247m (15) 249m (15) 251m (15) 253m (15) 255m (15) 257m (15) 259m (15) 261m (15) 263m (15) 265m (15) 267m (15) 269m (15) 271m (15) 273m (15) 275m (15) 277m (15) 279m (15) 281m (15) 283m (15) 285m (15) 287m (15) 289m (15) 291m (15) 293m (15) 295m (15) 297m (15) 299m (15) 301m (15) 303m (15) 305m (15) 307m (15) 309m (15) 311m (15) 313m (15) 315m (15) 317m (15) 319m (15) 321m (15) 323m (15) 325m (15) 327m (15) 329m (15) 331m (15) 333m (15) 335m (15) 337m (15) 339m (15) 341m (15) 343m (15) 345m (15) 347m (15) 349m (15) 351m (15) 353m (15) 355m (15) 357m (15) 359m (15) 361m (15) 363m (15) 365m (15) 367m (15) 369m (15) 371m (15) 373m (15) 375m (15) 377m (15) 379m (15) 381m (15) 383m (15) 385m (15) 387m (15) 389m (15) 391m (15) 393m (15) 395m (15) 397m (15) 399m (15) 401m (15) 403m (15) 405m (15) 407m (15) 409m (15) 411m (15) 413m (15) 415m (15) 417m (15) 419m (15) 421m (15) 423m (15) 425m (15) 427m (15) 429m (15) 431m (15) 433m (15) 435m (15) 437m (15) 439m (15) 441m (15) 443m (15) 445m (15) 447m (15) 449m (15) 451m (15) 453m (15) 455m (15) 457m (15) 459m (15) 461m (15) 463m (15) 465m (15) 467m (15) 469m (15) 471m (15) 473m (15) 475m (15) 477m (15) 479m (15) 481m (15) 483m (15) 485m (15) 487m (15) 489m (15) 491m (15) 493m (15) 495m (15) 497m (15) 499m (15) 501m (15) 503m (15) 505m (15) 507m (15) 509m (15) 511m (15) 513m (15) 515m (15) 517m (15) 519m (15) 521m (15) 523m (15) 525m (15) 527m (15) 529m (15) 531m (15) 533m (15) 535m (15) 537m (15) 539m (15) 541m (15) 543m (15) 545m (15) 547m (15) 549m (15) 551m (15) 553m (15) 555m (15) 557m (15) 559m (15) 561m (15) 563m (15) 565m (15) 567m (15) 569m (15) 571m (15) 573m (15) 575m (15) 577m (15) 579m (15) 581m (15) 583m (15) 585m (15) 587m (15) 589m (15) 591m (15) 593m (15) 595m (15) 597m (15) 599m (15) 601m (15) 603m (15) 605m (15) 607m (15) 609m (15) 611m (15) 613m (15) 615m (15) 617m (15) 619m (15) 621m (15) 623m (15) 625m (15) 627m (15) 629m (15) 631m (15) 633m (15) 635m (15) 637m (15) 639m (15) 641m (15) 643m (15) 645m (15) 647m (15) 649m (15) 651m (15) 653m (15) 655m (15) 657m (15) 659m (15) 661m (15) 663m (15) 665m (15) 667m (15) 669m (15) 671m (15) 673m (15) 675m (15) 677m (15) 679m (15) 681m (15) 683m (15) 685m (15) 687m (15) 689m (15) 691m (15) 693m (15) 695m (15) 697m (15) 699m (15) 701m (15) 703m (15) 705m (15) 707m (15) 709m (15) 711m (15) 713m (15) 715m (15) 717m (15) 719m (15) 721m (15) 723m (15) 725m (15) 727m (15) 729m (15) 731m (15) 733m (15) 735m (15) 737m (15) 739m (15) 741m (15) 743m (15) 745m (15) 747m (15) 749m (15) 751m (15) 753m (15) 755m (15) 757m (15) 759m (15) 761m (15) 763m (15) 765m (15) 767m (15) 769m (15) 771m (15) 773m (15) 775m (15) 777m (15) 779m (15) 781m (15) 783m (15) 785m (15) 787m (15) 789m (15) 791m (15) 793m (15) 795m (15) 797m (15) 799m (15) 801m (15) 803m (15) 805m (15) 807m (15) 809m (15) 811m (15) 813m (15) 815m (15) 817m (15) 819m (15) 821m (15) 823m (15) 825m (15) 827m (15) 829m (15) 831m (15) 833m (15) 835m (15) 837m (15) 839m (15) 841m (15) 843m (15) 845m (15) 847m (15) 849m (15) 851m (15) 853m (15) 855m (15) 857m (15) 859m (15) 861m (15) 863m (15) 865m (15) 867m (15) 869m (15) 871m (15) 873m (15) 875m (15) 877m (15) 879m (15) 881m (15) 883m (15) 885m (15) 887m (15) 889m (15) 891m (15) 893m (15) 895m (15) 897m (15) 899m (15) 901m (15) 903m (15) 905m (15) 907m (15) 909m (15) 911m (15) 913m (15) 915m (15) 917m (15) 919m (15) 921m (15) 923m (15) 925m (15) 927m (15) 929m (15) 931m (15) 933m (15) 935m (15) 937m (15) 939m (15) 941m (15) 943m (15) 945m (15) 947m (15) 949m (15) 951m (15) 953m (15) 955m (15) 957m (15) 959m (15) 961m (15) 963m (15) 965m (15) 967m (15) 969m (15) 971m (15) 973m (15) 975m (15) 977m (15) 979m (15) 981m (15) 983m (15) 985m (15) 987m (15) 989m (15) 991m (15) 993m (15) 995m (15) 997m (15) 999m (15) 1001m (15) 1003m (15) 1005m (15) 1007m (15) 1009m (15) 1011m (15) 1013m (15) 1015m (15) 1017m (15) 1019m (15) 1021m (15) 1023m (15) 1025m (15) 1027m (15) 1029m (15) 1031m (15) 1033m (15) 1035m (15) 1037m (15) 1039m (15) 1041m (15) 1043m (15) 1045m (15) 1047m (15) 1049m (15) 1051m (15) 1053m (15) 1055m (15) 1057m (15) 1059m (15) 1061m (15) 1063m (15) 1065m (15) 1067m (15) 1069m (15) 1071m (15) 1073m (15) 1075m (15) 1077m (15) 1079m (15) 1081m (15) 1083m (15) 1085m (15) 1087m (15) 1089m (15) 1091m (15) 1093m (15) 1095m (15) 1097m (15) 1099m (15) 1101m (15) 1103m (15) 1105m (15) 1107m (15) 1109m (15) 1111m (15) 1113m (15) 1115m (15) 1117m (15) 1119m (15) 1121m (15) 1123m (15) 1125m (15) 1127m (15) 1129m (15) 1131m (15) 1133m (15) 1135m (15) 1137m (15) 1139m (15) 1141m (15) 1143m (15) 1145m (15) 1147m (15) 1149m (15) 1151m (15) 1153m (15) 1155m (15) 1157m (15) 1159m (15) 1161m (15) 1163m (15) 1165m (15) 1167m (15) 1169m (15) 1171m (15) 1173m (15) 1175m (15) 1177m (15) 1179m (15) 1181m (15) 1183m (15) 1185m (15) 1187m (15) 1189m (15) 1191m (15) 1193m (15) 1195m (15) 1197m (15) 1199m (15) 1201m (15) 1203m (15) 1205m (15) 1207m (15) 1209m (15) 1211m (15) 1213m (15) 1215m (15) 1217m (15) 1219m (15) 1221m (15) 1223m (15) 1225m (15) 1227m (15) 1229m (15) 1231m (15) 1233m (15) 1235m (15) 1237m (15) 1239m (15) 1241m (15) 1243m (15) 1245m (15) 1247m (15) 1249m (15) 1251m (15) 1253m (15) 1255m (15) 1257m (15) 1259m (15) 1261m (15) 1263m (15) 1265m (15) 1267m (15) 1269m (15) 1271m (15) 1273m (15) 1275m (15) 1277m (15) 1279m (15) 1281m (15) 1283m (15) 1285m (15) 1287m (15) 1289m (15) 1291m (15) 1293m (15) 1295m (15) 1297m (15) 1299m (15) 1301m (15) 1303m (15) 1305m (15) 1307m (15) 1309m (15) 1311m (15) 1313m (15) 1315m (15) 1317m (15) 1319m (15) 1321m (15) 1323m (15) 1325m (15) 1327m (15) 1329m (15) 1331m (15) 1333m (15) 1335m (15) 1337m (15) 1339m (15) 1341m (15) 1343m (15) 1345m (15) 1347m (15) 1349m (15) 1351m (15) 1353m (15) 1355m (15) 1357m (15) 1359m (15) 1361m (15) 1363m (15) 1365m (15) 1367m (15) 1369m (15) 1371m (15) 1373m (15) 1375m (15) 1377m (15) 1379m (15) 1381m (15) 1383m (15) 1385m (15) 1387m (15) 1389m (15) 1391m (15) 1393m (15) 1395m (15) 1397m (15) 1399m (15) 1401m (15) 1403m (15) 1405m (15) 1407m (15) 1409m (15) 1411m (15) 1413m (15) 1415m (15) 1417m (15) 1419m (15) 1421m (15) 1423m (15) 1425m (15) 1427m (15) 1429m (15) 1431m (15) 1433m (15) 1435m (15) 1437m (15) 1439m (15) 1441m (15) 1443m (15) 1445m (15) 1447m (15) 1449m (15) 1451m (15) 1453m (15) 1455m (15) 1457m (15) 1459m (15) 1461m (15) 1463m (15) 1465m (15) 1467m (15) 1469m (15) 1471m (15) 1473m (15) 1475m (15) 1477m (15) 1479m (15) 1481m (15) 1483m (15) 1485m (15) 1487m (15) 1489m (15) 1491m (15) 1493m (15) 1495m (15) 1497m (15) 1499m (15) 1501m (15) 1503m (15) 1505m (15) 1507m (15) 1509m (15) 1511m (15) 1513m (15) 1515m (15) 1517m (15) 1519m (15) 1521m (15) 1523m (15) 1525m (15) 1527m (15) 1529m (15) 1531m (15) 1533m (15) 1535m (15) 1537m (15) 1539m (15) 1541m (15) 1543m (15) 1545m (15) 1547m (15) 1549m (15) 1551m (15) 1553m (15) 1555m (15) 1557m (15) 1559m (15) 1561m (15) 1563m (15) 1565m (15) 1567m (15) 1569m (15) 1571m (15) 1573m (15) 1575m (15) 1577m (15) 1579m (15) 1581m (15) 1583m (15) 1585m (15) 1587m (15) 1589m (15) 1591m (15) 1593m (15) 1595m (15) 1597m (15) 1599m (15) 1601m (15) 1603m (15) 1605m (15) 1607m (15) 1609m (15) 1611m (15) 1613m (15) 1615m (15) 1617m (15) 1619m (15) 1621m (15) 1623m (15) 1625m (15) 1627m (15) 1629m (15) 1631m (15) 1633m (15) 1635m (15) 1637m (15) 1639m (15) 1641m (15) 1643m (15) 1645m (15) 1647m (15) 1649m (15) 1651m (15) 1653m (15) 1655m (15) 1657m (15) 1659m (15) 1661m (15) 1663m (15) 1665m (15) 1667m (15) 1669m (15) 1671m (15) 1673m (15) 1675m (15) 1677m (15) 1679m (15) 1681m (15) 1683m (15) 1685m (15) 1687m (15) 1689m (15) 1691m (15) 1693m (15) 1695m (15) 1697m (15) 1699m (15) 1701m (15) 1703m (15) 1705m (15) 1707m (15) 1709m (15) 1711m (15) 1713m (15) 1715m (15) 1717m (15) 1719m (15) 1721m (15) 1723m (15) 1725m (15) 1727m (15) 1729m (15) 1731m (15) 1733m (15) 1735m (15) 1737m (15) 1739m (15) 1741m (15) 1743m (15) 1745m (15) 1747m (15) 1749m (15) 1751m (15) 1753m (15) 1755m (15) 1757m (15) 1759m (15) 1761m (15) 1763m (15) 1765m (15) 1767m (15) 1769m (15) 1771m (15) 1773m (15) 1775m (15) 1777m (15) 1779m (15) 1781m (15) 1783m (15) 1785m (15) 1787m (15) 1789m (15) 1791m (15) 1793m (15) 1795m (15) 1797m (15) 1799m (15) 1801m (15) 1803m (15) 1805m (15) 1807m (15) 1809m (15) 1811m (15) 1813m (15) 1815m (15) 1817m (15) 1819m (15) 1821m (15) 1823m (15) 1825m (15) 1827m (15) 1829m (15) 1831m (15) 1833m (15) 1835m (15) 1837m (15) 1839m (15) 1841m (15) 1843m (15) 1845m (15) 1847m (15) 1849m (15) 1851m (15) 1853m (15) 1855m (15) 1857m (15) 1859m (15) 1861m (15) 1863m (15) 1865m (15) 1867m (15) 1869m (15) 1871m (15) 1873m (15) 1875m (15) 1877m (15) 1879m (15) 1881m (15) 1883m (15) 1885m (15) 1887m (15) 1889m (15) 1891m (15) 1893m (15) 1895m (15) 1897m (15) 1899m (15) 1901m (15) 1903m (15) 1905m (15) 1907m (15) 1909m (15) 1911m (15) 1913m (15) 1915m (15) 1917m (15) 1919m (15) 1921m (15) 1923m (15) 1925m (15) 1927m (15) 1929m (15) 1931m (15) 1933m (15) 1935m (15) 1937m (15) 1939m (15) 1941m (15) 1943m (15) 1945m (15) 1947m (15) 1949m (15) 1951m (15) 1953m (15) 1955m (15) 1957m (15) 1959m (15) 1961m (15) 1963m (15) 1965m (15) 1967m (15) 1969m (15) 1971m (15) 1973m (15) 1975m (15) 1977m (15) 1979m (15) 1981m (15) 1983m (15) 1985m (15) 1987m (15) 1989m (15) 1991m (15) 1993m (15) 1995m (15) 1997m (15) 1999m (15) 2001m (15) 2003m (15) 2005m (15) 2007m (15) 2009m (15) 2011m (15) 2013m (15) 2015m (15) 2017m (15) 2019m (15) 2021m (15) 2023m (15) 2025m (15) 2027m (15) 2029m (15) 2031m (15) 2033m (15) 2035m (15) 2037m (15) 2039m (15) 2041m (15) 2043m (15) 2045m (15) 2047m (15) 2049m (15) 2051m (15) 2053m (15) 2055m (15) 2057m (15) 2059m (15) 2061m (15) 2063m (15) 2065m (15) 2067m (15) 2069m (15) 2071m (15) 2073m (15) 2075m (15) 2077m (15) 2079m (15) 2081m (15) 2083m (15) 2085m (15) 2087m (15) 2089m (15) 2091m (15) 2093m (15) 2095m (15) 2097m (15) 2099m (15) 2101m (15) 2103m (15) 2105m (15) 2107m (15) 2109m (15) 2111m (15) 2113m (15) 2115m (15) 2117m (15) 2119m (15) 2121m (15) 2123m (15) 2125m (15) 2127m (15) 2129m (15) 2131m (15) 2133m (15) 2135m (15) 2137m (15) 2139m (15) 2141m (15) 2143m (15) 2145m (15) 2147m (15) 2149m (15) 2151m (15) 2153m (15) 2155m (15) 2157m (15) 2159m (15) 2161m (15) 2163m (15) 2165m (15) 2167m (15) 2169m (15) 2171m (15) 2173m (15) 2175m (15) 2177m (15) 2179m (15) 2181m (15) 2183m (15) 2185m (15) 2187m (15) 2189m (15) 2191m (15) 2193m (15) 2195m (15) 2197m (15) 2199m (15) 2201m (15) 2203m (15) 2205m (15) 2207m (15) 2209m (15) 2211m (15) 2213m (15) 2215m (15) 2217m (15) 2219m (15) 2221m (15) 2223m (15) 2225m (15) 2227m (15) 2229m (15) 2231m (15) 2233m (15) 2235m (15) 2237m (15) 2239m (15) 2241m (15) 2243m (15) 2245m (15) 2247m (15) 2249m (15) 2251m (15) 2253m (15) 2255m (15) 2257m (15) 2259m (15) 2261m (15) 2263m (15) 2265m (15) 2267m (15) 2269m (15) 2271m (15) 2273m (15) 2275m (15) 2277m (15) 2279m (15) 2281m (15) 2283m (15) 2285m (15) 2287m (15) 2289m (15) 2291m (15) 2293m (15) 2295m (15) 2297m (15) 2299m (15) 2301m (15) 2303m (15) 2305m (15) 2307m (15) 2309m (15) 2311m (15) 2313m (15) 2315m (15) 2317m (15) 2319m (15) 2321m (15) 2323m (15) 2325m (15) 2327m (15) 2329m (15) 2331m (15) 2333m (15) 2335m (15) 2337m (15) 2339m (15) 2341m	
Services	LV	HV	EHV																
Footpath/unmade	0.45m	0.45m	0.8m																
Road Crossing	0.6m	0.6m	0.75m																
Agricultural	1m	1m	1.1m																



Warning: PDF designed for A4 colour print only with no page scaling

0 20m Dig Sites Area: Line:																																											
Date Requested: 23/ 11/ 2020 Job Reference: 20614304 Site Location: 494129 104180 Requested by: Ms Christina Elliott Your Scheme/ Reference: LM 90619/ SBS		<table border="1"> <thead> <tr> <th colspan="4">Voltages (V)</th> </tr> </thead> <tbody> <tr> <td>LV (Low Voltage) and Services</td> <td colspan="3">Up to 1,000V</td> </tr> <tr> <td>HV (High Voltage)</td> <td colspan="3">Over 1,000V to 11,000V</td> </tr> <tr> <td>EHV (Extra High Voltage)</td> <td colspan="3">22,000V to 132,000V</td> </tr> <tr> <td>Transmission</td> <td colspan="3">275,000V and 400,000V</td> </tr> <tr> <td colspan="4">NORMAL DEPTH TO THE TOP OF THE CABLE WHEN LAID</td> </tr> <tr> <td>Services</td> <td>LV</td> <td>HV</td> <td>EHV</td> </tr> <tr> <td>Footpath/unmade</td> <td>0.45m</td> <td>0.45m</td> <td>0.6m</td> </tr> <tr> <td>Road Crossing</td> <td>0.6m</td> <td>0.6m</td> <td>0.75m</td> </tr> <tr> <td>Agricultural</td> <td>1m</td> <td>1m</td> <td>1.1m</td> </tr> </tbody> </table>		Voltages (V)				LV (Low Voltage) and Services	Up to 1,000V			HV (High Voltage)	Over 1,000V to 11,000V			EHV (Extra High Voltage)	22,000V to 132,000V			Transmission	275,000V and 400,000V			NORMAL DEPTH TO THE TOP OF THE CABLE WHEN LAID				Services	LV	HV	EHV	Footpath/unmade	0.45m	0.45m	0.6m	Road Crossing	0.6m	0.6m	0.75m	Agricultural	1m	1m	1.1m
Voltages (V)																																											
LV (Low Voltage) and Services	Up to 1,000V																																										
HV (High Voltage)	Over 1,000V to 11,000V																																										
EHV (Extra High Voltage)	22,000V to 132,000V																																										
Transmission	275,000V and 400,000V																																										
NORMAL DEPTH TO THE TOP OF THE CABLE WHEN LAID																																											
Services	LV	HV	EHV																																								
Footpath/unmade	0.45m	0.45m	0.6m																																								
Road Crossing	0.6m	0.6m	0.75m																																								
Agricultural	1m	1m	1.1m																																								
Scale: 1:500 (When plotted at A4)		Scottish and Southern Energy Power Distribution Ltd. Registered Office: Inverlaimond House, 200 Dunkeld Road, Perth, PH1 3AQ. Registered in Scotland No. SC213459 If you're unsure & need to seek advice before commencing excavations, please contact: General Enquiries: 0800 048 3516 Subject to revision – Master held by SSEN Asset Data Team: asset.data@sse.com 01256 337 294																																									

Track

17

Warning: PDF designed for A4 colour print only with no page scaling


0 20m Dig Sites Area: Line:

Date Requested: 23/ 11/ 2020
Job Reference: 20614304
Site Location: 494129 104180
Requested by: Ms Christina Elliott

Your Scheme/ Reference: LM
90619/ SBS

Scale: 1:500 (When plotted at A4)


Voltages (V)				
LV (Low Voltage) and Services	Up to 1,000V			
HV (High Voltage)	Over 1,000V to 11,000V			
EHV (Extra High Voltage)	22,000V to 132,000V			
Transmission	275,000V and 400,000V			
NORMAL DEPTH TO THE TOP OF THE CABLE WHEN LAID				
	Services	LV	HV	EHV
Footpath/Unmade	0.45m	0.45m	0.6m	0.75m
Road Crossing	0.6m	0.6m	0.75m	0.75m
Agricultural	1m	1m	1m	1.1m

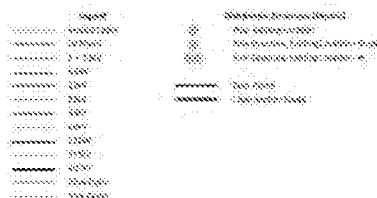

WARNING

From excavations below water-levels or below the surface level, the water must be removed, to the extent necessary, and depths of water must be marked from the surface and safety barriers must be erected around the excavation. The excavation must be completed before commencing excavation work.


WHEN WORKING ON THE SURFACE OF THE ROAD OR ON THE SURFACE OF THE ROAD, THE SURFACE MUST BE MARKED WITH THE APPROPRIATE



Scottish and Southern Energy Power Distribution Ltd.
Registered Office: Inverlaid House,
200 Dunkeld Road, Perth, PH1 3AQ
Registered In Scotland No. SC213459




If you're unsure & need to seek advice before commencing excavations, please contact:
General Enquiries: 0800 048 3516

Subject to revision – Master held by SSEN Asset Data Team:
Asset.Data@sse.com
01256 337 294



Date Requested: 23/ 11/ 2020
Job Reference: 20614304
Site Location: 494129 104180
Requested by: Ms Christina Elliott
Your Scheme/ Reference: LM
90619/ SBS

Voltages (V)				
LV (Low Voltage) and Services		Up to 1,000V		
HV (High Voltage)		Over 1,000V to 11,000V		
EHV (Extra High Voltage)		22,000V to 132,000V		
Transmission		275,000V and 400,000V		
NORMAL DEPTH TO THE TOP OF THE CABLE WHEN LAID				
	Services	LV	HV	EHV
Footpath/Unmade	0.45m	0.45m	0.6m	0.8m
Road Crossing	0.6m	0.6m	0.75m	0.9m
Agricultural	1m	1m	1m	1.1m

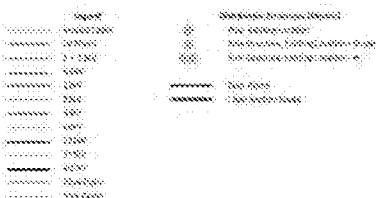

Scottish and Southern Energy Power Distribution Ltd.
Registered Office: Inveralmond House,
200 Dunkeld Road, Perth, PH1 3AQ
Registered in Scotland No. SC213459

If you're unsure & need to seek advice before commencing excavations, please contact:
General Enquiries: 0800 048 3516

Subject to revision – Master held by SSEN Asset Data Team:
Asset.Data@sse.com
 01256 337 294




Warning: PDF designed for A4 colour print only with no page scaling

0 20m Dig Sites Area: Line:																																											
Date Requested: 23/ 11/ 2020 Job Reference: 20614304 Site Location: 494129 104180 Requested by: Ms Christina Elliott Your Scheme/ Reference: LM 90619/ SBS		<table><tr><th colspan="4">Voltages (V)</th></tr><tr><td>LV (Low Voltage) and Services</td><td colspan="3">Up to 1,000V</td></tr><tr><td>HV (High Voltage)</td><td colspan="3">Over 1,000V to 11,000V</td></tr><tr><td>EHV (Extra High Voltage)</td><td colspan="3">22,000V to 132,000V</td></tr><tr><td>Transmission</td><td colspan="3">275,000V and 400,000V</td></tr><tr><th colspan="4">NORMAL DEPTH TO THE TOP OF THE CABLE WHEN LAID</th></tr><tr><th>Services</th><th>LV</th><th>HV</th><th>EHV</th></tr><tr><td>Footpath/unmade</td><td>0.45m</td><td>0.45m</td><td>0.6m</td></tr><tr><td>Road Crossing</td><td>0.6m</td><td>0.6m</td><td>0.75m</td></tr><tr><td>Agricultural</td><td>1m</td><td>1m</td><td>1.1m</td></tr></table> WARNING From positions based on aerial photography or other data, the position of cables may not be accurate. It is the responsibility of the user to verify the position of cables before excavation. The user should consult the relevant authorities for the location of cables and other underground services. The user should also consult the relevant authorities for the location of cables and other underground services. The user should also consult the relevant authorities for the location of cables and other underground services.	Voltages (V)				LV (Low Voltage) and Services	Up to 1,000V			HV (High Voltage)	Over 1,000V to 11,000V			EHV (Extra High Voltage)	22,000V to 132,000V			Transmission	275,000V and 400,000V			NORMAL DEPTH TO THE TOP OF THE CABLE WHEN LAID				Services	LV	HV	EHV	Footpath/unmade	0.45m	0.45m	0.6m	Road Crossing	0.6m	0.6m	0.75m	Agricultural	1m	1m	1.1m	Scottish and Southern Energy Power Distribution Ltd. Registered Office: Inverlaid House, 200 Dunkeld Road, Perth, PH1 3AQ Registered In Scotland No. SC213459 If you're unsure & need to seek advice before commencing excavations, please contact: General Enquiries: 0800 048 3516 Subject to revision – Master held by SSEN Asset Data Team: asset.data@sse.com 01256 337 294
Voltages (V)																																											
LV (Low Voltage) and Services	Up to 1,000V																																										
HV (High Voltage)	Over 1,000V to 11,000V																																										
EHV (Extra High Voltage)	22,000V to 132,000V																																										
Transmission	275,000V and 400,000V																																										
NORMAL DEPTH TO THE TOP OF THE CABLE WHEN LAID																																											
Services	LV	HV	EHV																																								
Footpath/unmade	0.45m	0.45m	0.6m																																								
Road Crossing	0.6m	0.6m	0.75m																																								
Agricultural	1m	1m	1.1m																																								
Scale: 1:500 (When plotted at A4)																																											

22

0 20m Dig Sites Area: Line:



Subject to revision – Master held by SSEN Asset Data Team:
Asset.Data@sse.com
 01256 337 294

Voltages (V)				
LV (Low Voltage) and Services	Up to 1,000V			
HV (High Voltage)	Over 1,000V to 11,000V			
EHV (Extra High Voltage)	22,000V to 132,000V			
Transmission	275,000V and 400,000V			
NORMAL DEPTH TO THE TOP OF THE CABLE WHEN LAID				
Services	LV	HV	EHV	
Footpath/Unmade	0.45m	0.45m	0.6m	0.8m
Road Crossing	0.6m	0.6m	0.75m	0.9m
Agricultural	1m	1m	1m	1.1m

NORMAL DEPTH TO THE TOP OF THE CABLE WHEN LAID				
	Services	LV	HV	EHV
Footpath/Unmade	0.45m	0.45m	0.6m	0.8m
Road Crossing	0.6m	0.6m	0.75m	0.9m
Agricultural	1m	1m	1m	1.1m

WARNING
There have been widespread abrasion in the station level. All water must be undertaken to determine condition and depth of water. If it is thicker than the health and safety officer - avoiding danger from these cables - should be considered when commencing excavation work.
When working in the vicinity of excavations, the safety and safety equipment must be used to ensure the safety of the workers.

BASED UPON THE ORDNANCE SURVEY MAP WITH THE SANCTION OF THE CONTROLLER OF H.M. STATIONERY OFFICE. CROWN COPYRIGHT RESERVED.
Distribution Ltd. Pursuant to section 47 of the Copyright, Designs and Patents Act 1988 ('The Act'). Unless the Act provides a relevant exception.

Warning: PDF designed for A4 colour print only with no page scaling


0 20m Dig Sites Area: Line:

Date Requested: 23/ 11/ 2020
Job Reference: 20614304
Site Location: 494129 104180
Requested by: Ms Christina Elliott
Your Scheme/ Reference: LM
90619/ SBS

Voltages (V)				
LV (Low Voltage) and Services	Up to 1,000V			
HV (High Voltage)	Over 1,000V to 11,000V			
EHV (Extra High Voltage)	22,000V to 132,000V			
Transmission	275,000V and 400,000V			
NORMAL DEPTH TO THE TOP OF THE CABLE WHEN LAID				
	Services	LV	HV	EHV
Footpath/unmade	0.45m	0.45m	0.6m	0.8m
Road Crossing	0.6m	0.6m	0.75m	0.9m
Agricultural	1m	1m	1m	1.1m

WARNING

From positions based on aerial photography or other sources, the position of cables must be determined by reference to the depth of the cable in the ground and the depth of the cable in the ground. The depth of the cable in the ground must be determined by reference to the depth of the cable in the ground. The depth of the cable in the ground must be determined by reference to the depth of the cable in the ground.



Scottish and Southern Energy Power Distribution Ltd.
Registered Office: Inverlamb House,
200 Dunkeld Road, Perth, PH1 3AQ
Registered In Scotland No. SC213459

If you're unsure & need to seek advice before commencing excavations, please contact:
General Enquiries: 0800 048 3516

Subject to revision – Master held by SSEN Asset Data Team:
asset.data@sse.com
01256 337 294

Scale: 1:500 (When plotted at A4)





Warning: PDF designed for A4 colour print only with no page scaling

0 **20m**

Dig Sites Area: Line:

Date Requested: 23/ 11/ 2020
 Job Reference: 20614304
 Site Location: 494129 104180
 Requested by: Ms Christina Elliott
 Your Scheme/ Reference: LM
 90619/ SBS

Voltages (V)			
LV (Low Voltage) and Services	Up to 1,000V		
HV (High Voltage)	Over 1,000V to 11,000V		
EHV (Extra High Voltage)	22,000V to 132,000V		
Transmission	275,000V and 400,000V		
NORMAL DEPTH TO THE TOP OF THE CABLE WHEN LAID			
Services	LV	HV	EHV
Footpath/unmade	0.45m	0.45m	0.8m
Road Crossing	0.6m	0.6m	0.75m
Agricultural	1m	1m	1.1m

WARNING

From positions based on aerial photography, the station level, tube size must be determined, to determine earth and depth of cable. HV EHV 47' should be the minimum and safety distance. Avoiding things like the cable tubes - should be considered before commencing excavation work.


Scottish and Southern Energy Power Distribution Ltd.
 Registered Office: Inverlamb House,
 200 Dunkeld Road, Perth, PH1 3AQ
 Registered In Scotland No. SC213459

If you're unsure & need to seek advice before commencing excavations, please contact:
 General Enquiries: 0800 048 3516

Subject to revision – Master held by SSEN Asset Data Team:
Asset.Data@ssen.com
 01256 337 294

Scale: 1:500 (When plotted at A4)

BASED UPON THE ORDNANCE SURVEY MAP WITH THE SANCTION OF THE CONTROLLER OF HER MAJESTY'S STATIONERY OFFICE. CROWN COPYRIGHT RESERVED.
 This map is made by or with the authority of Scottish and Southern Energy Power Distribution Ltd. Pursuant to section 47 of the Copyright, Designs and Patents Act 1988 (The Act). Unless the Act provides a relevant exception to copyright the copy must not be copied without prior permission of the copyright owner.
 Plans generated by DigSAFE Pro™ software provided by Linsearchbedford.

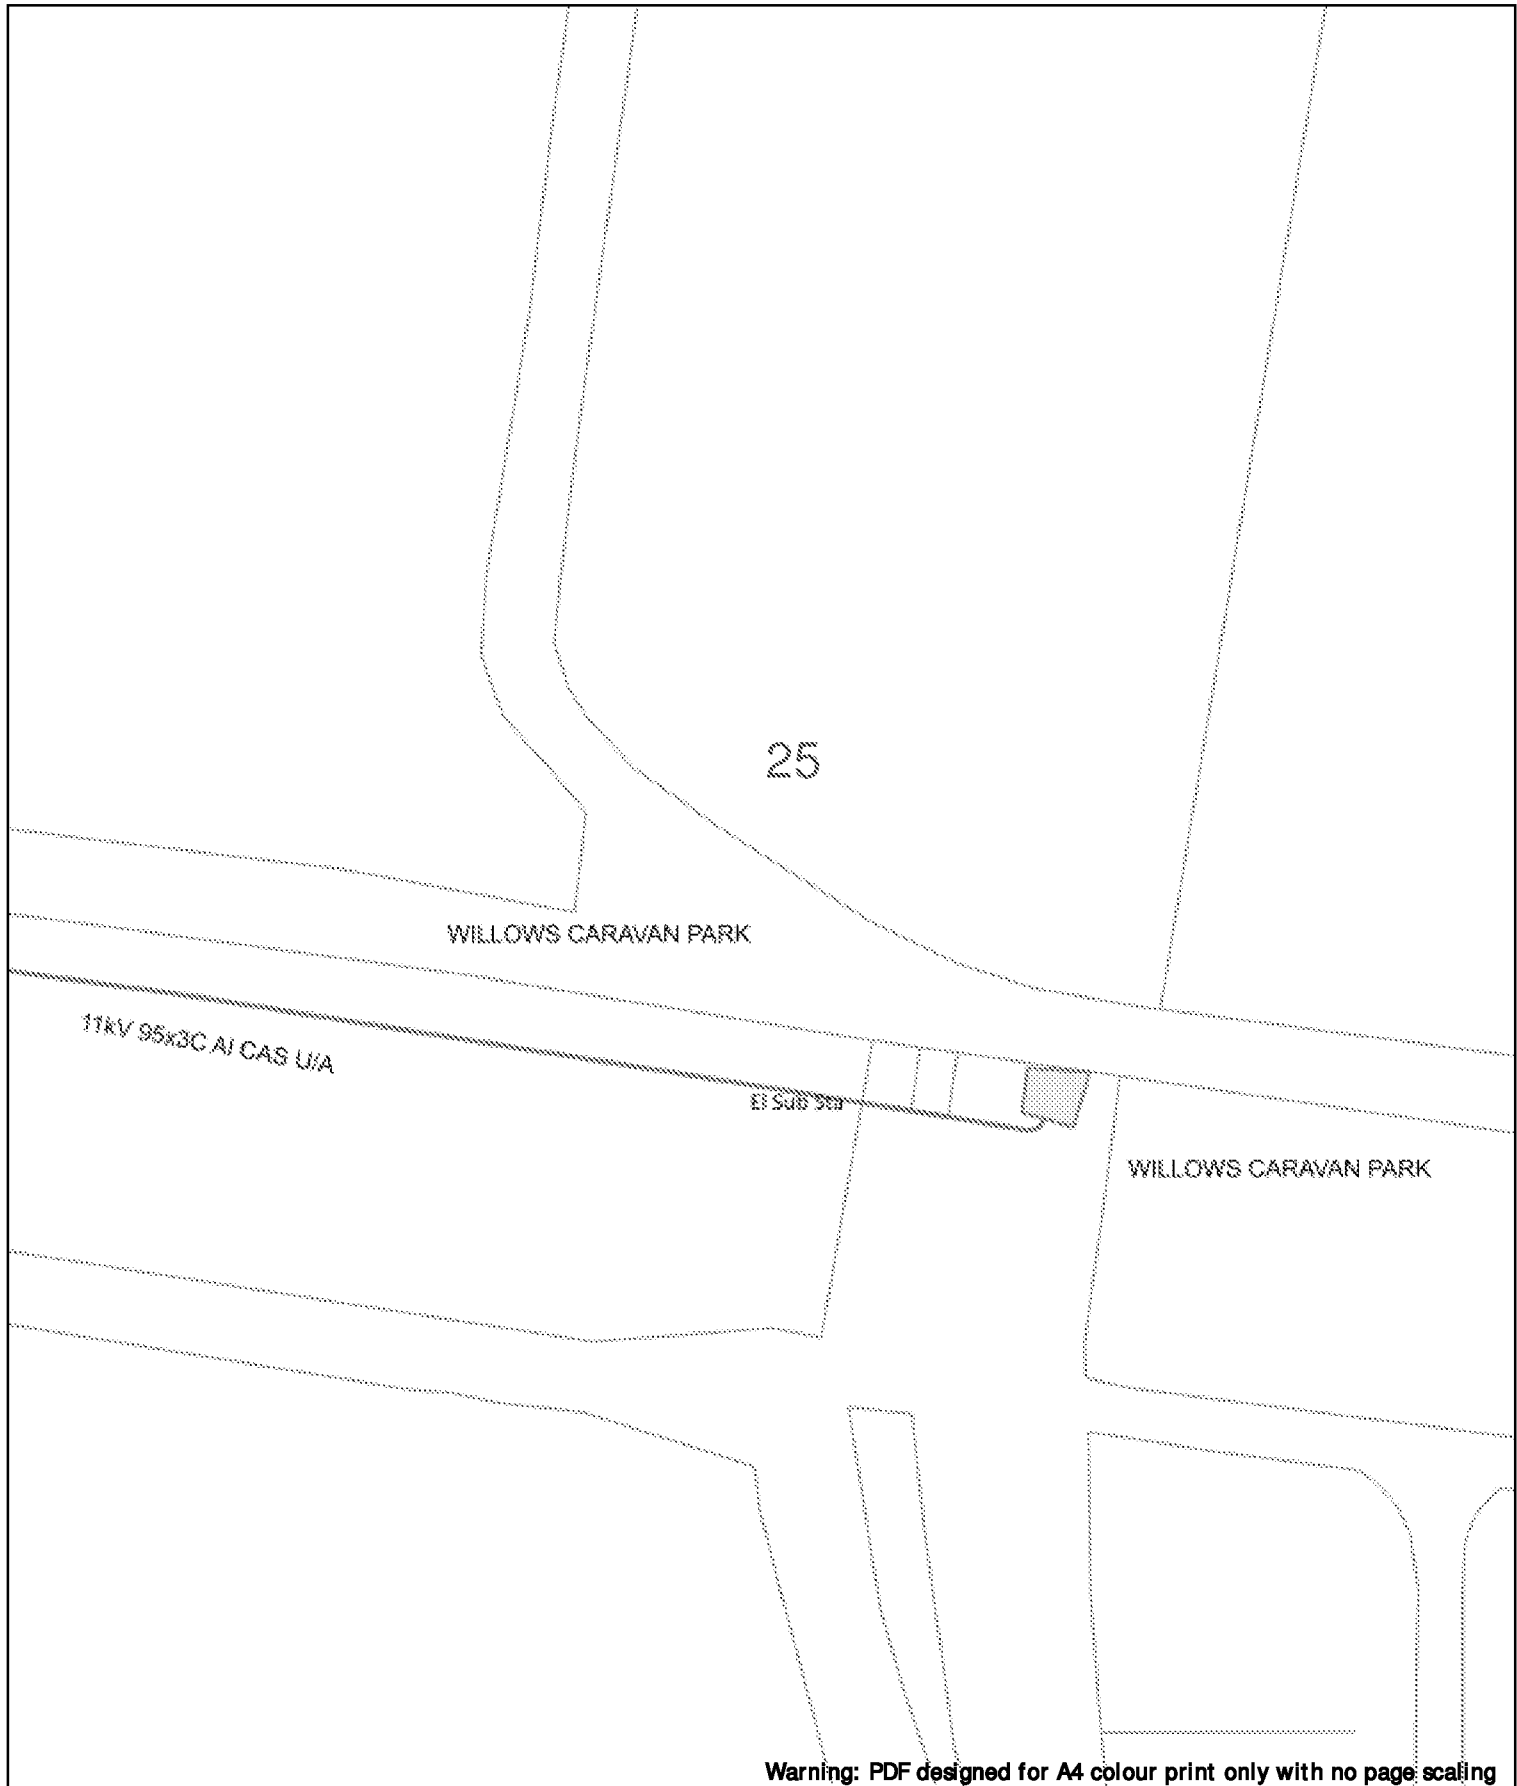

0 20m

Dig Sites Area: Line:

Warning: PDF designed for A4 colour print only with no page scaling

Date Requested: 23/ 11/ 2020
Job Reference: 20614304
Site Location: 494129 104180
Requested by: Ms Christina Elliott
Your Scheme/ Reference: LM
90619/ SBS

Voltages (V)			
LV (Low Voltage) and Services	Up to 1,000V		
HV (High Voltage)	Over 1,000V to 11,000V		
EHV (Extra High Voltage)	22,000V to 132,000V		
Transmission	275,000V and 400,000V		
NORMAL DEPTH TO THE TOP OF THE CABLE WHEN LAID			
Services	LV	HV	EHV
Footpath/unmade	0.45m	0.45m	0.8m
Road Crossing	0.6m	0.6m	0.9m
Agricultural	1m	1m	1.1m

WARNING

From positions based on aerial photography, the station level, tube level, cable level and depth of cable are not to be used for the health and safety of the digger. The digger should be advised of the cable level and depth of cable before commencing excavation work.

BASED UPON THE ORDNANCE SURVEY MAP WITH THE SANCTION OF THE CONTROLLER OF HER MAJESTY'S STATIONERY OFFICE. CROWN COPYRIGHT RESERVED.

Plans generated by DigSAFE Pro™ software provided by Linsearchbedford.org.

Scale: 1:500 (When plotted at A4)

Scale: 1:500 (When plotted at A4)

Scottish and Southern Energy Power Distribution Ltd.
Registered Office: Inverlaimond House,
200 Dunkeld Road, Perth, PH1 3AQ
Registered In Scotland No. SC213459

If you're unsure & need to seek advice before commencing excavations, please contact:
General Enquiries: 0800 048 3516

Subject to revision – Master held by SSEN Asset Data Team:
Asset.Data@sse.com
01256 337 294



26


Warning: PDF designed for A4 colour print only with no page scaling

0 20m Dig Sites Area: Line:

Voltages (V)				
LV (Low Voltage) and Services	Up to 1,000V			
HV (High Voltage)	Over 1,000V to 11,000V			
EHV (Extra High Voltage)	22,000V to 132,000V			
Transmission	275,000V and 400,000V			
NORMAL DEPTH TO THE TOP OF THE CABLE WHEN LAID				
	Services	LV	HV	EHV
Footpath/unmade	0.45m	0.45m	0.6m	0.8m
Road Crossing	0.6m	0.6m	0.75m	0.9m

[illegible]

There may have been wave-pool absorption in the surface basin. That water must be undertaken, to determine location and depth of water. It is 47' thicker than the head and safety factor. Avoiding danger from these cables - should be considered before commencing excavation work.




BASED UPON THE ORDINANCE SURVEY MAP WITH THE SANCTION OF THE CONTROLLER OF LAND STATIONERY OFFICE. COPYRIGHT RESERVED.
 RUN DISTRICT COUNCIL ALPH 107/21/PE made by and with the authority of Scottish and Southern Energy Power Distribution Ltd. Pursuant to section 47 of the Copyright, Designs and Patents Act 1988 ("The Act"). Unless the Act provides a relevant exception to copyright the copy must not be copied without prior permission of the copyright owner.
 Plans generated by DigiSAFE Pro™ software provided by Linsearcheletech Ltd.

Warning: PDF designed for A4 colour print only with no page scaling

0 20m Dig Sites Area: Line:

Date Requested: 23/ 11/ 2020
 Job Reference: 20614304
 Site Location: 494129 104180
 Requested by: Ms Christina Elliott
 Your Scheme/ Reference: LM
 90619/ SBS

Voltages (V)				
LV (Low Voltage) and Services	Up to 1,000V			
HV (High Voltage)	Over 1,000V to 11,000V			
EHV (Extra High Voltage)	22,000V to 132,000V			
Transmission	275,000V and 400,000V			
NORMAL DEPTH TO THE TOP OF THE CABLE WHEN LAID				
	Services	LV	HV	EHV
Footpath/unmade	0.45m	0.45m	0.6m	0.8m
Road Crossing	0.6m	0.6m	0.75m	0.9m
Agricultural	1m	1m	1m	1.1m

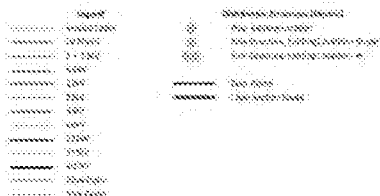

WARNING

From positions based on a map of the site, the location of the cable must be determined, to the extent possible, and depth of the cable must be determined from the map and other data. The location of the cable must be determined, to the extent possible, and depth of the cable must be determined from the map and other data. The location of the cable must be determined, to the extent possible, and depth of the cable must be determined from the map and other data.

BASED UPON THE ORDNANCE SURVEY MAP WITH THE SANCTION OF THE CONTROLLER OF HER MAJESTY'S STATIONERY OFFICE. CROWN COPYRIGHT RESERVED.
 Plans generated by DigSAFE Pro™ software provided by Linesearchuk Limited.



Scottish and Southern Energy Power Distribution Ltd.
 Registered Office: Inverlaid House,
 200 Dunkeld Road, Perth, PH1 3AQ
 Registered In Scotland No. SC213459

If you're unsure & need to seek advice before commencing excavations, please contact:
 General Enquiries: 0800 048 3516


Subject to revision – Master held by SSEN Asset Data Team:
Asset.Data@sse.com
 01256 337 294

Warning: PDF designed for A4 colour print only with no page scaling

0 20m Dig Sites Area: Line:

Date Requested: 23/ 11/ 2020
 Job Reference: 20614304
 Site Location: 494129 104180
 Requested by: Ms Christina Elliott
 Your Scheme/ Reference: LM
 90619/ SBS

Voltages (V)				
LV (Low Voltage) and Services	Up to 1,000V			
HV (High Voltage)	Over 1,000V to 11,000V			
EHV (Extra High Voltage)	22,000V to 132,000V			
Transmission	275,000V and 400,000V			
NORMAL DEPTH TO THE TOP OF THE CABLE WHEN LAID				
	Services	LV	HV	EHV
Footpath/unmade	0.45m	0.45m	0.6m	0.8m
Road Crossing	0.6m	0.6m	0.75m	0.9m
Agricultural	1m	1m	1m	1.1m

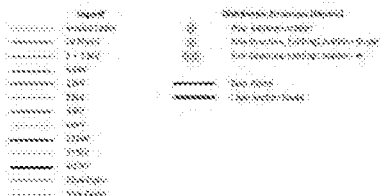

WARNING

From inspection based on visual inspection of the site, the following information must be obtained, to be verified, and depth of cable must be checked from the ground and safety certificates. Avoiding damage to the cables - should be considered before commencing excavation work.

WHICH MAY BE USED FOR THE PURPOSES OF THE DESIGN AND CONSTRUCTION OF THE CABLES AND SERVICES.

BASED UPON THE ORDNANCE SURVEY MAP WITH THE SANCTION OF THE CONTROLLER OF HER MAJESTY'S STATIONERY OFFICE. CROWN COPYRIGHT RESERVED.




Scottish and Southern Energy Power Distribution Ltd.
 Registered Office: Inverlaid House,
 200 Dunkeld Road, Perth, PH1 3AQ
 Registered In Scotland No. SC213459

If you're unsure & need to seek advice before commencing excavations, please contact:
 General Enquiries: 0800 048 3516

Subject to revision – Master held by SSEN Asset Data Team:

AssetData@sse.com
 01256 337 294

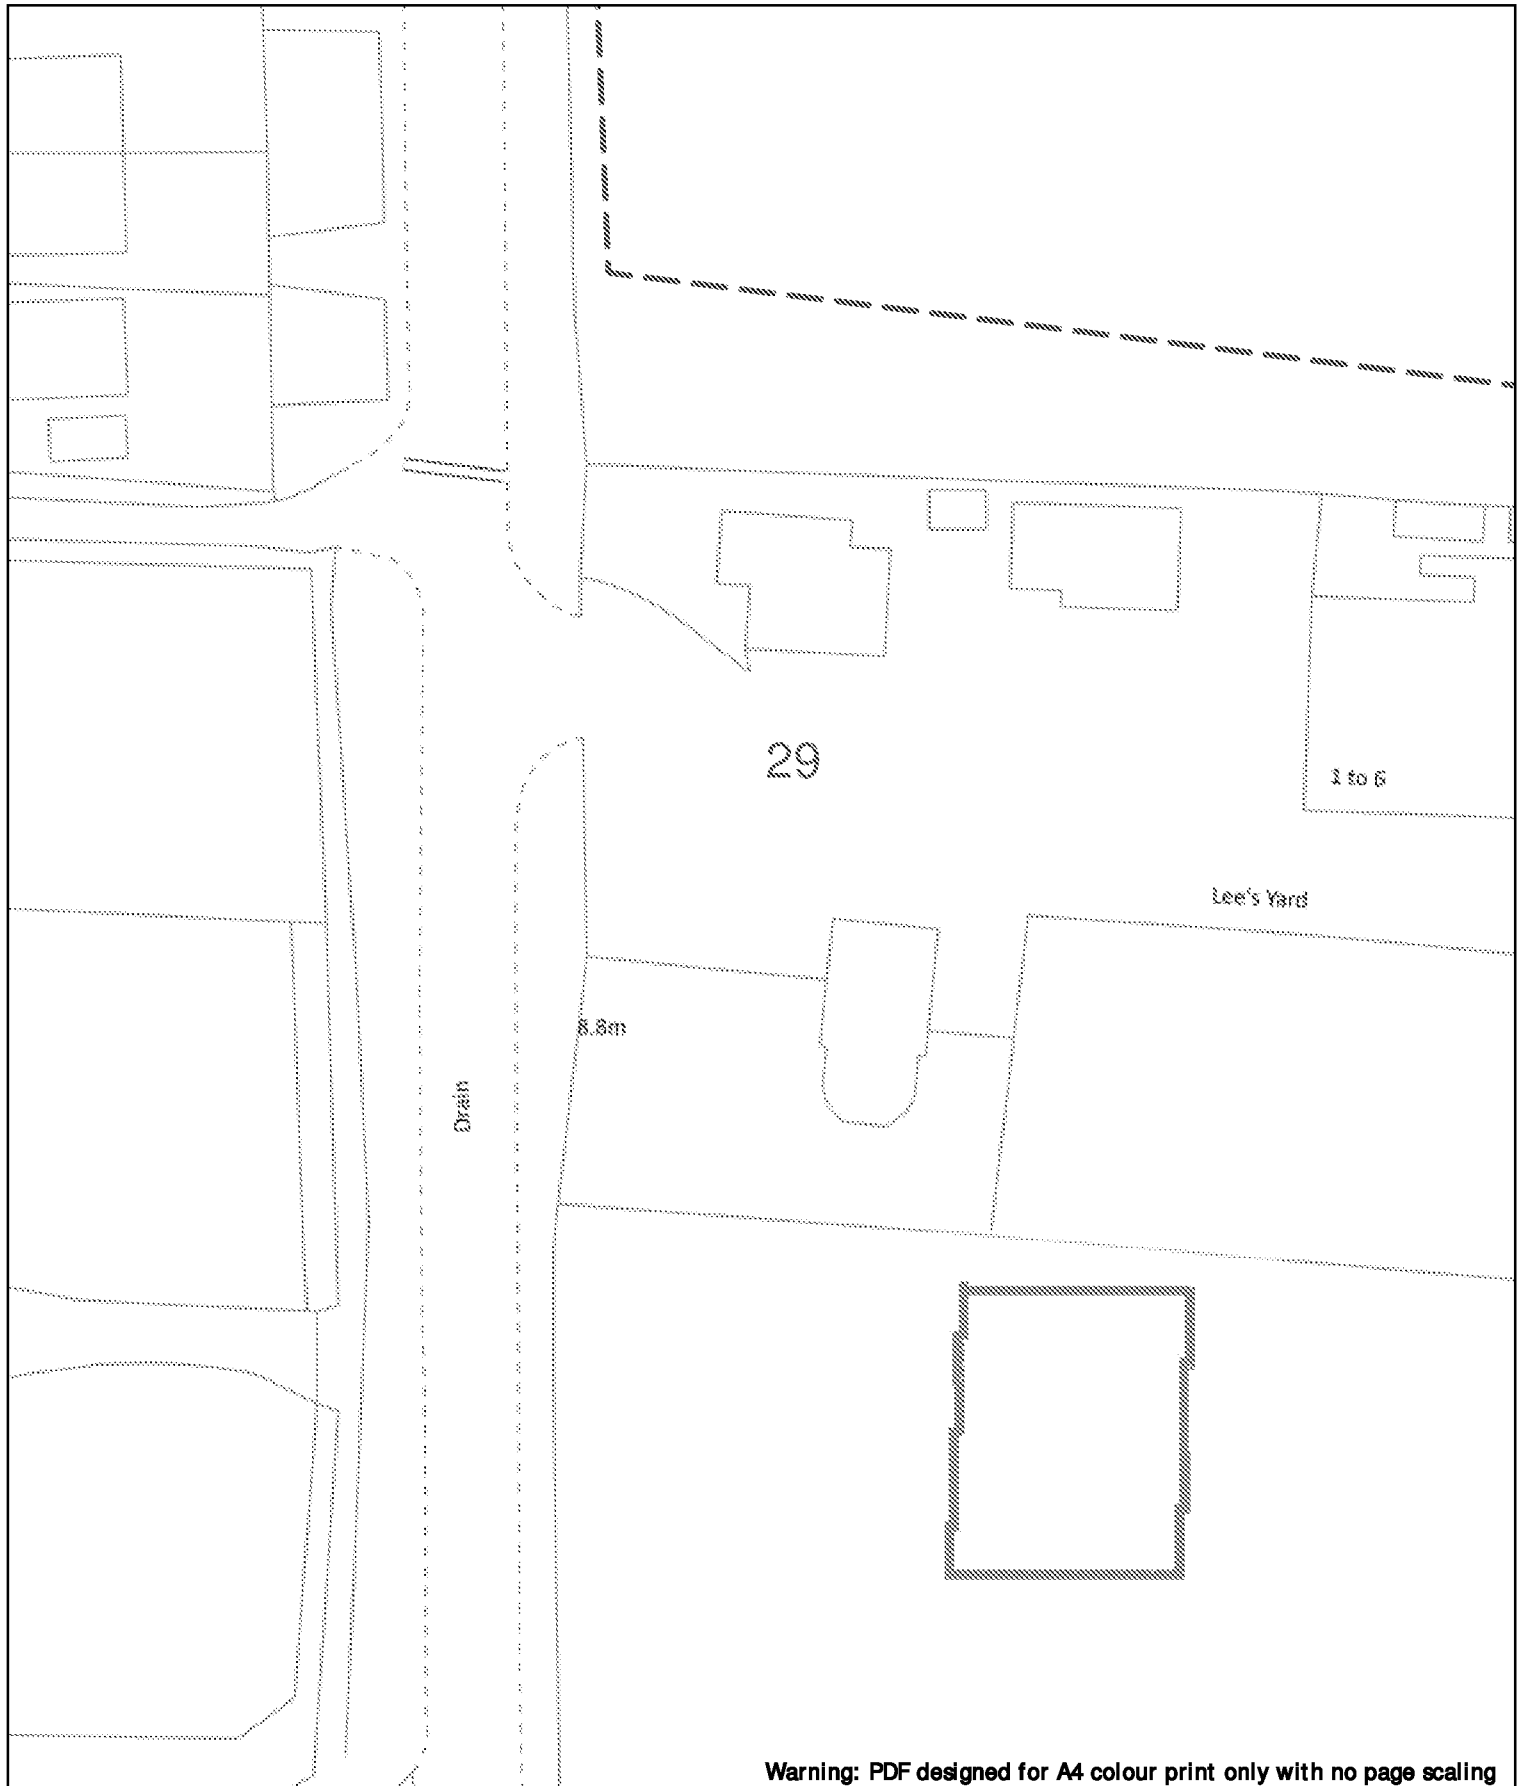

Warning: PDF designed for A4 colour print only with no page scaling

020m Dig Sites Area: Line:

Date Requested: 23/ 11/ 2020

Job Reference: 20614304

Site Location: 494129 104180

Requested by: Ms Christina Elliott

Your Scheme/ Reference: LM 90619/ SBS

Scale: 1:500 (When plotted at A4)

Voltages (V)

LV (Low Voltage) and Services Up to 1,000V

HV (High Voltage) Over 1,000V to 11,000V

EHV (Extra High Voltage) 22,000V to 132,000V

Transmission 275,000V and 400,000V

NORMAL DEPTH TO THE TOP OF THE CABLE WHEN LAID

Services LV HV EHV

Footpath/unmade 0.45m 0.45m 0.6m 0.8m

Road Crossing 0.6m 0.6m 0.75m 0.9m

Agricultural 1m 1m 1m 1.1m

WARNING

From positions based on a general impression of the surface level, the water must be considered, to be within the surface and depth of the water 47' (14.3m) from the shore and safety barriers - Avoiding things like these cables - should be considered before commencing excavation work.

WHICH MAY BE IN THE VICINITY OF THE SURFACE AND DEPTH OF THE WATER 47' (14.3m) FROM THE SHORE AND SAFETY BARRIERS - Avoiding things like these cables - should be considered before commencing excavation work.

Legend

Drainage (manhole, channel)

Gas (main, service)

Electricity (main, service)

Water (main, service)

Telecoms (main, service)

Other (main, service)

0.45m

0.6m

0.75m

0.9m

1m

1.1m

Scottish & Southern

Electricity Networks

Scottish and Southern Energy Power Distribution Ltd.

Registered Office: Inverlorn House,

200 Dunkeld Road, Perth, PH1 3AQ

Registered in Scotland No. SC213459

If you're unsure & need to seek advice before commencing excavations, please contact:


General Enquiries: 0800 048 3516

Subject to revision - Master held by SEN Asset Data Team:

asset.data@sse.com

01256 337 294

ARUN DISTRICT COUNCIL AL10721/PL

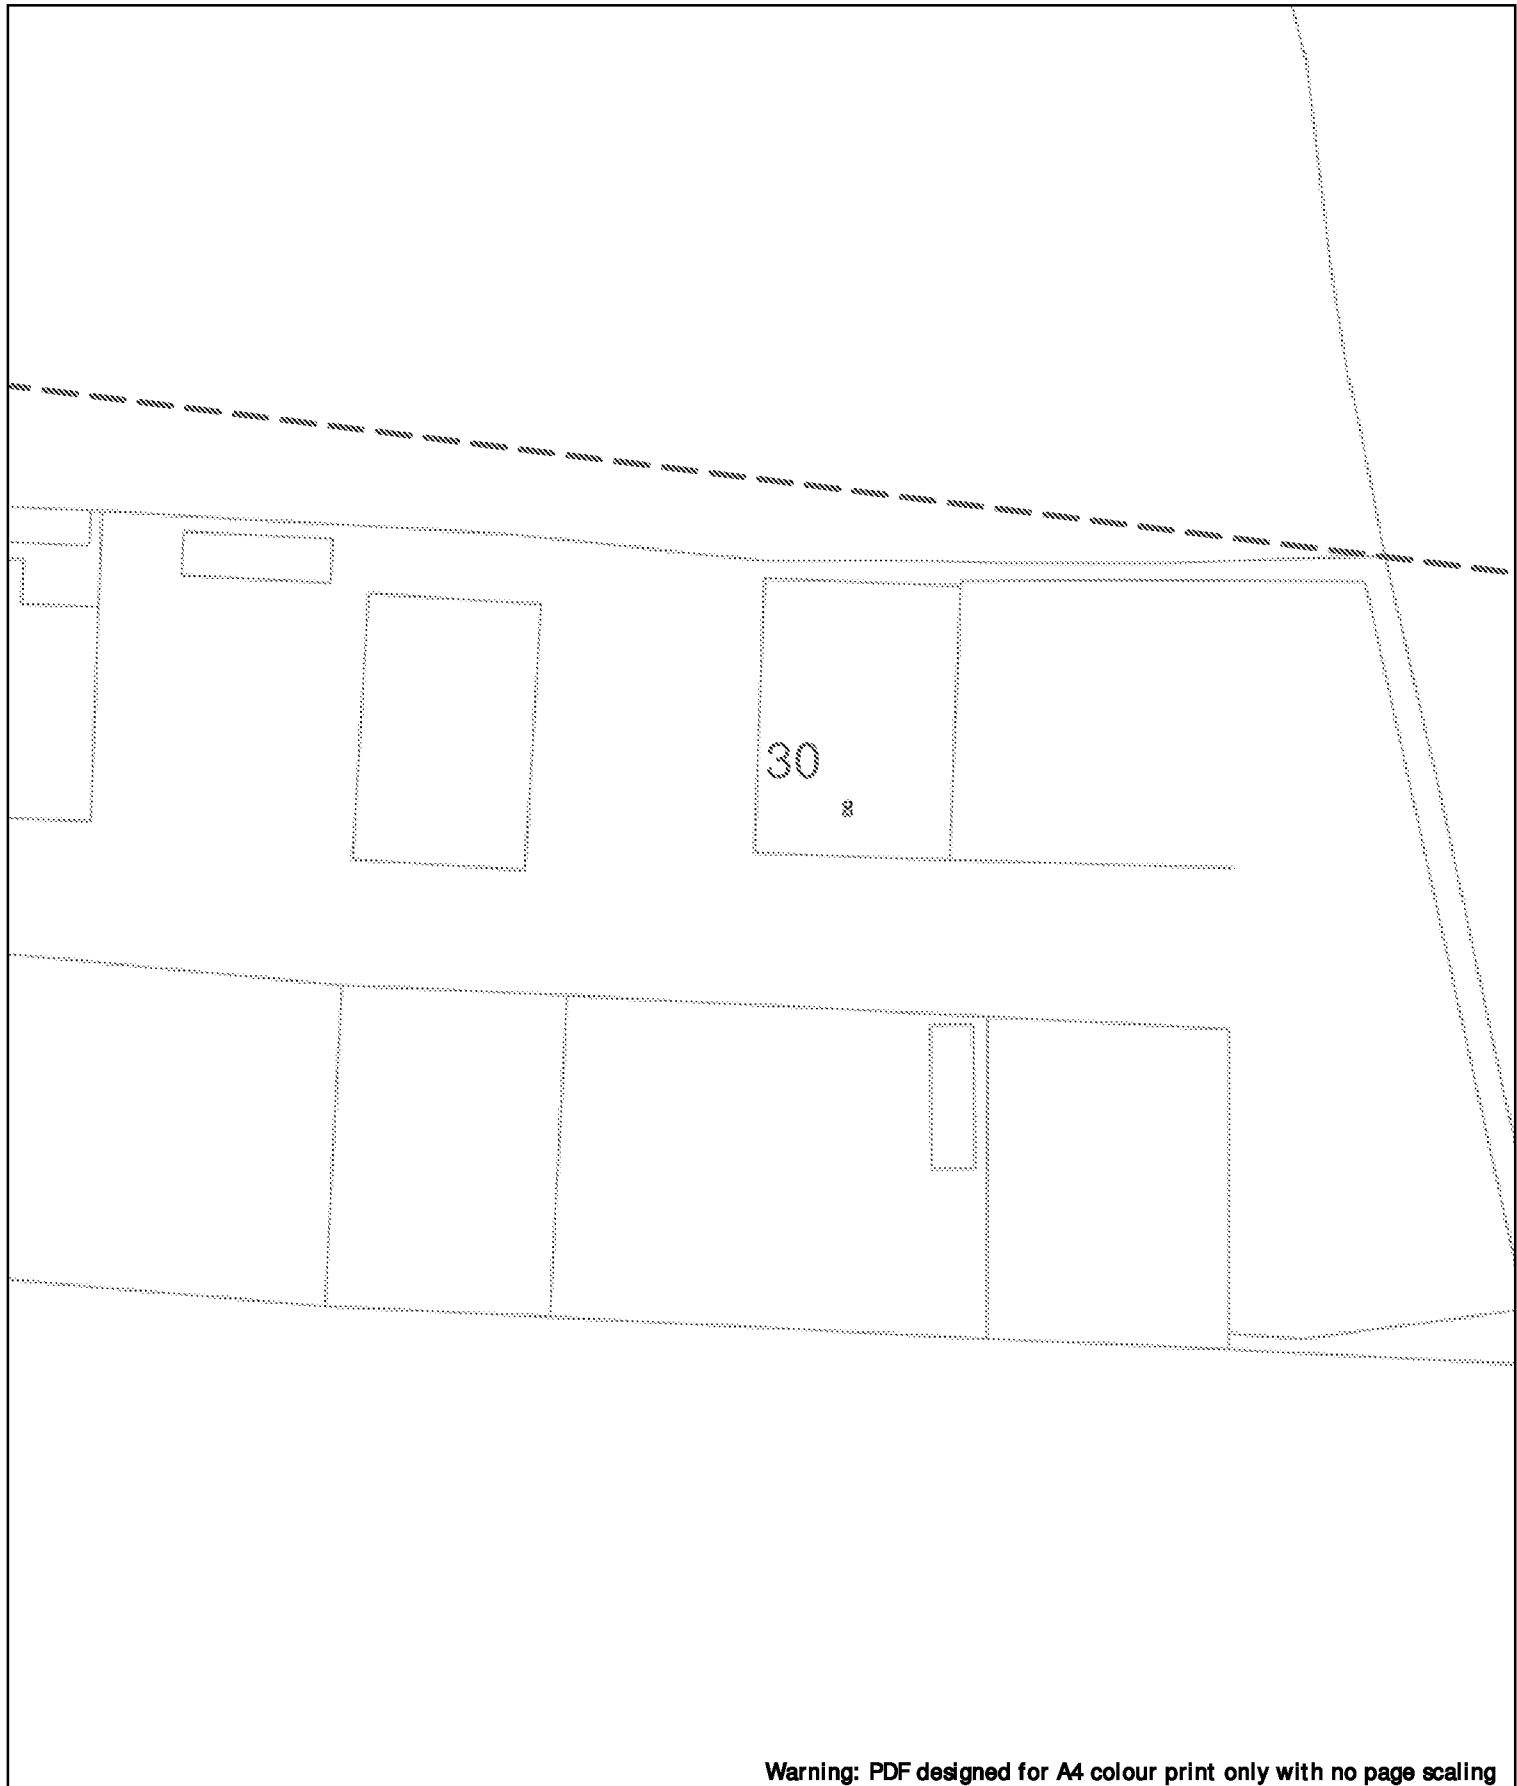

Warning: PDF designed for A4 colour print only with no page scaling

0 **20m**

Dig Sites Area: Line:

Date Requested: 23/ 11/ 2020
 Job Reference: 20614304
 Site Location: 494129 104180
 Requested by: Ms Christina Elliott
 Your Scheme/ Reference: LM
 90619/ SBS

Voltages (V)			
LV (Low Voltage) and Services	Up to 1,000V		
HV (High Voltage)	Over 1,000V to 11,000V		
EHV (Extra High Voltage)	22,000V to 132,000V		
Transmission	275,000V and 400,000V		
NORMAL DEPTH TO THE TOP OF THE CABLE WHEN LAID			
Services	LV	HV	EHV
Footpath/unmade	0.45m	0.45m	0.8m
Road Crossing	0.6m	0.6m	0.75m
Agricultural	1m	1m	1.1m

WARNING:
 From positions based on aerial photography, the station level, tide water must be determined, to determine earth and depth of water. It is 47' from the beach and safety barriers. Avoiding danger from the water. Should be considered before commencing excavation work.
 WHICH MAY BE USED FOR THE PURPOSES OF THE ACT. THE ACT IS NOT TO BE USED FOR THE PURPOSES OF THE ACT. THE ACT IS NOT TO BE USED FOR THE PURPOSES OF THE ACT.


BASED UPON THE ORDNANCE SURVEY MAP WITH THE SANCTION OF THE CONTROLLER OF HER MAJESTY'S STATIONERY OFFICE. CROWN COPYRIGHT RESERVED.
 This map is made by or with the authority of Scottish and Southern Energy Power Distribution Ltd. Pursuant to section 47 of the Copyright, Designs and Patents Act 1988 (The Act). Unless the Act provides a relevant exception to copyright the copy must not be copied without prior permission of the copyright owner.
 Plans generated by DigSAFE Pro™ software provided by Linemasterbedfordshire.

Scottish and Southern Energy Power Distribution Ltd.
 Registered Office: Inverlamb House,
 200 Dunkeld Road, Perth, PH1 3AQ
 Registered In Scotland No. SC213459



If you're unsure & need to seek advice before commencing excavations, please contact:
 General Enquiries: 0800 048 3516

Subject to revision – Master held by SSEN Asset Data Team:
Asset.Data@sse.com
 01256 337 294

Scale: 1:500 (When plotted at A4)

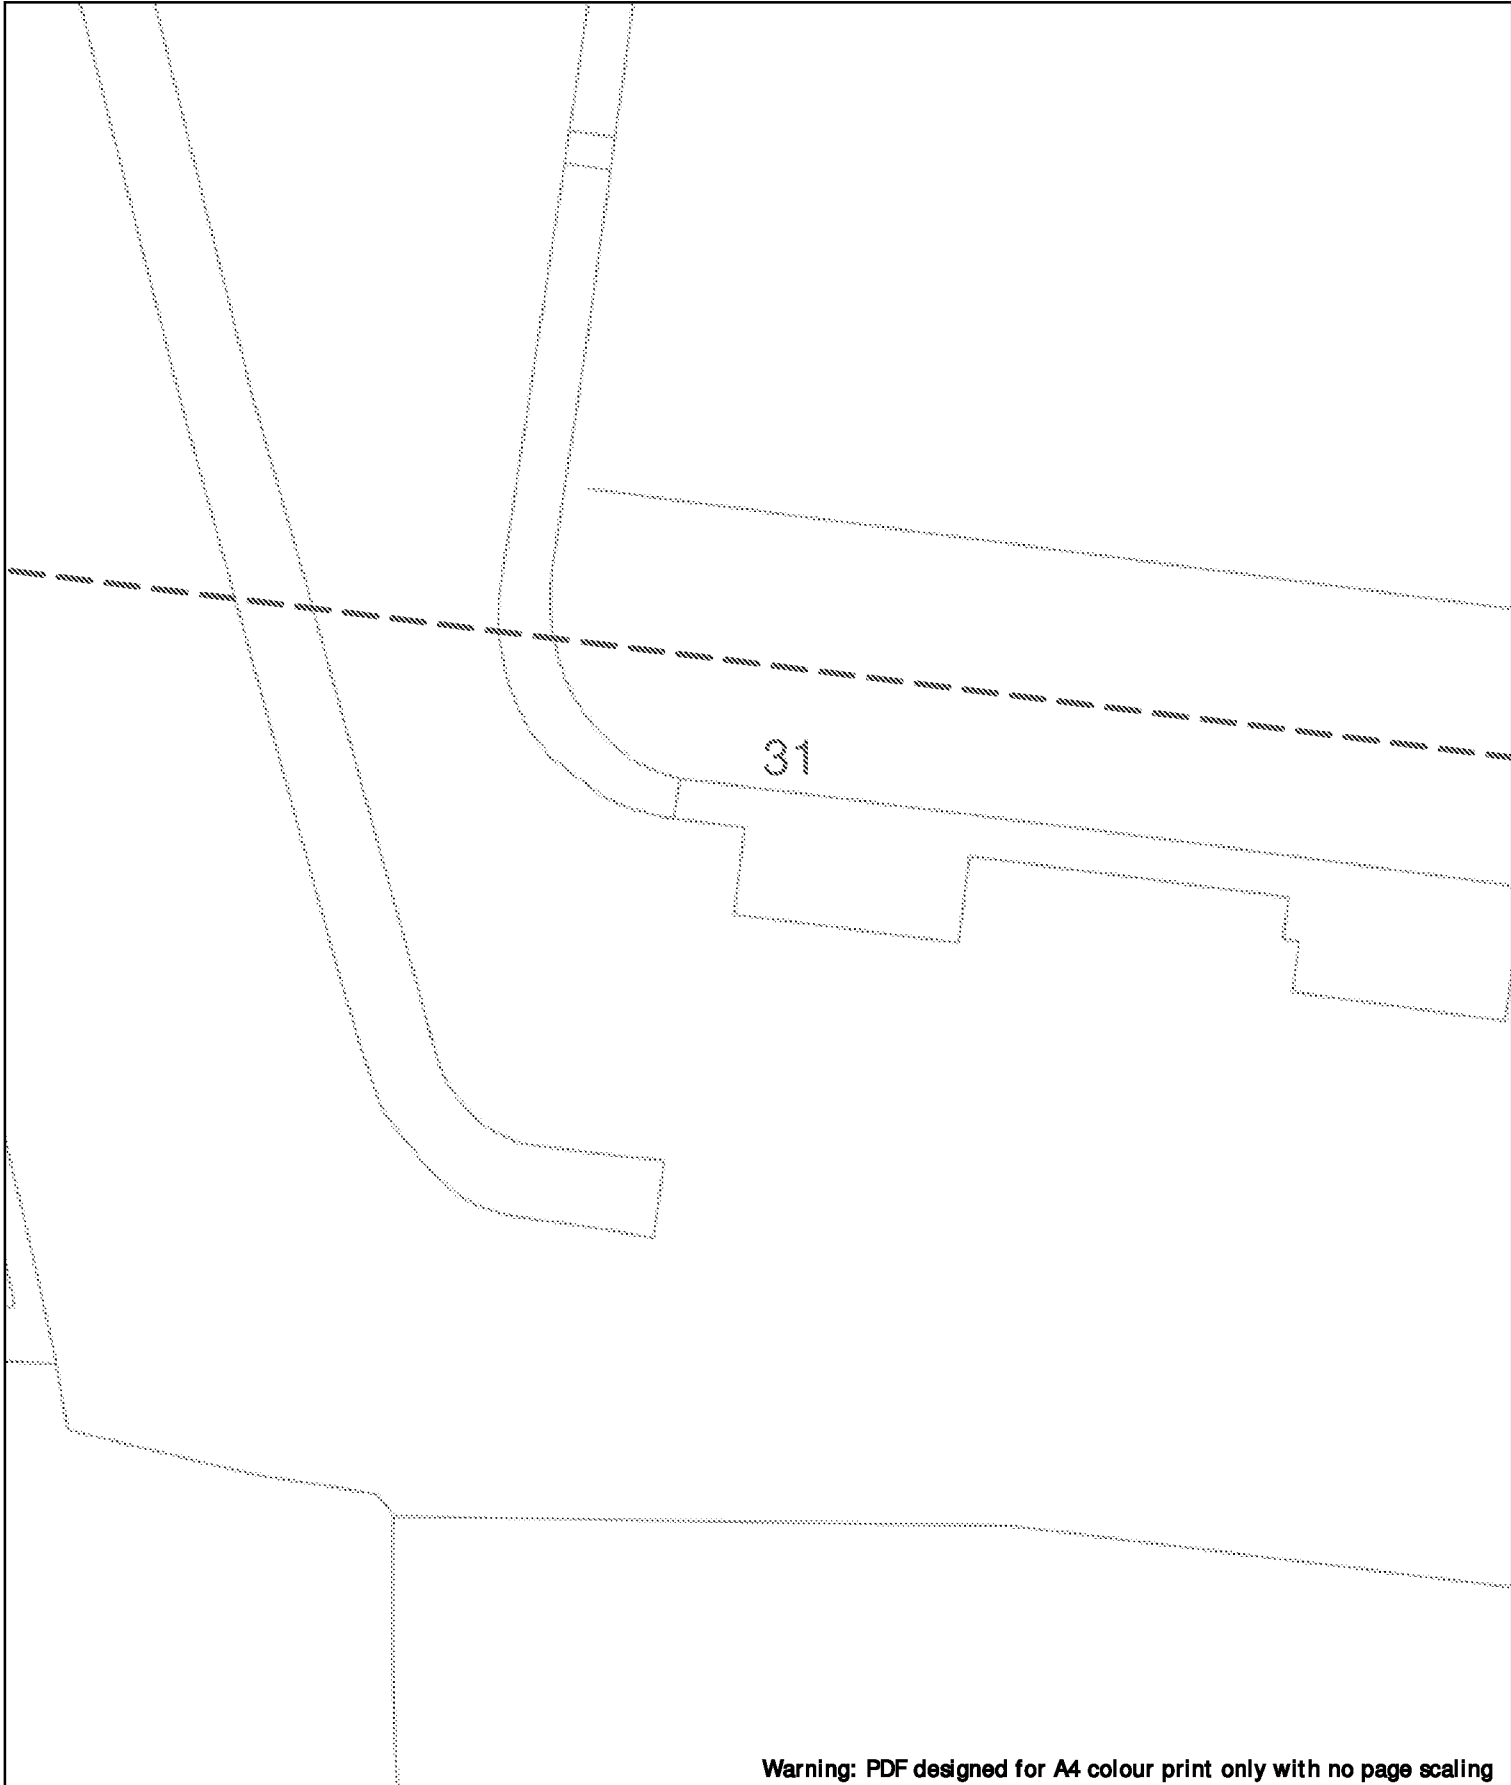

Warning: PDF designed for A4 colour print only with no page scaling

0  20m Dig Sites Area:  Line: 

Date Requested: 23/ 11/ 2020
Job Reference: 20614304
Site Location: 494129 104180
Requested by: Ms Christina Elliott

Your Scheme/ Reference: LM
90619/ SBS


Voltages (V)			
LV (Low Voltage) and Services	Up to 1,000V		
HV (High Voltage)	Over 1,000V to 11,000V		
EHV (Extra High Voltage)	22,000V to 132,000V		
Transmission	275,000V and 400,000V		
NORMAL DEPTH TO THE TOP OF THE CABLE WHEN LAID			
Services	LV	HV	EHV
Footpath/unmade	0.45m	0.45m	0.6m
Road Crossing	0.6m	0.6m	0.75m
Agricultural	1m	1m	1.1m

WARNING

From positions based on aerial photography, the station level, tide level must be determined, to determine accurate and depth of station. It is 47' from the station and safety barriers. Avoiding danger from these cables - should be considered before commencing excavation work.

WHICH MAY BE USED FOR CONDUIT AND CABLES AND SHOULD BE USED TO PROTECT THE CABLES FROM DAMAGE.

Symbol	Description
	11kV Cable
	33kV Cable
	66kV Cable
	132kV Cable
	275kV Cable
	400kV Cable
	500kV Cable
	600kV Cable
	700kV Cable
	800kV Cable



Scottish and Southern Energy Power Distribution Ltd.
Registered Office: Inverlamb House,
200 Dunkeld Road, Perth, PH1 3AQ.
Registered In Scotland No. SC213459

If you're unsure & need to seek advice before commencing excavations, please contact:
General Enquiries: 0800 048 3516

Subject to revision – Master held by SSEN Asset Data Team:
Asset.Data@sse.com
01256 337 294

Scale: 1:500 (When plotted at A4)


BASED UPON THE ORDNANCE SURVEY MAP WITH THE SANCTION OF THE CONTROLLER OF HER MAJESTY'S STATIONERY OFFICE. CROWN COPYRIGHT RESERVED.
This map is made by or with the authority of Scottish and Southern Energy Power Distribution Ltd. Pursuant to section 47 of the Copyright, Designs and Patents Act 1988 (The Act). Unless the Act provides a relevant exception to copyright the copy must not be copied without prior permission of the copyright owner.
Plans generated by DigSAFE Pro™ software provided by Lineaschekereddijg.

ARUN DISTRICT COUNCIL AL107921/PL

Willows Caravan Park

32

Warning: PDF designed for A4 colour print only with no page scaling



Subject to revision – Master held by SSEN Asset Data Team:
Asset.Data@ssen.com
 01256 337 294


33

Warning: PDF designed for A4 colour print only with no page scaling

0 20m Dig Sites Area: Line:

Date Requested: 23/ 11/ 2020
Job Reference: 20614304
Site Location: 494129 104180
Requested by: Ms Christina Elliott
Your Scheme/ Reference: LM
90619/ SBS

Voltages (V)				
LV (Low Voltage) and Services	Up to 1,000V			
HV (High Voltage)	Over 1,000V to 11,000V			
EHV (Extra High Voltage)	22,000V to 132,000V			
Transmission	275,000V and 400,000V			
NORMAL DEPTH TO THE TOP OF THE CABLE WHEN LAID				
	Services	LV	HV	EHV
Footpath/unmade	0.45m	0.45m	0.6m	0.8m
Road Crossing	0.6m	0.6m	0.75m	0.9m
Agricultural	1m	1m	1m	1.1m


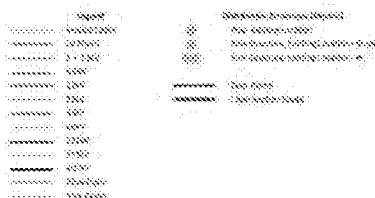


WARNING

From excavations below water-levels shown on the station level, the water must be drawn out, to the extent possible, and depth of water must be noted from the station and safety certificate. Avoiding danger from the cables - should be considered before commencing excavation work.

WHICH MAY BE USED FOR THE PURPOSES OF THE ACT, AND WHICH MAY BE USED FOR THE PURPOSES OF THE ACT, AND WHICH MAY BE USED FOR THE PURPOSES OF THE ACT.

BASED UPON THE ORDNANCE SURVEY MAP WITH THE SANCTION OF THE CONTROLLER OF HER MAJESTY'S STATIONERY OFFICE. CROWN COPYRIGHT RESERVED.



Scottish and Southern Energy Power Distribution Ltd.
Registered Office: Inverlamb House,
200 Dunkeld Road, Perth, PH1 3AQ.
Registered In Scotland No. SC213459

If you're unsure & need to seek advice before commencing excavations, please contact:
General Enquiries: 0800 048 3516

Subject to revision – Master held by SSEN Asset Data Team:
Asset.Data@sse.com
01256 337 294


[illegible]

0 20m Dig Sites Area: Line:

Voltages (V)				
LV (Low Voltage) and Services	Up to 1,000V			
HV (High Voltage)	Over 1,000V to 11,000V			
EHV (Extra High Voltage)	22,000V to 132,000V			
Transmission	275,000V and 400,000V			
NORMAL DEPTH TO THE TOP OF THE CABLE WHEN LAID				
	Services	LV	HV	EHV
Footpath/Unmade	0.45m	0.45m	0.6m	0.8m
Road Crossing	0.6m	0.6m	0.75m	0.9m
Agricultural	1m	1m	1m	1.1m

[illegible]


There may have been water-spread abortion in the station basin, but water must be undertaken to determine location and depth of water. HS 17) 47 Model from the Health and Safety Executive – Funding Design from these tables – should be considered before commencing preconstruction work.



Subject to revision – Master held by SSEN Asset Data Team:
Asset.Data@sse.com

ARJUN DISTRICT COUNCIL AL1107/21/PL

AFUN DISTRICT COUNCIL ALUN 107/24/PL

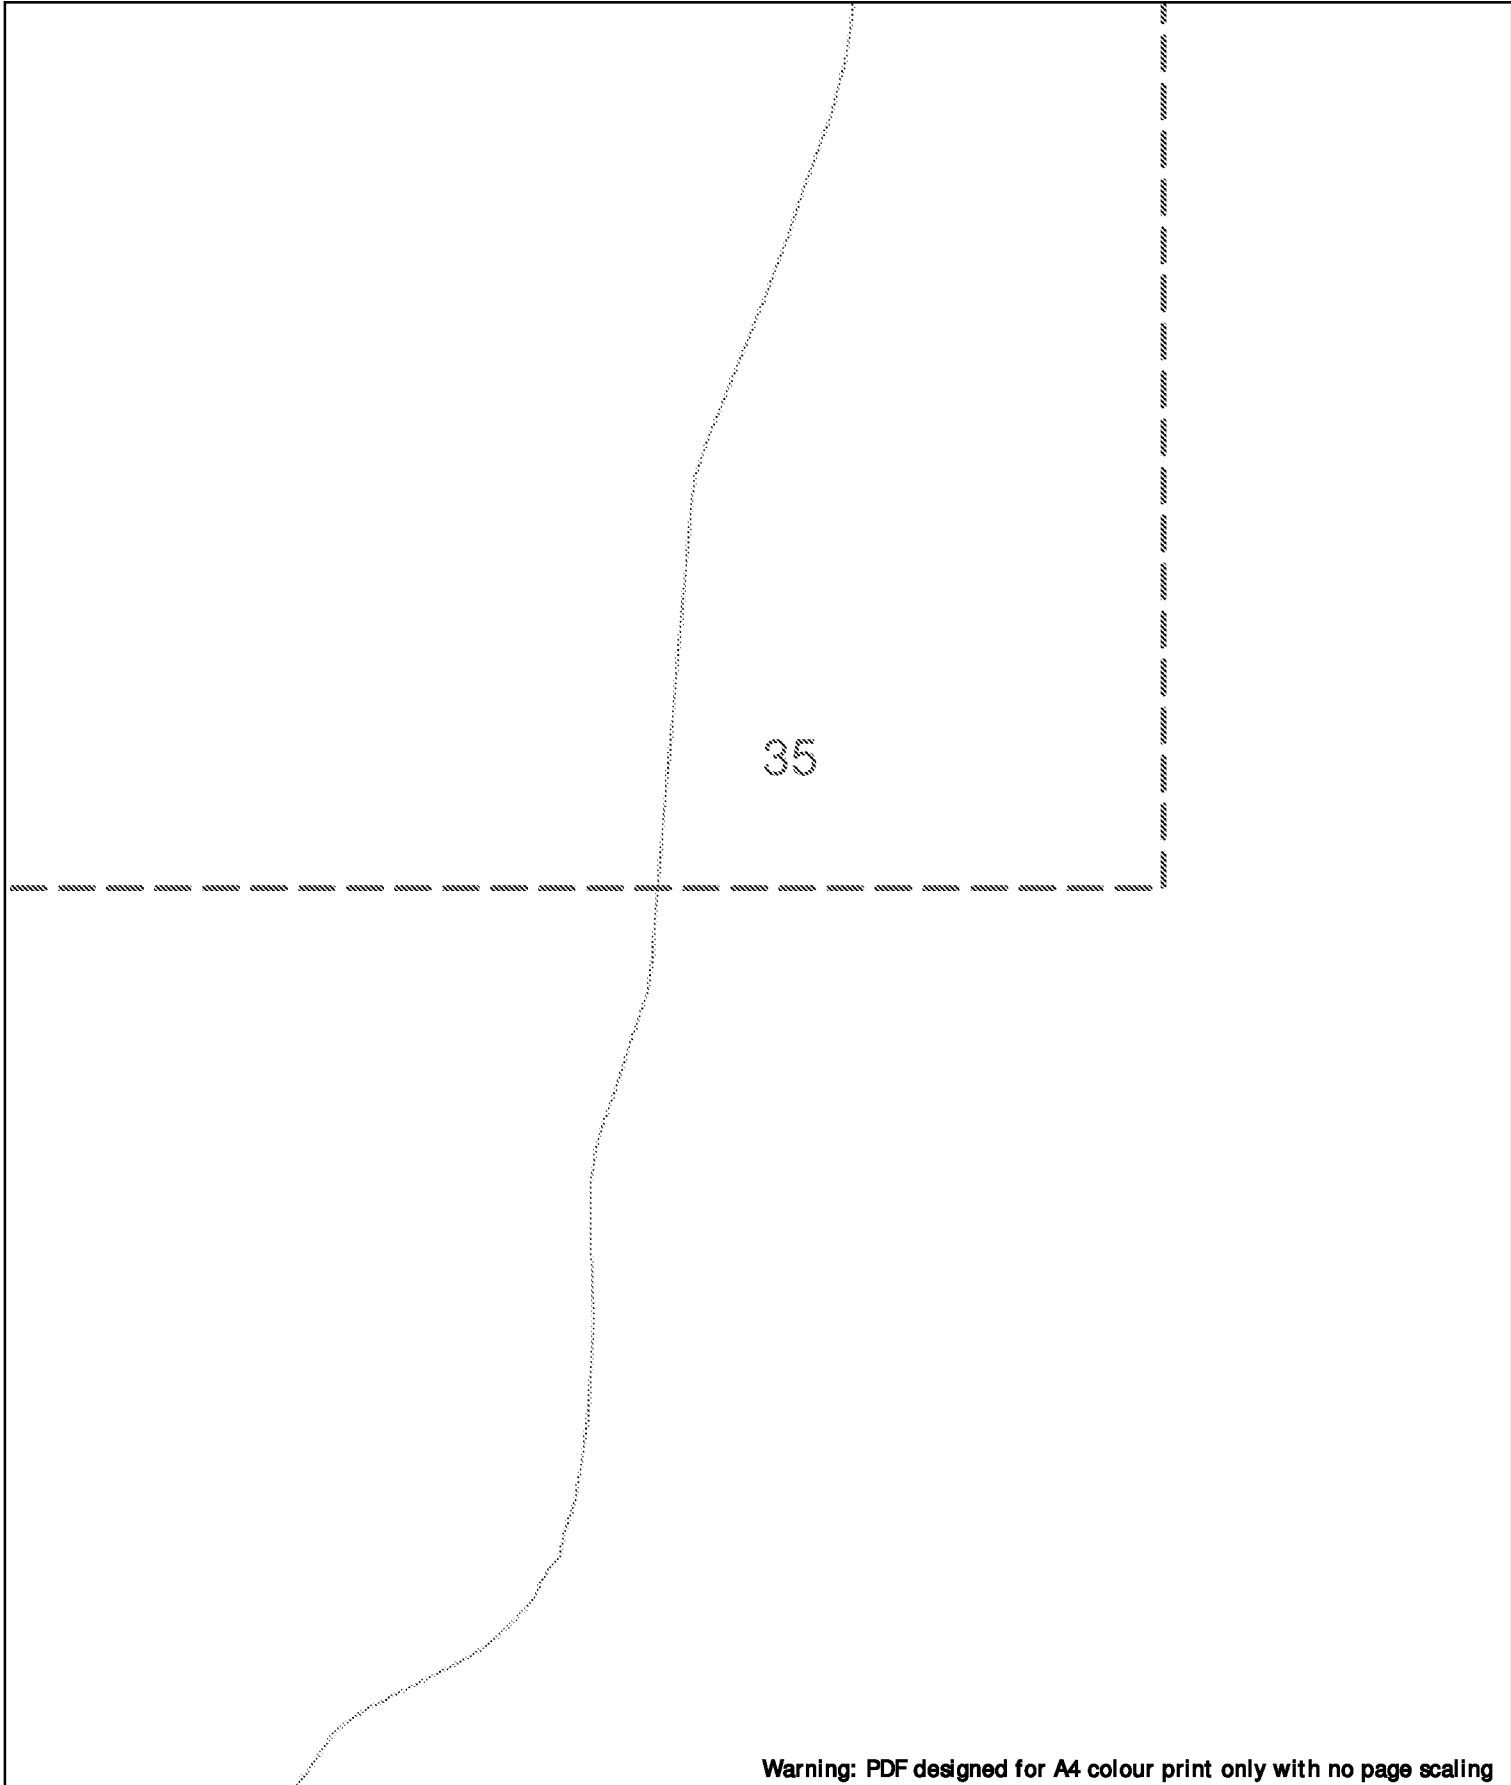

Warning: PDF designed for A4 colour print only with no page scaling

0 20m Dig Sites Area: Line:

Date Requested: 23/ 11/ 2020
Job Reference: 20614304
Site Location: 494129 104180
Requested by: Ms Christina Elliott

Your Scheme/ Reference: LM
90619/ SBS

Scale: 1:500 (When plotted at A4)

Voltages (V)			
LV (Low Voltage) and Services	Up to 1,000V		
HV (High Voltage)	Over 1,000V to 11,000V		
EHV (Extra High Voltage)	22,000V to 132,000V		
Transmission	275,000V and 400,000V		
NORMAL DEPTH TO THE TOP OF THE CABLE WHEN LAID			
Services	LV	HV	EHV
Footpath/unmade	0.45m	0.45m	0.6m
Road Crossing	0.6m	0.6m	0.75m
Agricultural	1m	1m	1.1m

WARNING

From positions based on aerial photography or the satellite based, total water must be considered, to determine width and depth of water. It is not to be used for the design and safety of the structure. It is not to be used for the design and safety of the structure. It is not to be used for the design and safety of the structure.

Scottish and Southern Energy Power Distribution Ltd.
Registered Office: Inverlaimond House,
200 Dunkeld Road, Perth, PH1 3AQ
Registered In Scotland No. SC213459

If you're unsure & need to seek advice before commencing excavations, please contact:
General Enquiries: 0800 048 3516

Subject to revision – Master held by SSEN Asset Data Team:
AssetData@ssen.com
01256 337 294

BASED UPON THE ORDNANCE SURVEY MAP WITH THE SANCTION OF THE CONTROLLER OF HER MAJESTY'S STATIONERY OFFICE. CROWN COPYRIGHT RESERVED.
This map is made by or with the authority of Scottish and Southern Energy Power Distribution Ltd. Pursuant to section 47 of the Copyright, Designs and Patents Act 1988 ("The Act"). Unless the Act provides a relevant exception to copyright, the copy must not be copied without prior permission of the copyright owner.
Plans generated by DigSAFE Pro™ software provided by Linsearchbedford.org.

Watch it!

Safety advice brought to you by Scottish and Southern Electricity Networks

These notes are intended to help all those who have to work in the vicinity of electrical apparatus. Employers have a legal obligation to ensure that their operatives are fully instructed in the correct procedures.

The Electricity at Work Regulations 1989 impose health and safety requirements upon employers, employees and self-employed persons with respect to electricity at work. The regulations impose restrictions on persons being engaged in work activities on or near live conductors.

Regulation 14 requires that: "No person shall be engaged in any work activity on or near any live conductor (other than one suitably covered with insulating material so as to prevent danger) that danger may arise unless:

- ♦ it is **unreasonable** in all circumstances for it to be dead; and
- ♦ it is **reasonable** in all circumstances for him to be at work on or near it while it is live; and
- ♦ suitable precautions (including where necessary the provision of suitable protective equipment) are taken to prevent injury."

The purpose of the regulations is to require precautions to be taken against the risk of death or personal injury from electricity in work activities.

Publications

The Health and Safety Executive have produced a document entitled 'Avoiding Danger from Underground Services', and the Appendix 1 deals specifically with electric cables. Copies are available from the HSE's Accredited Agents and good booksellers, Ref. HS(G) 47.

Copies of Health and Safety Guidance note GS6 relating to safe working in proximity to overhead lines, are available from the Health and Safety Executive's website - www.hse.gov.uk.

Note

In situations of emergency or danger, or where the advice contained in these notes cannot be followed, you must consult Scottish and Southern Electricity Networks immediately. Tel. 0800

Additional copies of these "Watch it!" leaflets can be obtained from our Asset Data Team office upon request.

You must read and accept the following safety notes as part of the contract to receive our network plans. You will have the option to print these and issue them to site staff.

Watch it! - Working in the vicinity of underground cables

Our plans show the positions and normal depths for the buried cables and pipes at the time when they were installed. However, alterations to road alignments surface levels and buildings may have occurred subsequently without our knowledge. If you discover plant or cables that are not marked or incorrectly marked, then you are required to contact us as soon as possible to give us the opportunity to amend our plans.

These plans show the equipment owned by Scottish and Southern Electricity Networks. There may be other privately owned plant in the area, which is outside of our control. You should always check with the Local Authority, National Grid Company, Department of the Environment, other Electricity Companies and other utilities before proceeding.

It is not intended that the issue of these plans will absolve either party from their obligation under any of the acts that control digging in the public highways.

Supplies To Properties, etc.

The location of cables supplying individual properties, street lighting, traffic signs, telephone kiosks etc. are not always shown on the plans. You should assume that each property, streetlight etc. will have its own supply cable.

Major Circuits

Where our plans indicate the presence of cables with a voltage exceeding 11,000 volts, you are advised to contact our local depot (telephone number is on the plans), before commencing any excavations within the vicinity of these cables. These major circuits form an extremely important link in Scottish and Southern Electricity Networks' networks, and damaging or modifying these circuits is a major and costly undertaking. Any development should therefore be designed to allow these circuits to remain undisturbed and accessible in their present location.

For your own and your workmates' safety, please follow the **do's** and **don'ts** listed below:

- do** make sure you have plans of the underground cables in the area **before** any excavation work starts. Remember that some cables may not be shown on plans. If carrying out emergency work, excavate as though there are buried live cables in the vicinity.
- do** use a cable locator to determine the position of existing cables in the work area. The positions should be marked and tests made as work proceeds. **If in doubt, get advice from your supervisor.**
- do** ask for a cable to be made dead if it is buried in concrete.

do backfill carefully, using stone-free soil around the cables, replacing marker-tapes and / or covers.

do notify us immediately if you accidentally damage our cables. Arrange to keep people well clear of a cable that has been damaged until we have confirmed it has been made safe.

do make sure before starting to demolish a building that all cables have been disconnected. We welcome prior notice of the intention to demolish buildings. This enables us to ensure that the site has been made safe electrically.

don't operate a bulldozer, scraper, dragline or excavator; unless you are satisfied that there are no buried cables in the working area.

don't use picks, pins, forks or pointed instruments in soft clay or soil when cables are present. Exercise extreme caution where such instruments are used to free lumps of stone, or break up firmly compacted ground. **Never** throw a fork or sharp instrument into the ground.

don't dig trial holes over the indicated route of the cable. Excavate alongside instead.

don't use exposed cables as a convenient step or handhold.

don't handle or attempt to alter the position of any cable.

Remember that a damaged cable may cause extensive loss of supplies, make expensive repairs necessary and cause serious or even fatal injury.

If effective measures are not adopted to protect our equipment, we will take steps to recover the cost of any damage caused. Persons causing damage resulting in loss of supply to customers can be held legally responsible for any claims made by those customers. Promptness in reporting an incident will minimise costs.

In most cases it is not practicable to make cables dead without interrupting supplies to our customers. But given adequate notice, we will wherever possible, give advice regarding special precautions which may be necessary on any site where particular problems are likely to be encountered. The right is reserved to make a charge for this service.

Electricity cables can exist anywhere - under paths or roads, in gardens or driveways, on new housing or industrial development sites or even farmland.

Watch it! - Working in the vicinity of overhead lines

For your own and your workmates' safety, please follow the **do's** and **don'ts** listed below

do carefully note the position of all overhead lines before commencing work.

do co-operate with us during planning and sitework stages.

do follow the advice given in HSE Guidance Note GS6 when siting barriers, goal posts, bunting etc.

do keep overhead lines in view when moving scaffolding or machinery and take special care when felling or lopping trees.

do remember that the raising or slewing of a crane or excavator jib may cause danger when operating near an overhead line.

do avoid any machinery that is in contact with an overhead line until we confirm that conditions are safe.

do warn others to keep well clear.

don't drive a high vehicle below an overhead line when an alternative route is available.

don't raise the bed of a tipper lorry beneath an overhead line or drive under the line with the body of the vehicle raised.

don't steady any suspended load until you are satisfied that there is no danger from overhead lines.

don't handle or use scaffold platforms, poles, pipes or ladders unless they are at a safe distance from overhead lines.

don't transport long objects beneath overhead lines, unless they are carried in a horizontal position.

don't approach or touch any broken or fallen overhead lines.

Always remember that:

- Electricity can jump gaps.
- Contact or near contact with a crane jib, scaffold or ladder can cause a discharge of electricity with a risk of fatal or severe shock and burns to any person in the vicinity.

If effective measures are not adopted to protect our equipment, we will take steps to recover the cost of any damage caused. Persons causing damage resulting in loss of supply to customers can be held legally responsible for any claims made by those customers. Promptness in reporting an incident will minimise costs.

In most cases it is not practicable to make overhead lines dead without interrupting supplies to customers. However, provided adequate notice is given, then we will, whenever possible, give advice regarding special precautions which may be necessary on site where specific problems may be encountered. The right is reserved to make a charge for this service.

Scottish and Southern Electricity Networks is a trading name of: Scottish and Southern Energy Power Distribution Limited Registered in Scotland No. SC213459; Scottish Hydro Electric Transmission plc Registered in Scotland No. SC213461; Scottish Hydro Electric Power Distribution plc Registered in Scotland No. SC213460 (all having their Registered Offices at Inveralmond House 200 Dunkeld Road Perth PH1 3AQ); and Southern Electric Power Distribution plc Registered in England & Wales No. 04094290 having its Registered Office at No.1 Forbury Place 43 Forbury Road Reading RG1 3JH which are members of the SSE Group www.ssen.co.uk




Scottish & Southern
Electricity Networks

POWER CUT?
CALL 105



GUIDE TO INTERPRETING MAINS RECORDS PLAN

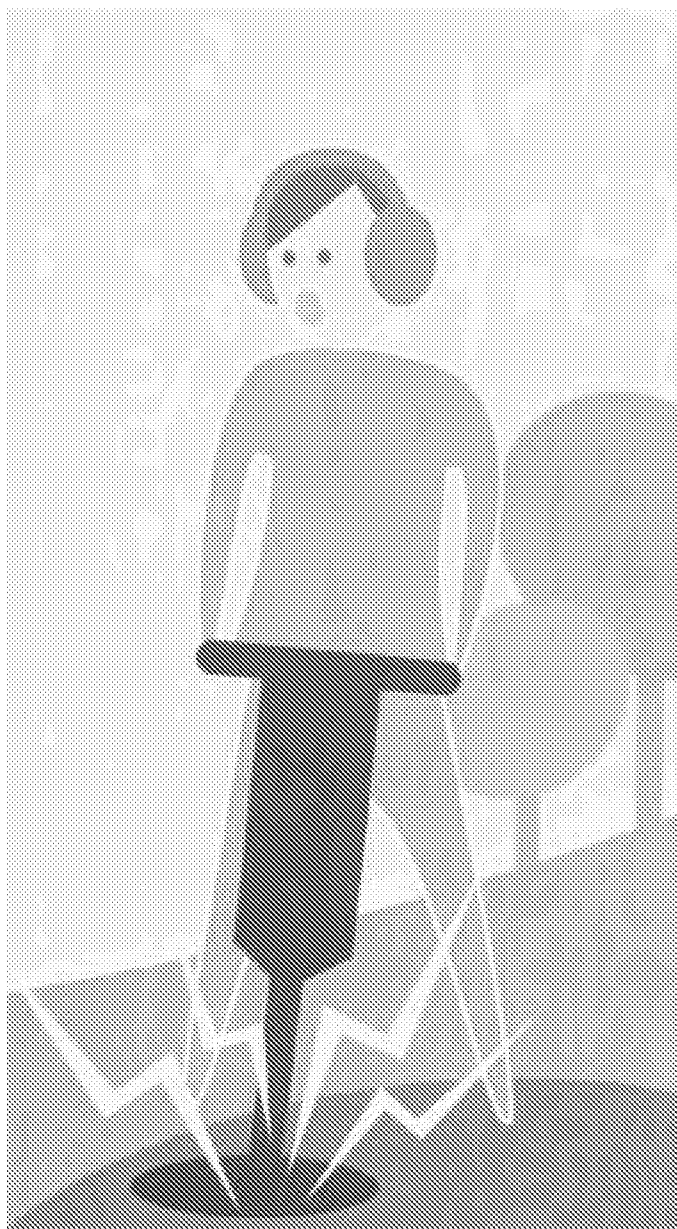

Inveralmond House, 200 Dunkeld Road, Perth PH1 3AQ



Scottish and Southern Electricity Networks is a trading name of: Scottish and Southern Energy Power Distribution Limited Registered in Scotland No. SC213459; Scottish Hydro Electric Transmission plc Registered in Scotland No. SC213461; Scottish Hydro Electric Power Distribution plc Registered in Scotland No. SC213460; (all having their Registered Offices at Inveralmond House 200 Dunkeld Road Perth PH1 3AQ); and Southern Electric Power Distribution plc Registered in England & Wales No. 04094290 having their Registered Office at No. 1 Forbury Place 43 Forbury Road Reading RG1 3JH which are members of the SSE Group www.sse.co.uk



INTRODUCTION

The Health & Safety Executive have produced a document entitled 'Avoiding danger from underground services'. Copies are available from HMSO's accredited agents and good booksellers, Ref HS(G)47, ISBN 0118854925.

WHEN WORKING IN THE VICINITY OF ELECTRICITY CABLES AND OVERHEAD LINES PLEASE FOLLOW THE DO'S & DON'T'S LISTED BELOW.

DO'S

- Do** Make sure that you have plans of the cables in the area before any excavation work starts. Remember that some cables such as service cables may not be shown on the plans. Cables owned by other companies are not shown, e.g. local authorities, Department of the Environment, National Grid Co. etc.
- Do** Make sure that you understand the plans that have been supplied to you. For detailed explanation of the symbols used by Scottish & Southern Electricity Networks refer to this guide & the key shown on the plan
- Do** Use a cable avoidance tool (CAT) to determine the position of the existing cables in the work area. The positions should be clearly marked, and further tests made as work proceeds. **If in doubt, get advice from your supervisor.**
- Do** Hand dig trial holes over the indicated route of the cable, excavate alongside.
- Do** Ask for a cable to be made dead if it is buried in concrete. Please note that this is likely to be a costly process.
- Do** Watch for signs of cables as work progresses, such as marker tapes or cable covers which may be exposed.
- Do** Backfill carefully using stone free soil around cables, replacing marker tapes and covers.



- Do** Ensure that there is maximum clearance above all cable & joints.
- Do** Notify Scottish & Southern Electricity Networks immediately should accidental damage to cables occur however large or small. Arrange to keep people well clear of the cable that has been damaged. Do not backfill an area where cable damage has occurred.

DON'T'S

- Don't** Operate a bulldozer, scraper, dragline or excavator unless you are satisfied that there are no buried cables or overhead lines in the working area.
- Don't** Use picks, forks or pointed instruments in soft clay or soil where cables are present, exercise extreme caution where such instruments are used to free lumps of stone or to break up firmly compacted ground.
- Don't** Use exposed cables as a convenient step or handhold.
- Don't** Handle or attempt to alter the position of any cable.

REMEMBER THAT A DAMAGED CABLE MAY CAUSE EXTENSIVE LOSS OF SUPPLIES, MAKE EXPENSIVE REPAIRS NECESSARY AND CAUSE SERIOUS OR EVEN FATAL INJURY.

IF IN DOUBT ASK SCOTTISH & SOUTHERN ELECTRICITY NETWORKS




UNDERSTANDING THE INFORMATION ON THE PLANS.

AVERAGE DEPTH OF CABLES: Footpaths 0.6 metres
 Road Crossings 0.75metres

NB These depths are only approximate, depths may vary. It should also be noted that surface levels can change subsequent to the cables being laid.

Mains records symbols definitions and examples:

A) Overhead lines & Poles – These are depicted as follows:

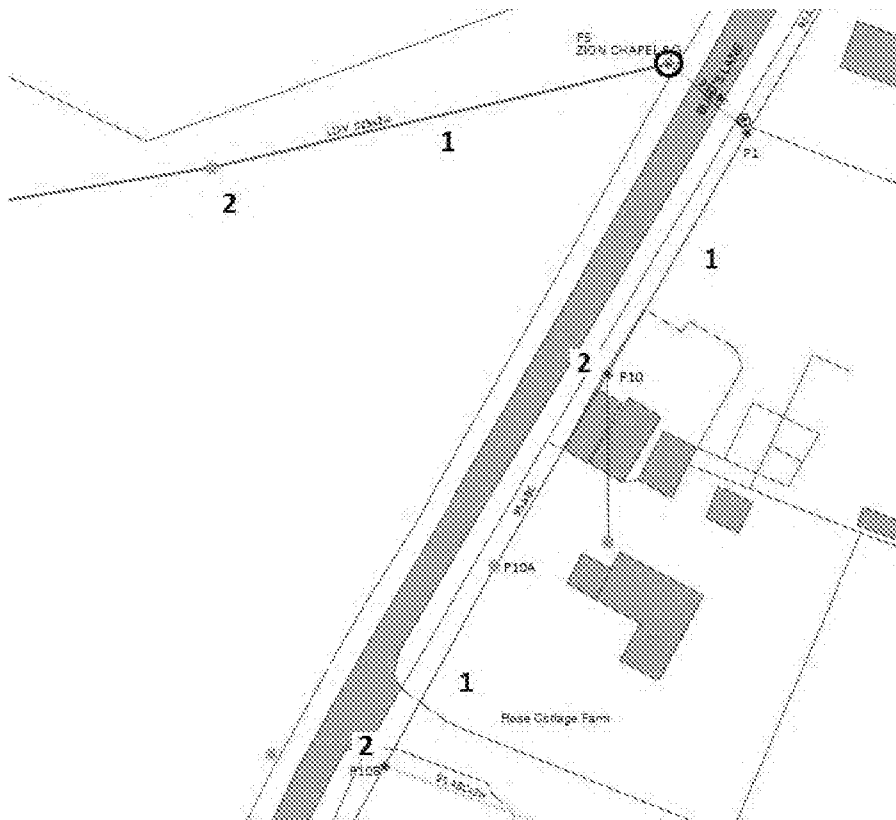

1. Overhead Line – These can be either High Voltage or Low Voltage, colour denotes voltage.
2. Poles.
3. Pole Mounted Transformer.



B) Typical example of Low Voltage cable records:




1. Sub Station
2. Low Voltage Underground cable.
3. Link Boxes: This is a box with a manhole cover marked as belonging to Scottish & Southern Energy containing links. Either two or four cables will lead away from a link box.
4. Straight Joint: This is where two separate cables are joined together.
5. Breech Joint: This is where another cable is attached to the main.
6. Pot End: This is the end of the cable. In certain circumstances service cables to properties can be taken from the pot end. These services may not be shown on the plans.
7. Road crossing duct where a cable is routed under a path or road.
8. Cable terminations/Pole Box: Where underground cables are connected to overhead lines
9. Overhead line.
10. Street Lamps.




11. Services to properties: The service cable to an individual property are not always shown on the mains records that Scottish & Southern Electricity Networks supply. In some cases, a service can be looped from an adjacent property.

C) Typical example of High Voltage cable record.

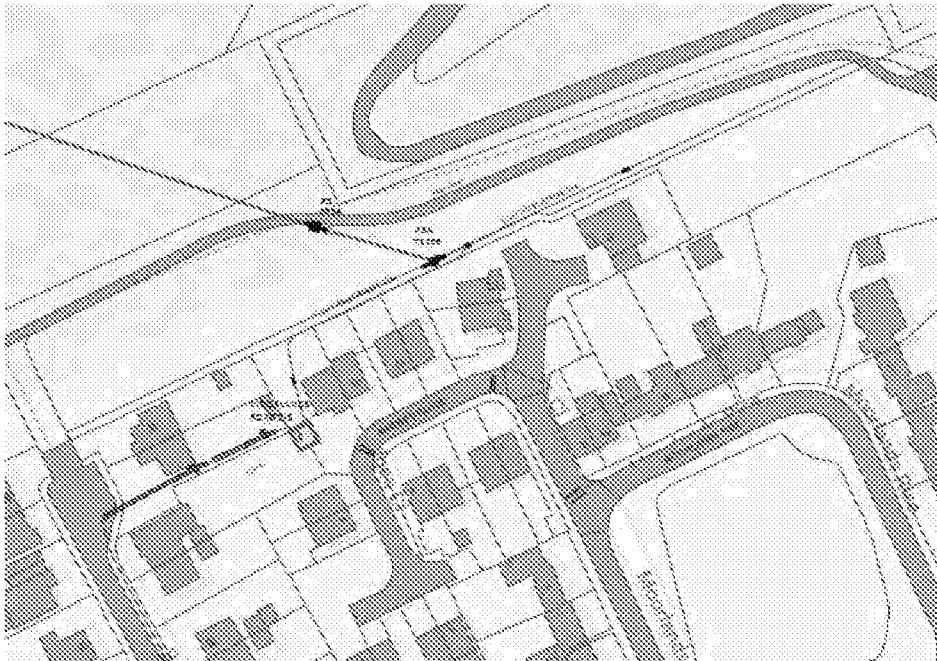

1. Sub Station
2. High Voltage Underground cable – Colour denotes voltage.
3. Straight Joint: This is where two separate cables are joined together.
4. Breech Joint: This is where another cable is attached to the main.
5. Cable terminations/Pole Box: Where underground cables are connected to overhead lines
6. Overhead Switch.

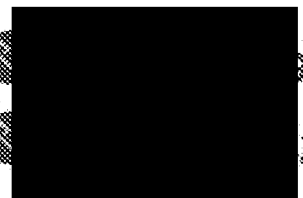

GIS ELECTRIC SYMBOLS

Service cable		Single Poles	
LV Mains		H Poles	
LV Mains and Services (Split Phase)		3 Poles	
2-3.3kV		Tower	
6.6kV		Pole Mounted Transformer	
11kV		Circuit Breaker	
22kV		Switch Disconnecter/ OH Air Break	
33kV		Pole Box	
66kV		Straight Joint	
132kV		Mains Breech Joint (Tee)	
275kV		Service Breech Joint	
320 kV		Trifurcating Joint	
400kV		Pot End	
Fibre Optic		Capped End	
Pilot Cable		Sealing End	



Scottish & Southern
Electricity Networks

POWER CUT?
CALL 105



Assumed Route		Surge Diverters	
Out of Service		Pillar	
Service Connector Joint		Substation	
Overhead Connector		Non Electrical Item	
Wall Box Joint		Street Furniture	
Flying Stay		LV Link Box	
Stay		LV Supply Point	
PME Earth		Oil Pipeline	
Neutral Earth		Gas Pipeline	
Ducting		Areas of Outstanding Natural Beauty	
Pit		National Park	
Embedded Network		Borehole	
Other Network		ASLs	
Water Extraction Point		Sensitive Waterway	



Scottish & Southern
Electricity Networks

POWER CUT?
CALL 105




Source Protection Zone		Site of Special Scientific Interest (SSSI)	
Vulnerability Zone		National Nature Reserve (NNR)	
Access		RAMSAR Special Area of Conservation (SAC)	
Ownership		Special Protection Area (SPA)	
Monuments		Ancient Woodland	
Flood Area		Restricted Access	

'Watch Out, Cables About!'

During the COVID-19 pandemic, construction work and projects across the UK have experienced a period of downtime, affecting the amount of excavation work undertaken. As a result, energy network companies have experienced a welcome reduction in third-party damages to their buried apparatus. In reality, this reduction in damage to underground cables, gas pipelines and other utility equipment, means a reduction in the risk of harm to those involved in the damage.

As lockdown restrictions begin to ease across the UK and work levels increase, it's essential that excavation teams remember the basic safety precautions necessary to ensure they stay safe.

When you are carrying out any excavations or work that involves breaking ground, **be aware of what is buried in the ground before you start. Work out how you are going to locate utility equipment and avoid the risk of damaging it.**

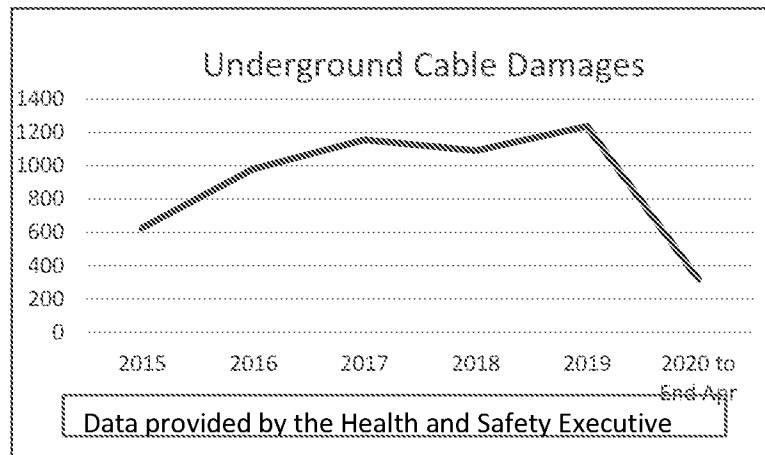

Follow the advice in Health and Safety Executive (HSE) [Guidance HSG47 'Avoiding danger from underground services'](#) and ENA's ['Watch Out, Cables About!'](#) Safety advice leaflet. Complete your risk assessment before starting work and share the details of this with everyone involved in the work. Further guidance and advice is available via the [Utility Strike Avoidance](#) web site:


- Be aware of the location of underground utility equipment before digging or excavating.
- Request location details and plans from Utility Companies well in advance of work starting. Remember that these are a guide only – you are responsible for confirming the exact location of all equipment and avoiding damage.
- Use a cable avoidance tool to identify the presence of buried cables before you start to dig. Rescan the area as your work progresses. Hand Dig — use safe digging techniques to dig trial holes to establish the line and depth of underground utility equipment.
- Always assume underground cables are Live. If they appear to be damaged do not approach them and contact the Network Operator using 105 for GB (or 03457 643 643 in Northern Ireland). Take care when lowering the ground levels as there may be underground cables in the area.
- If you damage an underground cable, vacate the excavation immediately, phone your electricity network operator's emergency number and keep everybody clear.

In an emergency dial **999** and tell them electricity is involved. Call 105 for GB (or 03457 643 643 in Northern Ireland) if you have a safety concern related to the electricity network or if you spot damage to overhead power lines, underground cables and substations that could put you, or someone else, in danger. If you are in any doubt about whether an underground cable or other piece of equipment is safe, always assume it is live, keep away from it and contact your local electricity network operator.

Plan your work safely and help us to keep Britain's energy flowing.

To find the local electricity network operator, search 'electricity distribution map' on the ENA website at

[http://www.electricitydistributionmap.co.uk](#)



Our Ref: 20614304 Your Ref: LM 90619/SBS



Tuesday, 24 November 2020

Christina Elliott
500 Park Avenue Aztec West
Almondsbury
Bristol
BS32 4RZ

Dear Christina Elliott

Thank you for your enquiry dated Tuesday, 24 November 2020

Please find an extract from our mains records for your proposed work area, any SGN assets are described in the map legend. **On some occasions blank maps may be sent to you, this is due to your proposed work being in a no gas area but within our operational boundaries.**

This mains record only shows the pipes owned by SGN in our role as a Licensed Gas Transporter (GT). Please note that privately owned gas pipes or pipes owned by other GTs may be present in this area and information regarding those pipes needs to be requested from the owners. If we know of any other pipes in the area we will note them on the plans as a shaded area and/or a series of x's.

The information shown on this plan is given without obligation or warranty and the accuracy cannot be guaranteed. Service pipes, valves, siphons, stub connections etc. are not shown but their presence should be anticipated. Your attention is drawn to the information and disclaimer on these plans. The information included on the plan is only valid for 28 days.

On the mains record you may see the low/medium/intermediate pressure gas main near your site. There should be no mechanical excavations taking place above or within 0.5m of a low/medium pressure system or above or within 3.0m of an intermediate pressure system. You should, where required confirm the position using hand dug trial holes.

A colour copy of these plans and the gas safety advice booklet enclosed should be passed to the senior person on site in order to prevent damage to our plant and potential direct or consequential costs to your organisation.

Safe digging practices in accordance with HSE publication HSG47 "Avoiding Danger from Underground Services" must be used to verify and establish the actual position of the mains, pipes, services and other apparatus on site before any mechanical plant is used. It is your responsibility to ensure that this information is provided to all relevant people (direct labour or contractors) working for you on or near gas pipes.

It must be stressed that both direct and consequential damage to gas plant can be dangerous for your employees and the general public and repairs to any such damage will incur a charge to you or the organisation carrying out work on your behalf. Your works should be carried out in such a manner that we are able to gain access to our apparatus throughout the duration of your operations.


If you require any further information please do not hesitate to contact us.

Yours sincerely,
The Safety Admin Team
For more information, visit our Dig Safely pages on sgn.co.uk

Smell gas?

SGN is a brand name of Scotia Gas Networks Limited
Registered in England & Wales No. 04958135
Registered Office: St Lawrence House | Station Approach | Horley | Surrey RH6 8HJ

Authorized and regulated by the Financial Conduct Authority

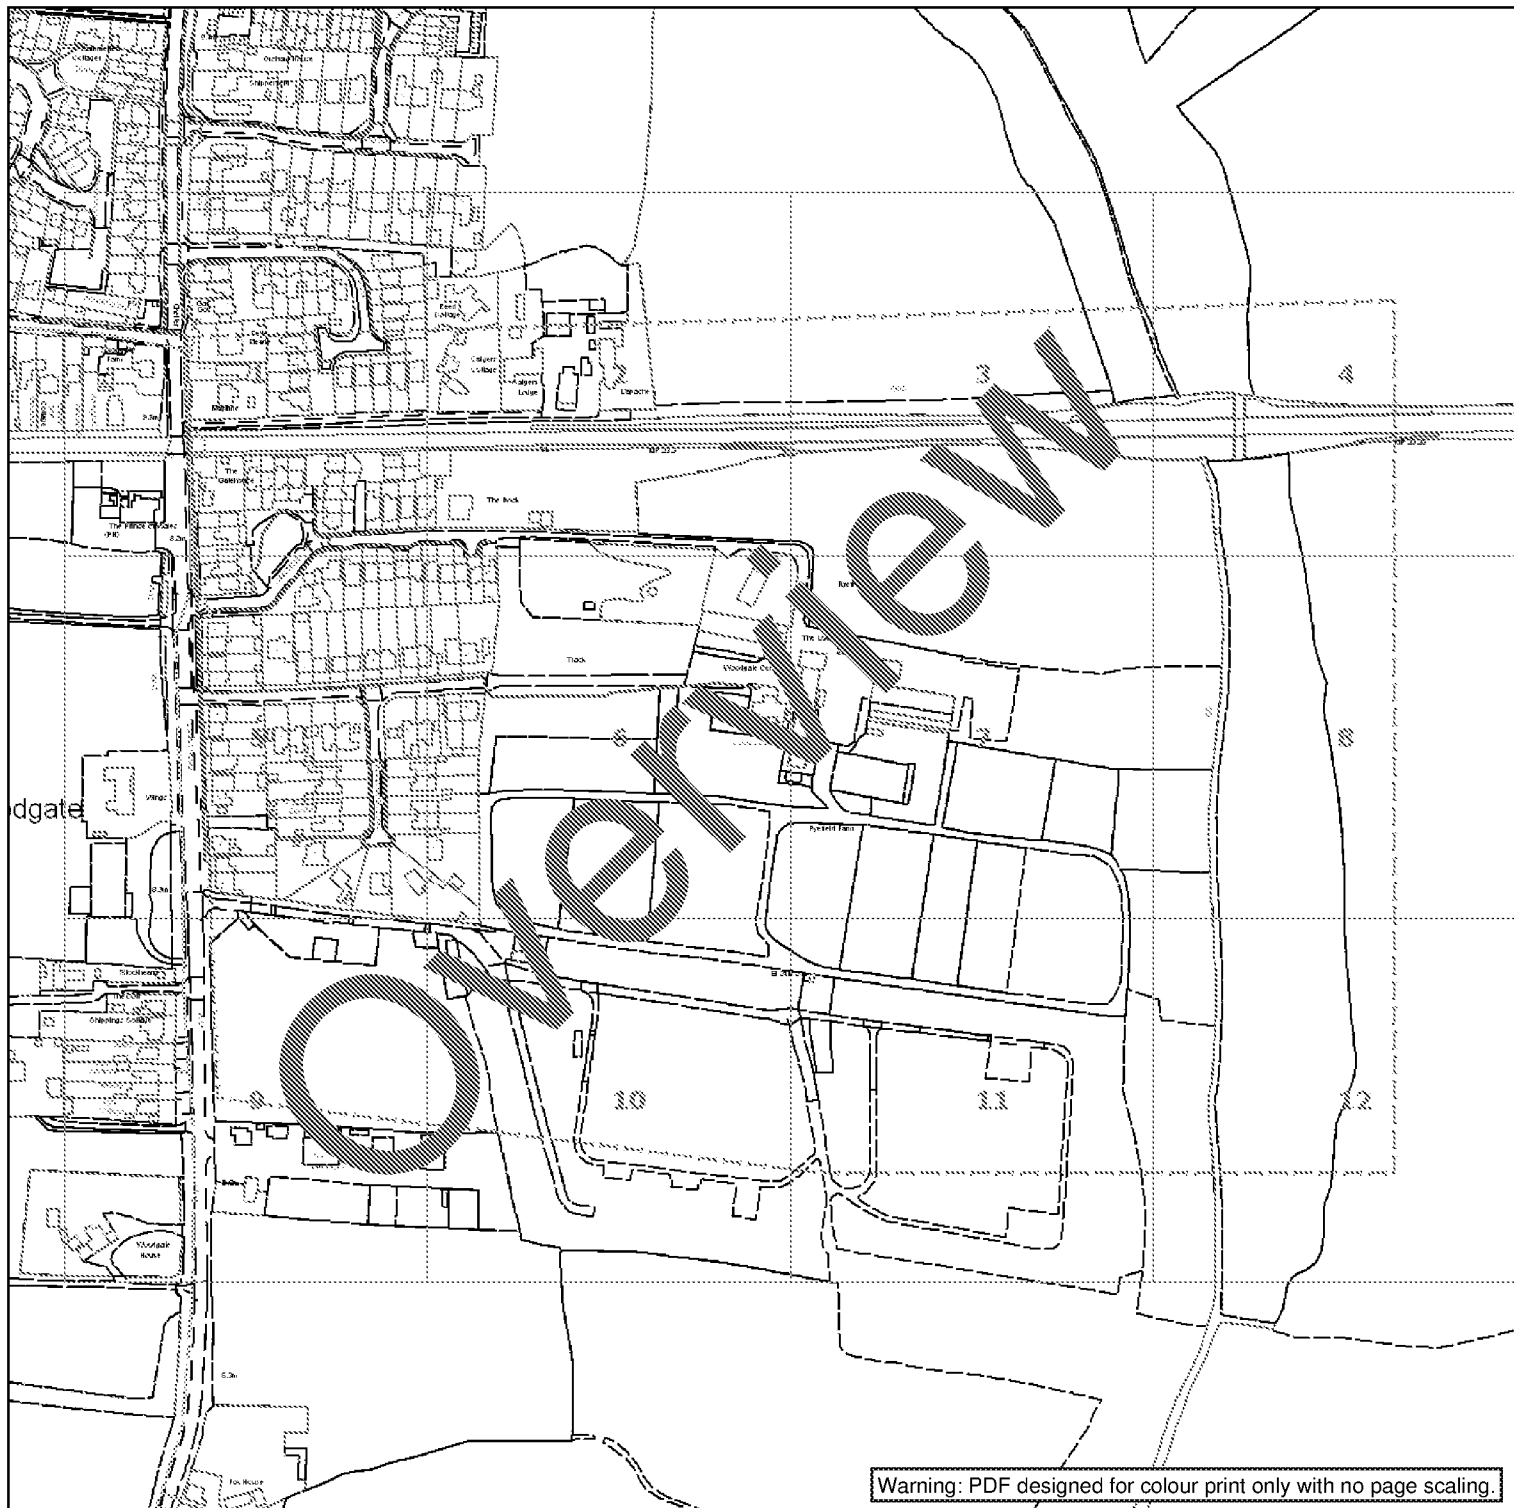

Warning: PDF designed for colour print only with no page scaling.



Contact Us

SGN Safety Admin Team:
0800 912 1722
Email:
plantlocation@sgn.co.uk

Low Pressure Mains

Medium Pressure Mains

Intermediate Pressure Mains

High Pressure Mains

Some Examples Of Plant Items

Valve

Syphon

Depth of Cover

Digsite:

Line:

Area:


LAS

GTs


SSSIs

Diameter Change

Material Change



This information is given as a guide only and its accuracy cannot be guaranteed.



This plan shows the location of those pipes owned by Scotia Gas Networks (SGN) by virtue of being a licensed Gas Transporter (GT). Gas pipes owned by other GTs or third parties may also be present in this area but are not shown on this plan. Information with regard to such pipes should be obtained from the relevant owners. No warranties are given with regard to the accuracy of the information shown on this plan. Service pipes, valves, siphons, sub-connections etc. are not shown but their presence should be anticipated. You should be aware that a small percentage of our pipes/assets may be undergoing review and will temporarily be highlighted in yellow. If your proposed works are close to one of these pipes, you should contact the SGN Safety Admin Team on 0800 912 1722 for advice. No liability of any kind whatsoever is accepted by SGN or its agents, servants or sub-contractors for any error or omission contained herein. Safe digging practices, in accordance with HS (G)47, must be used to verify and establish the actual position of mains, pipes, services and other apparatus on site before any mechanical plant is used. It is your responsibility to ensure that plant location information is provided to all persons (whether direct labour or sub-contractors) working for you on or near gas apparatus. Information included on this plan should not be referred to beyond a period of 28 days from the date of issue.

Report damage immediately -- KEEP EVERYONE AWAY FROM THE AREA
0800 111 999

This plan is reproduced from or based on the OS map by Scotia Gas Networks plc, with the sanction of the controller of HM Stationery Office. Crown Copyright Reserved. Southern Gas -- 100044373 and Scotland Gas -- 100044366.



Contact Us

SGN Safety Admin Team:
0800 912 1722
Email:
plantlocation@sgn.co.uk

Low Pressure Mains

Medium Pressure Mains

Intermediate Pressure Mains

High Pressure Mains

Some Examples Of Plant Items

Valve

Syphon

Depth of Cover

Digsite:

Line:

Area:

LAS

GTs

Diameter Change


Area:

LAS


GTs

Diameter Change

Material Change



This information is given as a guide only and its accuracy cannot be guaranteed.



This plan shows the location of those pipes owned by Scotia Gas Networks (SGN) by virtue of being a licensed Gas Transporter (GT). Gas pipes owned by other GTs or third parties may also be present in this area but are not shown on this plan. Information with regard to such pipes should be obtained from the relevant owners. No warranties are given with regard to the accuracy of the information shown on this plan. Service pipes, valves, siphons, sub-connections etc. are not shown but their presence should be anticipated. You should be aware that a small percentage of our pipes/assets may be undergoing review and will temporarily be highlighted in yellow. If your proposed works are close to one of these pipes, you should contact the SGN Safety Admin Team on 0800 912 1722 for advice. No liability of any kind whatsoever is accepted by SGN or its agents, servants or sub-contractors for any error or omission contained herein. Safe digging practices, in accordance with HS (G)47, must be used to verify and establish the actual position of mains, pipes, services and other apparatus on site before any mechanical plant is used. It is your responsibility to ensure that plant location information is provided to all persons (whether direct labour or sub-contractors) working for you on or near gas apparatus. Information included on this plan should not be referred to beyond a period of 28 days from the date of issue.

Report damage immediately -- KEEP EVERYONE AWAY FROM THE AREA

0800 111 999

This plan is reproduced from or based on the OS map by Scotia Gas Networks plc, with the sanction of the controller of HM Stationery Office. Crown Copyright Reserved. Southern Gas -- 100044373 and Scotland Gas -- 100044366.

Plans generated by DigSAFE Pro (tm) software provided by LineasearchbeforeUdig

Date Requested: 24/11/2020
Job Reference: 20614304
Site Location: 494125 104164
Requested by:
Ms Christina Elliott
Your Scheme/Reference:
LM 90619/SBS

Exact Scales:
1:1000 Area or Circle dig site
1:1000 Line dig site



Warning: PDF designed for colour print only with no page scaling.



Contact Us

SGN Safety Admin Team:
0800 912 1722
Email:
plantlocation@sgn.co.uk

Low Pressure Mains

Medium Pressure Mains

Intermediate Pressure Mains

High Pressure Mains

Some Examples Of Plant Items

Valve



Syphon



Depth of Cover



Digsite:

Line:

Area:

LAS

GTs




SSSIs




Diameter Change



Material Change



This information is given as a guide only and its accuracy cannot be guaranteed.



This plan shows the location of those pipes owned by Scotia Gas Networks (SGN) by virtue of being a licensed Gas Transporter (GT). Gas pipes owned by other GTs or third parties may also be present in this area but are not shown on this plan. Information with regard to such pipes should be obtained from the relevant owners. No warranties are given with regard to the accuracy of the information shown on this plan. Service pipes, valves, siphons, sub-connections etc. are not shown but their presence should be anticipated. You should be aware that a small percentage of our pipes/assets may be undergoing review and will temporarily be highlighted in yellow. If your proposed works are close to one of these pipes, you should contact the SGN Safety Admin Team on 0800 912 1722 for advice. No liability of any kind whatsoever is accepted by SGN or its agents, servants or sub-contractors for any error or omission contained herein. Safe digging practices, in accordance with HS (G)47, must be used to verify and establish the actual position of mains, pipes, services and other apparatus on site before any mechanical plant is used. It is your responsibility to ensure that plant location information is provided to all persons (whether direct labour or sub-contractors) working for you on or near gas apparatus. Information included on this plan should not be referred to beyond a period of 28 days from the date of issue.

Report damage immediately -- KEEP EVERYONE AWAY FROM THE AREA


0800 111 999

This plan is reproduced from or based on the OS map by Scotia Gas Networks plc, with the sanction of the controller of HM Stationery Office. Crown Copyright Reserved. Southern Gas -- 100044373 and Scotland Gas -- 100044366.

Plans generated by DigSAFE Pro (tm) software provided by LineasearchbeforeUdig

Date Requested: 24/11/2020
Job Reference: 20614304
Site Location: 494125 104164
Requested by:
Ms Christina Elliott
Your Scheme/Reference:
LM 90619/SBS

Exact Scales:
1:1000 Area or Circle dig site
1:1000 Line dig site

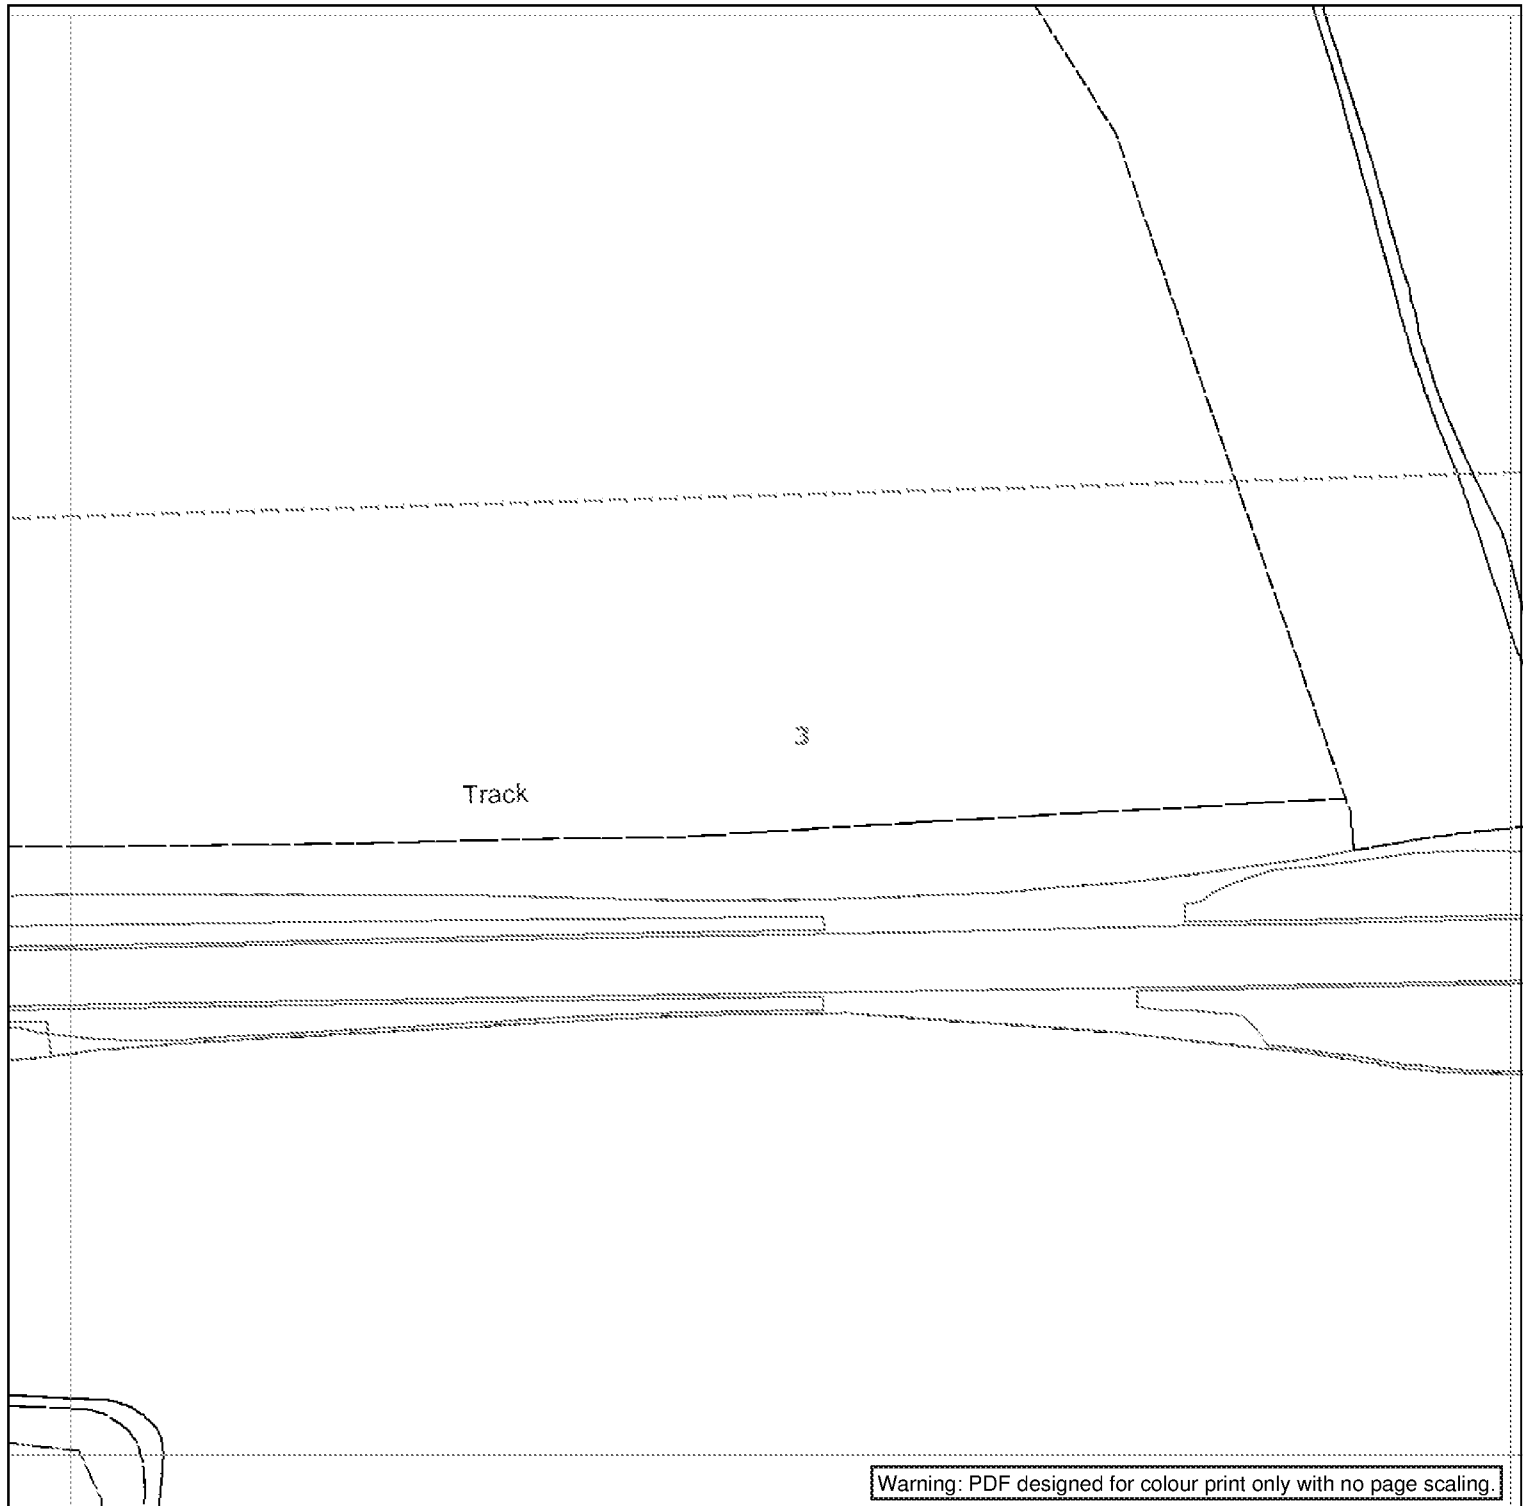

Warning: PDF designed for colour print only with no page scaling.



Contact Us

SGN Safety Admin Team:
0800 912 1722
Email:
plantlocation@sgn.co.uk

Low Pressure Mains

Medium Pressure Mains

Intermediate Pressure Mains

High Pressure Mains

Some Examples Of Plant Items

Valve



Syphon



Depth of Cover



Diameter Change



Material Change



Digsite:


Line:

Area:


LAS

GTs

SSSIs



This information is given as a guide only and its accuracy cannot be guaranteed.




This plan shows the location of those pipes owned by Scotia Gas Networks (SGN) by virtue of being a licensed Gas Transporter (GT). Gas pipes owned by other GTs or third parties may also be present in this area but are not shown on this plan. Information with regard to such pipes should be obtained from the relevant owners. No warranties are given with regard to the accuracy of the information shown on this plan. Service pipes, valves, siphons, sub-connections etc. are not shown but their presence should be anticipated. You should be aware that a small percentage of our pipes/assets may be undergoing review and will temporarily be highlighted in yellow. If your proposed works are close to one of these pipes, you should contact the SGN Safety Admin Team on 0800 912 1722 for advice. No liability of any kind whatsoever is accepted by SGN or its agents, servants or sub-contractors for any error or omission contained herein. Safe digging practices, in accordance with HS (G)47, must be used to verify and establish the actual position of mains, pipes, services and other apparatus on site before any mechanical plant is used. It is your responsibility to ensure that plant location information is provided to all persons (whether direct labour or sub-contractors) working for you on or near gas apparatus. Information included on this plan should not be referred to beyond a period of 28 days from the date of issue.

Report damage immediately -- KEEP EVERYONE AWAY FROM THE AREA
0800 111 999

This plan is reproduced from or based on the OS map by Scotia Gas Networks plc, with the sanction of the controller of HM Stationery Office. Crown Copyright Reserved. Southern Gas – 100044373 and Scotland Gas – 100044366.

Date Requested: 24/11/2020
Job Reference: 20614304
Site Location: 494125 104164
Requested by:
Ms Christina Elliott
Your Scheme/Reference:
LM 90619/SBS

Exact Scales:
1:1000 Area or Circle dig site
1:1000 Line dig site

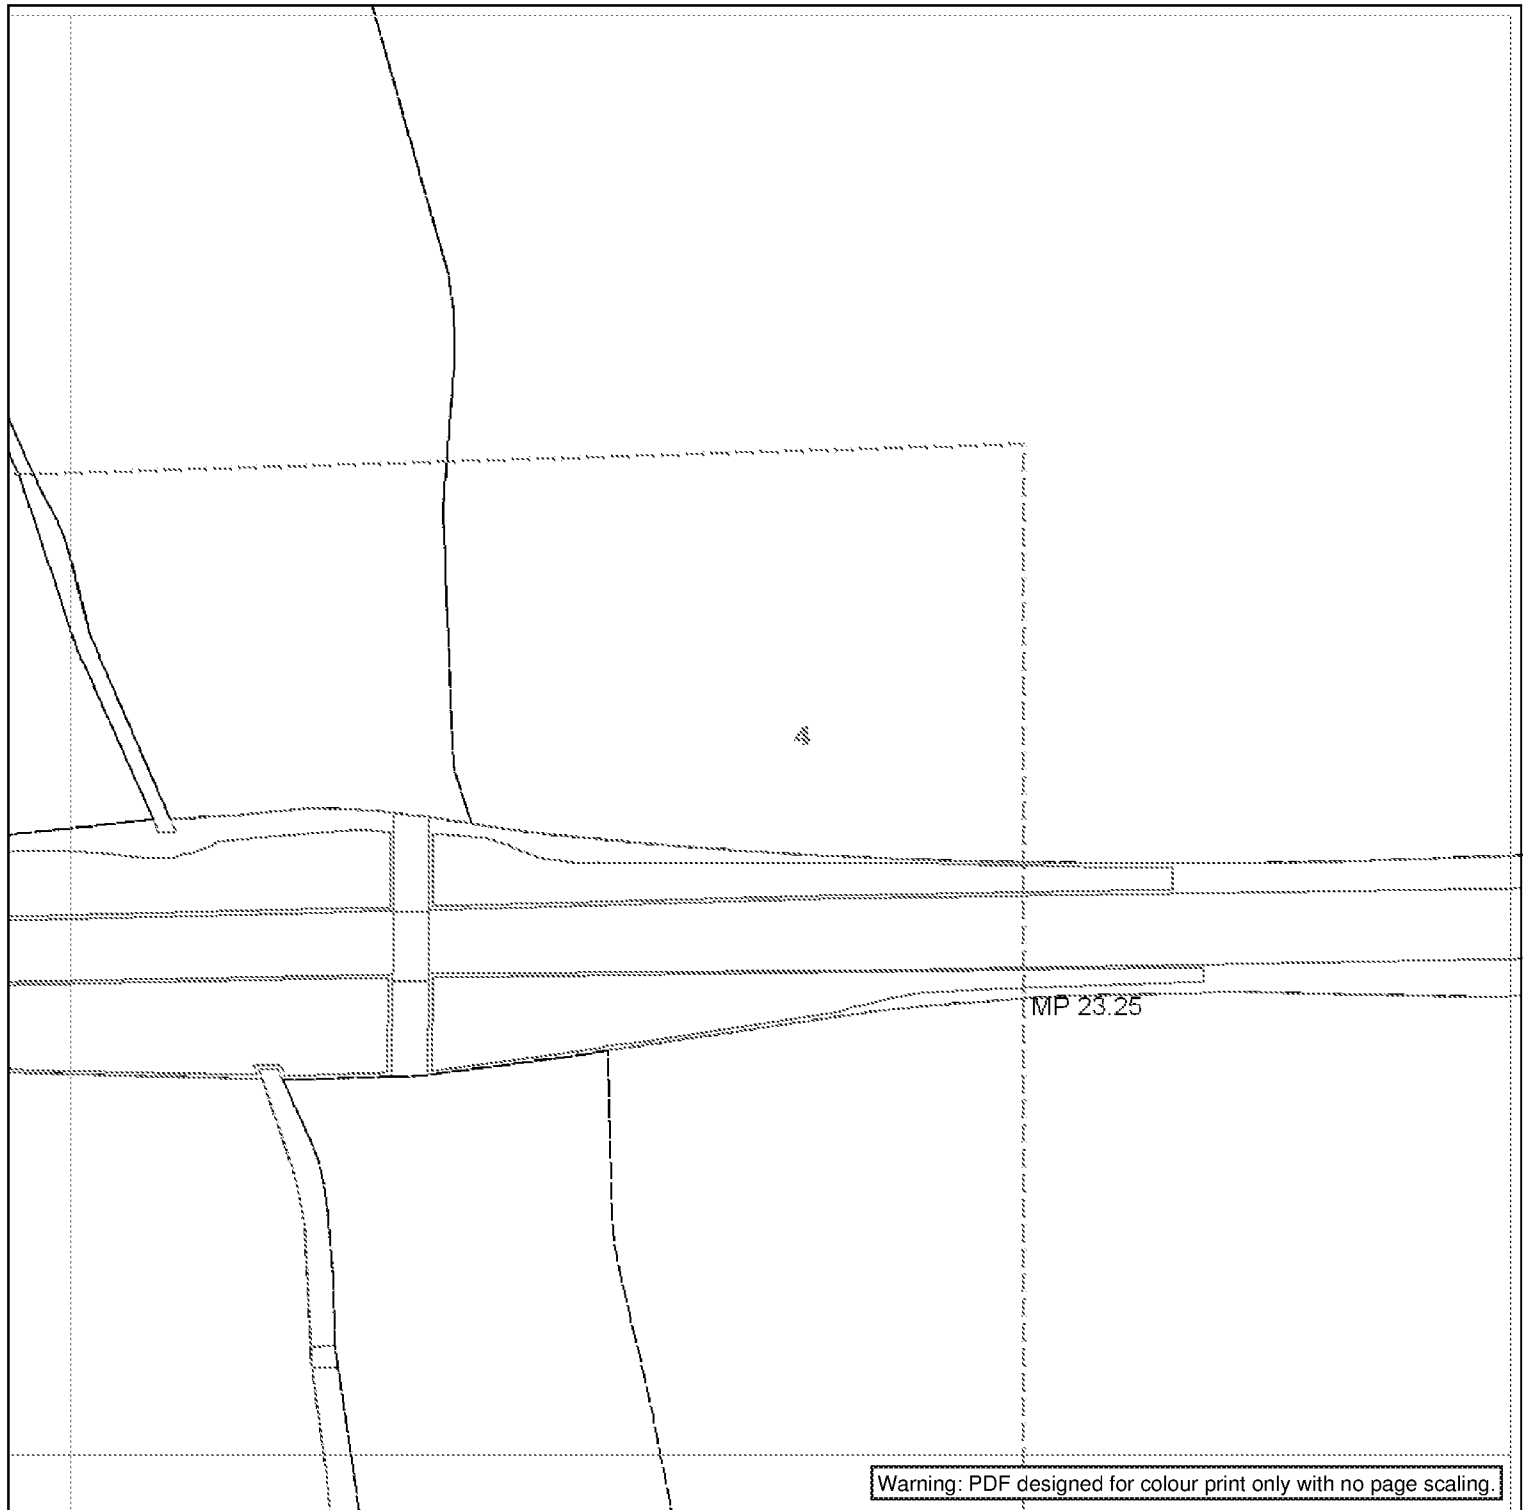

Warning: PDF designed for colour print only with no page scaling.



Contact Us

SGN Safety Admin Team:
0800 912 1722
Email:
plantlocation@sgn.co.uk

Low Pressure Mains

Medium Pressure Mains

Intermediate Pressure Mains

High Pressure Mains

Some Examples Of Plant Items

Valve



Syphon



Depth of
Cover



LAS

GTs

SSSIs

Material
Change



Diameter
Change



Material
Change



Material
Change



Material
Change



Material
Change




Material
Change




Material
Change



Material
Change



This information is given as a guide only and its accuracy cannot be guaranteed.



This plan shows the location of those pipes owned by Scotia Gas Networks (SGN) by virtue of being a licensed Gas Transporter (GT). Gas pipes owned by other GTs or third parties may also be present in this area but are not shown on this plan. Information with regard to such pipes should be obtained from the relevant owners. No warranties are given with regard to the accuracy of the information shown on this plan. Service pipes, valves, siphons, sub-connections etc. are not shown but their presence should be anticipated. You should be aware that a small percentage of our pipes/assets may be undergoing review and will temporarily be highlighted in yellow. If your proposed works are close to one of these pipes, you should contact the SGN Safety Admin Team on 0800 912 1722 for advice. No liability of any kind whatsoever is accepted by SGN or its agents, servants or sub-contractors for any error or omission contained herein. Safe digging practices, in accordance with HS (G)47, must be used to verify and establish the actual position of mains, pipes, services and other apparatus on site before any mechanical plant is used. It is your responsibility to ensure that plant location information is provided to all persons (whether direct labour or sub-contractors) working for you on or near gas apparatus. Information included on this plan should not be referred to beyond a period of 28 days from the date of issue.

Report damage immediately -- KEEP EVERYONE AWAY FROM THE AREA


0800 111 999

This plan is reproduced from or based on the OS map by Scotia Gas Networks plc, with the sanction of the controller of HM Stationery Office. Crown Copyright Reserved. Southern Gas -- 100044373 and Scotland Gas -- 100044366.

Plans generated by DigSAFE Pro (tm) software provided by LinesearchbeforeUdig

Date Requested: 24/11/2020
Job Reference: 20614304
Site Location: 494125 104164
Requested by:
Ms Christina Elliott
Your Scheme/Reference:
LM 90619/SBS

Exact Scales:
1:1000 Area or Circle dig site
1:1000 Line dig site

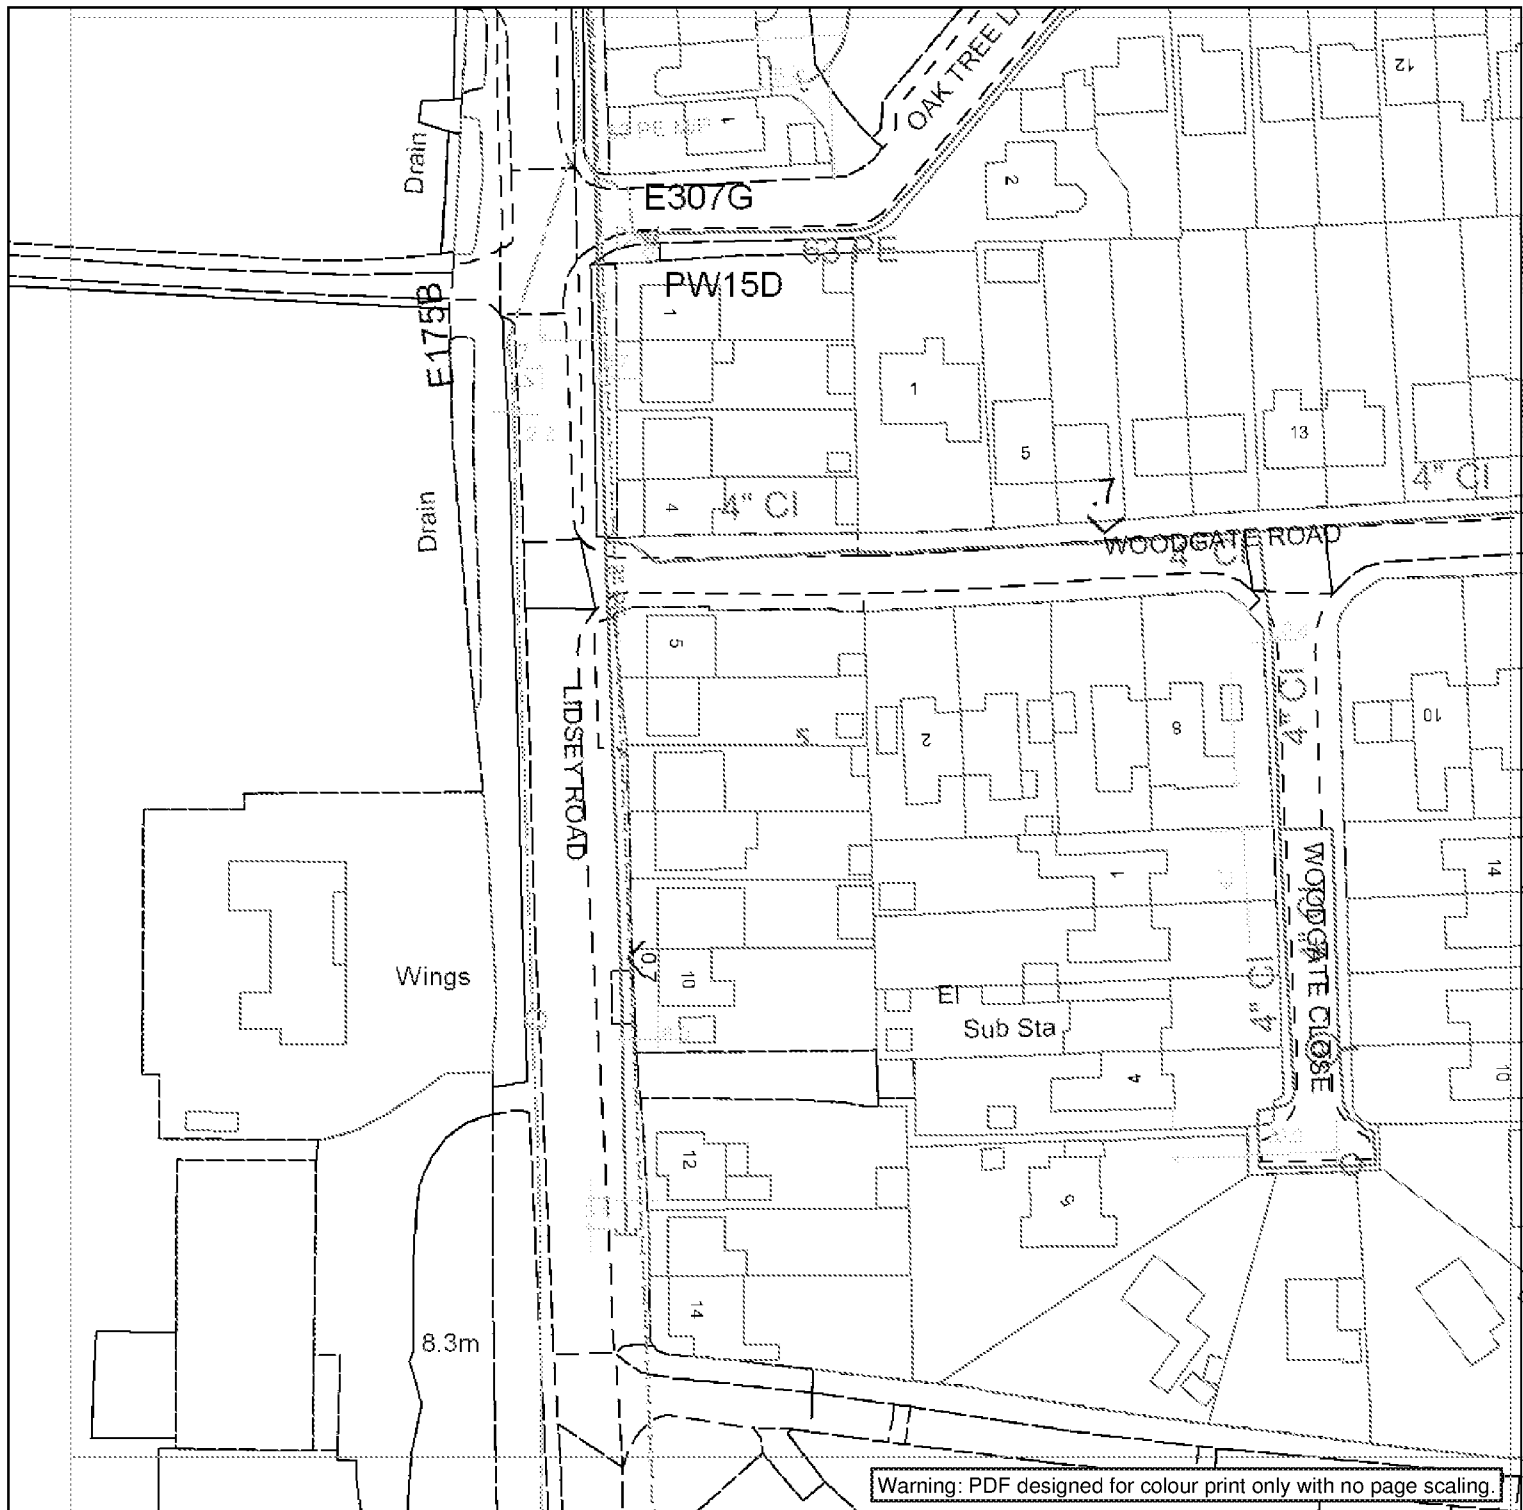

Warning: PDF designed for colour print only with no page scaling.



Contact Us

SGN Safety Admin Team:
0800 912 1722
Email:
plantlocation@sgn.co.uk

Low Pressure Mains

Medium Pressure Mains

Intermediate Pressure Mains

High Pressure Mains

Some Examples Of Plant Items

Valve

Syphon

Depth of Cover

Digsite:

Line:

Area:


LAS

GTs


SSSIs

Diameter Change

Material Change



This information is given as a guide only and its accuracy cannot be guaranteed.



This plan shows the location of those pipes owned by Scotia Gas Networks (SGN) by virtue of being a licensed Gas Transporter (GT). Gas pipes owned by other GTs or third parties may also be present in this area but are not shown on this plan. Information with regard to such pipes should be obtained from the relevant owners. No warranties are given with regard to the accuracy of the information shown on this plan. Service pipes, valves, siphons, sub-connections etc. are not shown but their presence should be anticipated. You should be aware that a small percentage of our pipes/assets may be undergoing review and will temporarily be highlighted in yellow. If your proposed works are close to one of these pipes, you should contact the SGN Safety Admin Team on 0800 912 1722 for advice. No liability of any kind whatsoever is accepted by SGN or its agents, servants or sub-contractors for any error or omission contained herein. Safe digging practices, in accordance with HS (G)47, must be used to verify and establish the actual position of mains, pipes, services and other apparatus on site before any mechanical plant is used. It is your responsibility to ensure that plant location information is provided to all persons (whether direct labour or sub-contractors) working for you on or near gas apparatus. Information included on this plan should not be referred to beyond a period of 28 days from the date of issue.

Report damage immediately -- KEEP EVERYONE AWAY FROM THE AREA

0800 111 999

This plan is reproduced from or based on the OS map by Scotia Gas Networks plc, with the sanction of the controller of the HM Stationery Office. Crown Copyright Reserved. Southern Gas -- 100044373 and Scotland Gas -- 100044366.

Plans generated by DigSAFE Pro (tm) software provided by LinesearchbeforeUdig

Date Requested: 24/11/2020
Job Reference: 20614304
Site Location: 494125 104164
Requested by:
Ms Christina Elliott
Your Scheme/Reference:
LM 90619/SBS

Exact Scales:
1:1000 Area or Circle dig site
1:1000 Line dig site



Warning: PDF designed for colour print only with no page scaling.



Contact Us

SGN Safety Admin Team:
0800 912 1722
Email:
plantlocation@sgn.co.uk

Low Pressure Mains

Medium Pressure Mains

Intermediate Pressure Mains

High Pressure Mains

Some Examples Of Plant Items

Valve



Syphon



Depth of Cover



Digsite:

Line:

LAS

GTs




SSSIs




Diameter Change



Material Change



This information is given as a guide only and its accuracy cannot be guaranteed.



This plan shows the location of those pipes owned by Scotia Gas Networks (SGN) by virtue of being a licensed Gas Transporter (GT). Gas pipes owned by other GTs or third parties may also be present in this area but are not shown on this plan. Information with regard to such pipes should be obtained from the relevant owners. No warranties are given with regard to the accuracy of the information shown on this plan. Service pipes, valves, siphons, sub-connections etc. are not shown but their presence should be anticipated. You should be aware that a small percentage of our pipes/assets may be undergoing review and will temporarily be highlighted in yellow. If your proposed works are close to one of these pipes, you should contact the SGN Safety Admin Team on 0800 912 1722 for advice. No liability of any kind whatsoever is accepted by SGN or its agents, servants or sub-contractors for any error or omission contained herein. Safe digging practices, in accordance with HS (G)47, must be used to verify and establish the actual position of mains, pipes, services and other apparatus on site before any mechanical plant is used. It is your responsibility to ensure that plant location information is provided to all persons (whether direct labour or sub-contractors) working for you on or near gas apparatus. Information included on this plan should not be referred to beyond a period of 28 days from the date of issue.

Report damage immediately -- KEEP EVERYONE AWAY FROM THE AREA

0800 111 999

This plan is reproduced from or based on the OS map by Scotia Gas Networks plc, with the sanction of the controller of the controller of HM Stationery Office. Crown Copyright Reserved. Southern Gas -- 100044373 and Scotland Gas -- 100044366.

Plans generated by DigSAFE Pro (tm) software provided by LinesearchbeforeUdig

Date Requested: 24/11/2020
Job Reference: 20614304
Site Location: 494125 104164
Requested by:
Ms Christina Elliott
Your Scheme/Reference:
LM 90619/SBS

Exact Scales:
1:1000 Area or Circle dig site
1:1000 Line dig site

Ryefield Farmhouse

The Lodge

3 meter

Ryefield Farm

Warning: PDF designed for colour print only with no page scaling.



Contact Us

SGN Safety Admin Team:
0800 912 1722
Email:
plantlocation@sgn.co.uk

Low Pressure Mains

Medium Pressure Mains

Intermediate Pressure Mains

High Pressure Mains

Some Examples Of Plant Items

Valve



Syphon



Depth of Cover



Digsite:

Line:

Area:

LAS

GTs




SSSIs




Diameter Change



Material Change



This information is given as a guide only and its accuracy cannot be guaranteed.



This plan shows the location of those pipes owned by Scotia Gas Networks (SGN) by virtue of being a licensed Gas Transporter (GT). Gas pipes owned by other GTs or third parties may also be present in this area but are not shown on this plan. Information with regard to such pipes should be obtained from the relevant owners. No warranties are given with regard to the accuracy of the information shown on this plan. Service pipes, valves, siphons, sub-connections etc. are not shown but their presence should be anticipated. You should be aware that a small percentage of our pipes/assets may be undergoing review and will temporarily be highlighted in yellow. If your proposed works are close to one of these pipes, you should contact the SGN Safety Admin Team on 0800 912 1722 for advice. No liability of any kind whatsoever is accepted by SGN or its agents, servants or sub-contractors for any error or omission contained herein. Safe digging practices, in accordance with HS (G)47, must be used to verify and establish the actual position of mains, pipes, services and other apparatus on site before any mechanical plant is used. It is your responsibility to ensure that plant location information is provided to all persons (whether direct labour or sub-contractors) working for you on or near gas apparatus. Information included on this plan should not be referred to beyond a period of 28 days from the date of issue.

Report damage immediately -- KEEP EVERYONE AWAY FROM THE AREA


0800 111 999

This plan is reproduced from or based on the OS map by Scotia Gas Networks plc, with the sanction of the controller of HM Stationery Office. Crown Copyright Reserved. Southern Gas -- 100044373 and Scotland Gas -- 100044366.

Plans generated by DigSAFE Pro (tm) software provided by LinesearchbeforeUdig

Date Requested: 24/11/2020
Job Reference: 20614304
Site Location: 494125 104164
Requested by:
Ms Christina Elliott
Your Scheme/Reference:
LM 90619/SBS

Exact Scales:
1:1000 Area or Circle dig site
1:1000 Line dig site

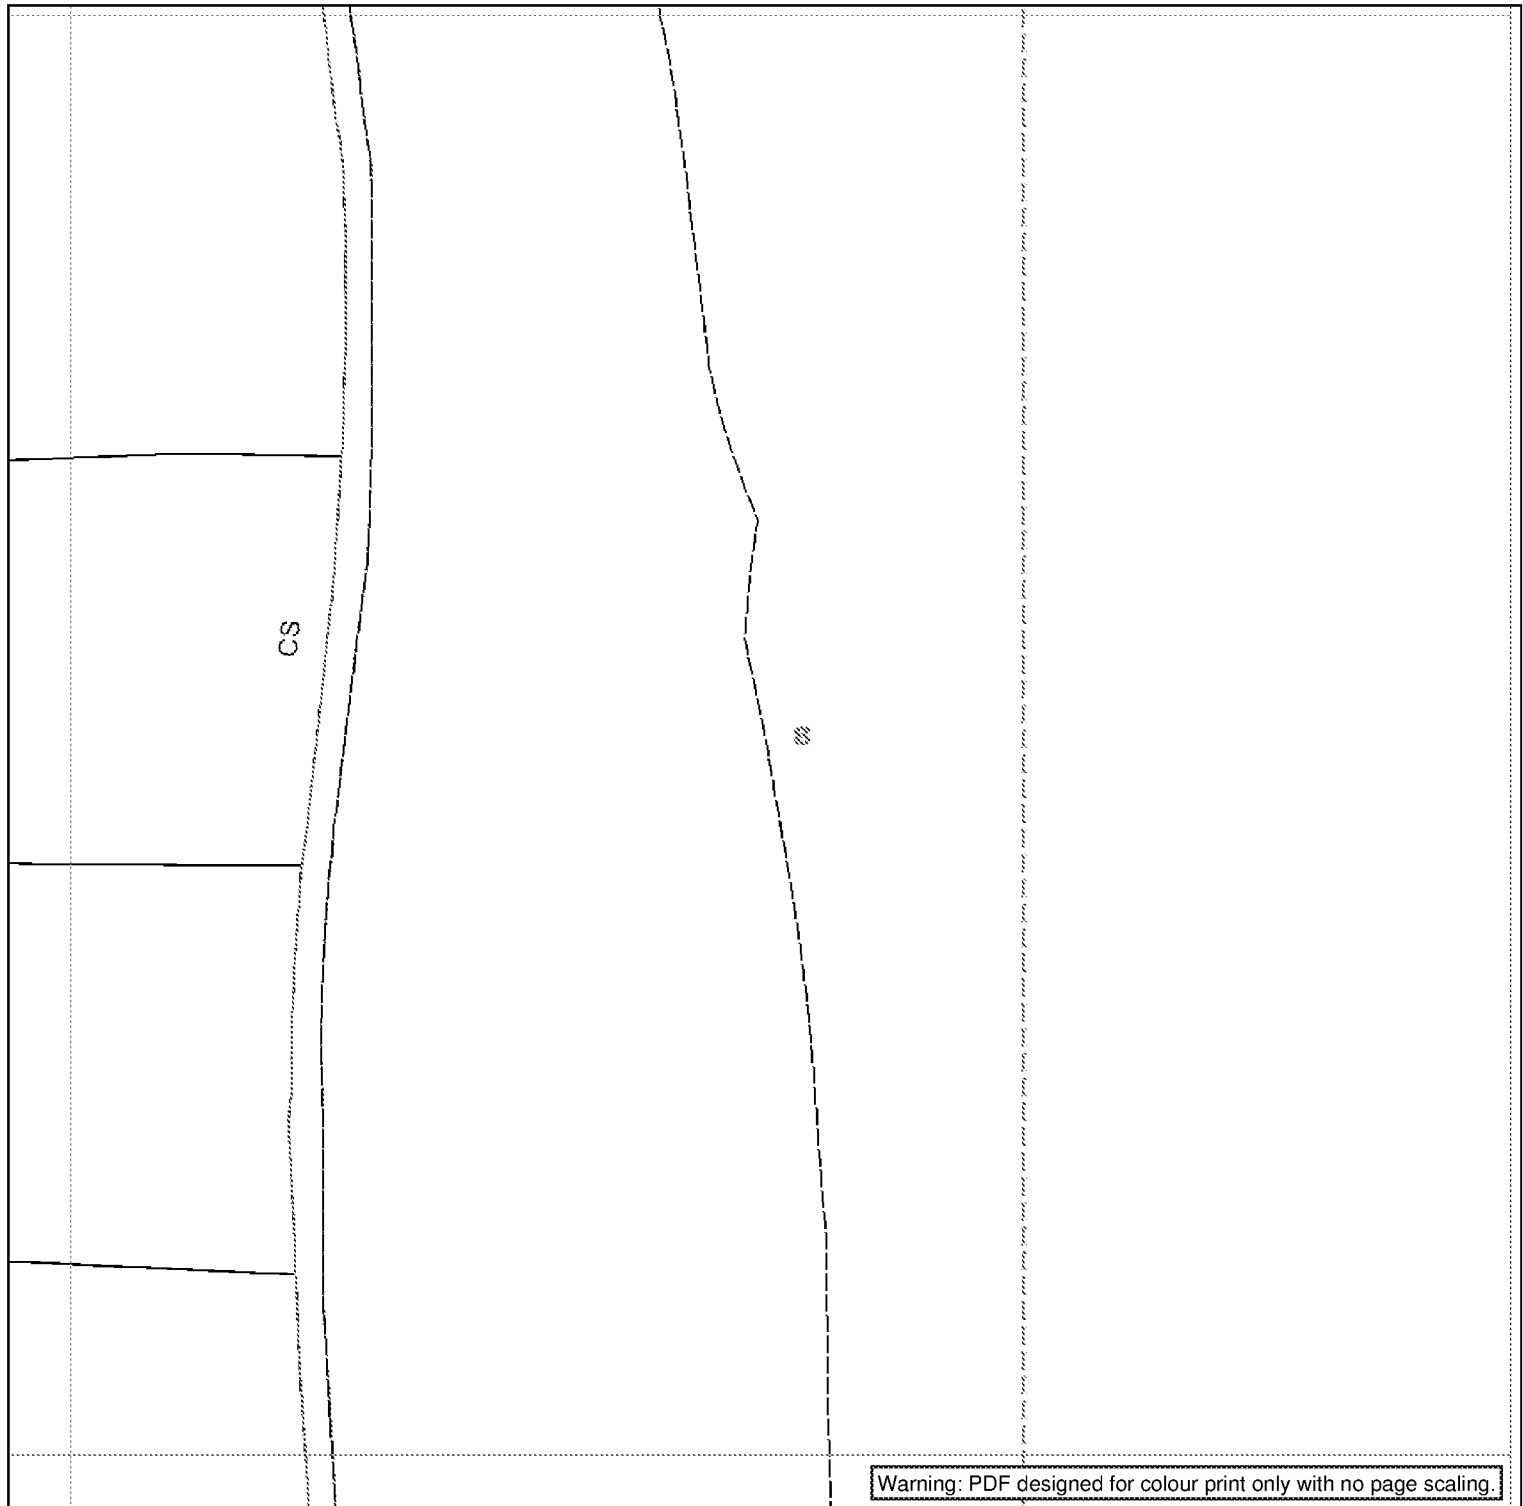

Warning: PDF designed for colour print only with no page scaling.



Contact Us

SGN Safety Admin Team:
0800 912 1722
Email:
plantlocation@sgn.co.uk

Low Pressure Mains

Medium Pressure Mains

Intermediate Pressure Mains

High Pressure Mains

Some Examples Of Plant Items

Valve



Syphon



Depth of Cover



LAS

GTs

SSSIs

Material Change


Diameter Change




Digsite:

Line:

Area:



This information is given as a guide only and its accuracy cannot be guaranteed.



This plan shows the location of those pipes owned by Scotia Gas Networks (SGN) by virtue of being a licensed Gas Transporter (GT). Gas pipes owned by other GTs or third parties may also be present in this area but are not shown on this plan. Information with regard to such pipes should be obtained from the relevant owners. No warranties are given with regard to the accuracy of the information shown on this plan. Service pipes, valves, siphons, sub-connections etc. are not shown but their presence should be anticipated. You should be aware that a small percentage of our pipes/assets may be undergoing review and will temporarily be highlighted in yellow. If your proposed works are close to one of these pipes, you should contact the SGN Safety Admin Team on 0800 912 1722 for advice. No liability of any kind whatsoever is accepted by SGN or its agents, servants or sub-contractors for any error or omission contained herein. Safe digging practices, in accordance with HS (G)47, must be used to verify and establish the actual position of mains, pipes, services and other apparatus on site before any mechanical plant is used. It is your responsibility to ensure that plant location information is provided to all persons (whether direct labour or sub-contractors) working for you on or near gas apparatus. Information included on this plan should not be referred to beyond a period of 28 days from the date of issue.


Report damage immediately -- KEEP EVERYONE AWAY FROM THE AREA

0800 111 999

This plan is reproduced from or based on the OS map by Scotia Gas Networks plc, with the sanction of the controller of HM Stationery Office. Crown Copyright Reserved. Southern Gas -- 100044373 and Scotland Gas -- 100044366.

Date Requested: 24/11/2020
Job Reference: 20614304
Site Location: 494125 104164
Requested by:
Ms Christina Elliott
Your Scheme/Reference:
LM 90619/SBS

Exact Scales:
1:1000 Area or Circle dig site
1:1000 Line dig site

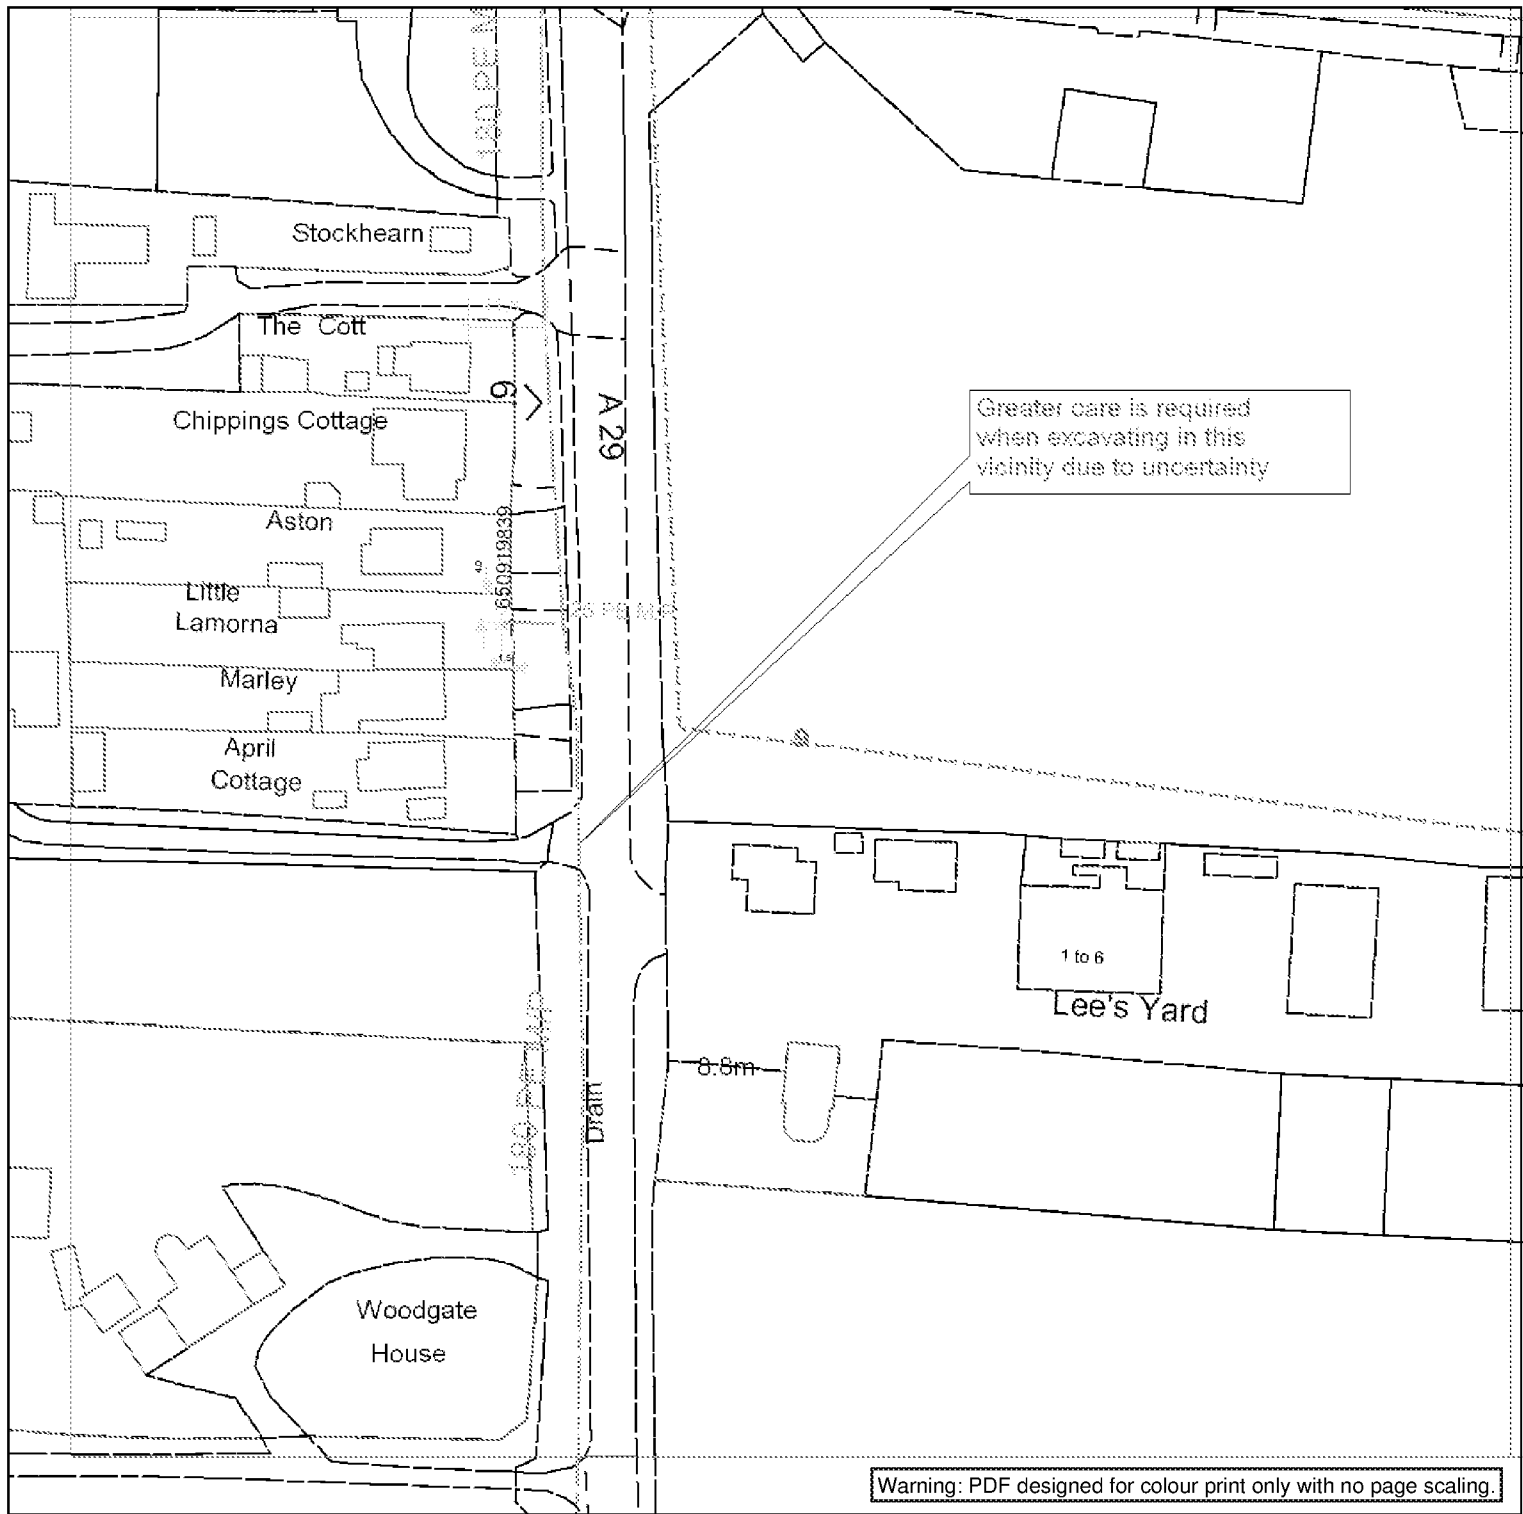

Contact Us

SGN Safety Admin Team:
0800 912 1722
Email:
plantlocation@sgn.co.uk

Low Pressure Mains

Medium Pressure Mains

Intermediate Pressure Mains

High Pressure Mains

Some Examples Of Plant Items

Valve

Syphon

Depth of Cover

Digsite:

Line:

Area:


LAS

GTs


SSSIs

Diameter Change

Material Change



This information is given as a guide only and its accuracy cannot be guaranteed.



This plan shows the location of those pipes owned by Scotia Gas Networks (SGN) by virtue of being a licensed Gas Transporter (GT). Gas pipes owned by other GTs or third parties may also be present in this area but are not shown on this plan. Information with regard to such pipes should be obtained from the relevant owners. No warranties are given with regard to the accuracy of the information shown on this plan. Service pipes, valves, siphons, sub-connections etc. are not shown but their presence should be anticipated. You should be aware that a small percentage of our pipes/assets may be undergoing review and will temporarily be highlighted in yellow. If your proposed works are close to one of these pipes, you should contact the SGN Safety Admin Team on 0800 912 1722 for advice. No liability of any kind whatsoever is accepted by SGN or its agents, servants or sub-contractors for any error or omission contained herein. Safe digging practices, in accordance with HS (G)47, must be used to verify and establish the actual position of mains, pipes, services and other apparatus on site before any mechanical plant is used. It is your responsibility to ensure that plant location information is provided to all persons (whether direct labour or sub-contractors) working for you on or near gas apparatus. Information included on this plan should not be referred to beyond a period of 28 days from the date of issue.

Report damage immediately -- KEEP EVERYONE AWAY FROM THE AREA

0800 111 999

This plan is reproduced from or based on the OS map by Scotia Gas Networks plc, with the sanction of the controller of HM Stationery Office. Crown Copyright Reserved. Southern Gas -- 100044373 and Scotland Gas -- 100044366.

Plans generated by DigSAFE Pro (tm) software provided by LineasearchbeforeUdig

Date Requested: 24/11/2020
Job Reference: 20614304
Site Location: 494125 104164
Requested by:
Ms Christina Elliott
Your Scheme/Reference:
LM 90619/SBS

Exact Scales:
1:1000 Area or Circle dig site
1:1000 Line dig site



Warning: PDF designed for colour print only with no page scaling.



Contact Us

SGN Safety Admin Team:
0800 912 1722
Email:
plantlocation@sgn.co.uk

Low Pressure Mains

Medium Pressure Mains

Intermediate Pressure Mains

High Pressure Mains

Some Examples Of Plant Items

Valve



Syphon



Depth of Cover



Digsite:

Line:

Area:

LAS

GTs




SSSIs




Diameter Change



Material Change



This information is given as a guide only and its accuracy cannot be guaranteed.



This plan shows the location of those pipes owned by Scotia Gas Networks (SGN) by virtue of being a licensed Gas Transporter (GT). Gas pipes owned by other GTs or third parties may also be present in this area but are not shown on this plan. Information with regard to such pipes should be obtained from the relevant owners. No warranties are given with regard to the accuracy of the information shown on this plan. Service pipes, valves, siphons, sub-connections etc. are not shown but their presence should be anticipated. You should be aware that a small percentage of our pipes/assets may be undergoing review and will temporarily be highlighted in yellow. If your proposed works are close to one of these pipes, you should contact the SGN Safety Admin Team on 0800 912 1722 for advice. No liability of any kind whatsoever is accepted by SGN or its agents, servants or sub-contractors for any error or omission contained herein. Safe digging practices, in accordance with HS (G)47, must be used to verify and establish the actual position of mains, pipes, services and other apparatus on site before any mechanical plant is used. It is your responsibility to ensure that plant location information is provided to all persons (whether direct labour or sub-contractors) working for you on or near gas apparatus. Information included on this plan should not be referred to beyond a period of 28 days from the date of issue.

Report damage immediately -- KEEP EVERYONE AWAY FROM THE AREA

0800 111 999

This plan is reproduced from or based on the OS map by Scotia Gas Networks plc, with the sanction of the controller of HM Stationery Office. Crown Copyright Reserved. Southern Gas -- 100044373 and Scotland Gas -- 100044366.

Date Requested: 24/11/2020
Job Reference: 20614304
Site Location: 494125 104164
Requested by:
Ms Christina Elliott
Your Scheme/Reference:
LM 90619/SBS

Exact Scales:
1:1000 Area or Circle dig site
1:1000 Line dig site



Warning: PDF designed for colour print only with no page scaling.



Contact Us

SGN Safety Admin Team:
0800 912 1722
Email:
plantlocation@sgn.co.uk

Low Pressure Mains

Medium Pressure Mains

Intermediate Pressure Mains

High Pressure Mains

Some Examples Of Plant Items

Valve



Syphon



Depth of Cover



Diameter Change



Material Change



Digsite:

Line:


Area:

LAS


GTs



SSSIs



This information is given as a guide only and its accuracy cannot be guaranteed.



This plan shows the location of those pipes owned by Scotia Gas Networks (SGN) by virtue of being a licensed Gas Transporter (GT). Gas pipes owned by other GTs or third parties may also be present in this area but are not shown on this plan. Information with regard to such pipes should be obtained from the relevant owners. No warranties are given with regard to the accuracy of the information shown on this plan. Service pipes, valves, siphons, sub-connections etc. are not shown but their presence should be anticipated. You should be aware that a small percentage of our pipes/assets may be undergoing review and will temporarily be highlighted in yellow. If your proposed works are close to one of these pipes, you should contact the SGN Safety Admin Team on 0800 912 1722 for advice. No liability of any kind whatsoever is accepted by SGN or its agents, servants or sub-contractors for any error or omission contained herein. Safe digging practices, in accordance with HS (G)47, must be used to verify and establish the actual position of mains, pipes, services and other apparatus on site before any mechanical plant is used. It is your responsibility to ensure that plant location information is provided to all persons (whether direct labour or sub-contractors) working for you on or near gas apparatus. Information included on this plan should not be referred to beyond a period of 28 days from the date of issue.

Report damage immediately -- KEEP EVERYONE AWAY FROM THE AREA

0800 111 999

This plan is reproduced from or based on the OS map by Scotia Gas Networks plc, with the sanction of the controller of HM Stationery Office. Crown Copyright Reserved. Southern Gas -- 100044373 and Scotland Gas -- 100044366.

Plans generated by DigSAFE Pro (tm) software provided by LineSearchbeforeUdig

Date Requested: 24/11/2020
Job Reference: 20614304
Site Location: 494125 104164
Requested by:
Ms Christina Elliott
Your Scheme/Reference:
LM 90619/SBS

Exact Scales:
1:1000 Area or Circle dig site
1:1000 Line dig site



Warning: PDF designed for colour print only with no page scaling.



Contact Us

SGN Safety Admin Team:
0800 912 1722
Email:
plantlocation@sgn.co.uk

Low Pressure Mains

Medium Pressure Mains

Intermediate Pressure Mains

High Pressure Mains

Some Examples Of Plant Items

Valve



Syphon



Depth of Cover



Digsite:

Line:

Area:

LAS

GTs




SSSIs




Diameter Change



Material Change



This information is given as a guide only and its accuracy cannot be guaranteed.



This plan shows the location of those pipes owned by Scotia Gas Networks (SGN) by virtue of being a licensed Gas Transporter (GT). Gas pipes owned by other GTs or third parties may also be present in this area but are not shown on this plan. Information with regard to such pipes should be obtained from the relevant owners. No warranties are given with regard to the accuracy of the information shown on this plan. Service pipes, valves, siphons, sub-connections etc. are not shown but their presence should be anticipated. You should be aware that a small percentage of our pipes/assets may be undergoing review and will temporarily be highlighted in yellow. If your proposed works are close to one of these pipes, you should contact the SGN Safety Admin Team on 0800 912 1722 for advice. No liability of any kind whatsoever is accepted by SGN or its agents, servants or sub-contractors for any error or omission contained herein. Safe digging practices, in accordance with HS (G)47, must be used to verify and establish the actual position of mains, pipes, services and other apparatus on site before any mechanical plant is used. It is your responsibility to ensure that plant location information is provided to all persons (whether direct labour or sub-contractors) working for you on or near gas apparatus. Information included on this plan should not be referred to beyond a period of 28 days from the date of issue.

Report damage immediately -- KEEP EVERYONE AWAY FROM THE AREA

0800 111 999


This plan is reproduced from or based on the OS map by Scotia Gas Networks plc, with the sanction of the controller of HM Stationery Office. Crown Copyright Reserved. Southern Gas -- 100044373 and Scotland Gas -- 100044366.

Date Requested: 24/11/2020
Job Reference: 20614304
Site Location: 494125 104164
Requested by:
Ms Christina Elliott
Your Scheme/Reference:
LM 90619/SBS

Exact Scales:
1:1000 Area or Circle dig site
1:1000 Line dig site

Map Symbols

VALVE OPEN	VALVE CLOSED	GOVERNOR	END CLOSURE	SYPHON	REDUCER	TEE
TEST POINT	CATHODIC PROTECTION	GENERAL REFERENCE	FLOW MEASURE	DIP POINT	MONO ETHYLENE GLYCOL	OILING POINT
FLOW STOP	PRESSURE MEASUREMENT	STAND PIPE	OFFICIAL MINISTRY RECORD	PURGE POINT	GAS CONDITIONER	DRAIN POINT
					LP MAINS	
SKETCH BUBBLE	DEPTH OF COVER	METER	MATERIAL CHANGE		MP MAINS	
					IP MAINS	
					LHP MAINS	
					HISTORY DATA	
					SSSI	
PIG TRAP	CROSSOVER CONNECTION	CHANGE OF DIAMETER	PIPE JOINT		CONTACT ZONE	
						LTS



SGN

Your gas. Our network.

Dig safely

Measures to avoid injury
and damage to gas pipes



The following protective and precautionary measures MUST be taken when working in the vicinity of gas mains and services.

It is the responsibility of the property owner or company carrying out the work to make sure they've complied with the relevant legislation and Health and Safety Executive (HSE) guidance, eg HS(G)47. In practice, this means that whoever is carrying out the work MUST obtain gas mains location information and/or maps showing the indicative position of the gas network before any work takes place.

To avoid injury to yourself, your employees, colleagues and the general public you MUST suitably mark the position of the pipes on site.

HS(G)47 outlines best practice that should be followed to ensure you work safely:

1. Plan the work, obtain maps.
2. Detecting, identifying and marking underground services.
3. Safe excavation and safe digging practices.

In addition to the requirements under the Health and Safety At Work etc. Act 1974 to prevent injuries to employees and others (not employed), it is an offence under regulation 15 of the Pipelines Safety Regulations 1996 to cause damage to a pipeline (which includes gas mains and services as well as higher pressure pipelines) so as to give rise to a danger to persons.

You MUST make sure that current full colour copies of our maps are issued to all relevant personnel on site and they're aware of the presence and location of our gas mains and services prior to any excavation.

In a gas emergency

If you cause a gas leak or suspect a main or service pipe or equipment is leaking, you **MUST** take the following emergency actions immediately:


- **Ask people to move away from the area of the gas escape.**



1. **Don't attempt to repair the escape or stop the leakage.**
2. **As gas may enter buildings, ask people in the surrounding premises to leave until it's safe for them to return.**
3. **Stop anyone going near the immediate vicinity of the gas escape.**
4. **Prohibit smoking and extinguish all naked flames.**
5. **Don't use mobile phones or other ignition sources.**
6. **Assist our representatives and other emergency services such as the police, ambulance, and fire service as requested.**

Additional reference material

- SGN guidance for Safe Working in the Vicinity of Pipelines & Associated Installations operating >7barg. Applicable for HP only.
- HS(G)47 Avoiding Danger from Underground Services available from hse.gov.uk
- NJUG Utilities Guidance on Positioning and Colour Coding of Apparatus available from njug.org.uk

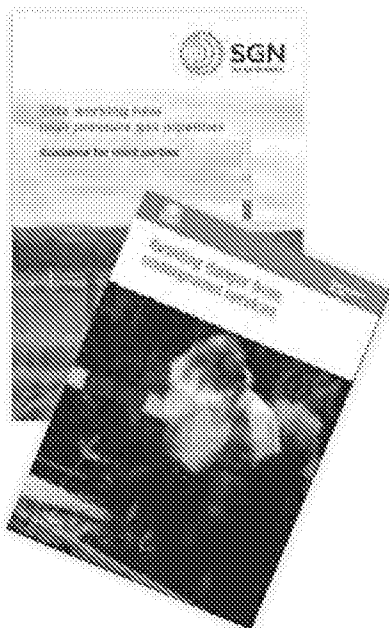



Making an enquiry for gas mains or services maps

Please visit our **Dig safely** pages on sgn.co.uk for plant protection information and links to our online mapping system and other associated information and guidance.


Our simple and easy to use online mapping system is available 24/7, 365 days a year.

You'll need to register/log in and provide a few details about your site location and the work you'll be carrying out. We'll respond immediately by email.

What force will be sent

You'll be sent an email with a map. This will be an extract from our gas mains record, showing your site and any of our gas pipes as well as relevant safety information.

We always send out safety information, however we may forward your enquiry on to a local plant protection officer or a pipelines engineer to make direct contact with you depending on the work location.

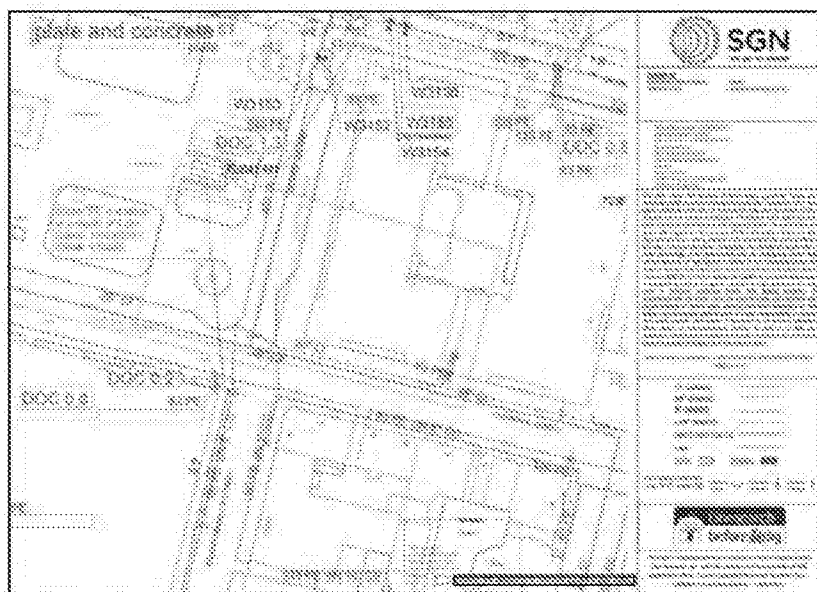

Example of a gas map

Note: Service pipes are not shown on our maps

When working near our gas mains and services

Safe system of work

To satisfy ourselves that work in the vicinity of our gas mains is being carried out safely, we may ask for a copy of your risk assessment and/or method statement paperwork.

Where work falls under the Construction (Design and Management) Regulations 2015 reference to our gas mains and services MUST be made within your site Health and Safety file.

Financial

Every reasonable precaution MUST be taken to avoid personal injury or damage to our gas network at all times.

If we incur any costs to repair direct or consequential damage or divert any gas main or service, you'll be recharged in full.

HSE

Any damage to our gas mains or services will be subject to legislative reporting responsibilities to the Health and Safety Executive under Reporting of Injuries, Diseases & Dangerous Occurrences Regulations 2013, Gas Safety Management Regulations 1996, and the Pipelines Safety Regulations 1996.

Minimum safe working distances

Depending on the activity being undertaken and the gas mains or services you are working within the vicinity of, there are different safe distances that MUST be adhered to. SGN plant protection officers or pipeline engineers will inform you of these if required.

Surface boxes and manholes

Do not bury or move our surface boxes. Free access MUST be maintained during and after your work. No manhole cover or other structure can be built over, around or under a gas main, and no work is to be carried out that results in a reduction or increase in cover or protection without prior written agreement.

Deep excavations

Adequate protection, approved by us, MUST be applied for any deep excavations in the vicinity of our gas mains and services that may affect its security and integrity. Ground movement around gas mains MUST be prevented. We MUST be contacted if a sewer trench or any other water authority is to be constructed at greater than 1.5 metres depth near a buried gas main or service pipe. You MUST give us detailed drawings showing the line and width of the proposed sewer or other trench, together with the soil group classification of the area concerned.



Crossing our mains or services

The placing of heavy construction plant, equipment, materials or the passage of heavy vehicles over our gas mains is prohibited unless specifically agreed protective measures (ie the construction of reinforced crossing points) have been carried out. This is particularly important where reductions in side support or ground cover are planned. You **MUST NOT** carry out any work in servitudes/easements without our prior written consent.

Exposed plant

Where excavations in the vicinity of our gas mains affect its support, the plant **MUST** be adequately supported and protected in consultation with us and to our satisfaction. It **MUST** be protected from impact, restraints and thrust blocks, and supports **MUST NOT** be removed without our agreement.

Hot work

One of our representatives should be present when welding or other hot work involving naked flames is being carried out near our gas mains, as there's potential for heat damage to plastic pipeline/coatings.

Backfilling

Concrete backfill should not be placed closer than 300mm to our mains. No concrete or hard material should be placed under or adjacent to any of our gas mains. Shuttering MUST be constructed to maintain the stated clearances and prevent fresh concrete encasing our mains or services. Material used for backfill around our gas mains MUST conform to the following:

- If sand, it MUST be well-graded in accordance with BS EN 12620:2002.
- It MUST NOT contain any sharp particles (stones, bricks, lumps or corrosive materials).
- Foamed concrete MUST NOT be used.
- It MUST be laid to a minimum depth of 250mm above the crown of the gas main.

Note: Power ramming MUST NOT take place until a 300mm hand rammed layer has been completed over the crown of the main.

Access

Free access to our sites, mains and services, including temporary structures and spoil heaps MUST be available at all times.





Mechanical excavation


Mechanical excavators (including breaker attachments) **MUST NOT** be used within the following distances from the confirmed location of our gas mains and services shown on our gas maps without prior agreement:

Type of mains and services	Gas map identification	Hand excavation required inside	Pipe pressure indication shown on map
Low Pressure (LP)	0 – 75mbar	0.5 metres	=====
Medium Pressure (MP)	75mbar to 2 bar	0.5 metres	-----
Intermediate Pressure (IP)	2 – 7 bar	3.0 metres	-----
High Pressure (HP)	Above 7 bar	You must seek approval from us prior to any work	-----

Major accident hazard pipelines

High pressure pipeline

No work is to take place near an HP pipeline until it is agreed with us. After agreement and before any work does take place, the location of our pipeline **MUST** be marked up and its position confirmed by digging trial holes with our personnel in attendance.

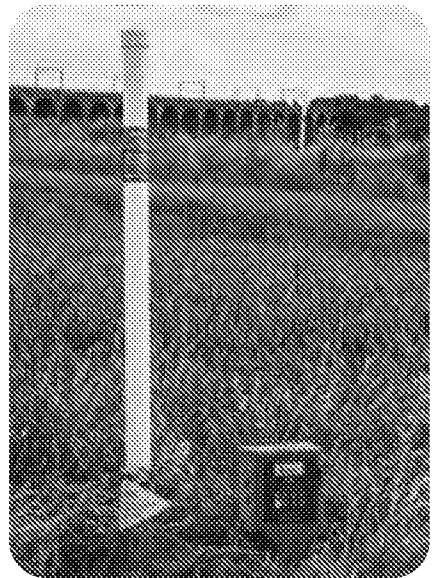

Pipeline markers

High pressure


We will be involved in any work taking place near high pressure pipelines. We will provide you with additional information that you **MUST** familiarise yourself with before carrying out any work.

The default method of excavating near high pressure gas pipelines MUST always be by hand.



Wind turbines

The UK Onshore Pipelines Operations Association (UKOPA) has identified the appropriate exclusion zone (distance from the base of the wind turbine mast to the edge of the pipeline) as 1.5 times the turbine height. Contact MUST be made with us during the planning stages of a wind turbine or wind farm.

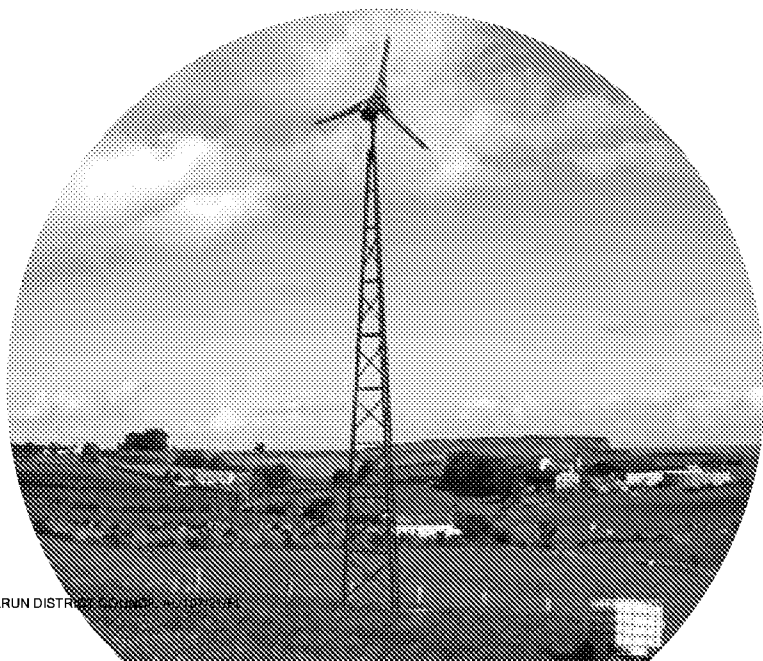


Tree planting

If trees or shrubs are to be planted in the vicinity of our gas mains and services, the selection of tree or shrub type and how it's planted **MUST** be considered carefully. This is to avoid root damage to buried mains or services, and to ensure our subsequent excavations for main repair and maintenance won't damage the trees or shrubs.

Written approval from us **MUST** be obtained before any tree planting is carried out on a servitude/easement. Any approval we grant to plant trees

The following trees and those of similar size (deciduous or evergreen) **MUST NOT** be planted within 6m of the centre line of the main: ash, beech, birch, most conifers, elm, maple, lime, horse chestnut, oak, and sycamore. Apple and pear trees are also included in this category.

Dwarf apple stocks may be planted up to 3m of the centre line of the main.




In cases where screening is required, the following are shallow rooting and may be planted close to the gas mains and services: blackthorn, broom, cotoneaster, elder, hazel, laurel, quickthorn, privet, snowberry and most ornamental shrubs.

Gas main centre


Raspberries, gooseberries and blackcurrants may be planted on the gas main, but a four metre strip, centred on the main, **MUST** be left clear at all times.

on a servitude/easement will be subject to us retaining the right to remove any tree, which in our opinion may become a danger to our mains in the future.

The written consent to plant trees will state what area may be planted and also the type of tree. The diagram details the specific species and the distances they **MUST** be planted from gas mains or services. You **MUST** contact us for further information.

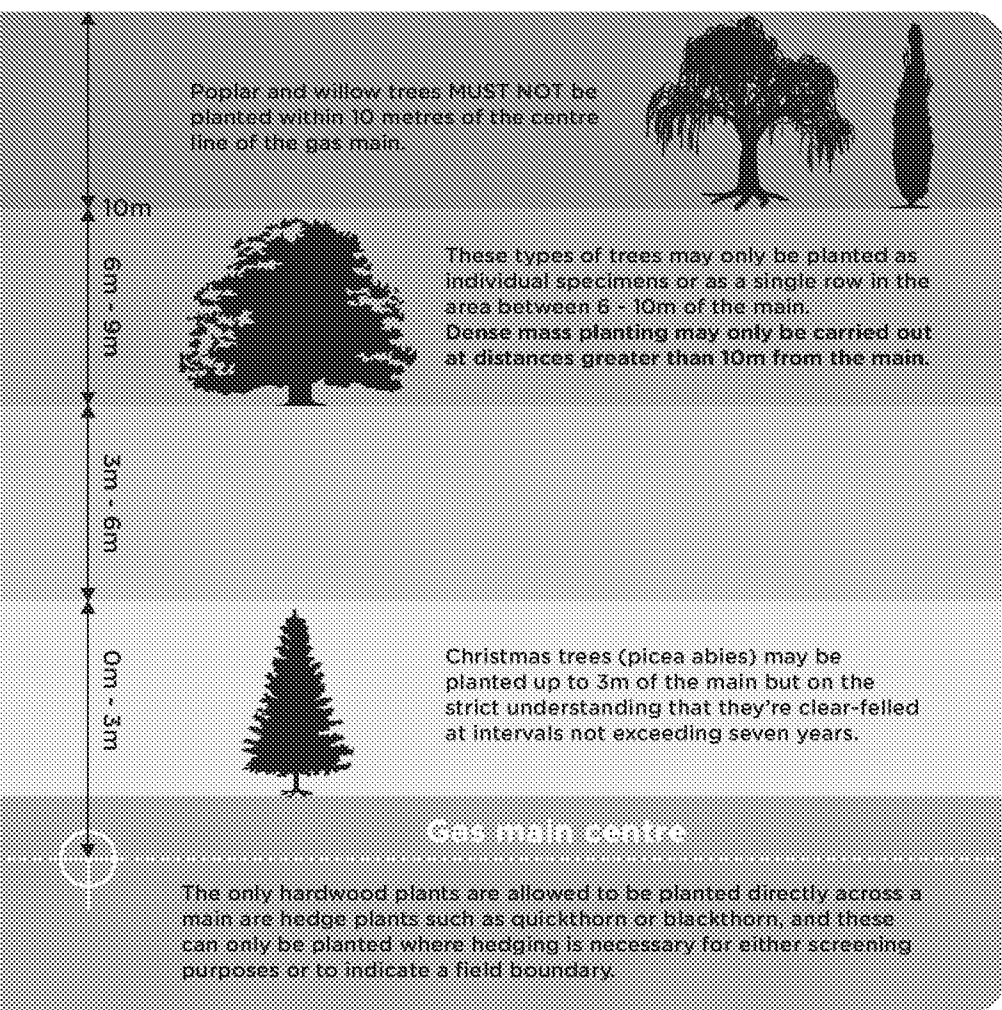

Note: For further guidance, please refer to NJUG 10.

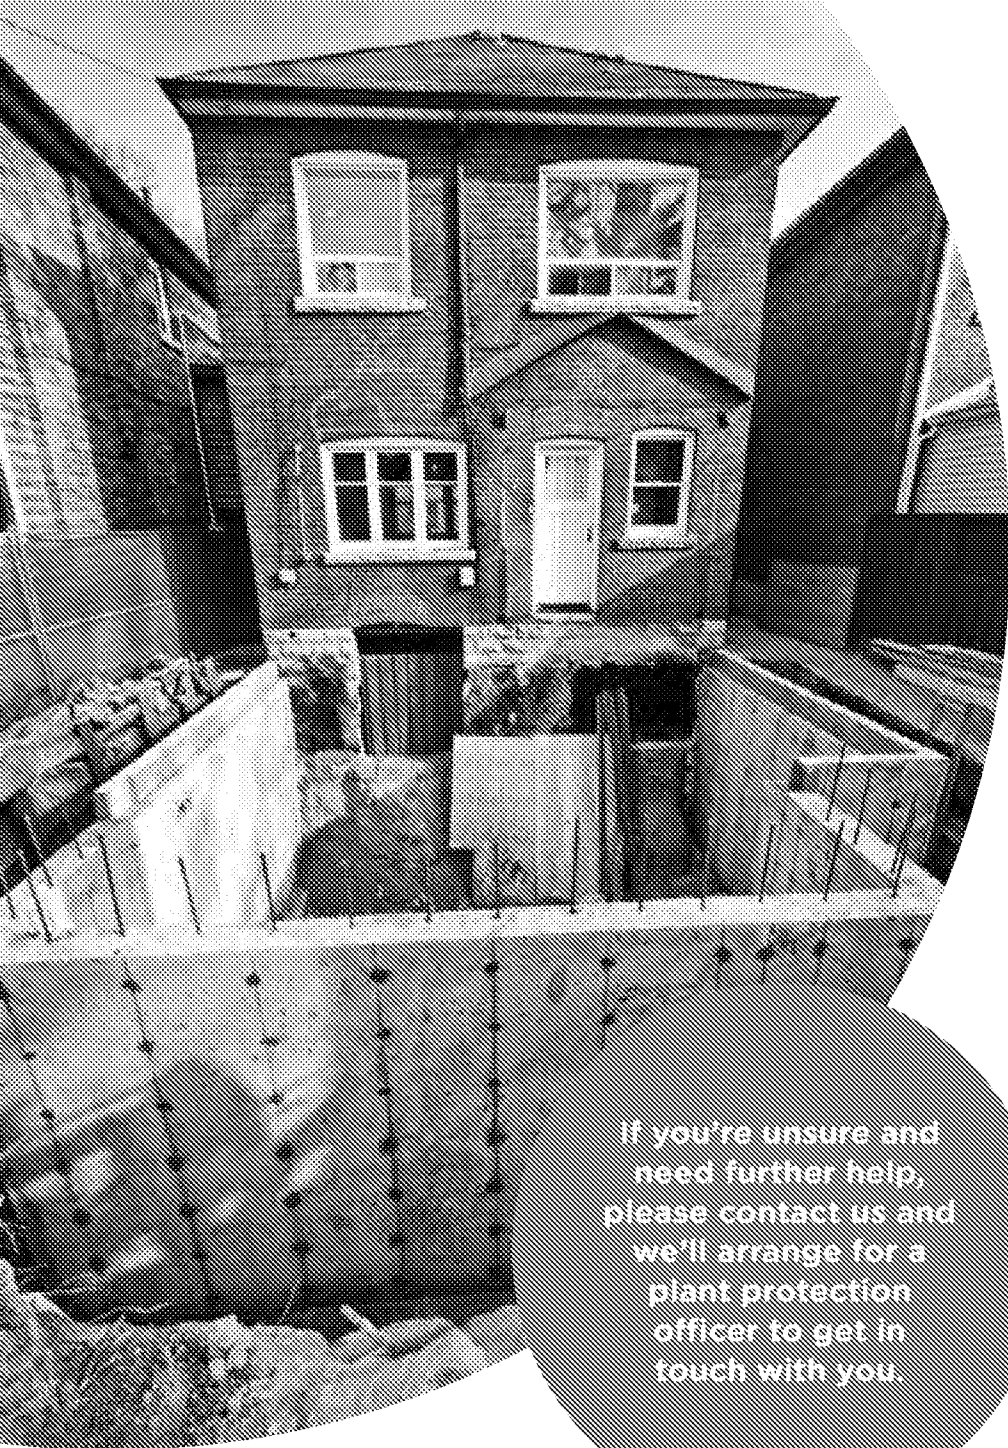


If you're unsure and need further help, please contact us and we'll arrange for a plant protection officer to get in touch with you.

Gas services/hot in gardens

If you're going to be carrying out work around your home, or a third party is carrying out work on your behalf, we may send you a site map of our gas mains and services but your own gas service won't be marked.

The simplest way to understand the location of your gas service is to know where it enters your house.

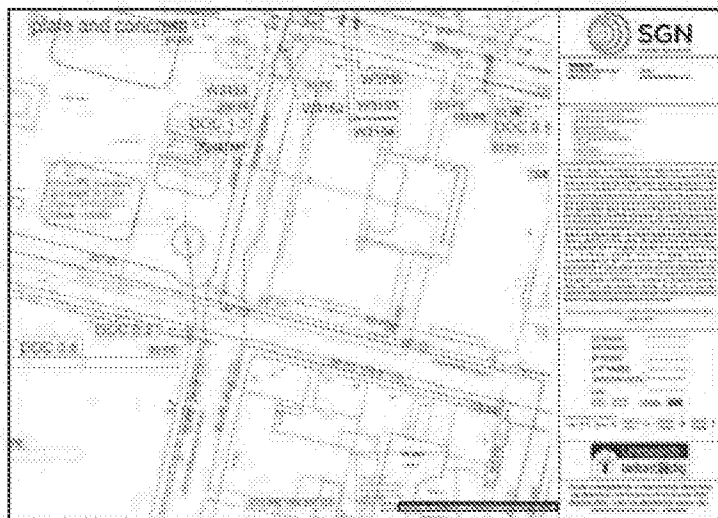


< Your gas service pipe usually takes the shortest route to the gas main, as shown on the sample network map/drawing.



We provide a free plant location enquiry service and we're always happy to help.



All calls are recorded and may be monitored



SGN

Your gas. Our network.

Know what's below

Protecting you and your family

Protecting you and your family

Are you planning on carrying out any home improvements such as building a conservatory, an extension, a new pond, decking, concreting, landscaping, fencing or planting trees in your garden? You must make sure you have drawings/maps showing any pipes or cables around your home. To obtain copies of our gas drawings/maps please visit our **Dig safely** pages on sgn.co.uk and follow the link to our online system.

This service is free of charge.

Our Dig safely page is also where you'll find advice on any protective measures you may need to take before you start work, whether you're planning on doing it yourself or hiring a professional.

Damaging gas pipes is dangerous and could lead to a fire or an explosion. It could also cause large-scale loss of gas supply to the local community and is potentially very expensive.



Responsibilities

It's the responsibility of whoever is doing the work to make sure they've complied with the relevant legislation and Health and Safety Executive (HSE) guidance.

In practice, this means anyone carrying out work must obtain a copy of any available colour drawings showing the position of buried utilities for reference before and during the project.

Non-recording of service pipes >

Individual service pipes are not normally recorded on gas network drawings. This is accepted practice and reinforced by guidance given in Design, construction and installation of service pipes – approved code of practice, published by the HSE, and IGE/TD/4 – Gas Services, published by the Institute of Gas Engineers and Managers.


What you need to do when planning a conservatory or house extension, landscaping, fencing or any other groundworks

It's the responsibility of whoever is undertaking the work to check with utility companies before the work starts.

If you're planning any building or digging work remember that gas pipes, power cables, water pipes and sewers all run underground and could be right beneath your feet. Construction or excavation work can damage underground services or prevent further maintenance.

Remember that obtaining planning permission or a building warrant from your local authority doesn't normally involve consultation with utility companies so you should get in touch with them when you start planning your project. This will help keep everyone safe.

Please visit our **Dig safely** pages on sgn.co.uk for more information and our online mapping system.

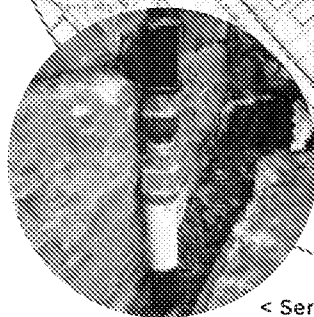

< Service entry

Gas services/work in gardens

If you're going to be carrying out work around your home, or a third party is carrying out work on your behalf and you have requested a map from us, **your own gas service may not be marked**. The simplest way to understand the location of your gas service is to know where it enters your house, as pictured.

Your gas service pipe usually takes the shortest route to the gas main, as shown on the sample network map/drawing above.

If you're unsure and need further help, please contact us and we'll arrange for a Plant Protection officer to contact you.



Any damage, however minor, must be reported to the National Gas Emergency Service

Planting a tree or landscaping your garden

Tree roots can damage utilities.

If you're planting trees or shrubs, make sure you consider the type of plant, root type and their location in relation to buried gas pipes to avoid any damage. We may need access to repair and maintain our pipes and equipment in the future, and we reserve the right to remove any tree or bush if we need to.

What happens if you damage a pipe?

If you damage a gas pipe:

- Call the National Gas Emergency Service on 0800 111 999 immediately
- **DON'T** attempt to make repairs yourself
- **DON'T** handle or attempt to alter the position of the exposed pipe

Damaging a gas pipe can result in:

- Major fire/explosion leading to death or serious injury
- Asphyxiation due to gas exposure leading to death or serious injury
- Loss of gas supply to individuals or communities
- Financial costs to you for repair and remedial work
- Enforcement action by the HSE

We will recover all reasonable costs incurred in repairing damaged gas pipes.


Delivering gas safely, reliably and efficiently

Your safety is our top priority


We manage the network that distributes natural and green gas to over 5.9 million customers in Scotland and the south of England.

We own and operate 74,000km of gas mains, and associated plant and equipment. We're committed to delivering gas safely, reliably and efficiently to every one of our customers.


Accidental damage to our pipes could put you or members of the public at risk.



All our engineers and contractors carry a photo ID card with our company logo on it. Don't be afraid to check with our Security team on **0800 015 5170** that the person on your property is supposed to be there.

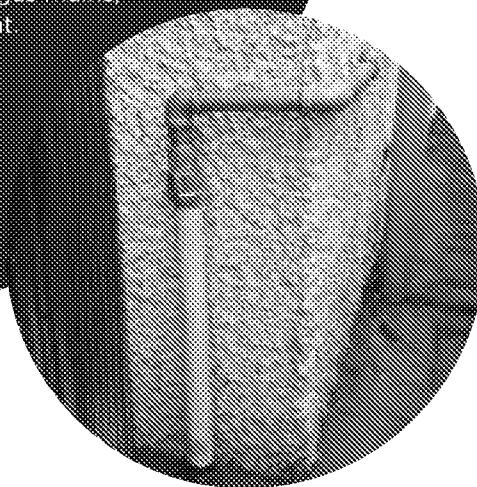

Service entry

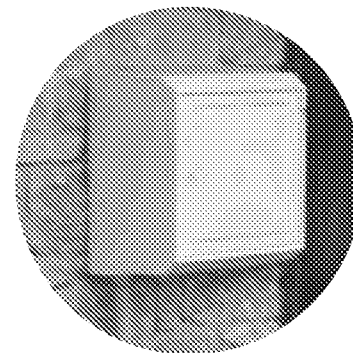

Meter box

Help

If you're planning any work on or around your property and you need more information, you'll find everything you need on our Dig Safely pages.

www



Smell gas?

Follow these six steps if you smell gas:



DO open windows and doors to help ventilate the gas



DO turn off the gas supply at the meter and make sure any gas appliances are turned off



DO call the National Gas Emergency number on 0800 111 999. Lines are open 24 hours a day, 365 days a year



DON'T smoke or use any naked flames




DON'T touch any electrical switches. Turning a switch on or off could ignite a gas leak



DON'T enter a cellar if you smell gas, even if your gas meter is located in the cellar

Safety Advice - Valves



SGN
Your gas. Our network.


Guidance when undertaking work near gas valves in our network areas

SGN manages the network that distributes gas to 5.8 million homes and businesses across Scotland and the south of England.

Due to a manufacturing issue, we are currently replacing or upgrading certain valve types that are at risk of bolt failure. In extreme cases, this can lead to gas escapes. This is a safety hazard and we have produced this guide to ensure you undertake adequate safety precautions when working near gas valves.

Identifying gas valves

The images below are an illustration of typical gas valves. Please note, valves come in various colours, shapes and sizes, and you may come across a valve that looks different to those found in the images.

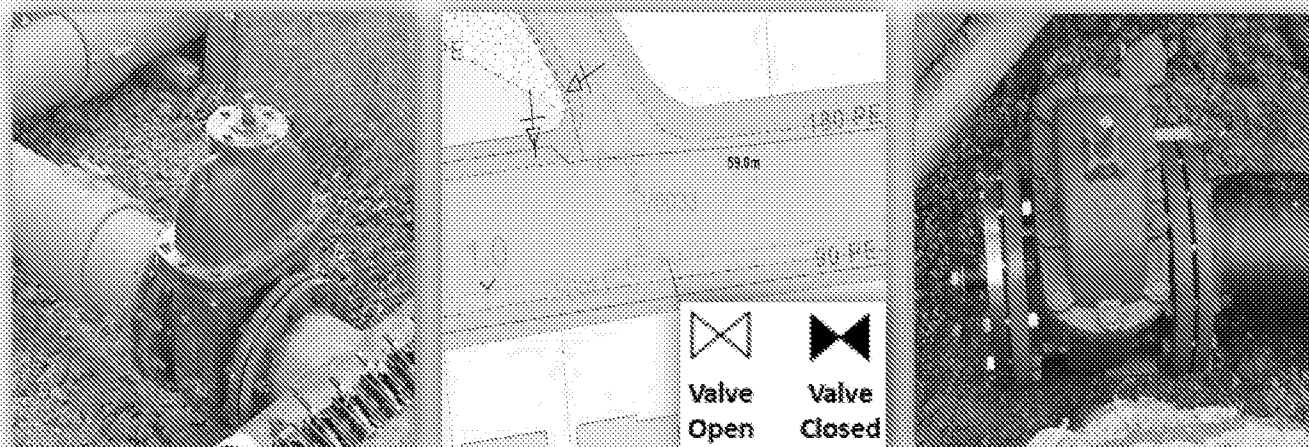

What should you do?

When planning to work in our network areas, please observe the following points:

1. You must contact us before starting any work activity within **3.0m** of a gas valve identified on our maps.
2. If an unexpected gas valve is exposed you must immediately stop excavation works and report this to us.
3. To protect yourself against the risks associated with exposing a valve, we advise that you contact us when in doubt.

Contact details

If you require further information or need assistance please contact us:

Safety Admin Team:



Valve enquiries will be forwarded to a local engineer who will provide further safety information.





We have checked West Sussex County Council's website and in this instance your area is not affected for CCTV.