

**BARRATT DAVID WILSON SOUTHAMPTON LIMITED - QUARTER JACK PARK, PHASE 2,
WIMBOURNE, BH21 2AN
3 WORKSHEET - WATER SPT - WORKSHEET - 23 JUNE 2025 (RHYS (O) FEARNHEAD)**

RAMS

Have you read the RAMs
and do you understand the
Risks and Control
Measures associated with
this task? (If No, DO NOT
PROCEED and call your
Manager).

Yes

INSTALLATION DETAILS

Job number	1
Network Reference Number	1
Water Company:	ICOSA
House / Plot / Flat	Bin Store
Additional Plot Non Standard Information (eg Block No, TBS, A etc)	
Postal Address	N/A
Quantity	1.00
Task Ref	012 - Water Service Complete Inc SPT Per Plot
Comment	BIN STORES TO PLOTS 133-138

PRE CONNECTION CHECKS

Stop Cock Fitted	No
Photo to confirm Stop Cock Fitted	1
Tracer Wire Connected	N/A
Service Connection	Yes
Flushed Through	



TEST DETAILS

For service tee connections to PE mains, a two-minute hydraulic pressure test at 1.5 times the nominal pressure rating of the pipe or fitting which ever is the lower shall be applied to the fused fitting prior to tapping in accordance with our WIRs procedure.

Test Pass or Fail

Pass

MAIN CONNECTION DETAILS

Photo Confirming Service	1
Pipe at Correct Depth and	
Insulated where required	
Photo of Connection Onto	1
Main	
Photo of Water Meter Box /	1
Boundary Box	





NEW METER DETAILS

Meter Serial Number 70B3D5A9F010C396

AMR Number (If Affinity
Water):

RFID Number (South East
Water Only):

Please scan barcode

As Installed Meter Reading 022

Photo of meter 1

Distance to LHS of front
door (metres): 0

Distance to RHS of front
door (metres): 0

Distance to back of kerb 1.7
(metres):



NEW METER LOCATION DETAILS

Ground Type Made Footpath

Service Pipe Length 7M

Service Pipe Size 25MM

Service Pipe Material PEB

Main Size 90mm

SIGN OFF

I confirm the above information is correct


Photo of Sketch

1

Name

Rhys Fearnhead

Signature

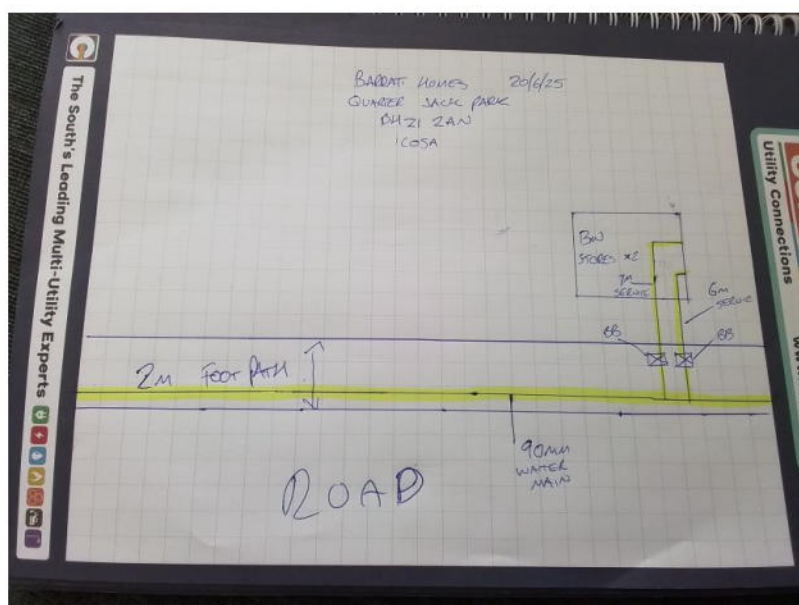

INSTALLATION DETAILS

Inspector Phone Number: 07803282959

WRAS Membership No: GW9961

Comment

SUPPLY DETAILS (SELF LAY)

Brief Description of Works: 1X 25MM CONNECTION TO SELF LAID MAIN. SERVICE PIPE HAS BEEN LAID TO A DEPTH OF 750 ON A BED OF SAND. A BS1010 TAP INSTALLED WITHIN THE PROPERTY. THE DUCT IS FOAMED AND LAGGED AND RUN IN A STRAIGHT LINE FROM THE PROPERTY TO THE CONNECTION POINT.

Internal or External Meter: External
 New or Replacement: New Supply
 Service

PHOTOS

Photo of Foam Filled	1
External Ducting around Pipe:	
Evidence of Capped Pipe:	1
Photo of WRAS Certificate:	1





OWIAPS CERTIFICATE OF COMPLIANCE

White copy: Customer Blue copy: Water Company Green copy: when for records

NEW SUPPLY: Yes ☒ No ☐ Internal ☐ External ☒

Water Company: **ICOSA**

Application/Reference Number: **[REDACTED]**

Member's Name: **PHYS FERNHEAD** Membership No: **649961**

Company Name: **CONNECT IT** Membership: **[REDACTED]**

Address where work carried out (include plot numbers where applicable):

QUARTER JACK PARK
BARTON HOMES (Quaker Jack Park)
BS1 3BS Plot No: **BS1 3BS** Plot No: **BS1 3BS** Plot No: **BS1 3BS** Plot No: **BS1 3BS**

Name and address of the person who commissioned the work (the customer):

PAUL REED **QUARTER JACK PARK**
WIMBOURNE

Telephone Number: **07715236429** Email address: **PAUL@DORRISON-ROSE**

Please give a brief description of the work completed and its location within the premises:

WS7411 2x 25mm PEB SERVICES TO TWO BIN STORES

(confirm that the work carried out complies with the Water Supply (Water Fittings) Regulations 1999, Water Supply (Water Fittings) (Scotland) Byelaws 2005 (Northern Ireland 2005))

Date: **20/6/25** Certificate No: **P 585061**

SUTTON AND EAST SURREY SPECIFIC


Photo of Trench Depth with Tape Measure
 Photo of Building Entry Depth with Tape Measure
 Photo of of the Duct Sealed at Both Ends (either cap ends or non-oil based foam but not in direct contact with the pipe)
 Photo of Insulation in the Duct (to SES Standard).

SIGN OFF

I confirm that the work carried out complies with the Water Supply (Water Fittings) Regulations 1999, Water Supply (Water Fittings)(Scotland) Byelaws 2014 or Water Supply (Water Fittings) Regulations (Northern Ireland) 2009.

Name
Signature

Rhys Fearnhead

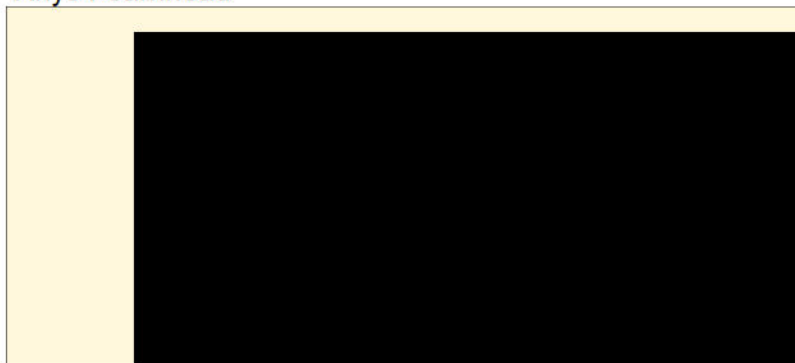

Date:

22 Jun 2025