
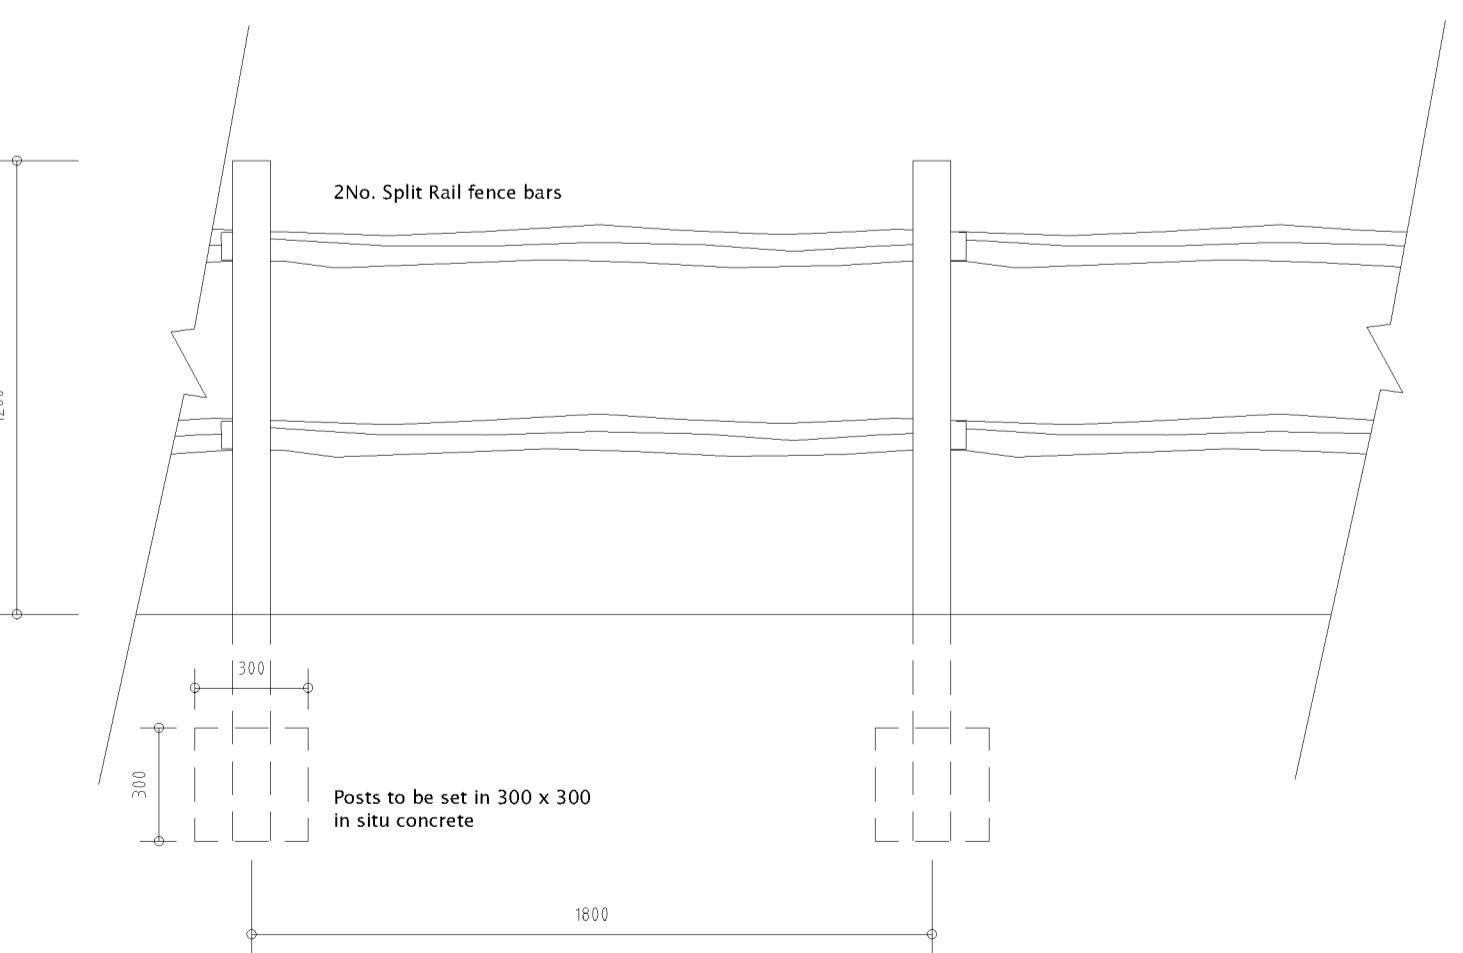
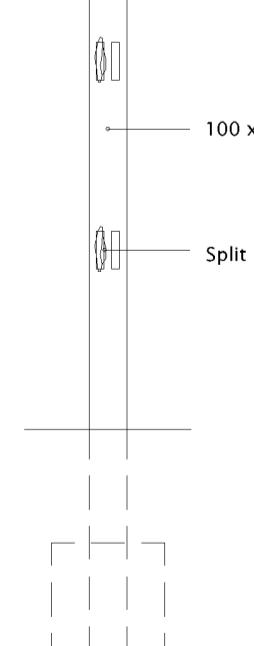
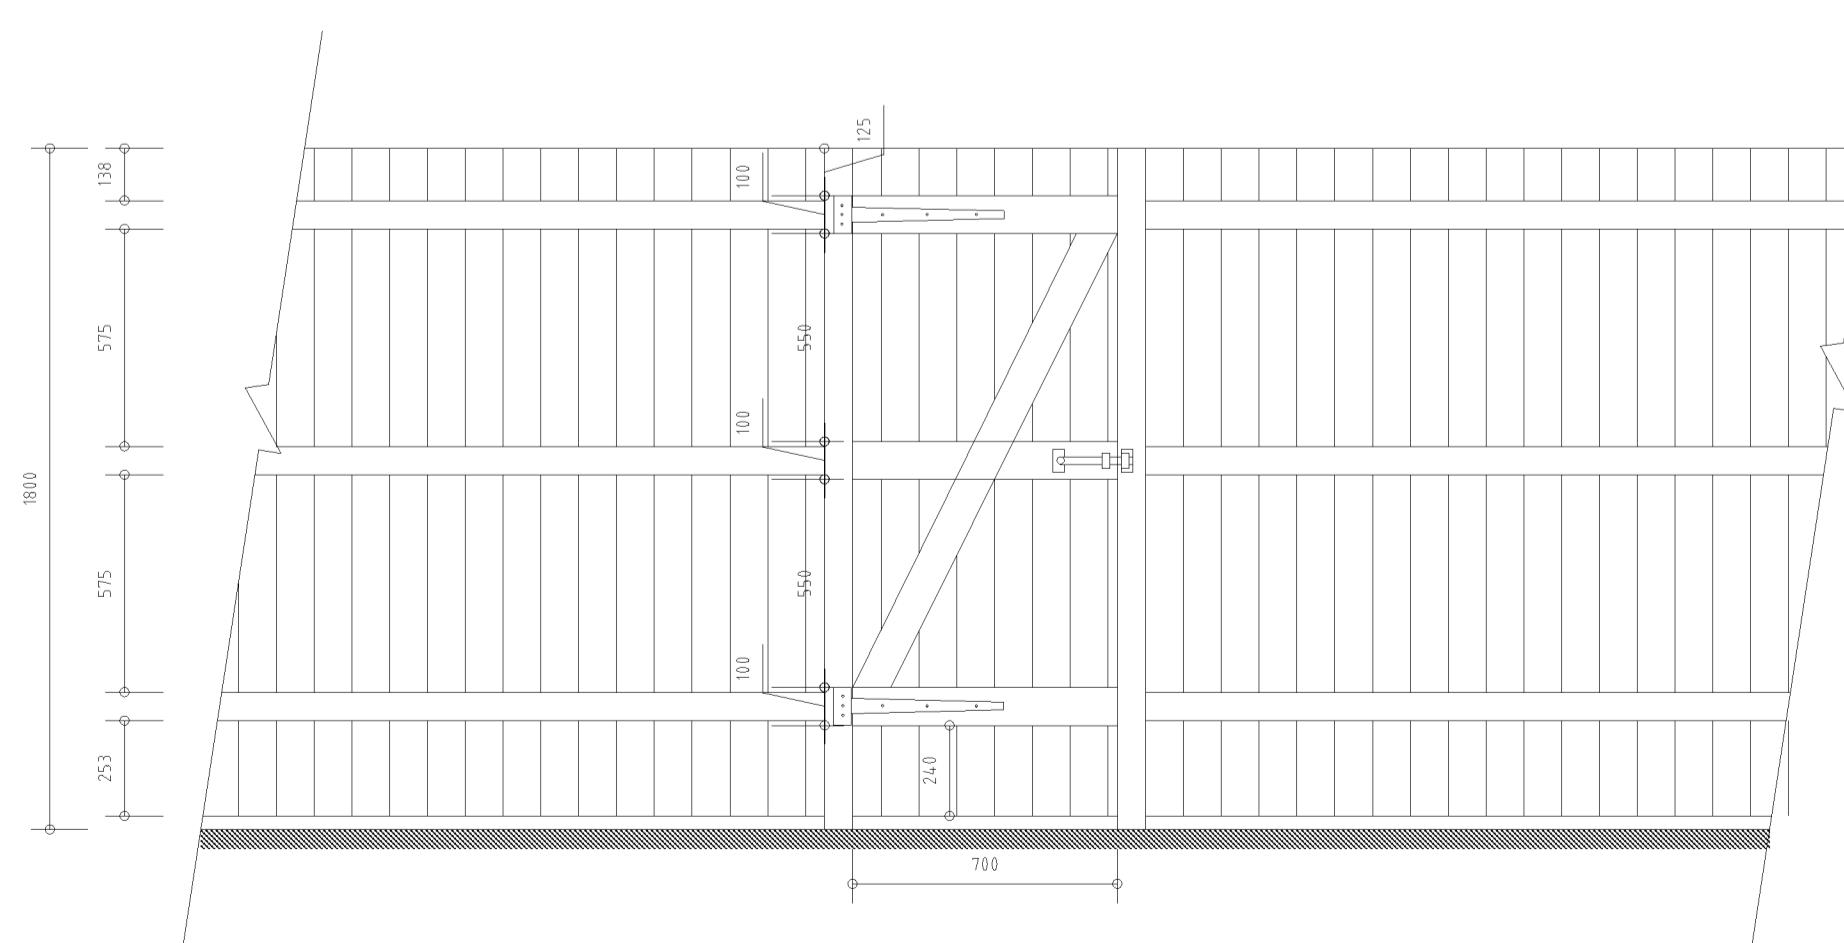
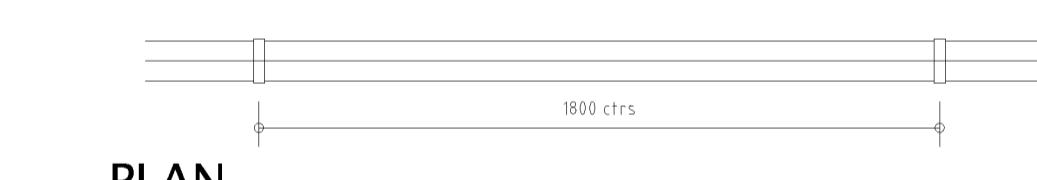
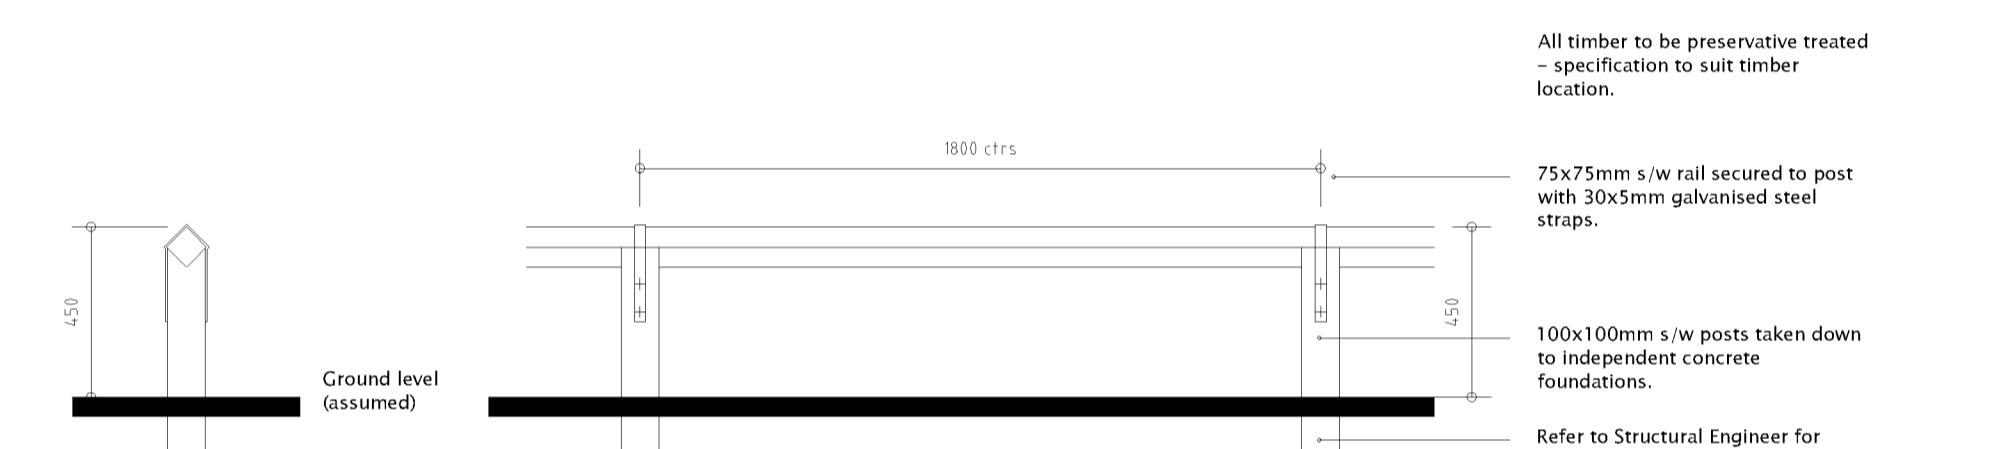
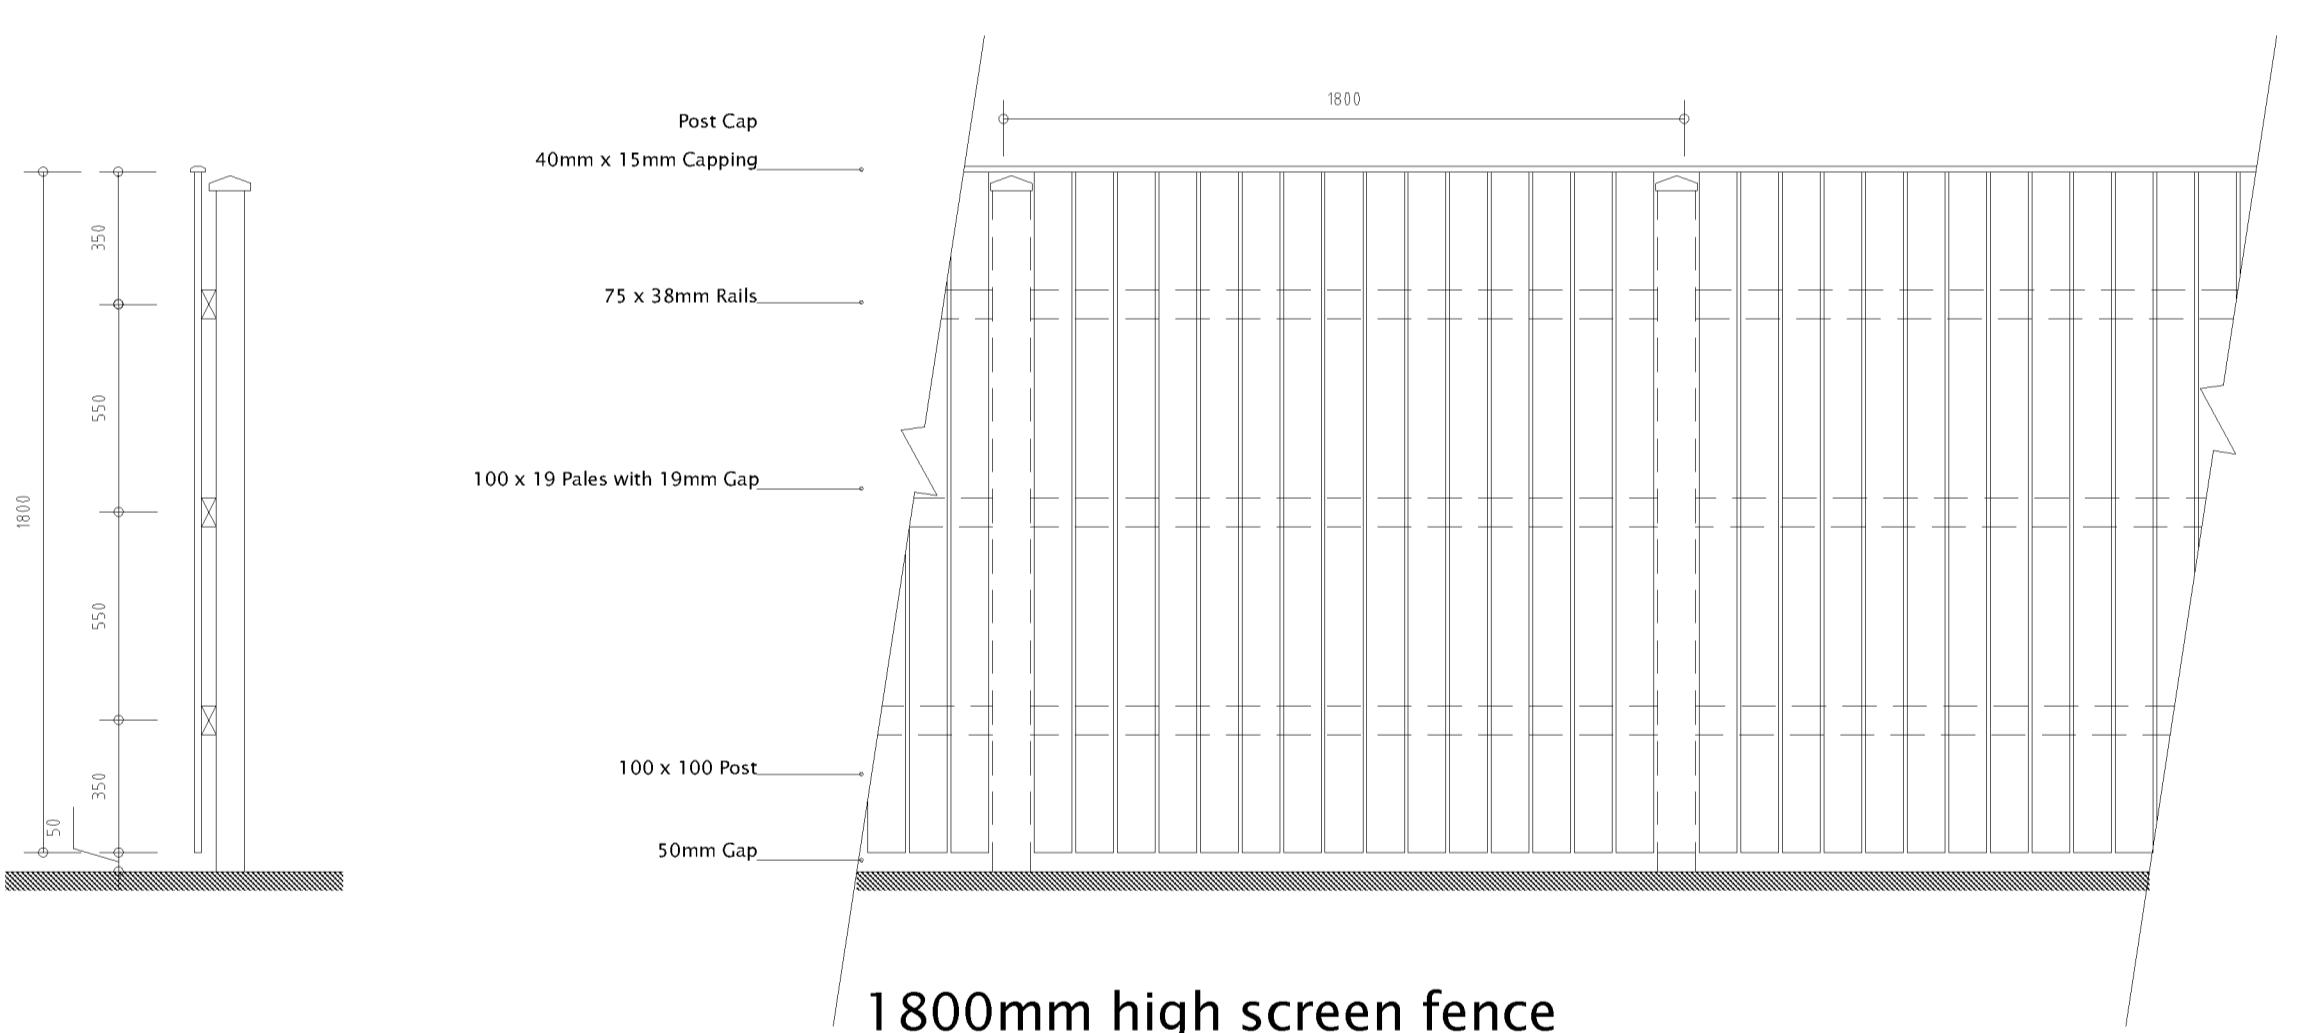


12mm Wide Movement joints at 10m centres, first joint no more than 5m from end

Foundations should be a minimum of 550 x 150 thick concrete & give 150 cover (or same as depth in certain cases) around all piers, depth from GL to underside 450mm minimum, all subject to site investigation report, for specific sites.

Wall Pillars To Be Filled with concrete & Strengthened With Wall Ties

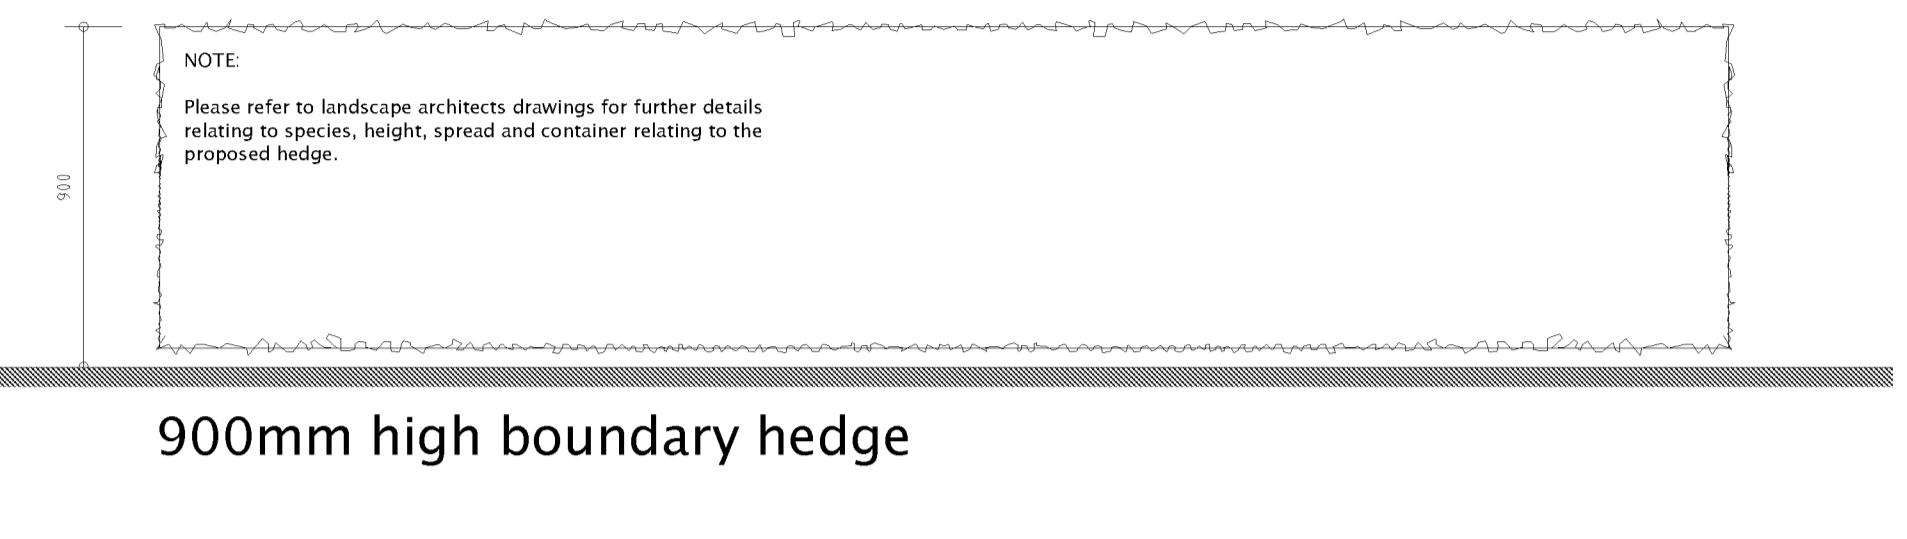

Rev	Description	Date	Drawn	Chkd
Boundary Treatment Details				
Project:	Lidsey Road - Phase 1 Woodgate			
Client(s):	BDW Southampton			
Drwg No:	ST-22-14	Rev:	Initial Issue	
Scale:	1:20 @ A1	Date:	10.09.2024	
Drawn By:	SW	Checked By:		
GROUP URBAN DESIGN				
BARRATT DEVELOPMENTS PLC				
BARRATT HOUSE, FOREST BUSINESS PARK, CARTWRIGHT WAY, BARDON HILL, LS67 1UF 01530 278274				