



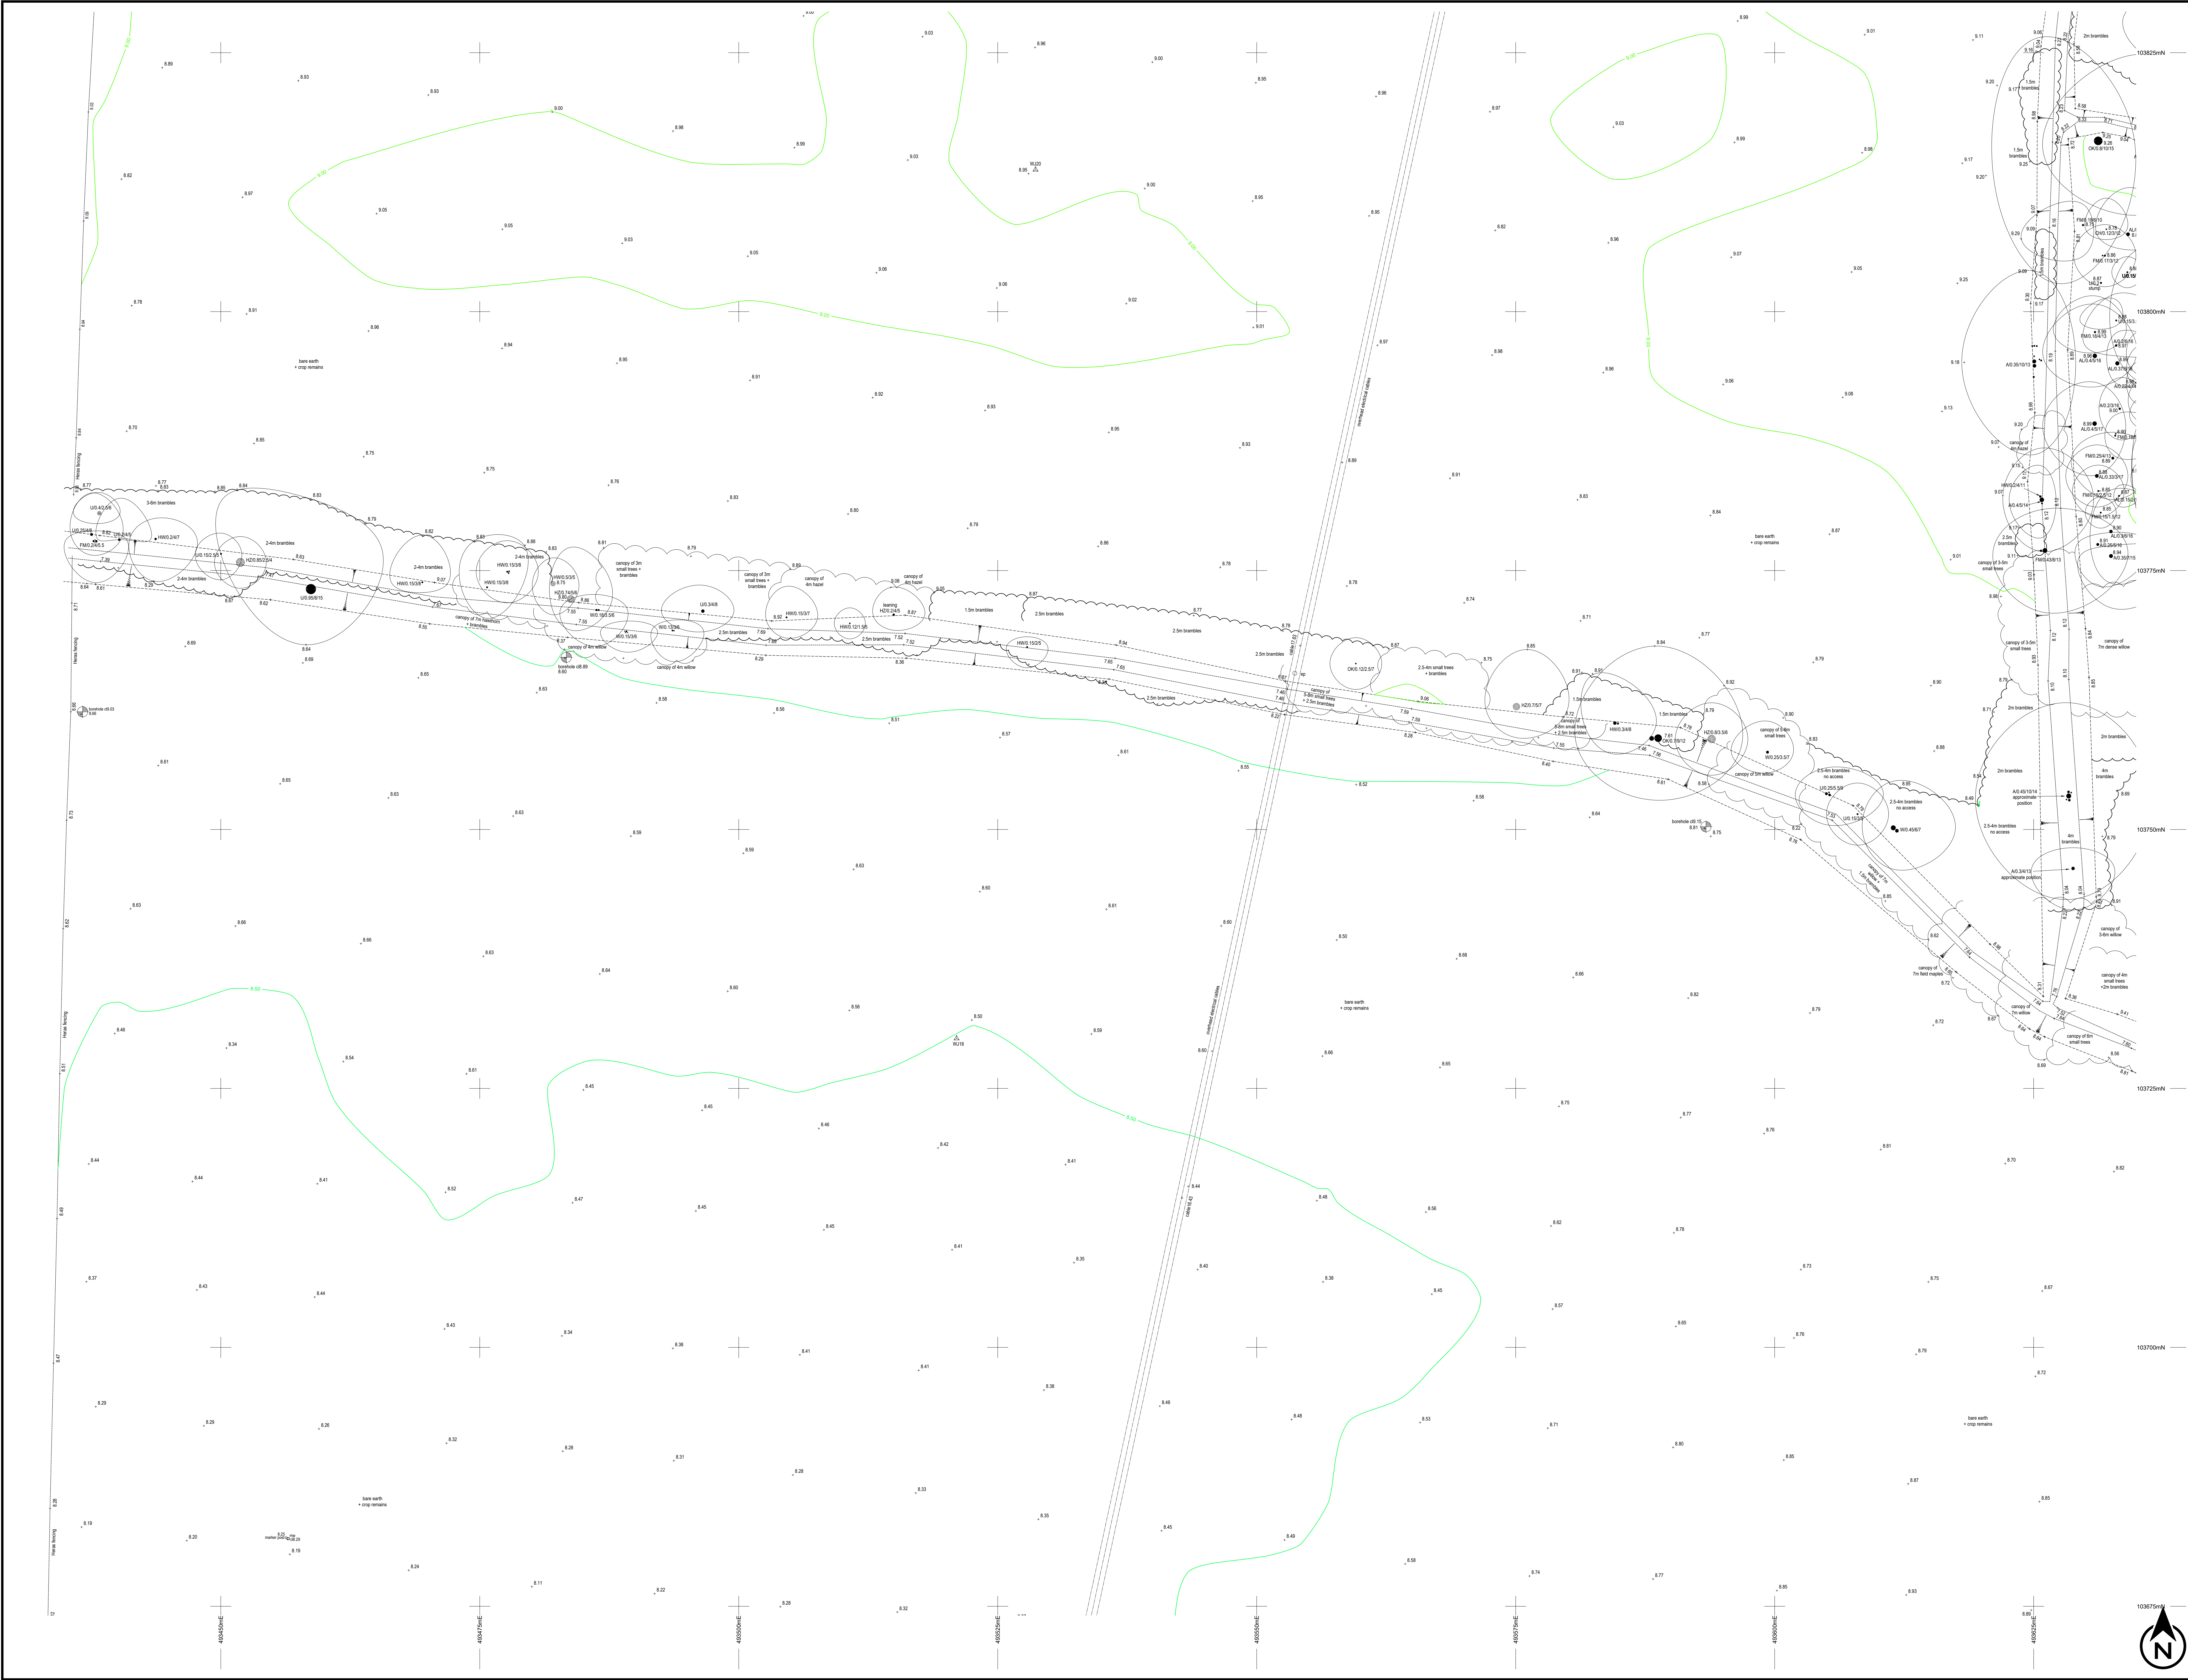


KEY	air conditioning	pb	post box
av	air valve	pc	pram crossing
br	barthole	rd	rodding eye
bol	bollard	rp	road name plate
bs	bus stop	rs	road sign
cb	cable tv cover	rw	rain water pipe
el	electric box	sa	soakaway
ep	electricity pole	st	slay / strut
er	transformer pole	sv	stop valve
fn	fire hydrant	sw	storm water manhole
fw	foul water manhole	tb	telephone box
g	gully	tc	telecoms cover
gv	gas stop valve	th	trial hole
ic	inspection cover	tl	traffic light
kd	kerb drain	tp	telegraph pole
li	litter bin	ul	unable to lift
lp	lamp post	vp	vent pipe
lt	light	vm	water meter
mh	manhole	wo	wash out
mkr	marker post	ws	water stop valve
mw	monitoring well	yg	yard gully
oh	overhead		

TREES (species / trunk diameter / max. spread / height)	
A	ash
AL	alder
AP	apple
BA	bay
C	cedar
CB	copper beech
CH	cherry
CY	cypress
EL	elm
EU	eucalyptus
FM	field maple
H	hornbeam
HC	horse chestnut
HQ	holm oak
HW	hawthorn
HY	holly
HZ	hazel
IB	indian beech tree
JM	japanese maple
LM	lime
LO	locust

FENCES	barbed wire fence	cl	cover level
bwf	barbed wire fence	cl	cover level
cbf	closed-board fence	dpc	damp-proof course
cd	concrete post	fl	floor level
cpf	chestnut paling fence	gu	gully level
cwf	chicken wire fence	il	invert level
if	iron railing fence	oh	overhead cable level
pkf	picket fence	sof	suffit level
prf	post and rail fence	th	threshold level
pwf	post and wire fence	ul	underside level
scf	security fence	wl	water level
sp	steel post	wt	wall top
wmf	wire mesh fence		
wpf	wood panel fence		

LEVELS	
cl	cover level
dpc	damp-proof course
fl	floor level
gu	gully level
il	invert level
oh	overhead cable level
sof	suffit level
th	threshold level
ul	underside level
wl	water level
wt	wall top

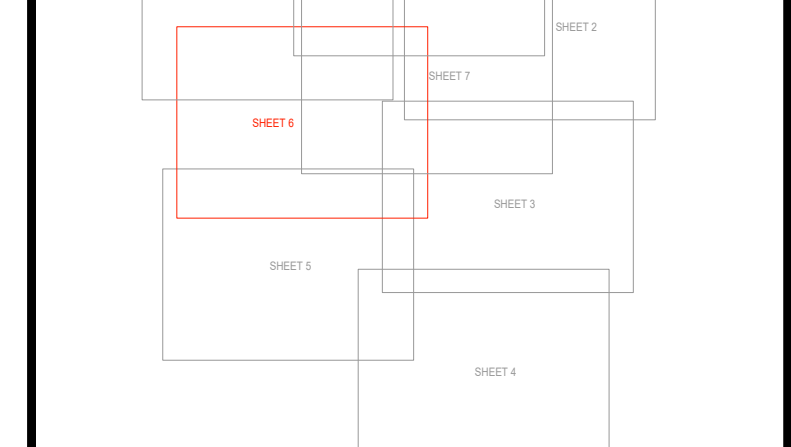


NOTES

The survey grid has been related to OS National Grid using a flat earth projection and metric scale factor of 1, centred on Station [WJ16]. Levels are related to OS datum determined from the National GPS Network using OSGM15.

All setting out should be referenced to the permanent control stations shown on this survey. Do not use GNSS/GPS operating on the OS Active Network without first carrying out a site calibration.

The position and height of adjacent buildings have been obtained using higher level reflectorless measurement and may not take account of single storey extensions or conservatories below the line of sight.

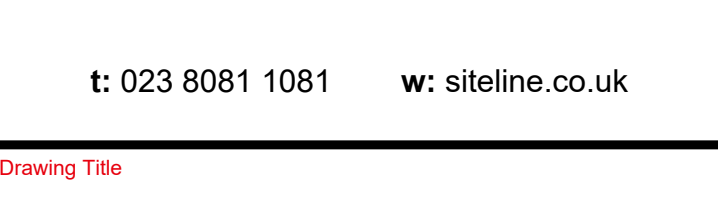

t: 023 8081 1081 w: siteline.co.uk

Drawing Title

SITE SURVEY

Drawing Number

36WJ01

Client

BARRATT DAVID WILSON HOMES

Contact

LAND WEST OF LIDSEY ROAD WOODGATE

Scale

1:200 at A0

Date

NOVEMBER 2024

Surveyor(s)

HB

Checked by

IA

SHEET 6 OF 9