

KEY:

Proposed Adoptable Sewers:

Foul sewer

Proposed Private Drainage:

Foul drain

Storm drain

Rodding eye

Yard gully

Aco drain

Filter Drain

Highway gullies to discharge via permeavoids to a permeable sub-base

Beany kerbs

Permeable block paving

Impermeable block paving

All private inspection chambers shall be polypropylene non-access chambers in accordance with The Building Regulations, Part H.

Chamber sizes:

Depth to invert <0.6m DN300

Depth to invert >0.6m DN475

Invert levels shown thus: F10.00 S10.00

Finished floor levels shown thus: FFL 10.00

Stepped Cavity Tray

External Brickwork

Tanking

Slab on Edge

Retaining Wall




Fall Arrows

Proposed Levels

Primary Access

Secondary Access

KEY PLAN:

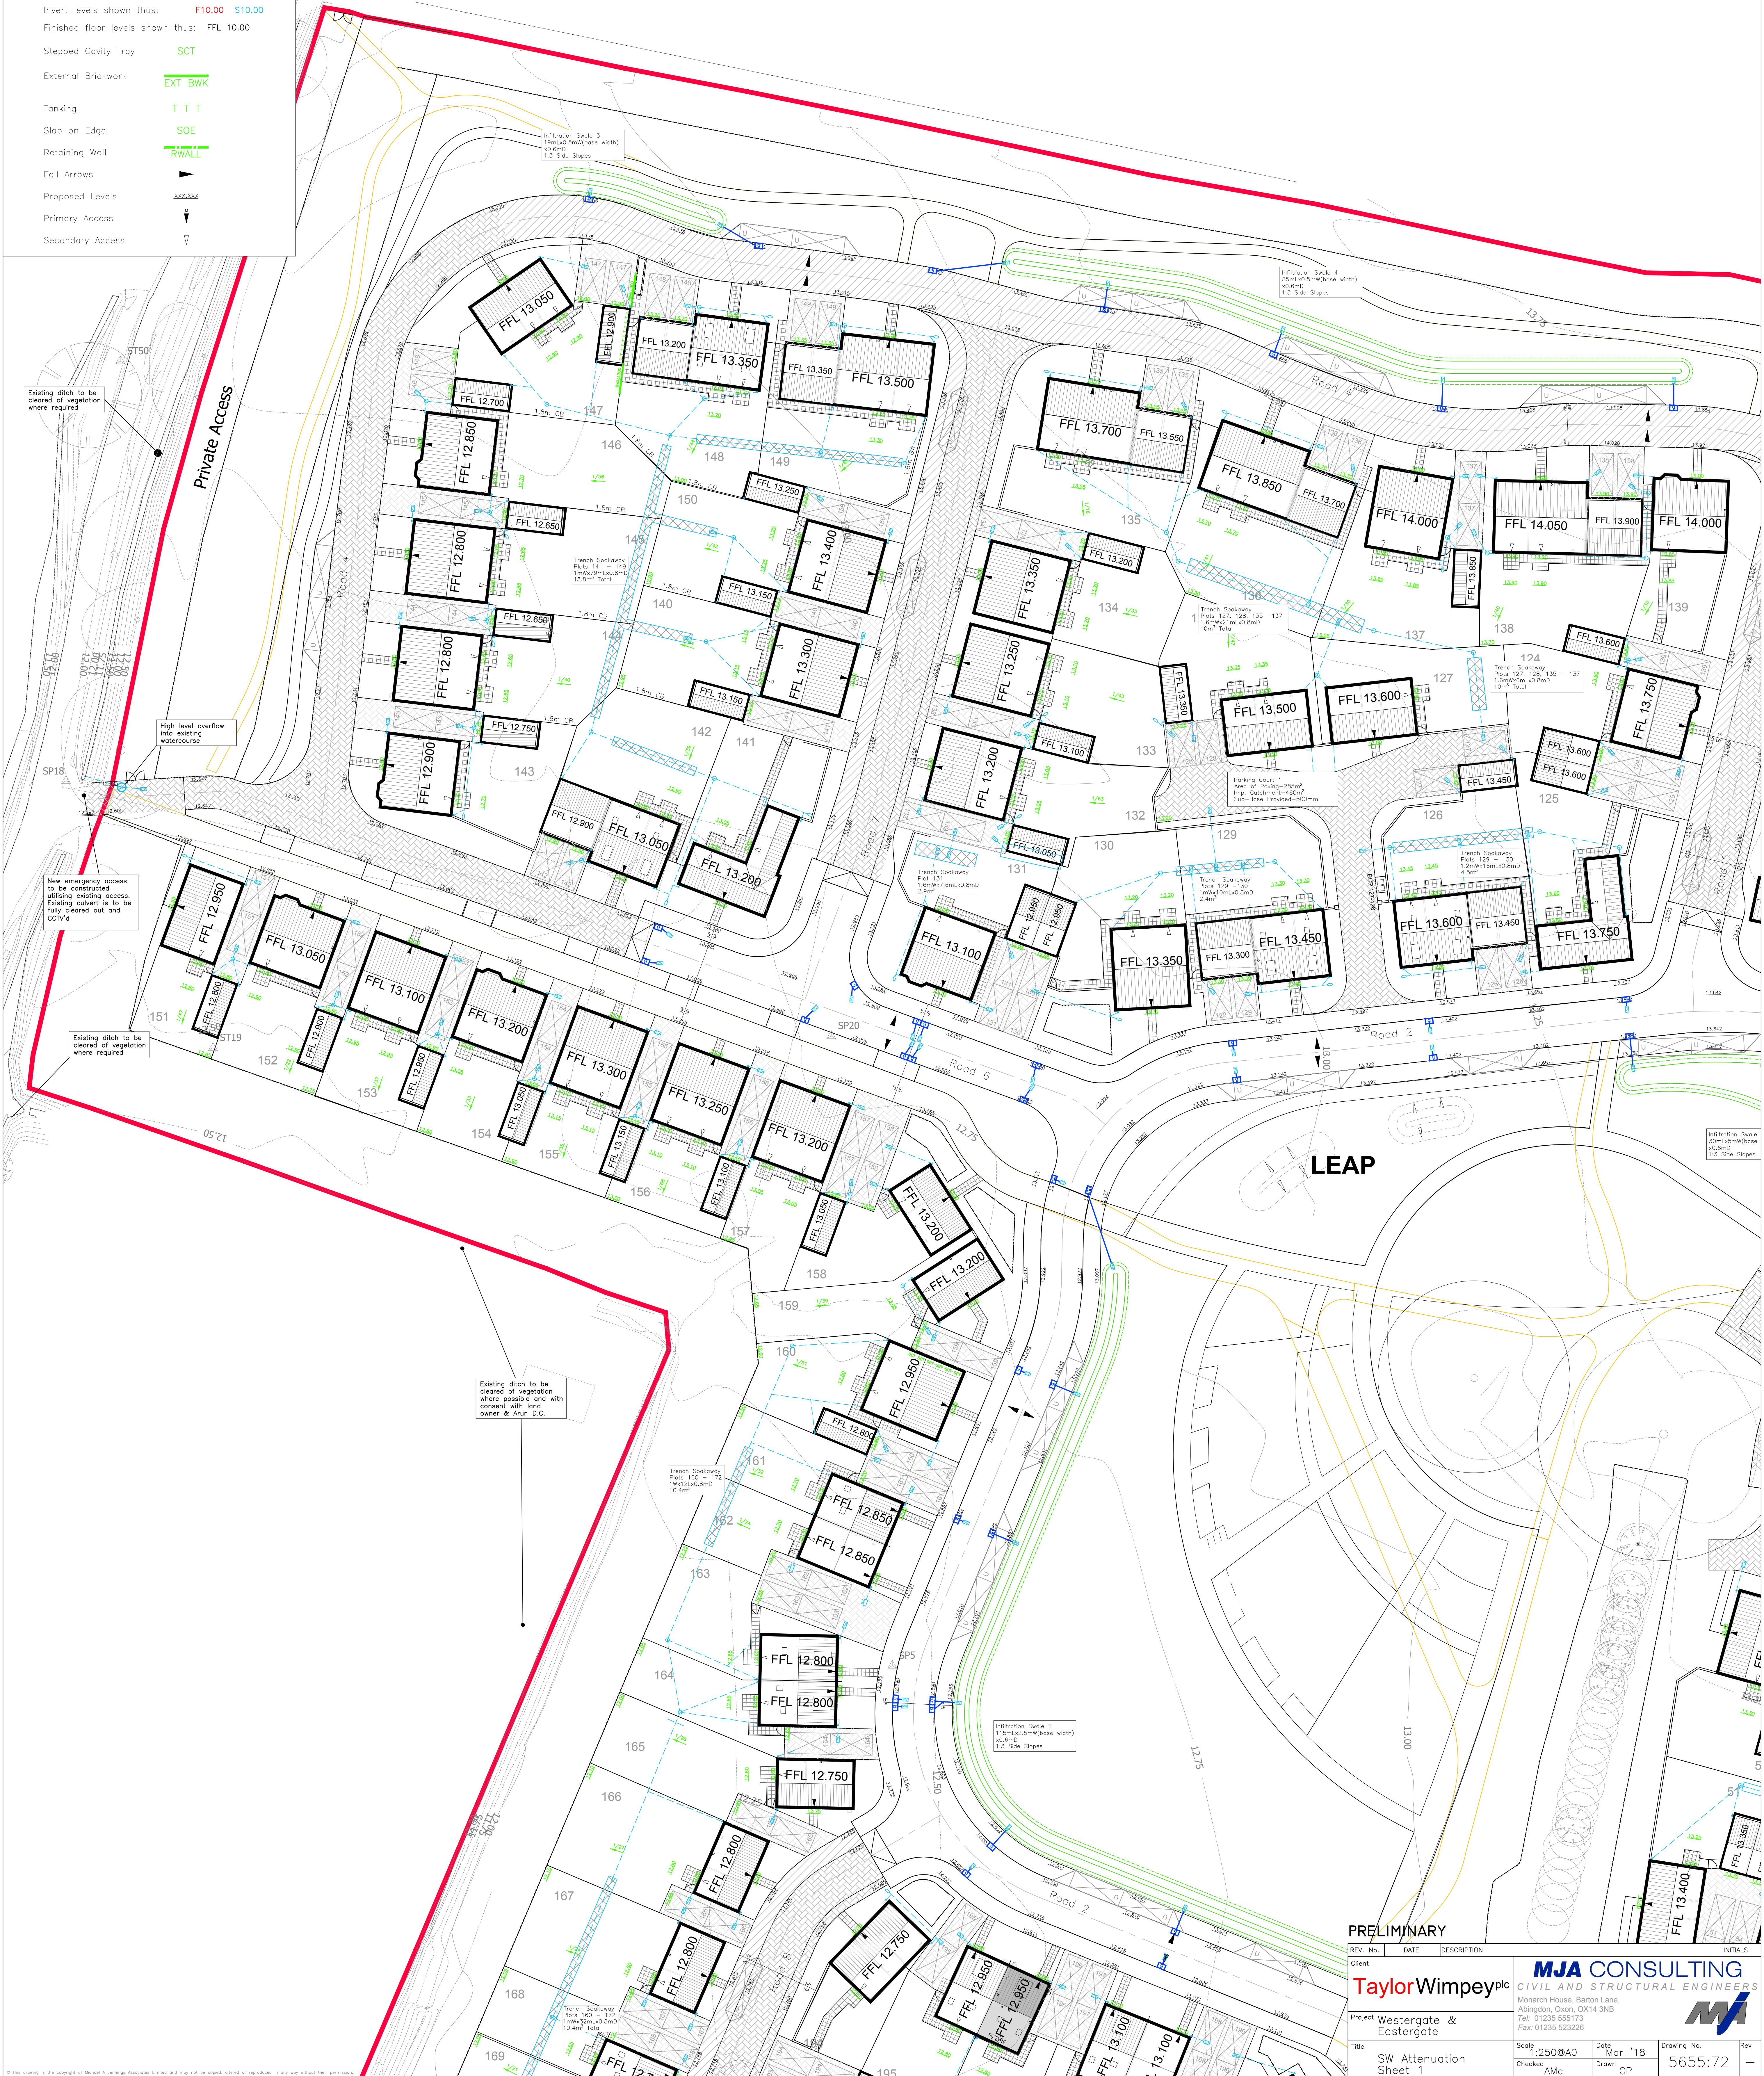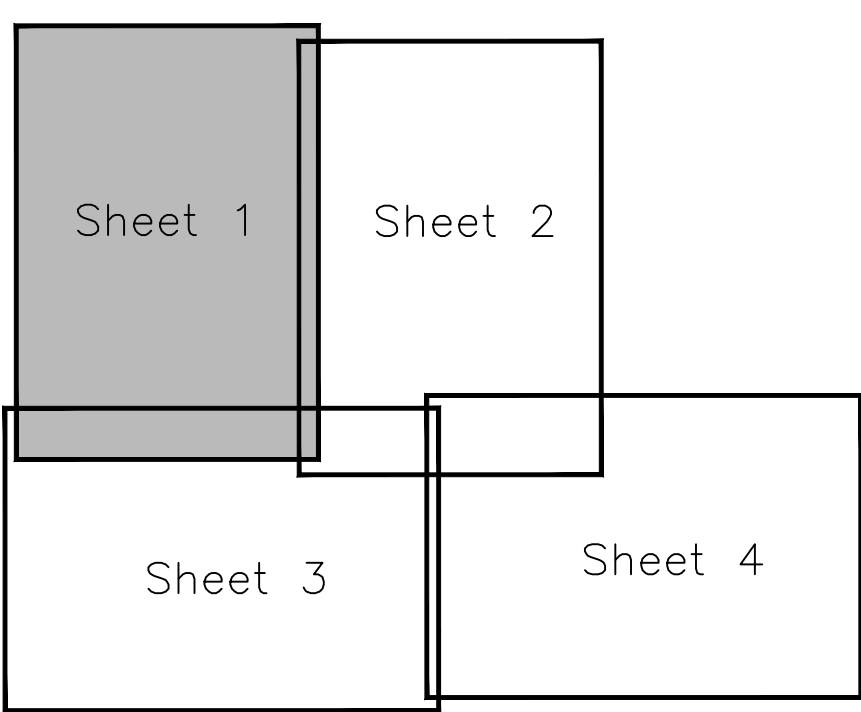

PRELIMINARY

REV. No. DATE DESCRIPTION

Client

Taylor Wimpey plc

Project Westergate & Eastergate

Title SW Attenuation Sheet 1

MJA CONSULTING

CIVIL AND STRUCTURAL ENGINEERS

Monarch House, Barton Lane, Abingdon, Oxon, OX14 3NB

Tel: 01235 555173 Fax: 01235 523225

Scale 1:250 @ A0

Checks AMc

Date Mar '18

Drawn CP

Drawing No. 5655:72

Rev -