

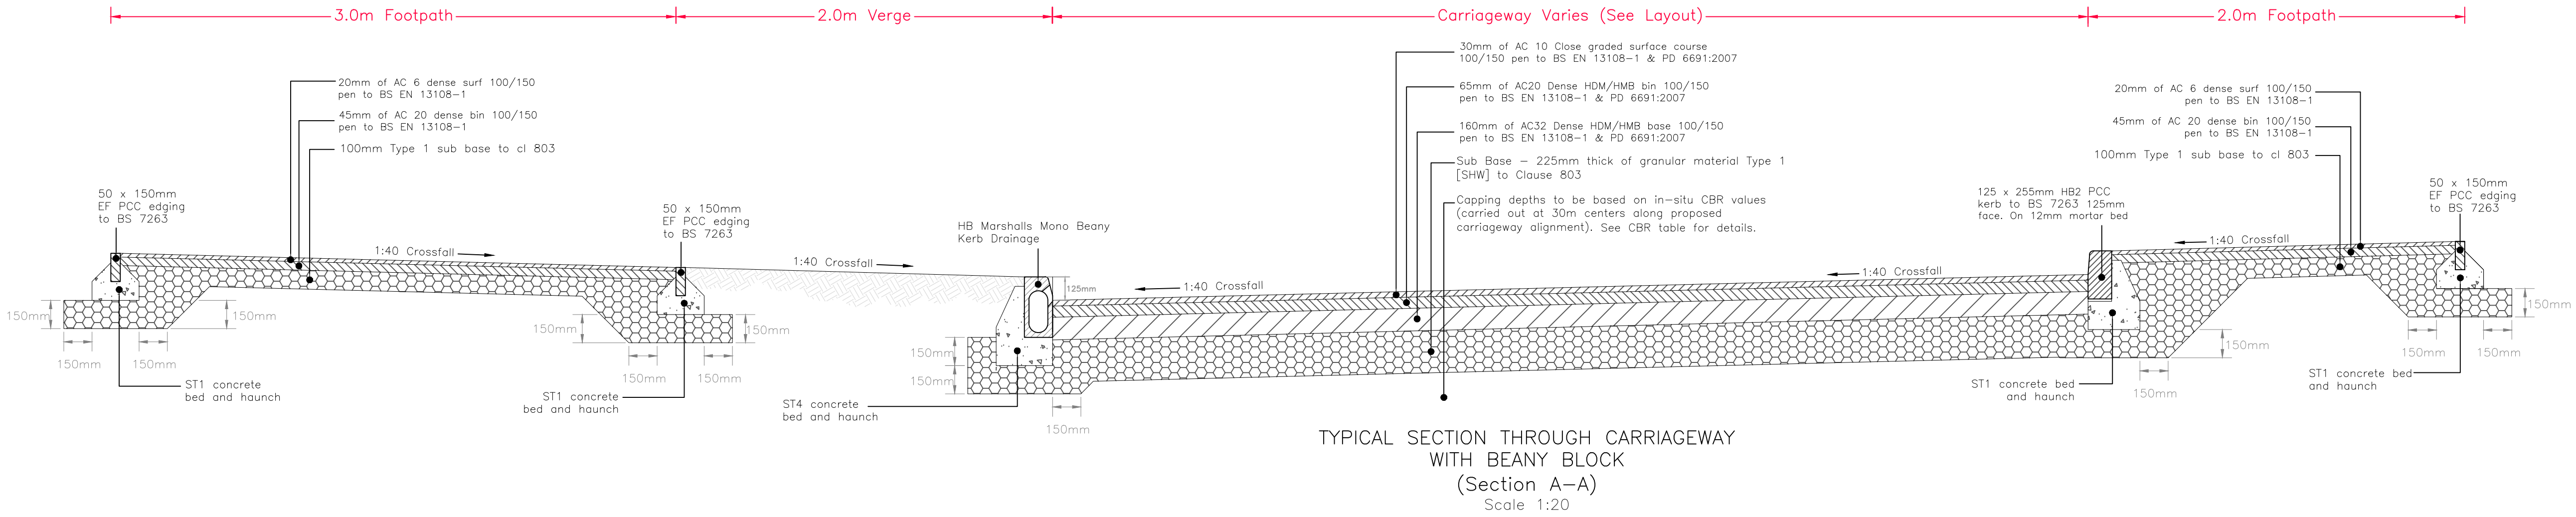
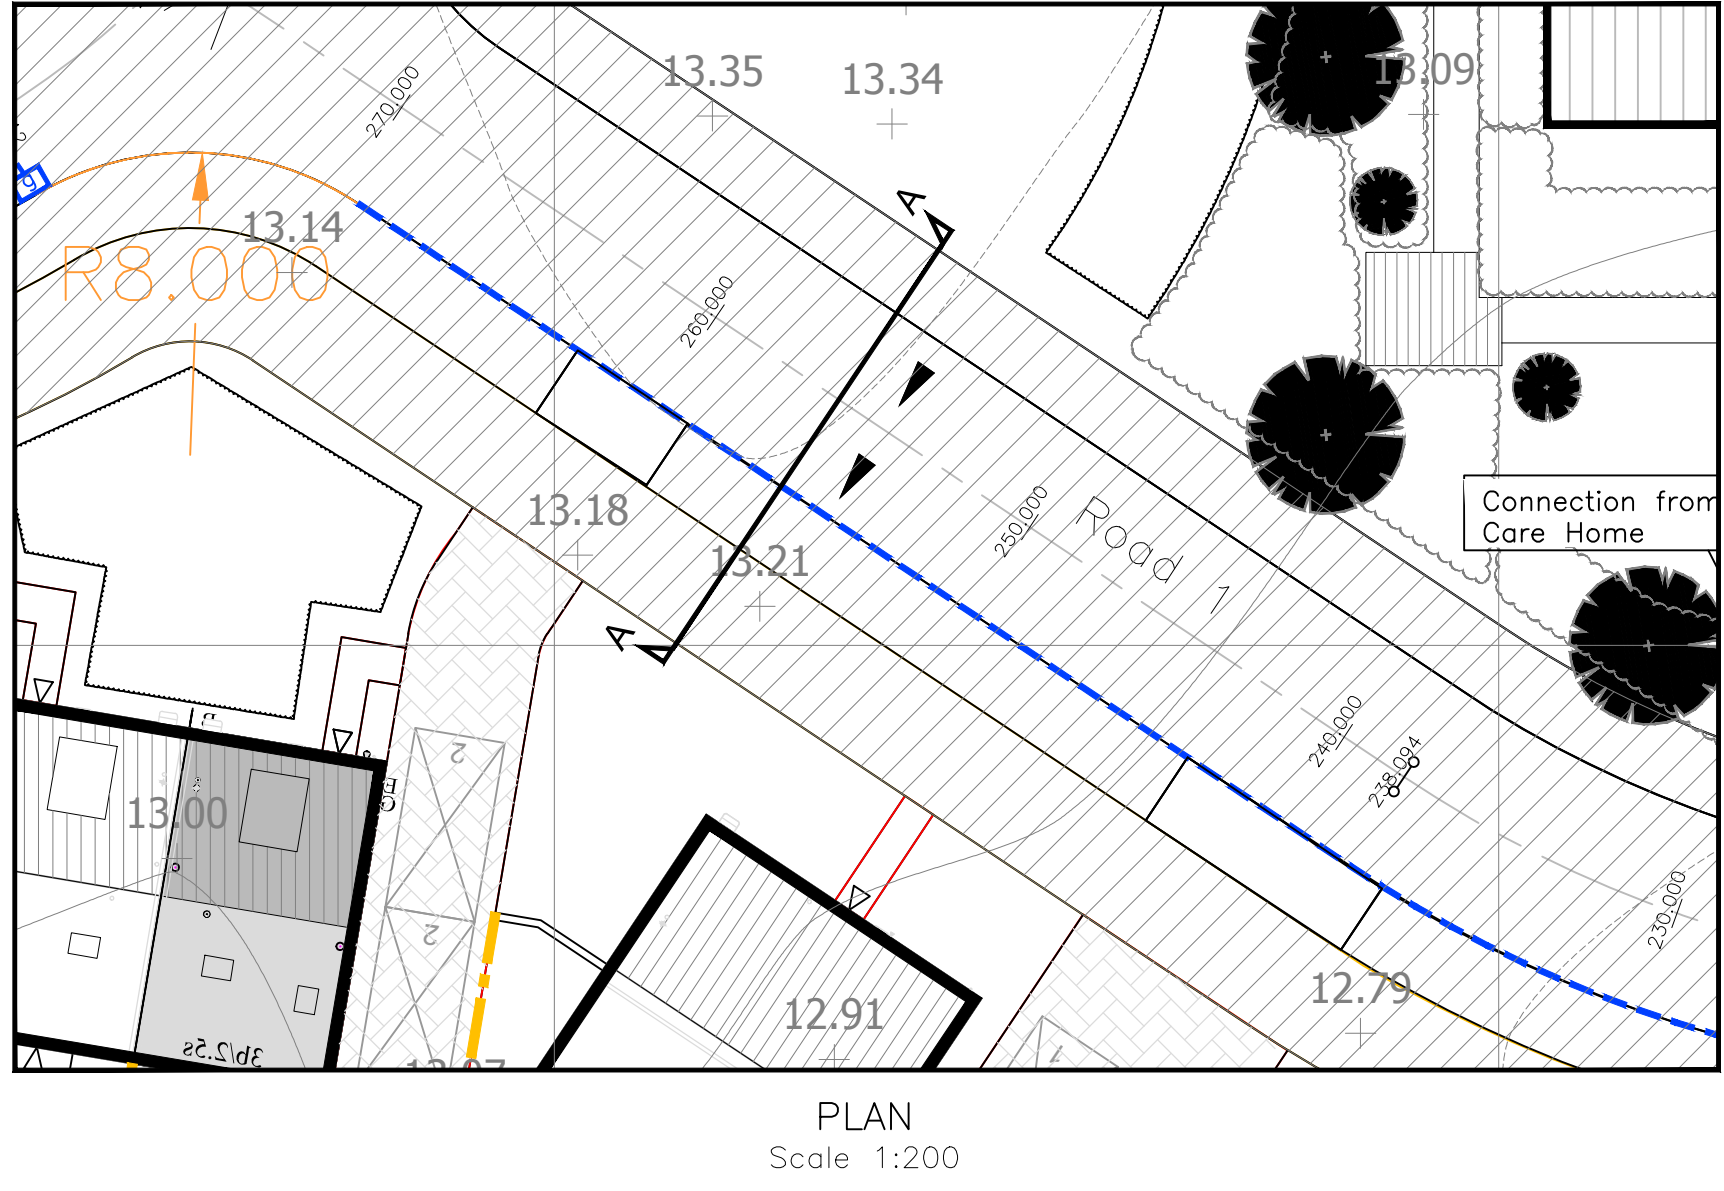
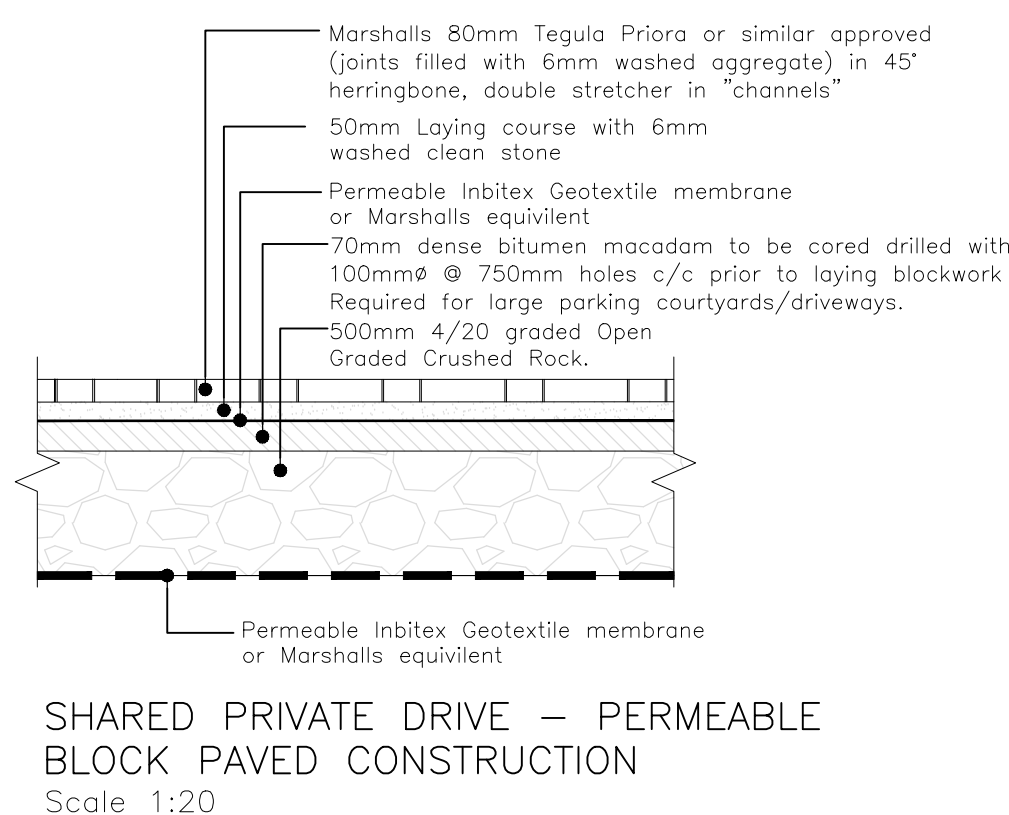
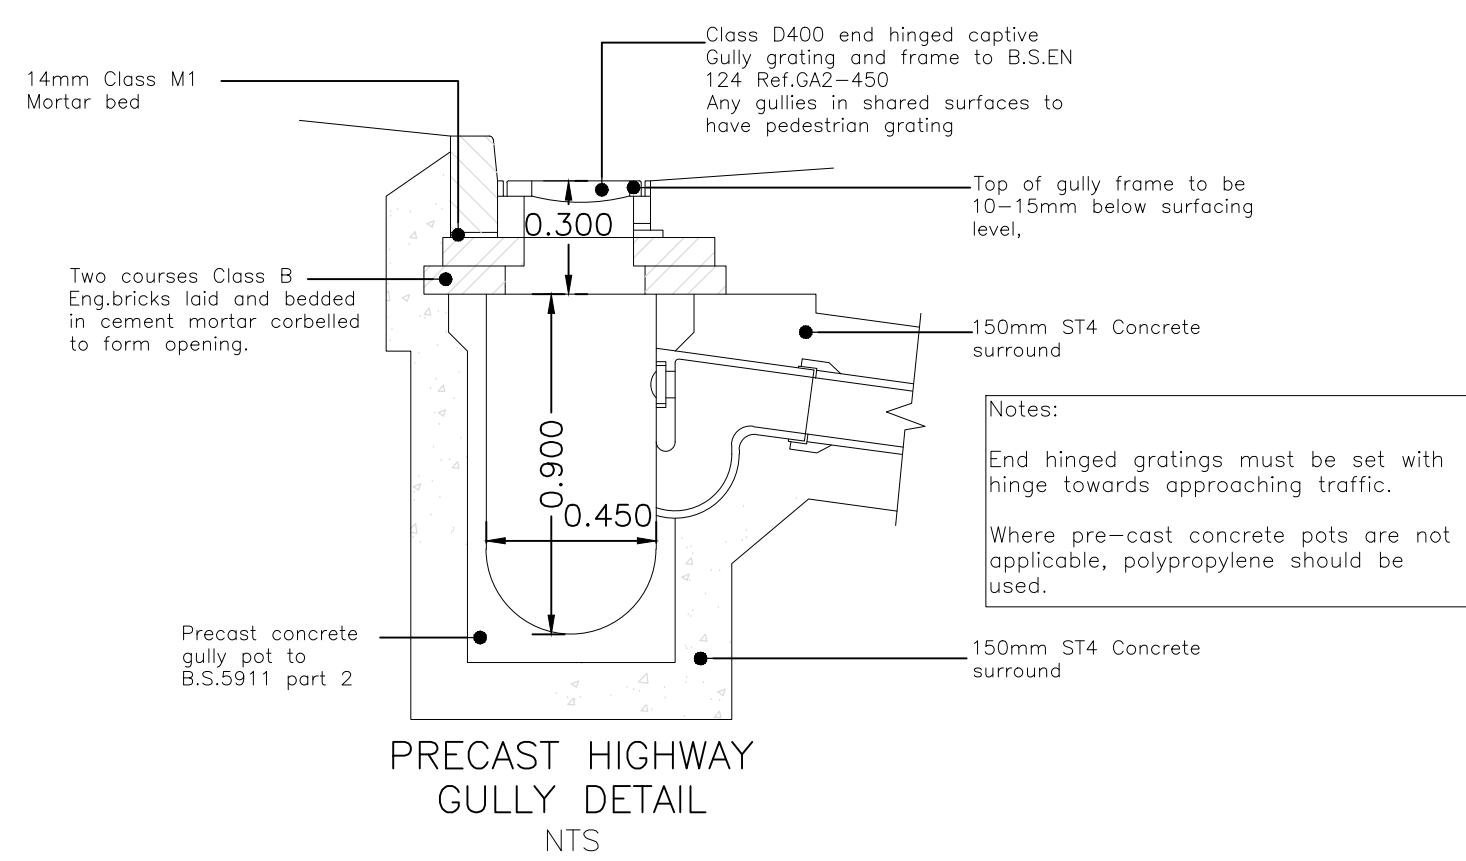
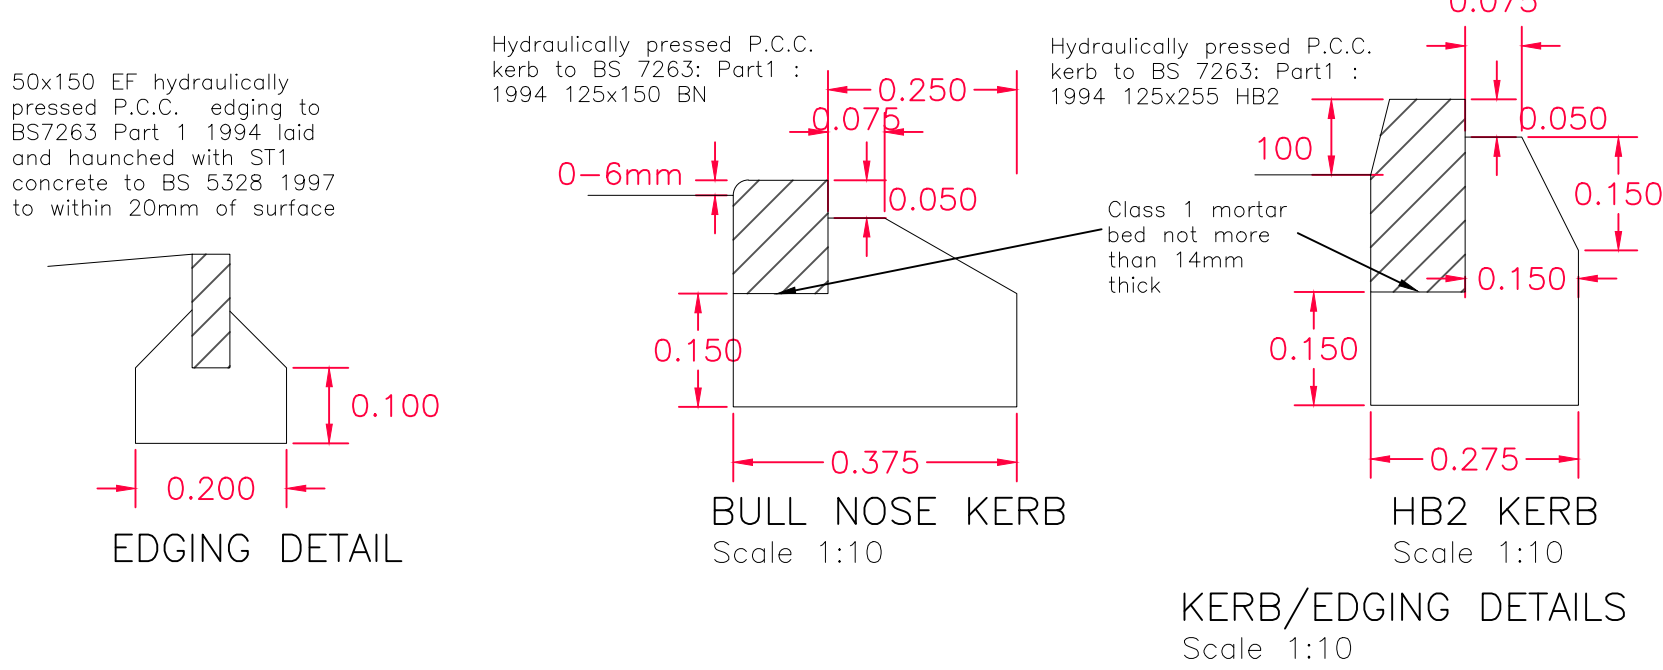
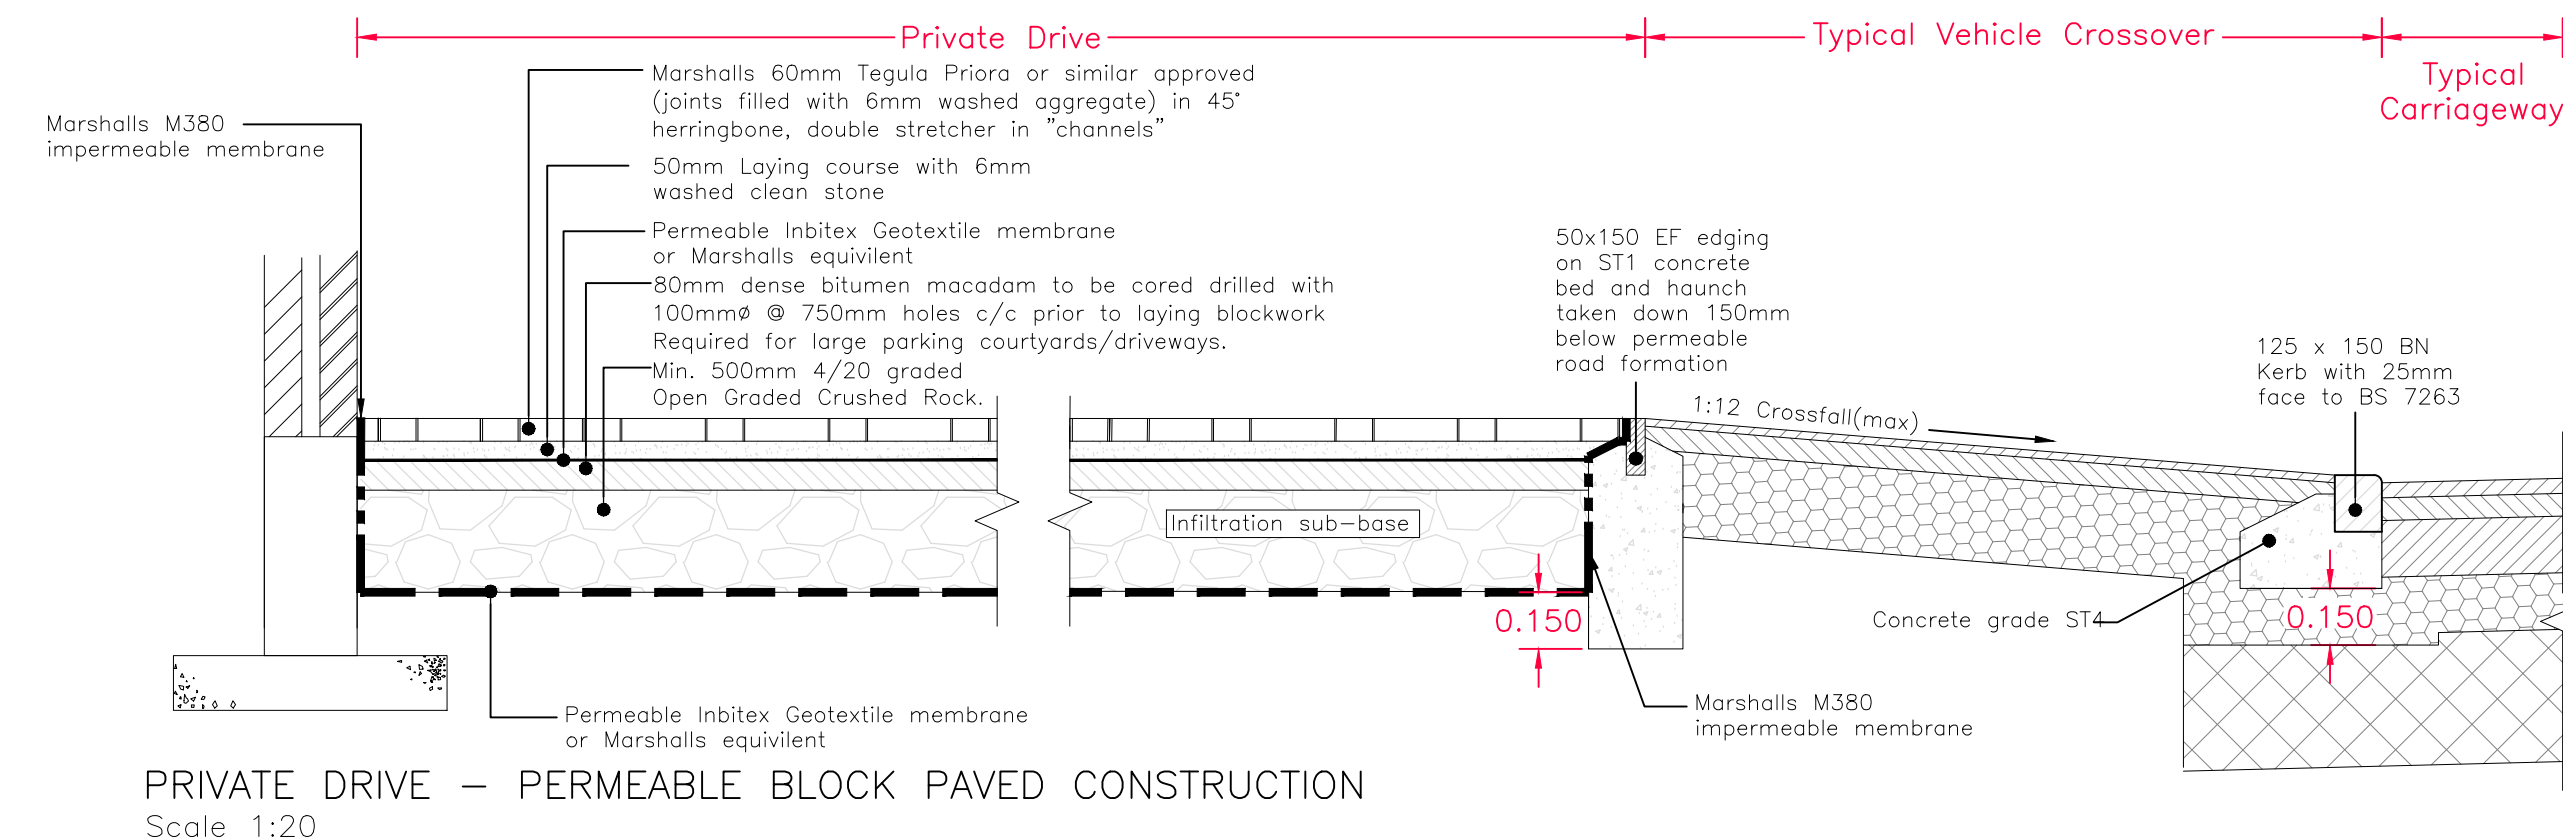
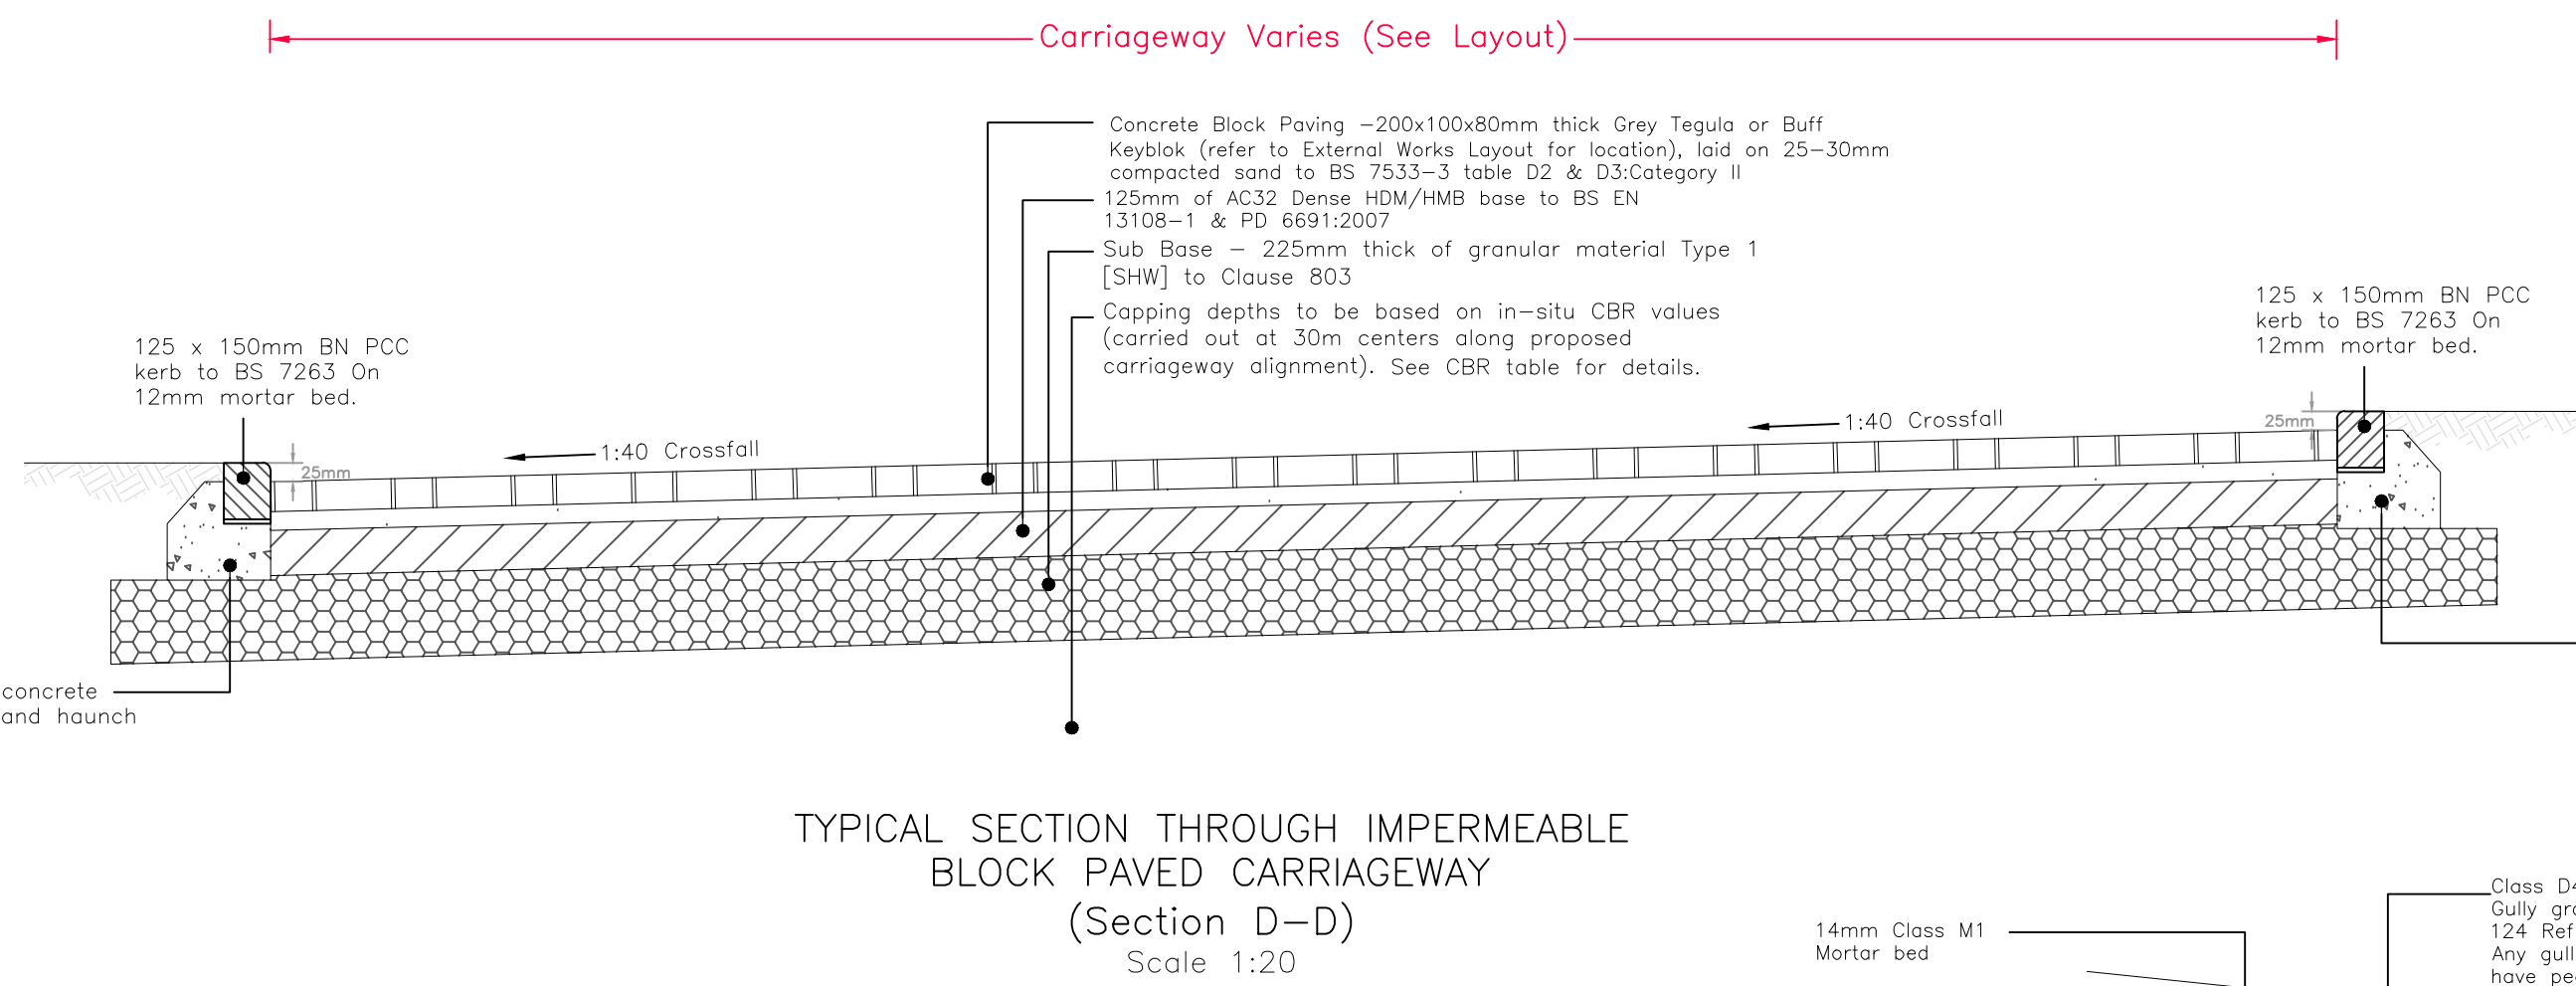
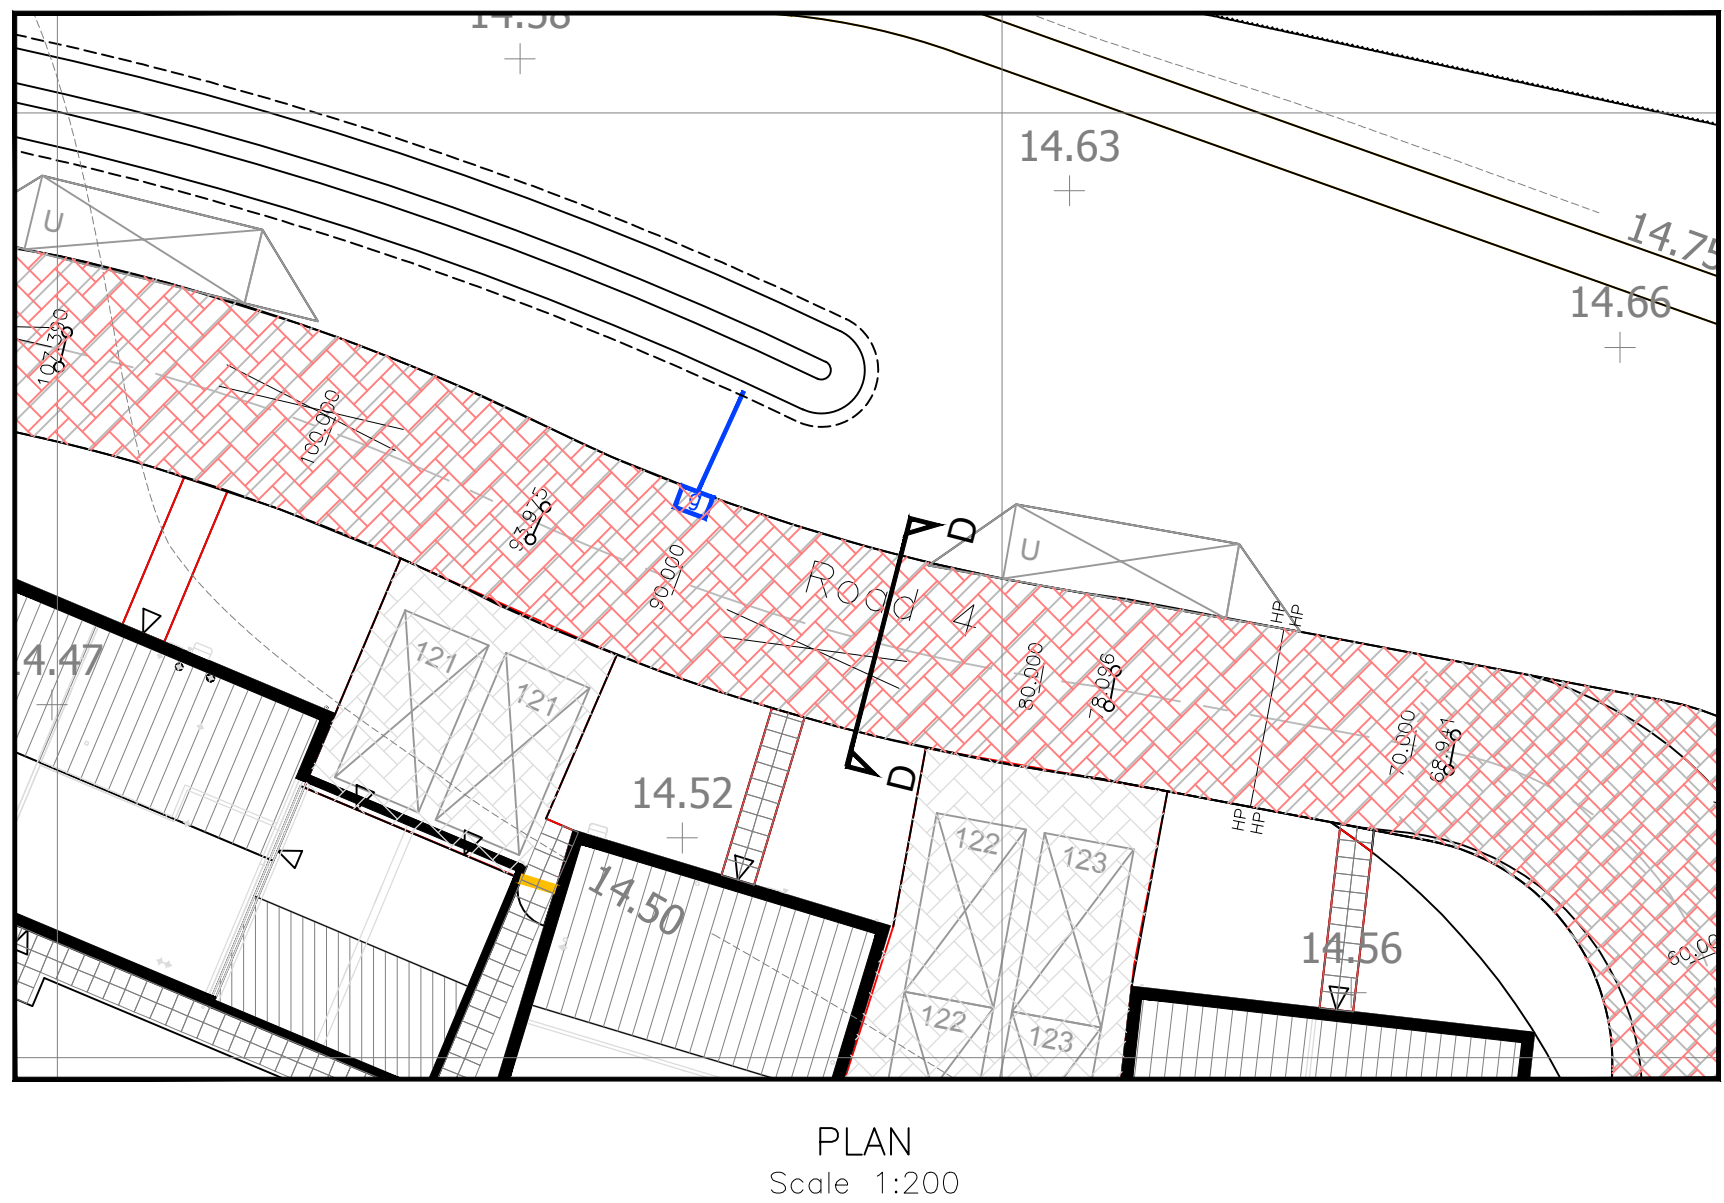
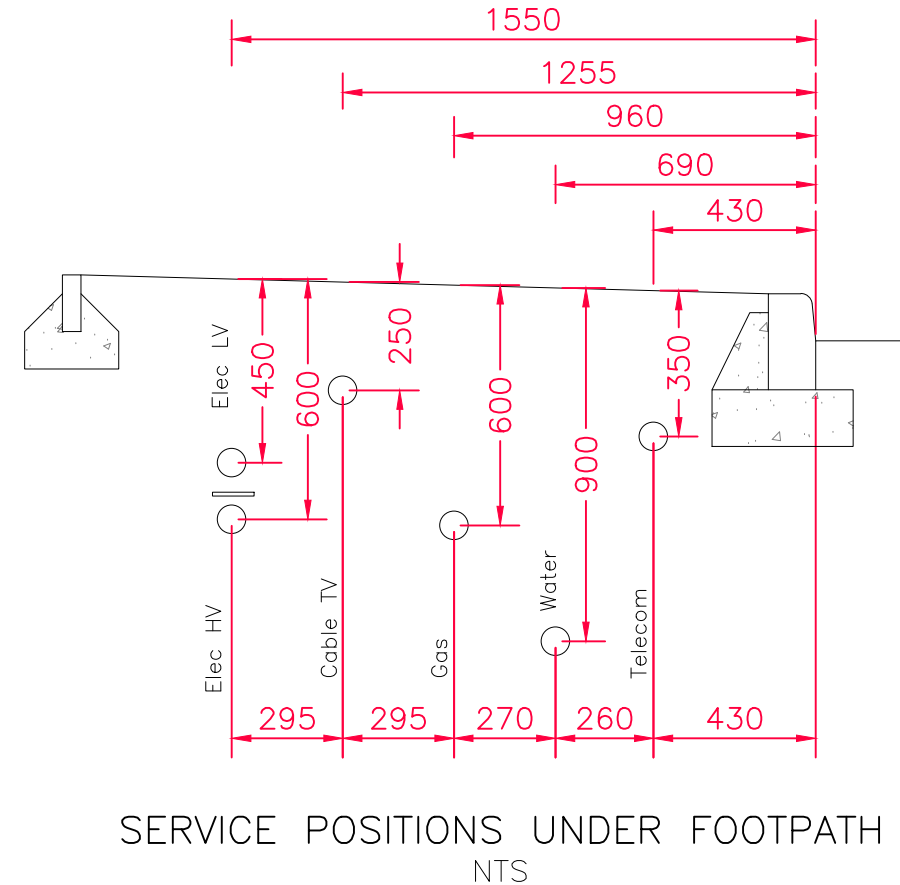
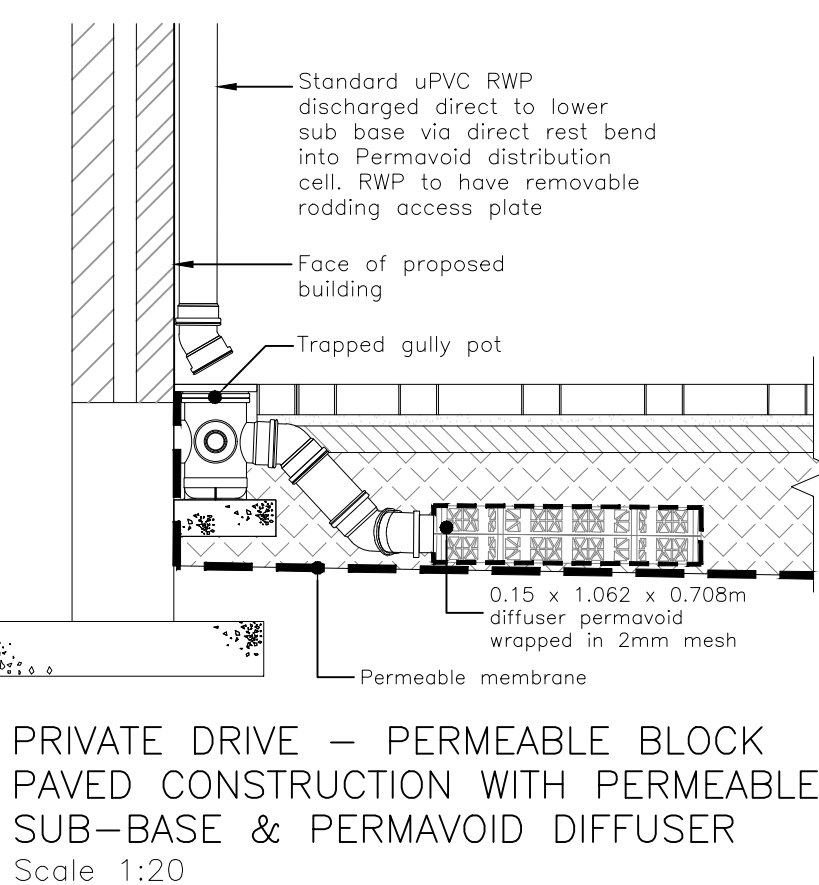
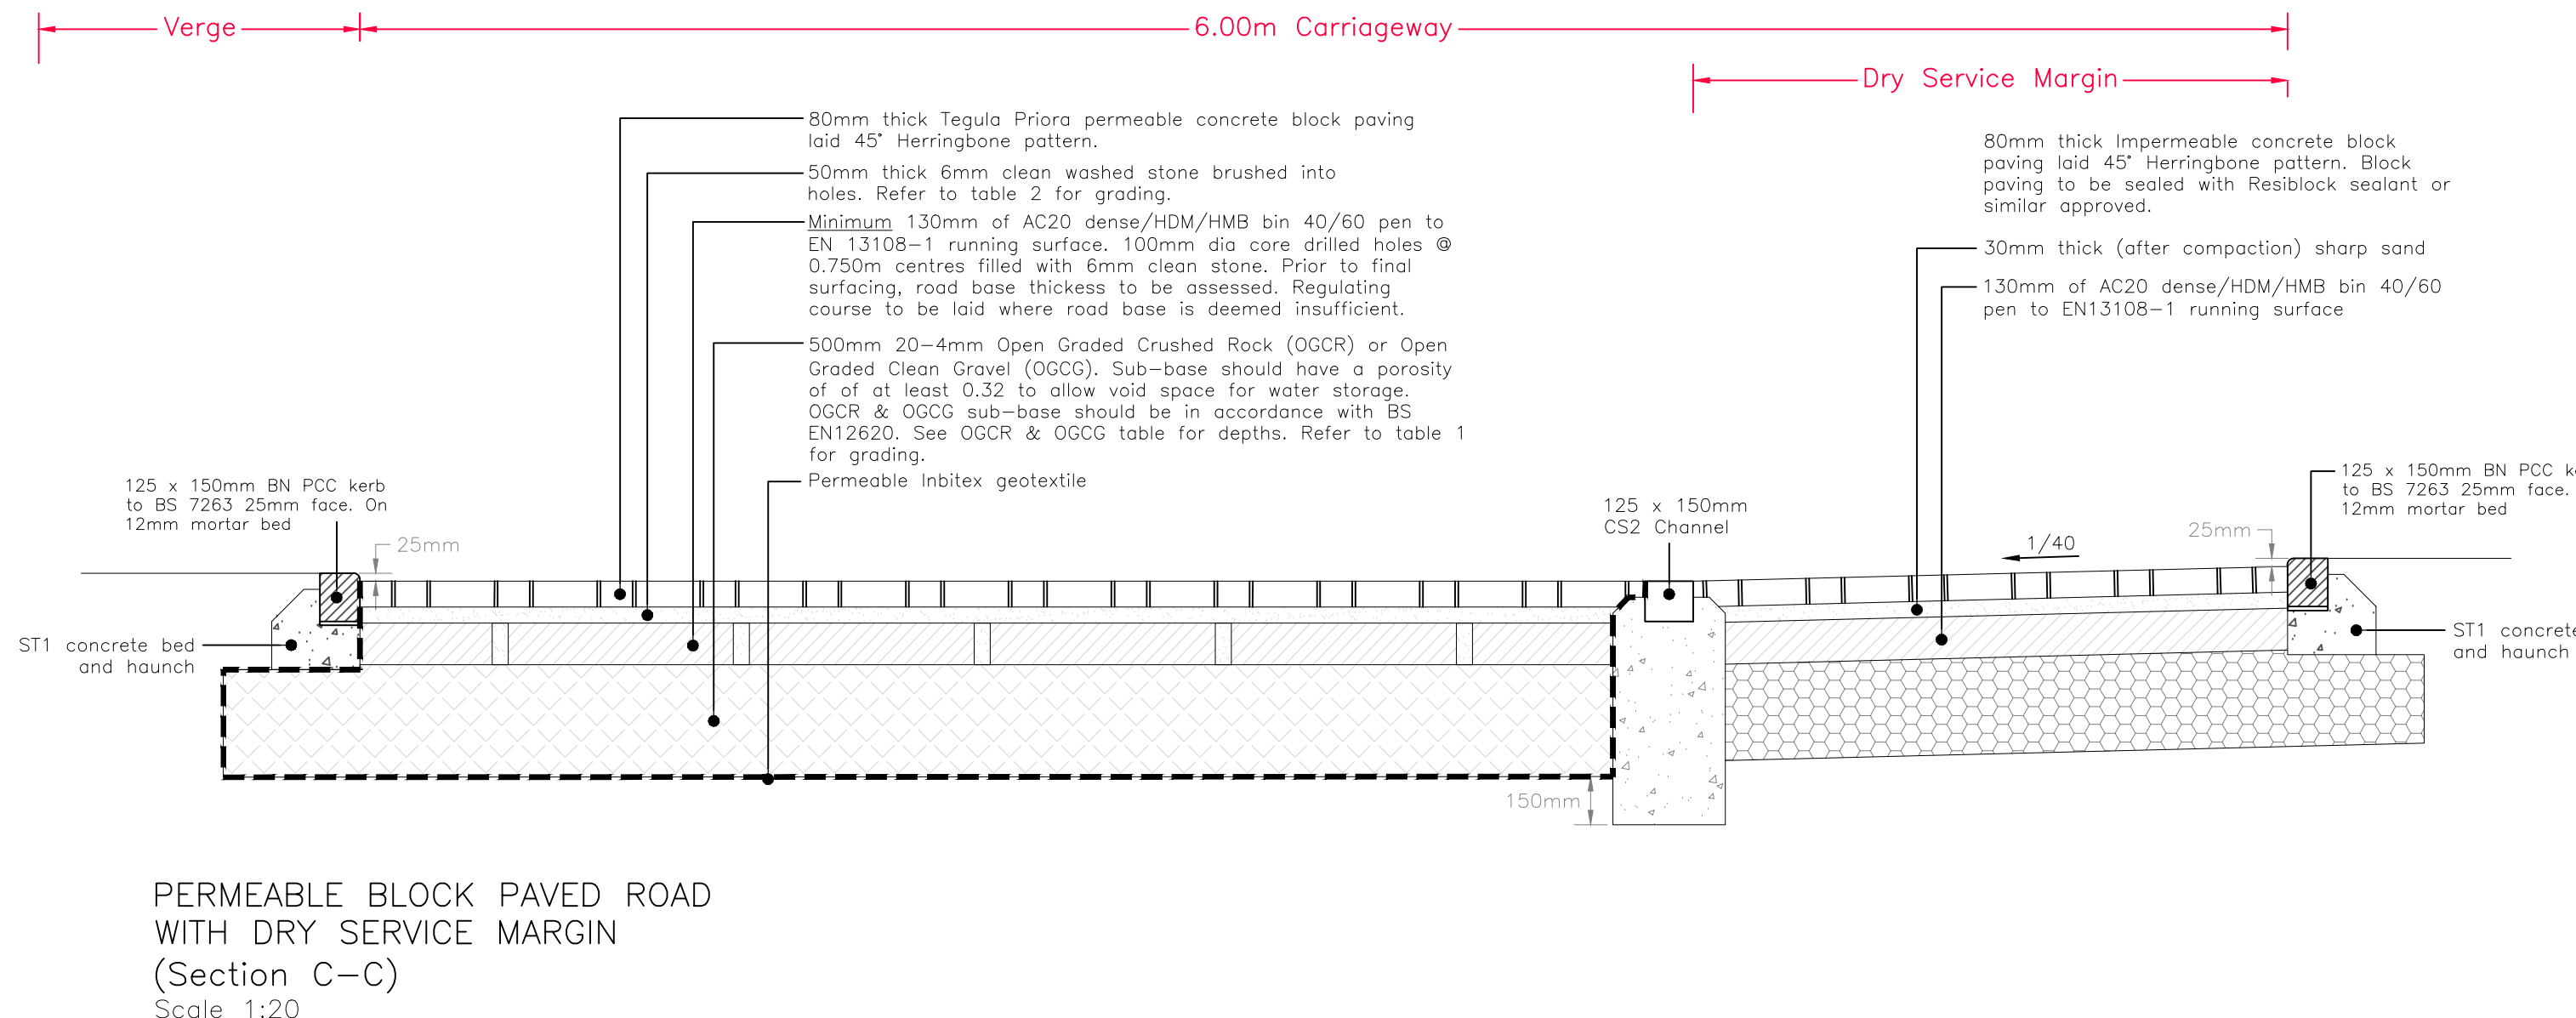
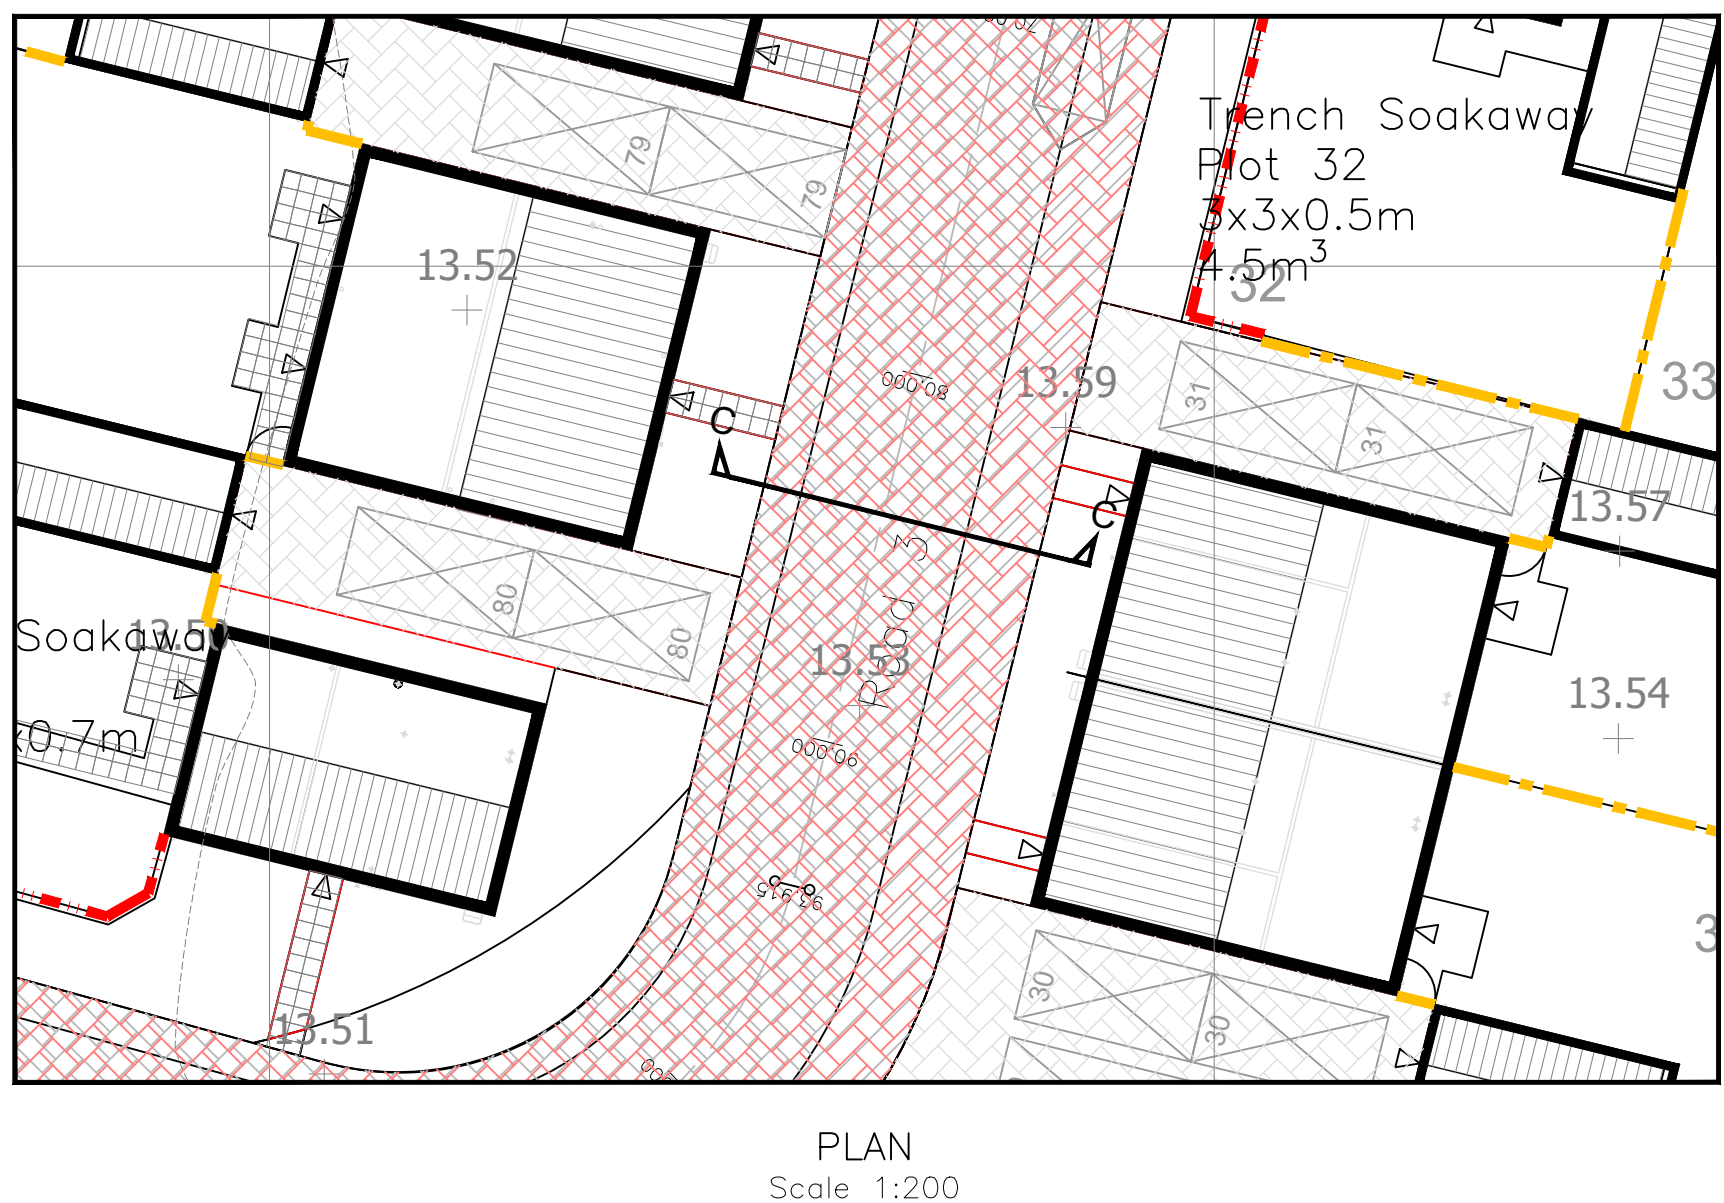
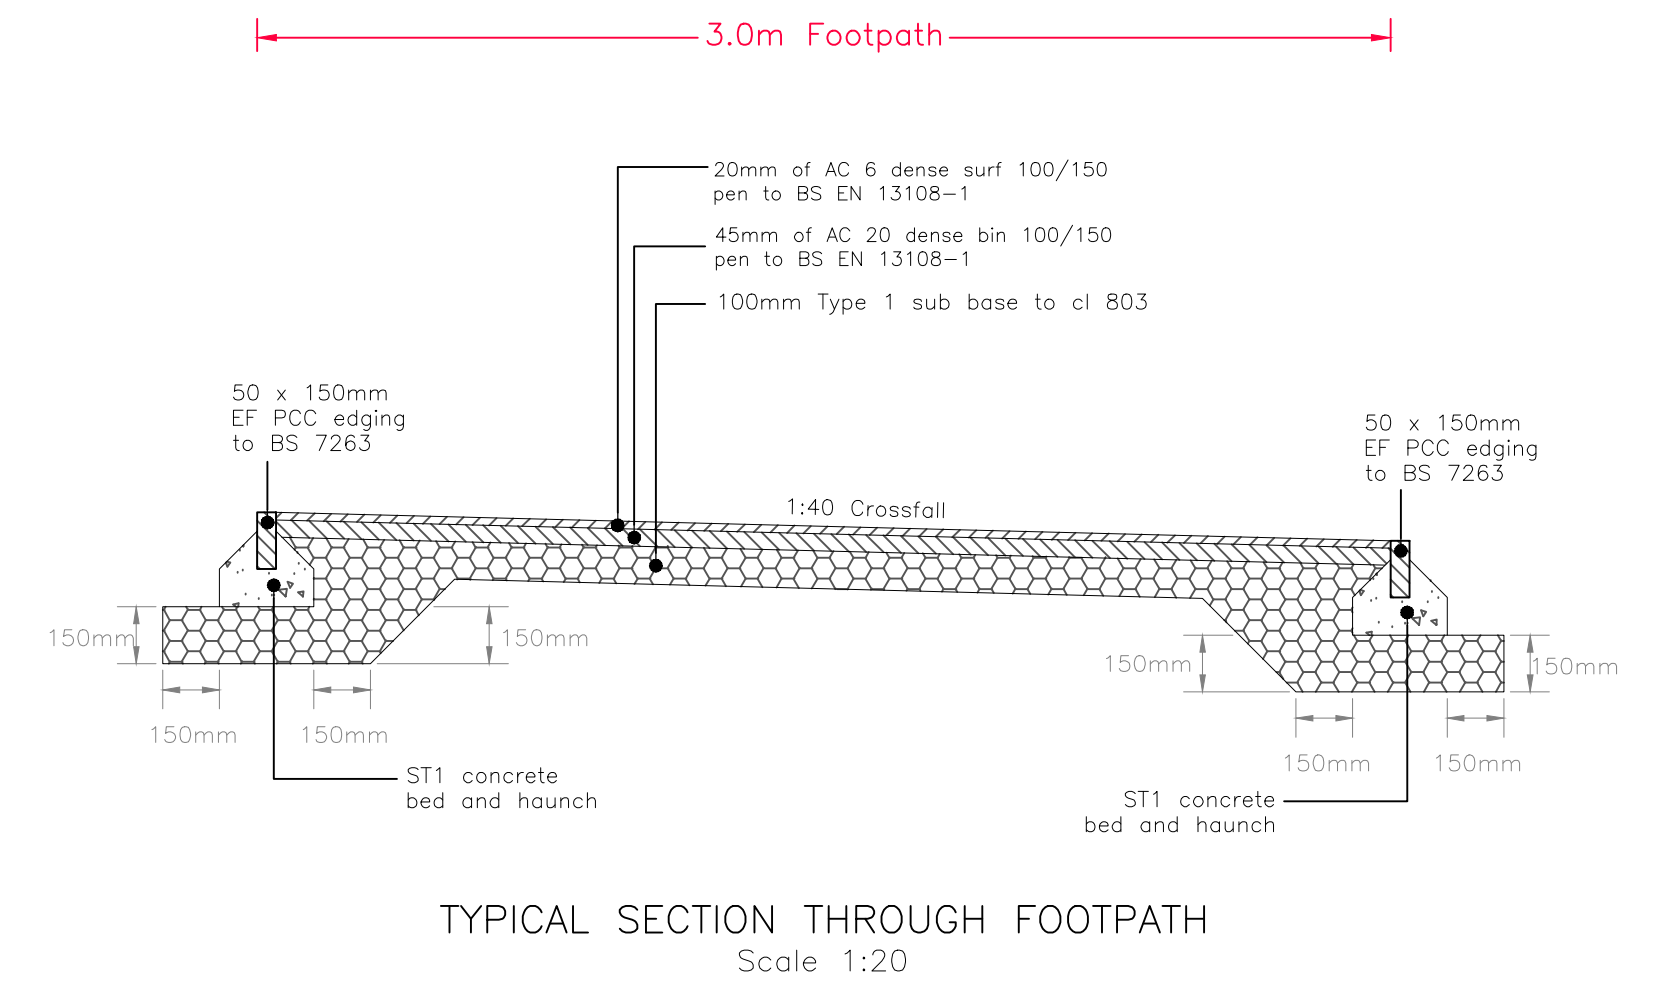


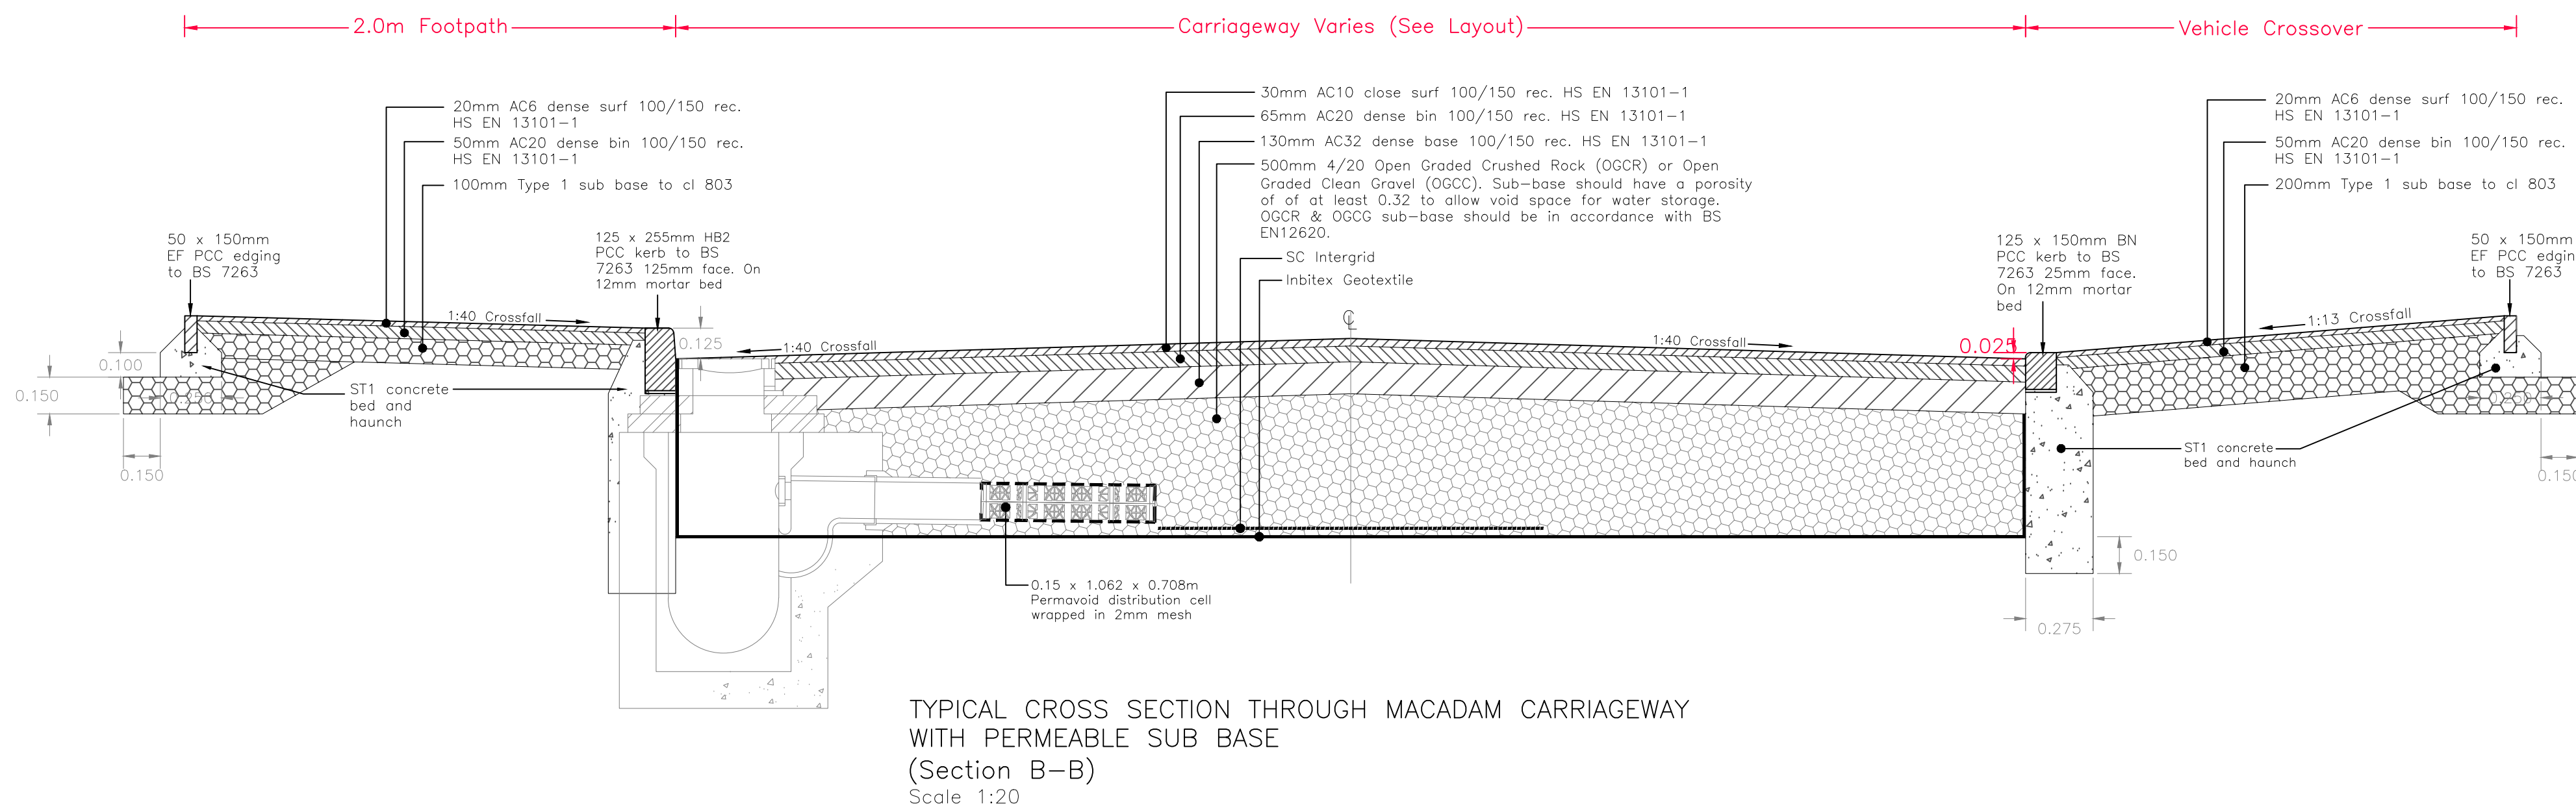

SUB-GRADE CBR %	CAPPING LAYER THICKNESS (mm)	SUB-BASE LAYER THICKNESS (mm)
15-30	0	150
>5	0	225
2-5	350	150
<2	600	150

CBR tests to be undertaken on formation to determine sub-base thickness.

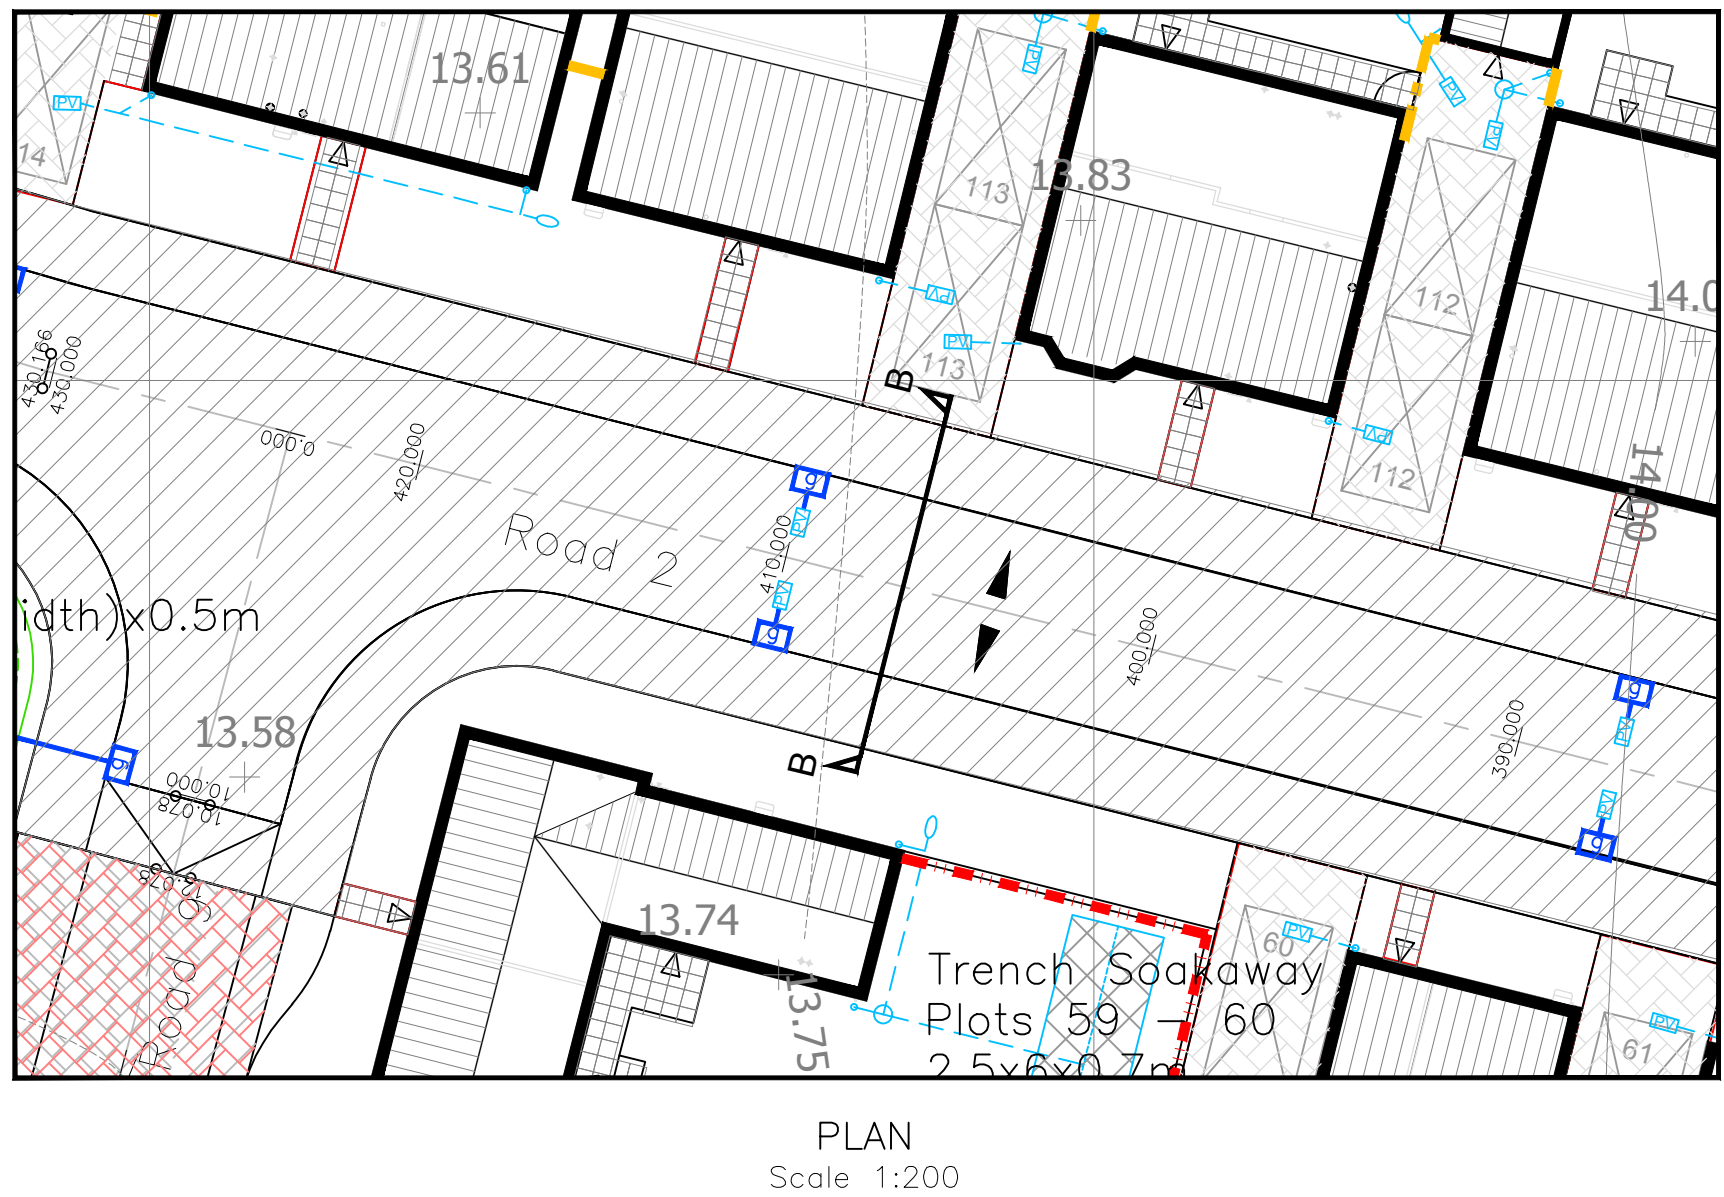

PRELIMINARY

REV. No.	DATE	DESCRIPTION	CP
A	07.03.18	Granular sub-base depths updated	CP
Client	MJA CONSULTING Civil and Structural Engineers Monarch House, Barton Lane, Abingdon, Oxon, OX14 3NB Tel: 01235 556173 Fax: 01235 523226		
Project	Westergate & Eastergate		
Title	Construction Details		
Scale	As Shown @ A0	Date	Sep '17
Checked	WSR	Drawn	DT
Drawing No.	5655:20		
Rev	A		