
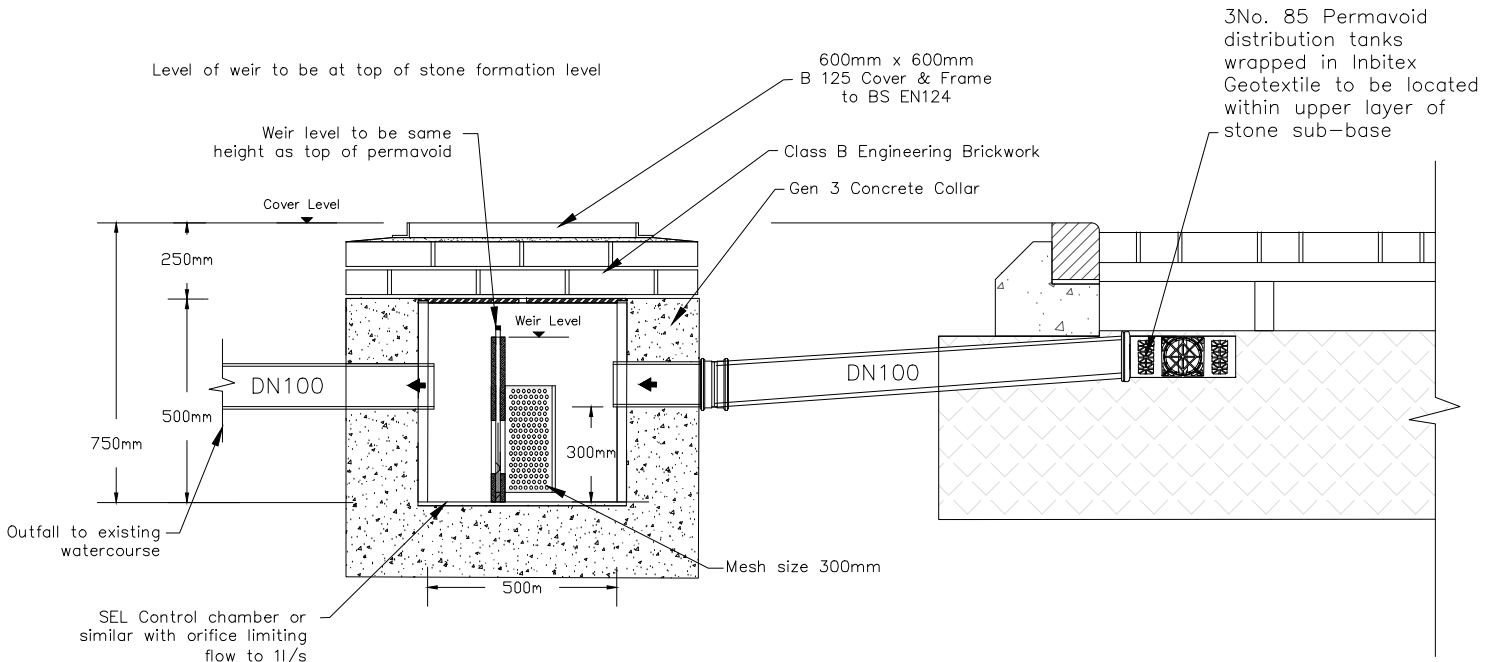
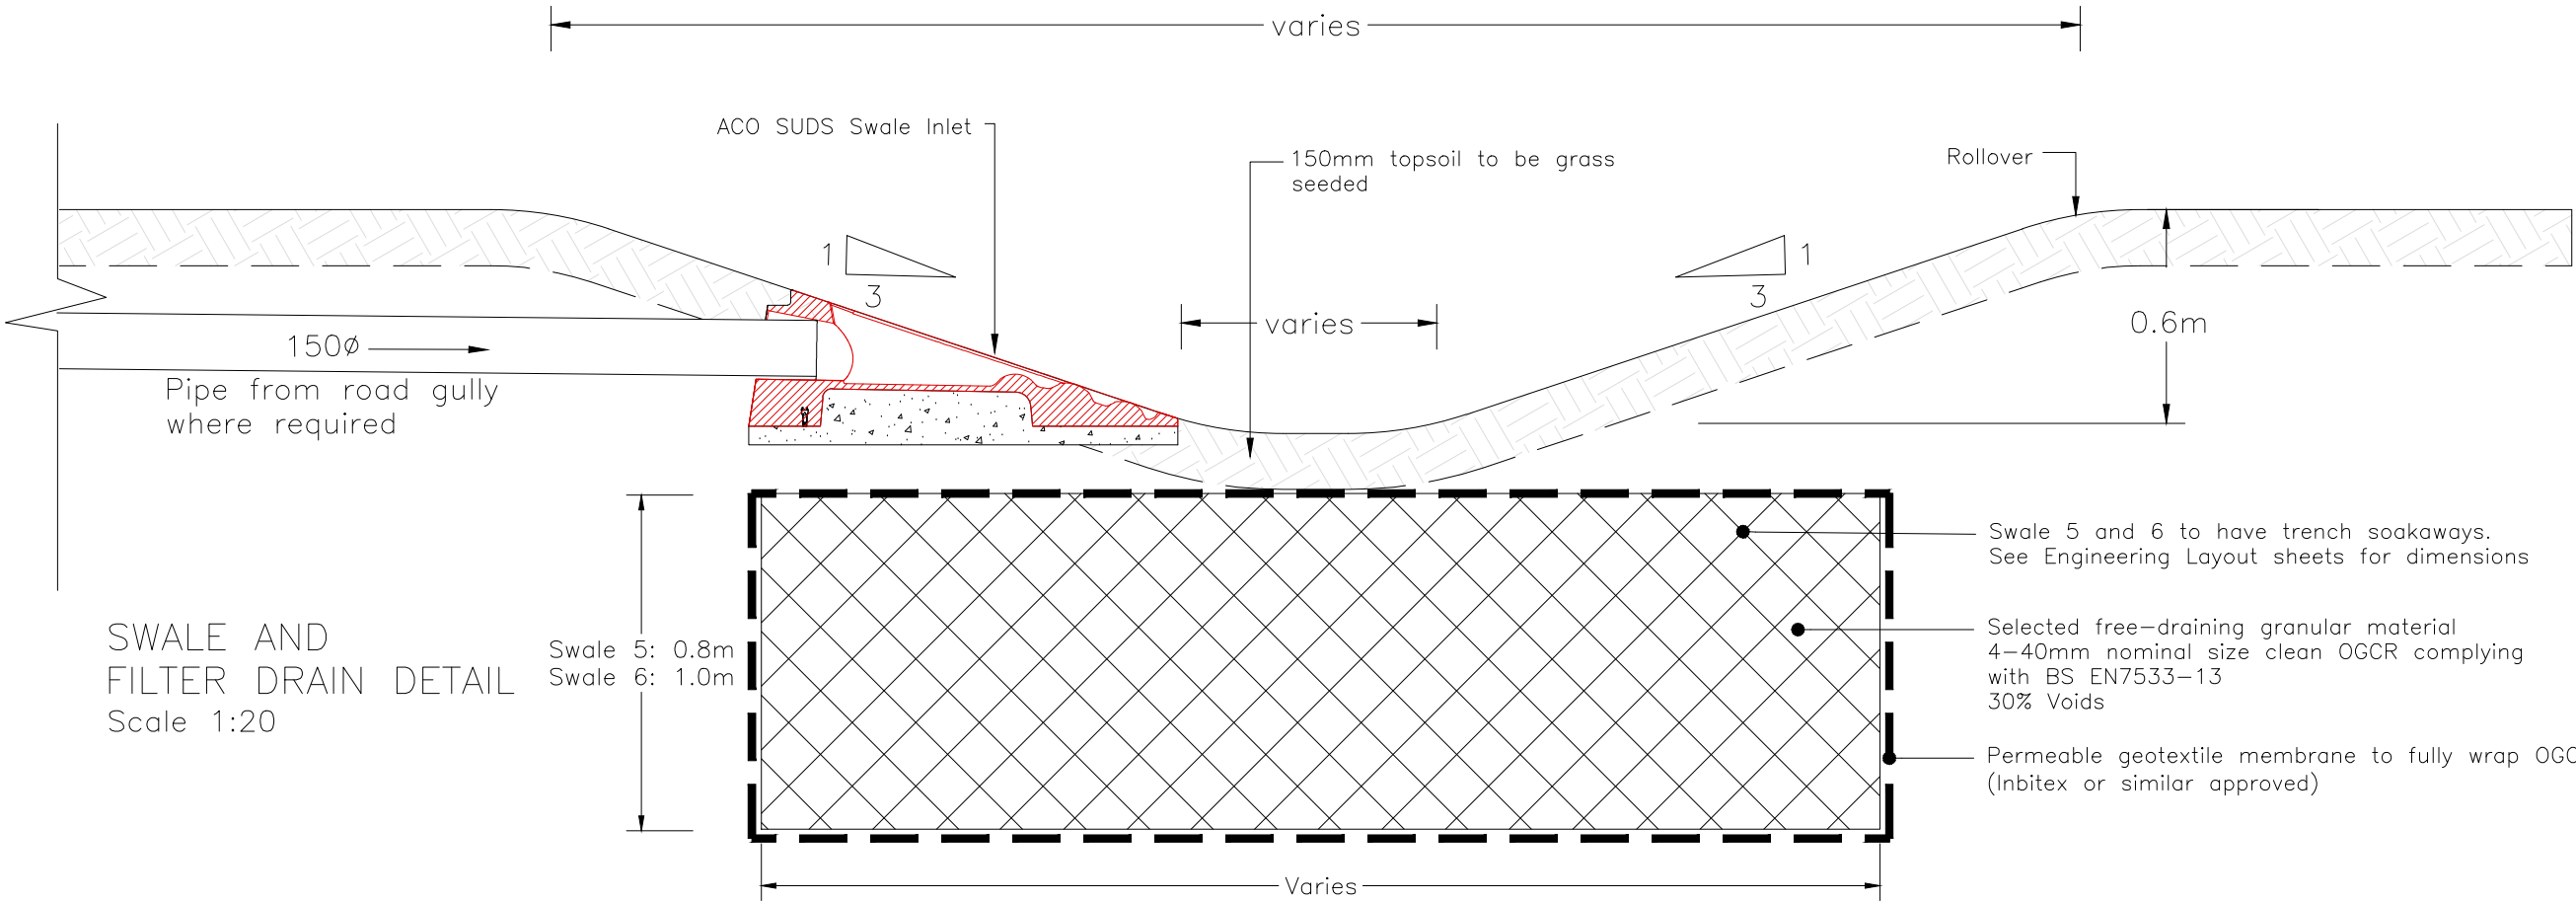
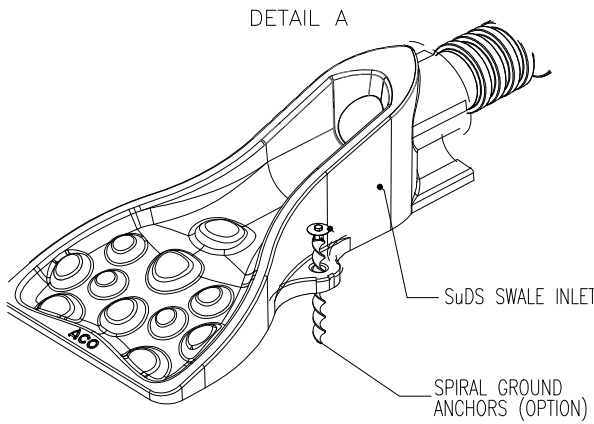



SuDS SWALE INLET – INSTALLTION GUIDANCE
SCALE NTS

DETAILS TO BE MODIFIED AS APPROPRIATE TO SUIT SITE CONDITIONS

- 1.0 GROUND CONDITIONS: The customer should ensure that the ground conditions are suitable for the proposed installation detail. Engineering advice may be necessary.
- 2.0 WATERTIGHT JOINTS: Where a secure watertight joint is required between the pipework and the SuDS Swale Inlet unit, a suitable proprietary sealant should be used.
- 3.0 SURFACE PROTECTION: The installer should ensure that the adjacent ground level is higher than the SuDS Swale Inlet unit to avoid damage to the unit during installation or mowing activities.

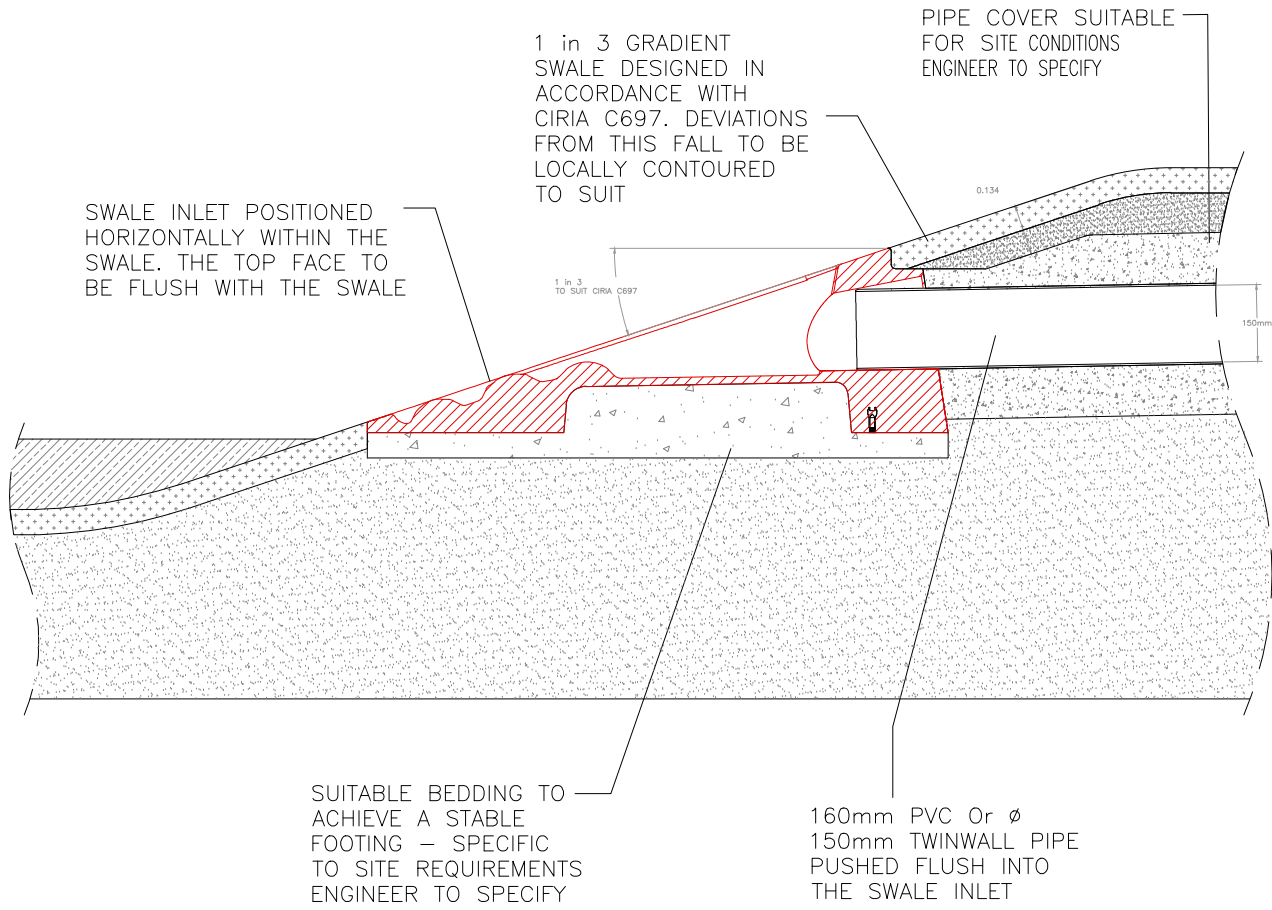

HIGH LEVEL OVERFLOW WITHIN PERMEABLE PAVING
AND FLOW CONTROL CHAMBER
Not to Scale

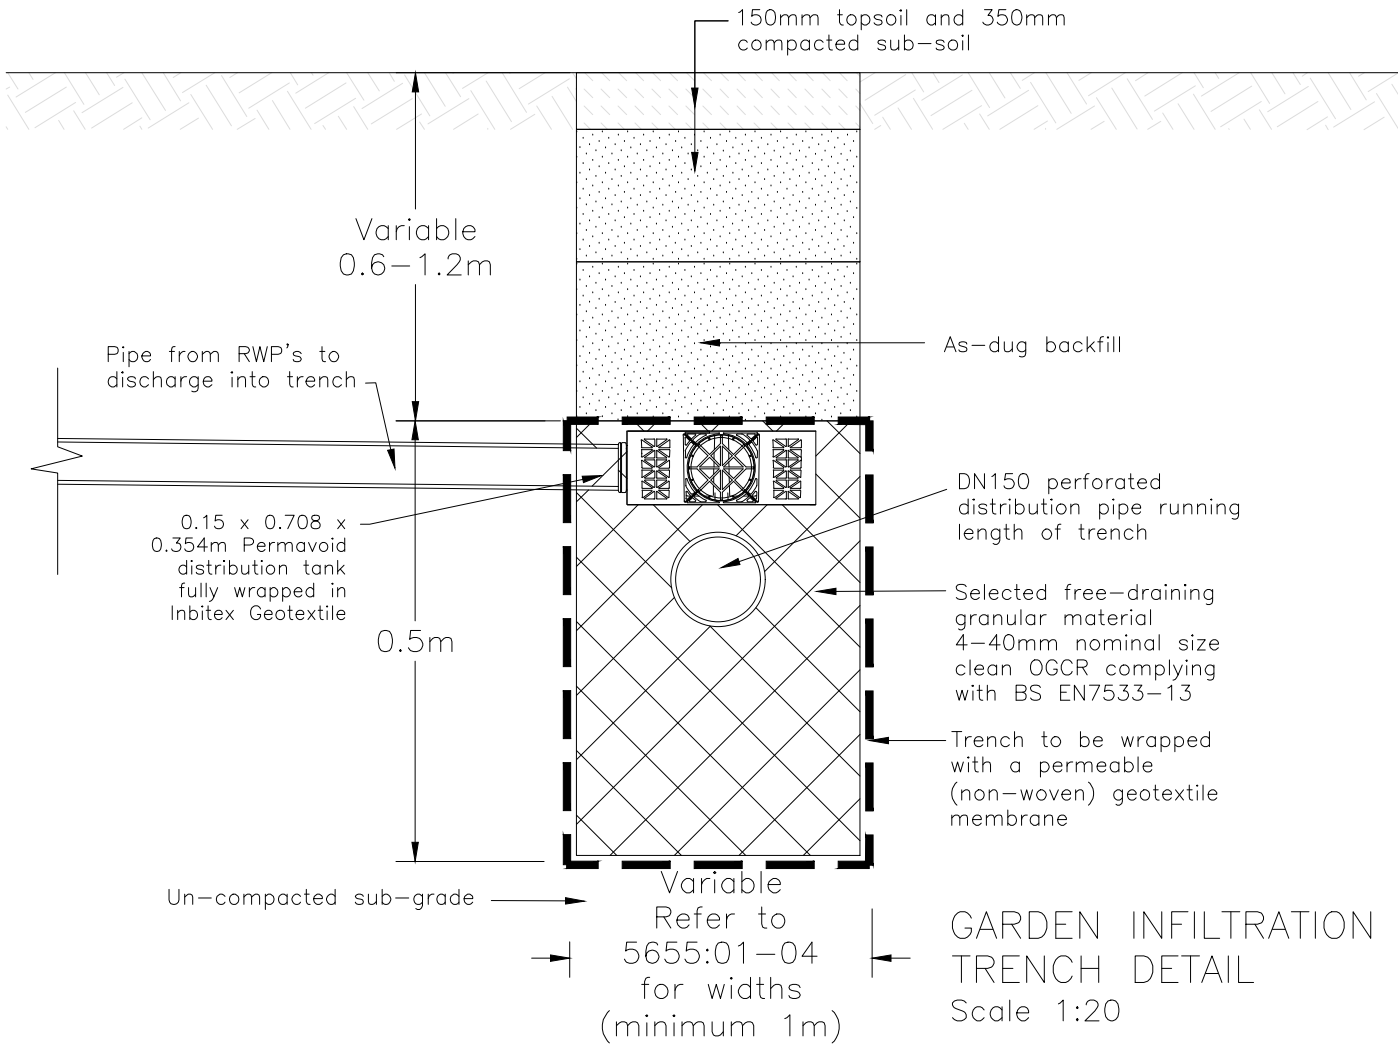

GARDEN INFILTRATION
TRENCH DETAIL
Scale 1:20

E	10.05.18	Updated to councils comments.	SS
D	13.04.18	Updated to councils comments.	SS
C	10.04.18	Updated to clients comments.	SS
B	09.04.18	Updated to councils comments.	SS
A	07.03.18	Details updated	CP
REV. No.	DATE	DESCRIPTION	INITIALS
Client			
Taylor Wimpey plc		MJA CONSULTING CIVIL AND STRUCTURAL ENGINEERS Monarch House, Barton Lane, Abingdon, Oxon, OX14 3NB Tel: 01235 555173 Fax: 01235 523226	
Project Westergate & Eastergate		Scale As Shown @ A2 Checked WSR	
Title Attenuation Details		Date Sep '17 Drawn DT	Drawing No. 5655:70 Rev E

E	20.04.18	Updated to councils comments.	SS
---	----------	-------------------------------	----