


NOTES

1. This drawing is to be read in conjunction with all relevant Engineering and Architects drawings, and the Specification. See drawing 383199-401 for relevant drawings details.
2. All dimensions are in millimetres unless noted otherwise. All levels are in Metres above an arbitrary datum and not to Ordinance Datum.
3. In accordance with CDM 2015 the Contractor is to:
 - Notify HSE of works
 - Comply with the requirements of Health and Safety Plan(if applicable)
 - Provide risk assessments and method statements for all potential hazards relevant to this project.
4. The main contractor shall be responsible for the setting out and accuracy of all dimensions. He shall satisfy himself that the information given is correct, and any discrepancies should be noted to the Engineer immediately.
5. DO NOT SCALE. If discrepancy or query arises on dimensions consult Engineer.
6. The Contractor is responsible for specifying product and codes and ordering of drainage materials.
7. All drainage to be installed to BS5955 P16 and in strict accordance with the manufacturers instructions.
8. All PVC-U drainage products to conform to BS EN1401 & Kite mark certified in accordance with specification. If used for connection to public sewer must be able to withstand 4000psi.
9. All drainage pipes on this drawing to be 100mm unless shown otherwise. Min. falls 1/80 for foul and 1/100 for storm drainage.
10. Cover grades and gully gratings are in accordance with BS497 Pt 1
11. Cover Grades :- D400 – carriageways.
B125 – carriageways for slow traffic.
A15 – inaccessible to vehicles
12. Sewer runs and manholes to be adopted are to be in accordance with Sewers for Adoption, 6th Edition.
13. Any drainage laid less than 600mm below FG to be covered with minimum 150mm Gen 3 grade concrete to half diameter.
14. Stormwater soakaways to be a minimum of 5.0m from new buildings. Treatment plant to be min. 15m from new and existing houses. New treatment plant drainage field to be min. 10m from existing or new houses.
15. Provide 100x100 PCC inlets max. span 650mm where s/wp exit the building.
16. ACO channels installed and bedded to manufacturers requirements.
17. External backdrop connection to comply with backdrop detail within Sewers for adoption 7th edition.

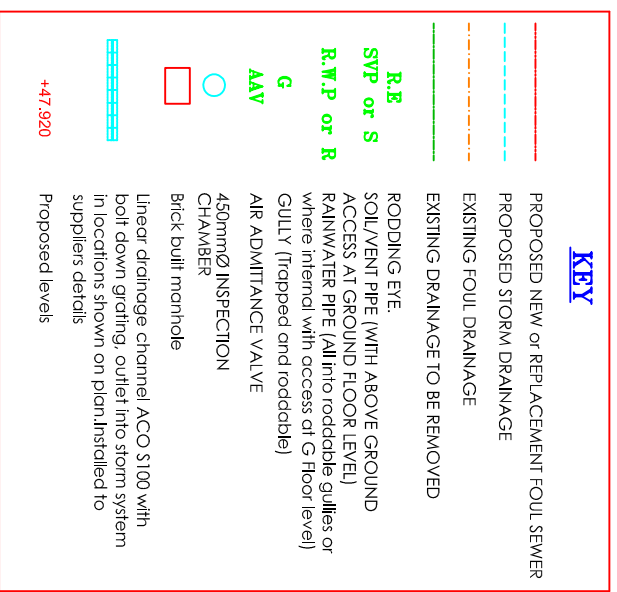

Date	By	Revision	QA'd	Chk'd	Ref
Status					

PRELIMINARY

 **Cowah
Consultancy**
STRATEGIC, CIVIL AND BUILDING CONSULTANCY

Also at:
Landguard Manor Road
Landguard
Isle of Wight
PO37 7JB

3. Tumberley House
4400 Parkway
Whiteley
Fareham
Hampshire
PO15 7JF

Tel: 01489 577488
Fax: 01489 579873
consultants@cowahconsult.co.uk
www.cowahconsult.co.uk

Project Nylon Road, Westergate

Title
Drainage General Arrangment

Date	Oct 18	Scale	1/200	Drg. No. 45000-100P2
Drawn	EG	Chk'd	QA'D	

DO NOT SCALE THIS DRAWING

