
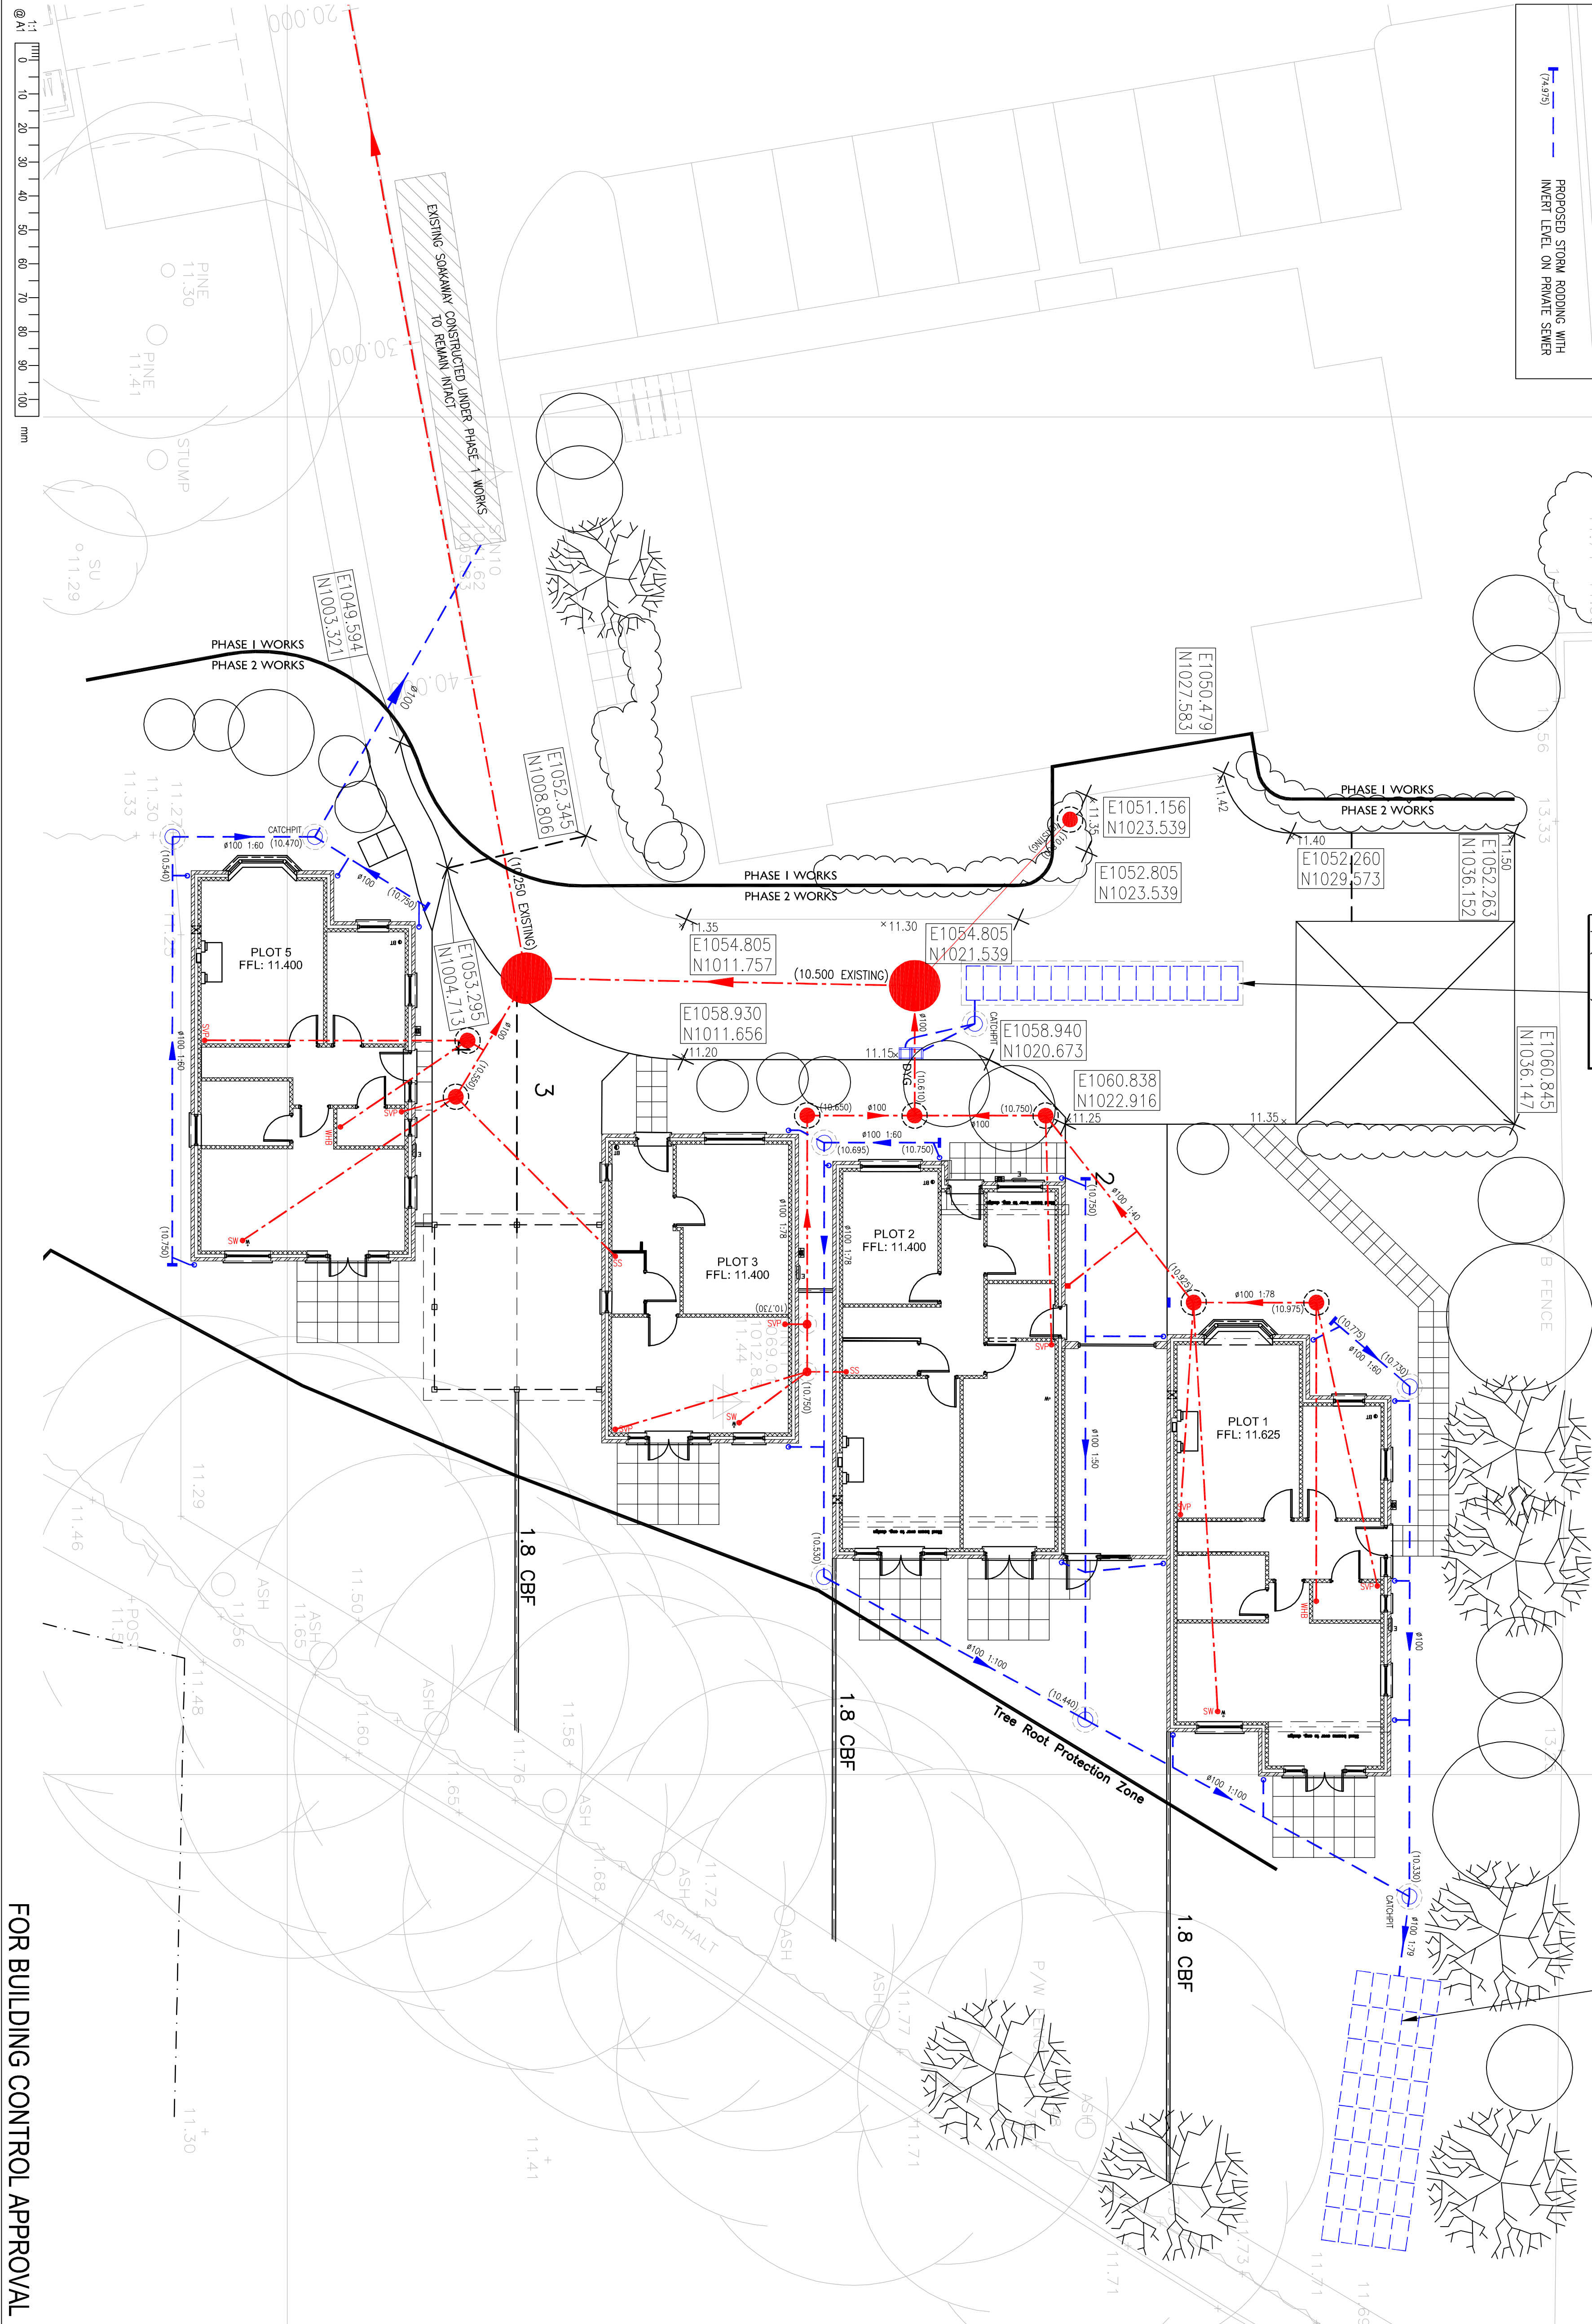
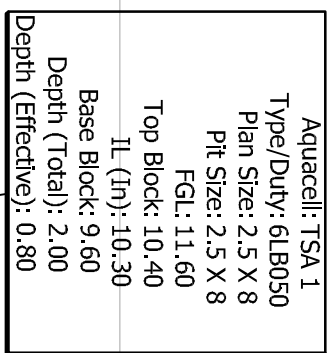
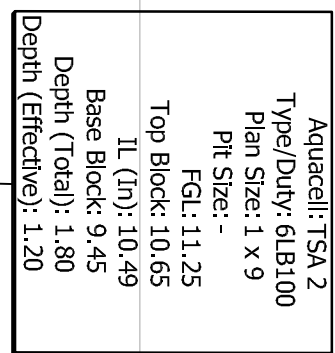


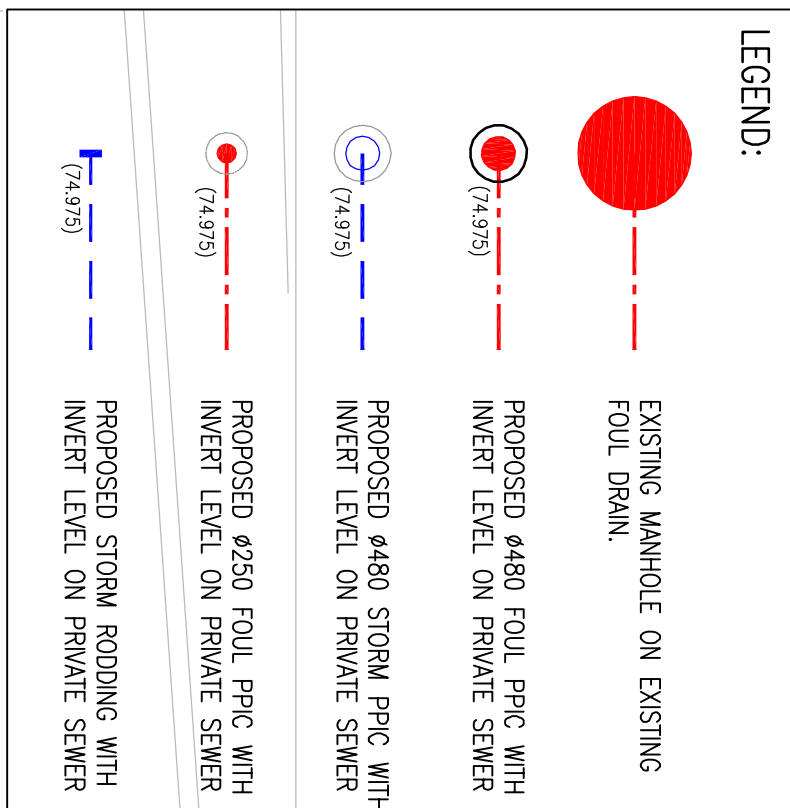

FOR BUILDING CONTROL APPROVAL

STANDARD NOTES:


- [illegible]

DRAINAGE NOTES:

1. All works shall be conducted in strict accordance with specification of the Local Authority, BS6801:1986 & BSEN 752:1.
2. All pipe runs over buildings or through walls by the Building Regulations 2002 Part H4. Where a pipe is within a run of foundation, the trench shall be filled with class GSN concrete to the level of the top of the foundation, where the trench is lower than the level of the foundation, the trench shall be filled with class GSN concrete to a level below the lowest level of the foundation equal to the distance from the foundation base to 50mm. In such cases the pipe shall be bedded and supported by 150mm thick class GSN concrete.
3. Where pipe, external to the structure, has a depth to ebb from ground level of less than 450mm they shall have a class GSN concrete surrounding 150mm thick.

- [illegible]

Problem	Assessment	Approved	Refused
P3	GETTING OUR INFORMATION ADDED	C6J	03.03
P4	SO WHAT? ISN'T IT EASY?		
P1	THEY SAID	APF	14.07

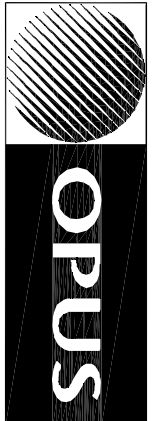

Fareham Office
Modulus House, Salthams Lane
Fareham, Hampshire, PO16 0QS
01329 822021

Drawn	Designed	Approved	Revision
DLS	DLS	APT	01.07.20
Project No.			Scale
FAEG8849.00			1:100
Project			

The Homestead, Westergate. (Phase II)

DRAINAGE

Drawing No.	Sheet No.	Revision
300	1	P3