


All storage tank drainage works shall be carried out in accordance with the specifications, method statements and recommendations of polypipe



SEL Environmental LTD
Phone: 01254 589987
Email: sales@selenvironmental.com

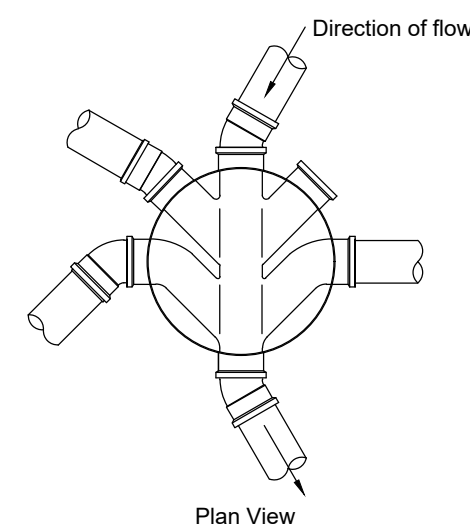

1. In all installations, the main channel of the inspection chamber should always be used. Where the chamber is being used as a change of direction for the drainage system, short radius bends of $11\frac{1}{2}^{\circ}$, 15° , 30° and 45° can be used in the inlet and outlet to achieve the required angle.
2. Side inlet branch connections enter the inspection chamber approx. 55mm above the invert of the main channel
3. 320mm dia. chambers are supplied with 2no. blanking plugs for the side inlets and 460mm dia. chambers are supplied with 3no. blanking plugs.



P-	25.03.20	PRELIMINARY ISSUE	LH	CS	CS
REV	DATE	DESCRIPTION	BY	CHK	APP
					
CLIENT					
ARCHITECT SMITH SIMMONS AND PARTNERS					
JOB TITLE TYRONE HOUSE ALDINGBOURNE					
DRAWING TITLE CONSTRUCTION DETAILS SHEET 1 OF 2					
DRAWN LH		ENGINEER CS		CHECKED CS	APPROVED
DATE MARCH 2020		SCALE @ A1 1:20			
JOB No. C1340		STATUS P		DRAWING No. 300	REV. P-

PRELIMINARY