

Guilfoyle

Rear of Woodgate Farm

Hook Lane, Woodgate,
Westergate. PO20 3SS

Job title:	Development at rear of Woodgate Farm
Drawing title:	Proposed drainage diversion
Drawing number:	171123_02
Client:	Guilfoyle Construction Ltd
Revision:	C1
Date of revision:	22.05.2018
Revision detail:	Revisions to foul drainage. Issued for legal Agreement.
Status:	INFORMATION

Drawn by:	SLH
Checked by:	JG
Date:	23.11.2017
Scale (A3):	1:1250 / 1:200 / 1:50



LOCATIONS	CLASS
Frederation Traffic	A15
Light Traffic	B125
Heavy Traffic	D400



Recessed covers which are optioned to BS EN 1461 are to be used in Blockwork areas.

Manhole Covers

MANHOLE COVERS





T:01243 814728
M:07881 825519

Improving the built environment.....

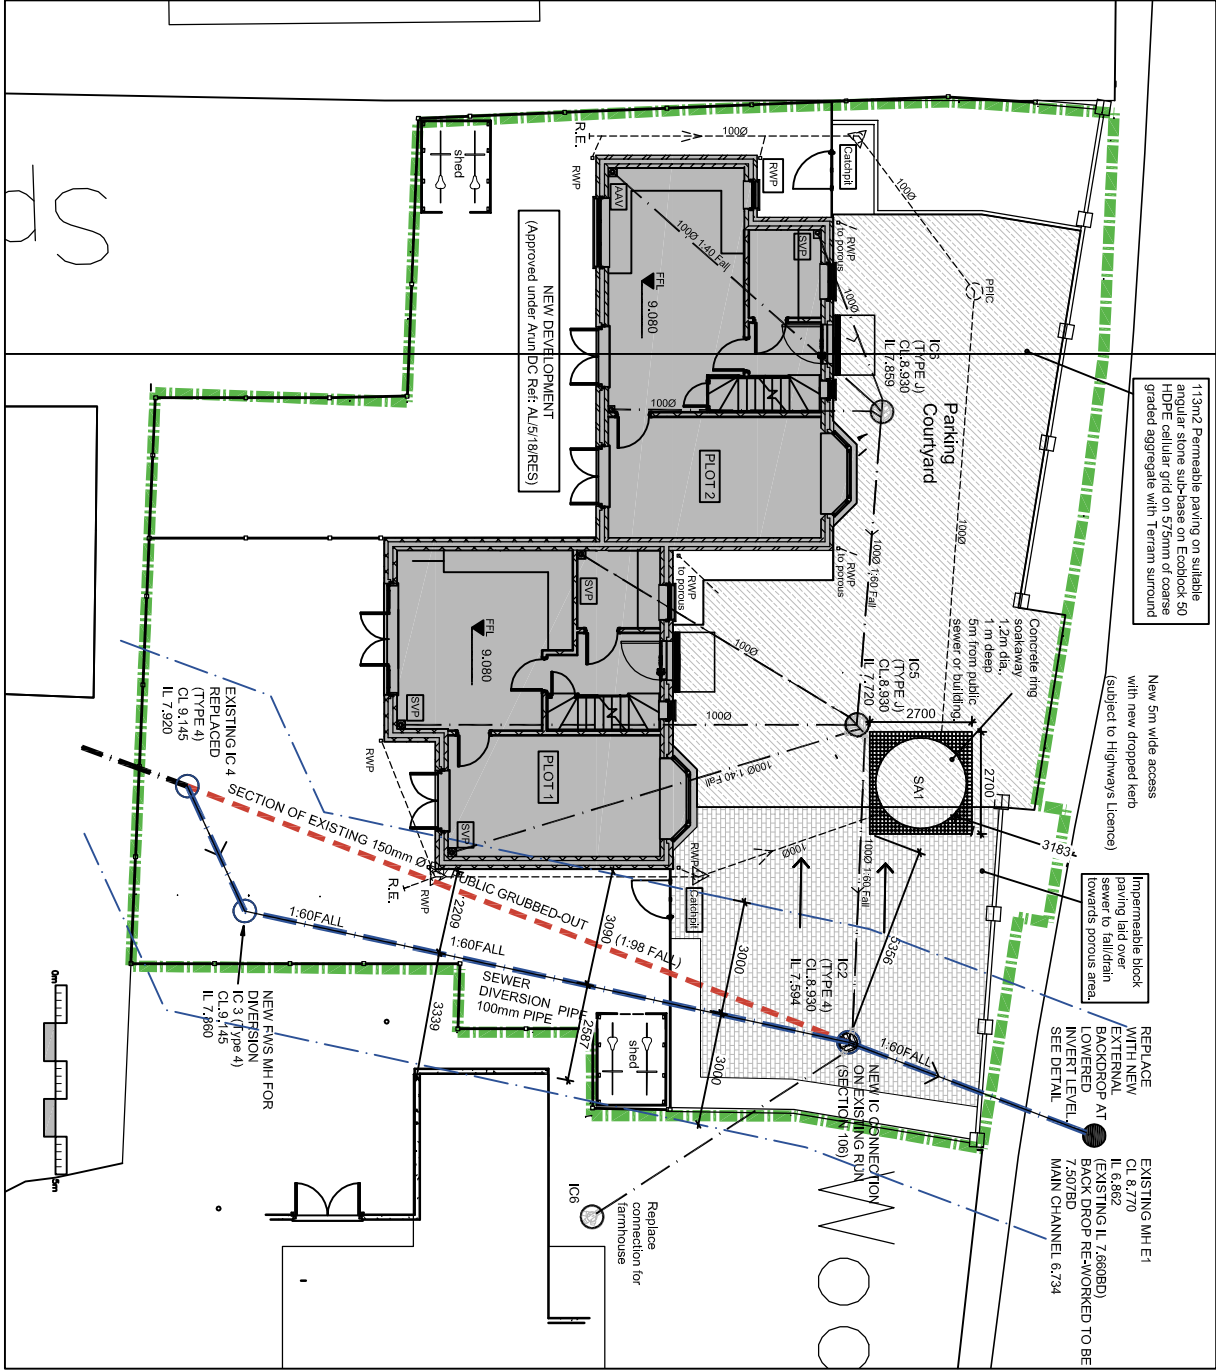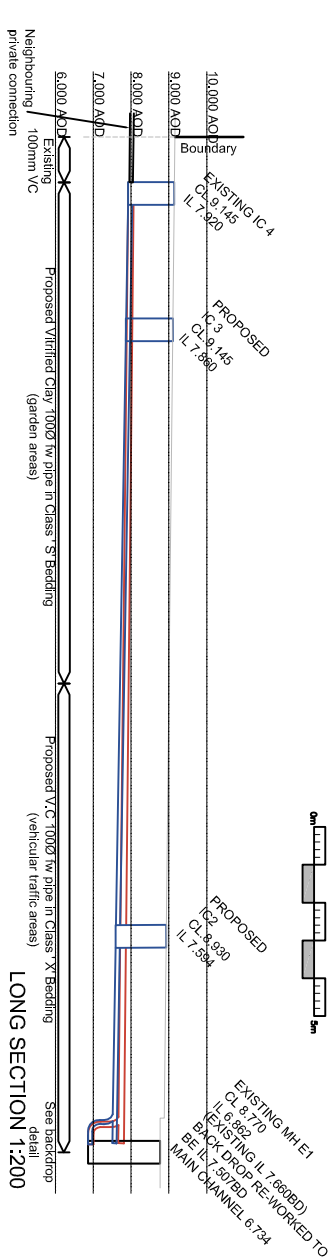


TYPICAL INSPECTION CHAMBER DETAIL – TYPE 4

Plastic chambers and rings shall comply with BS EN 13598-1 or BS EN 13598-2 or have equivalent independent approval.

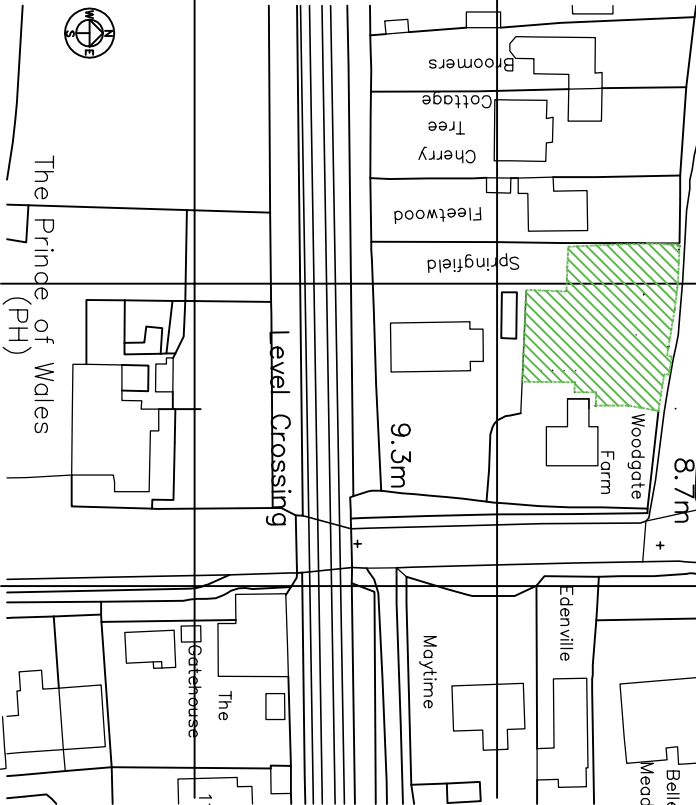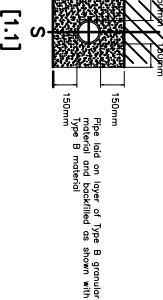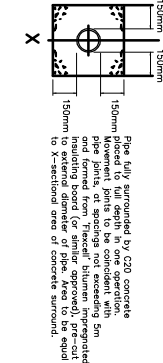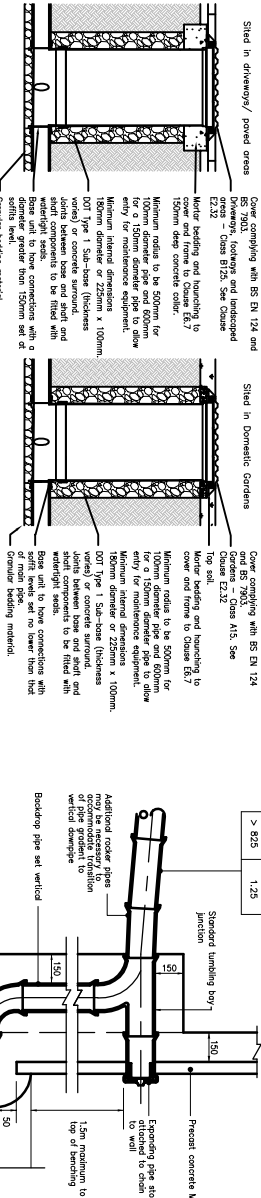

ALL WORKS TO PUBLIC AND ADJOINABLE SEWERS SHOULD BE COMPLETED WITH THE M.C. – SEWER FOR ADOPTION 2ND EDITION.

1. Brickwork manholes are to be built in English Bond.
2. Where corbelling is required the overall should not exceed 30mm per course.
3. Manhole covers and frames shall comply with the relevant provisions of BS EN 124 and they shall be of a material which does not rely on the use of cushion inserts.
4. All plastic pipes below ground to be Domo Wanh.
5. All manholes shall have closed keyways.
6. Vertical clay pipes and pipe fittings shall comply with the relevant provisions of BS EN 124 and they shall be of a material which does not rely on the use of cushion inserts.
7. Concrete pipes and fittings shall comply with the relevant requirements of BS 5911 Part 100, and BS EN 1916.
8. The style shown for the pipe joints is indicative only. Whether these are sleeve joints or spigot and socket joints will be specified separately.
9. Where pipes of large dia occur in Type C Manholes it is not always possible to corbel the brickwork as required. In these situations a lined as shown supplied by Supreme Concrete may be used as a reducing slab.

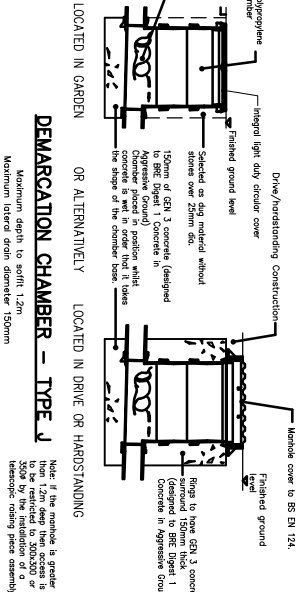

ASSUMED DETAILS - TO BE ADVISED BY SOUTHERN WATER