


Where insulation follows the slope of the roof use 100mm 'Celotex GA 4000' insulation between rafters with an additional layer of 50mm (GA 4000) running on the underside to give a 0.17 U-value. Allow for a minimum 50mm gap between insulation and the underside of the roof felt for ventilation – refer to 'Celotex' standard detail for fixing and installation instructions.

The ridge will need to be ventilated to achieve the equivalent of a continuous 5mm gap either by the use of a series of ridge vents, high level roof vent tiles or an 'under ridge' ventilation system or a combination of any of them for suitable cross ventilation given an equivalent of a continuous 25mm eaves vent.

NOTES:

1. Do not scale this drawing. Use figured dimensions only, except for Planning purposes.
2. All dimensions must be checked on site by the contractor prior to commencement of work.
3. All construction details are indicative and are to be checked and confirmed on site and any divergence's are to be agreed with the Contract Administrator.

THIS DRAWING TO BE READ IN-CONJUNCTION WITH THE BUILDING CONTROL AND CONSTRUCTION NOTES

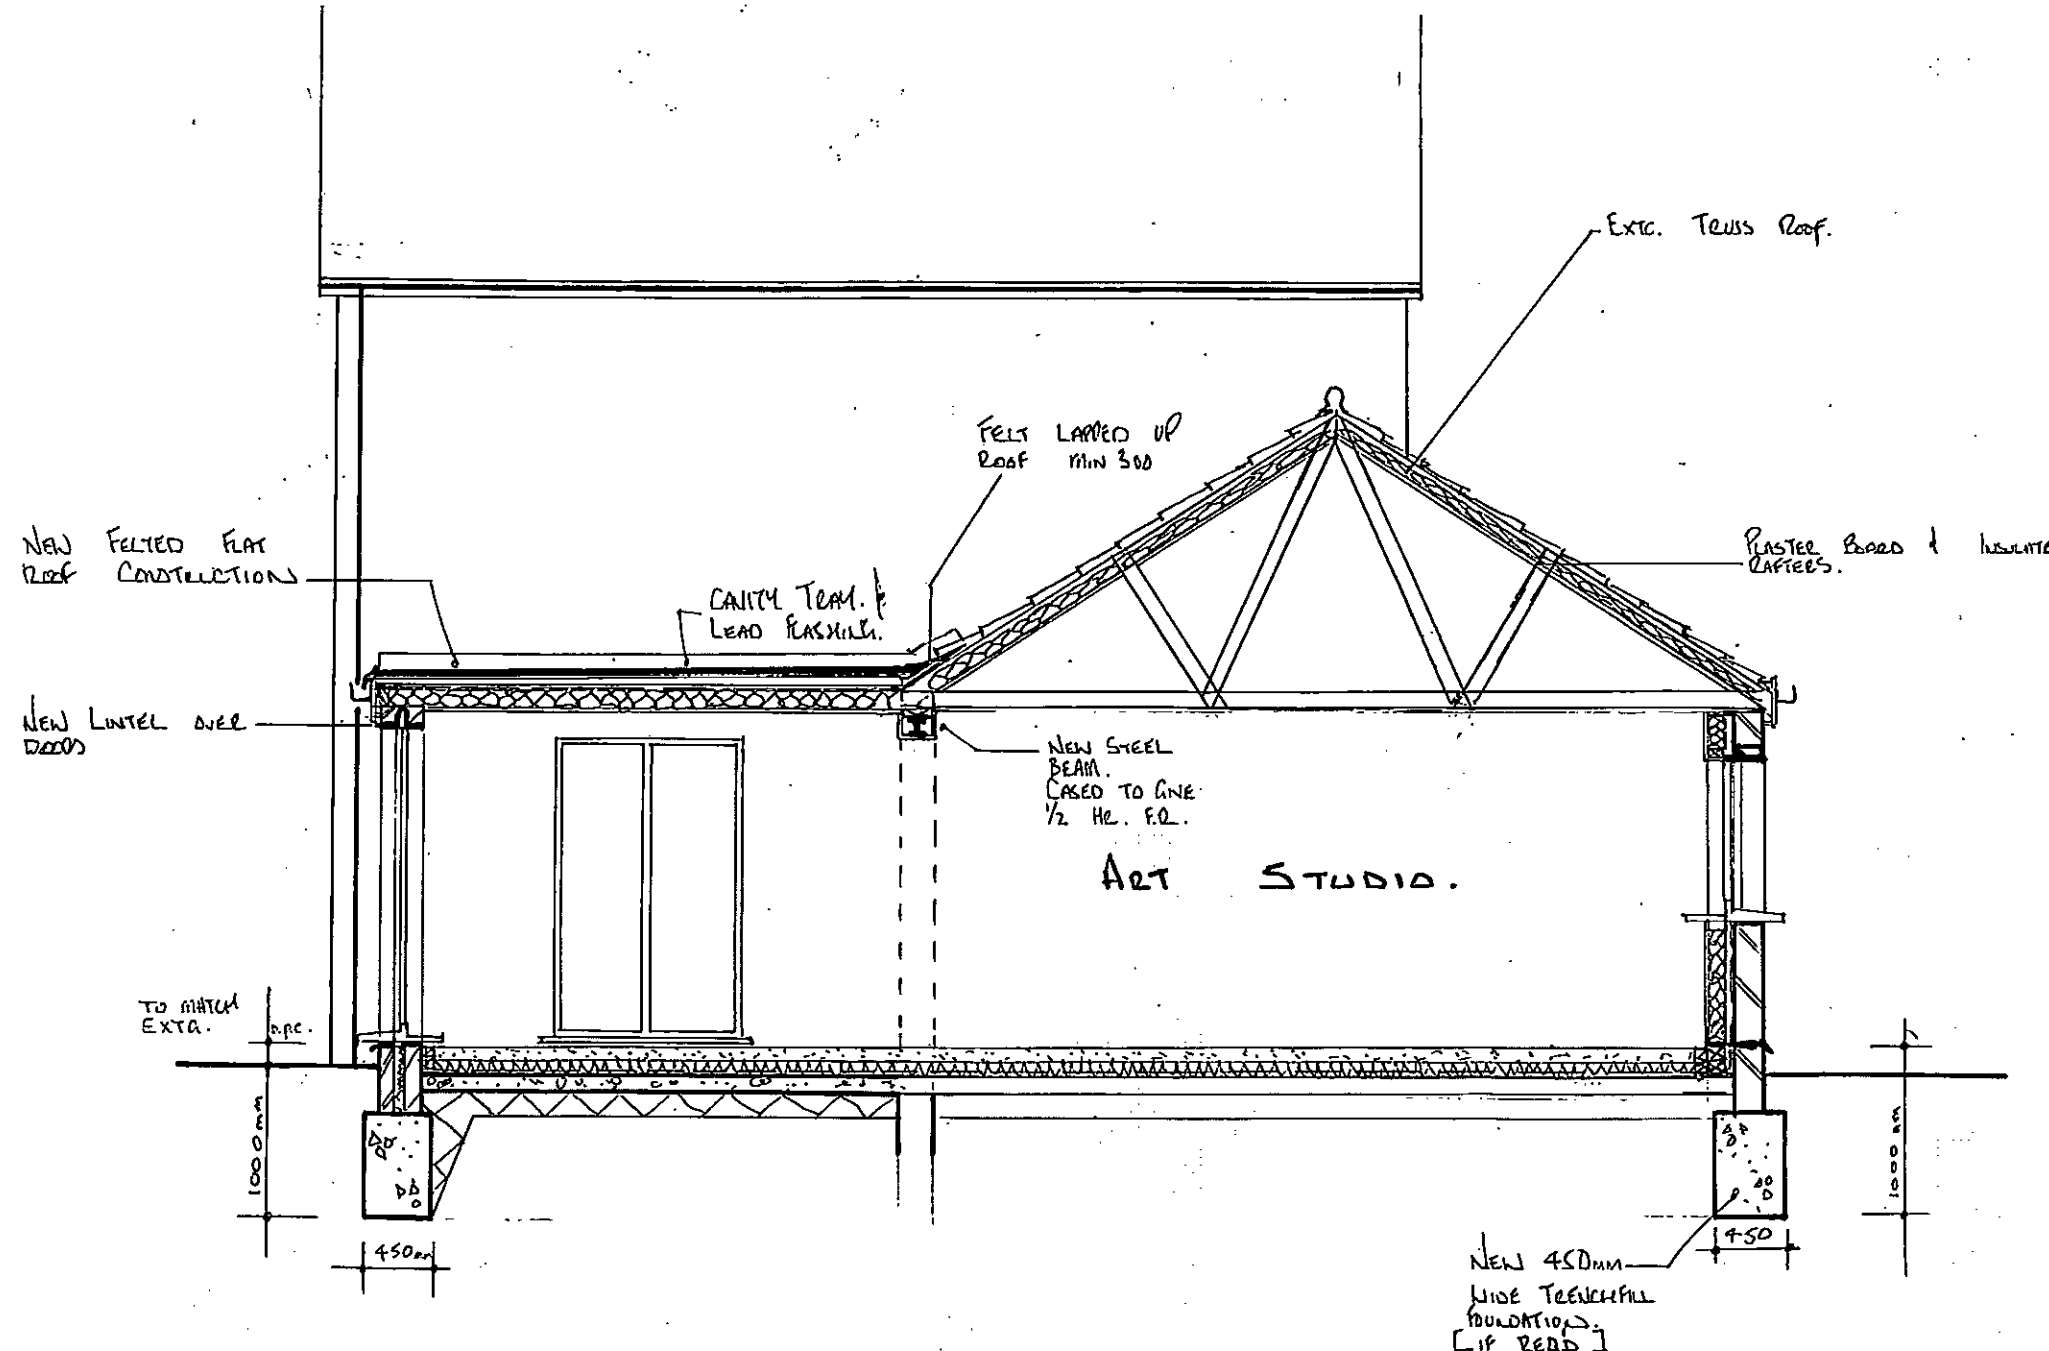

SECTION X-X.

Extension & Alterations – 29 Bedencroft, Aldwick Fields, Aldwick, Bognor Regis.
PO21 3SD.

K.E. HILTON AND ASSOCIATES
Chartered Structural Engineers

2 ALBERT CHAMBERS Tel: 01243 865500
SUDLEY ROAD Fax: 01243 860489
BOGNOR REGIS Mobile: 07968 333140
WEST SUSSEX
PO21 1EQ E-Mail: k_e_hilton@yahoo.co.uk

SECTION X-X.

Scale	1:50.	@ A3	Drawn By	C.R.B.
Date	SEP. 13.		Checked	K.E.H.
Drawing Number	4990-6.			