
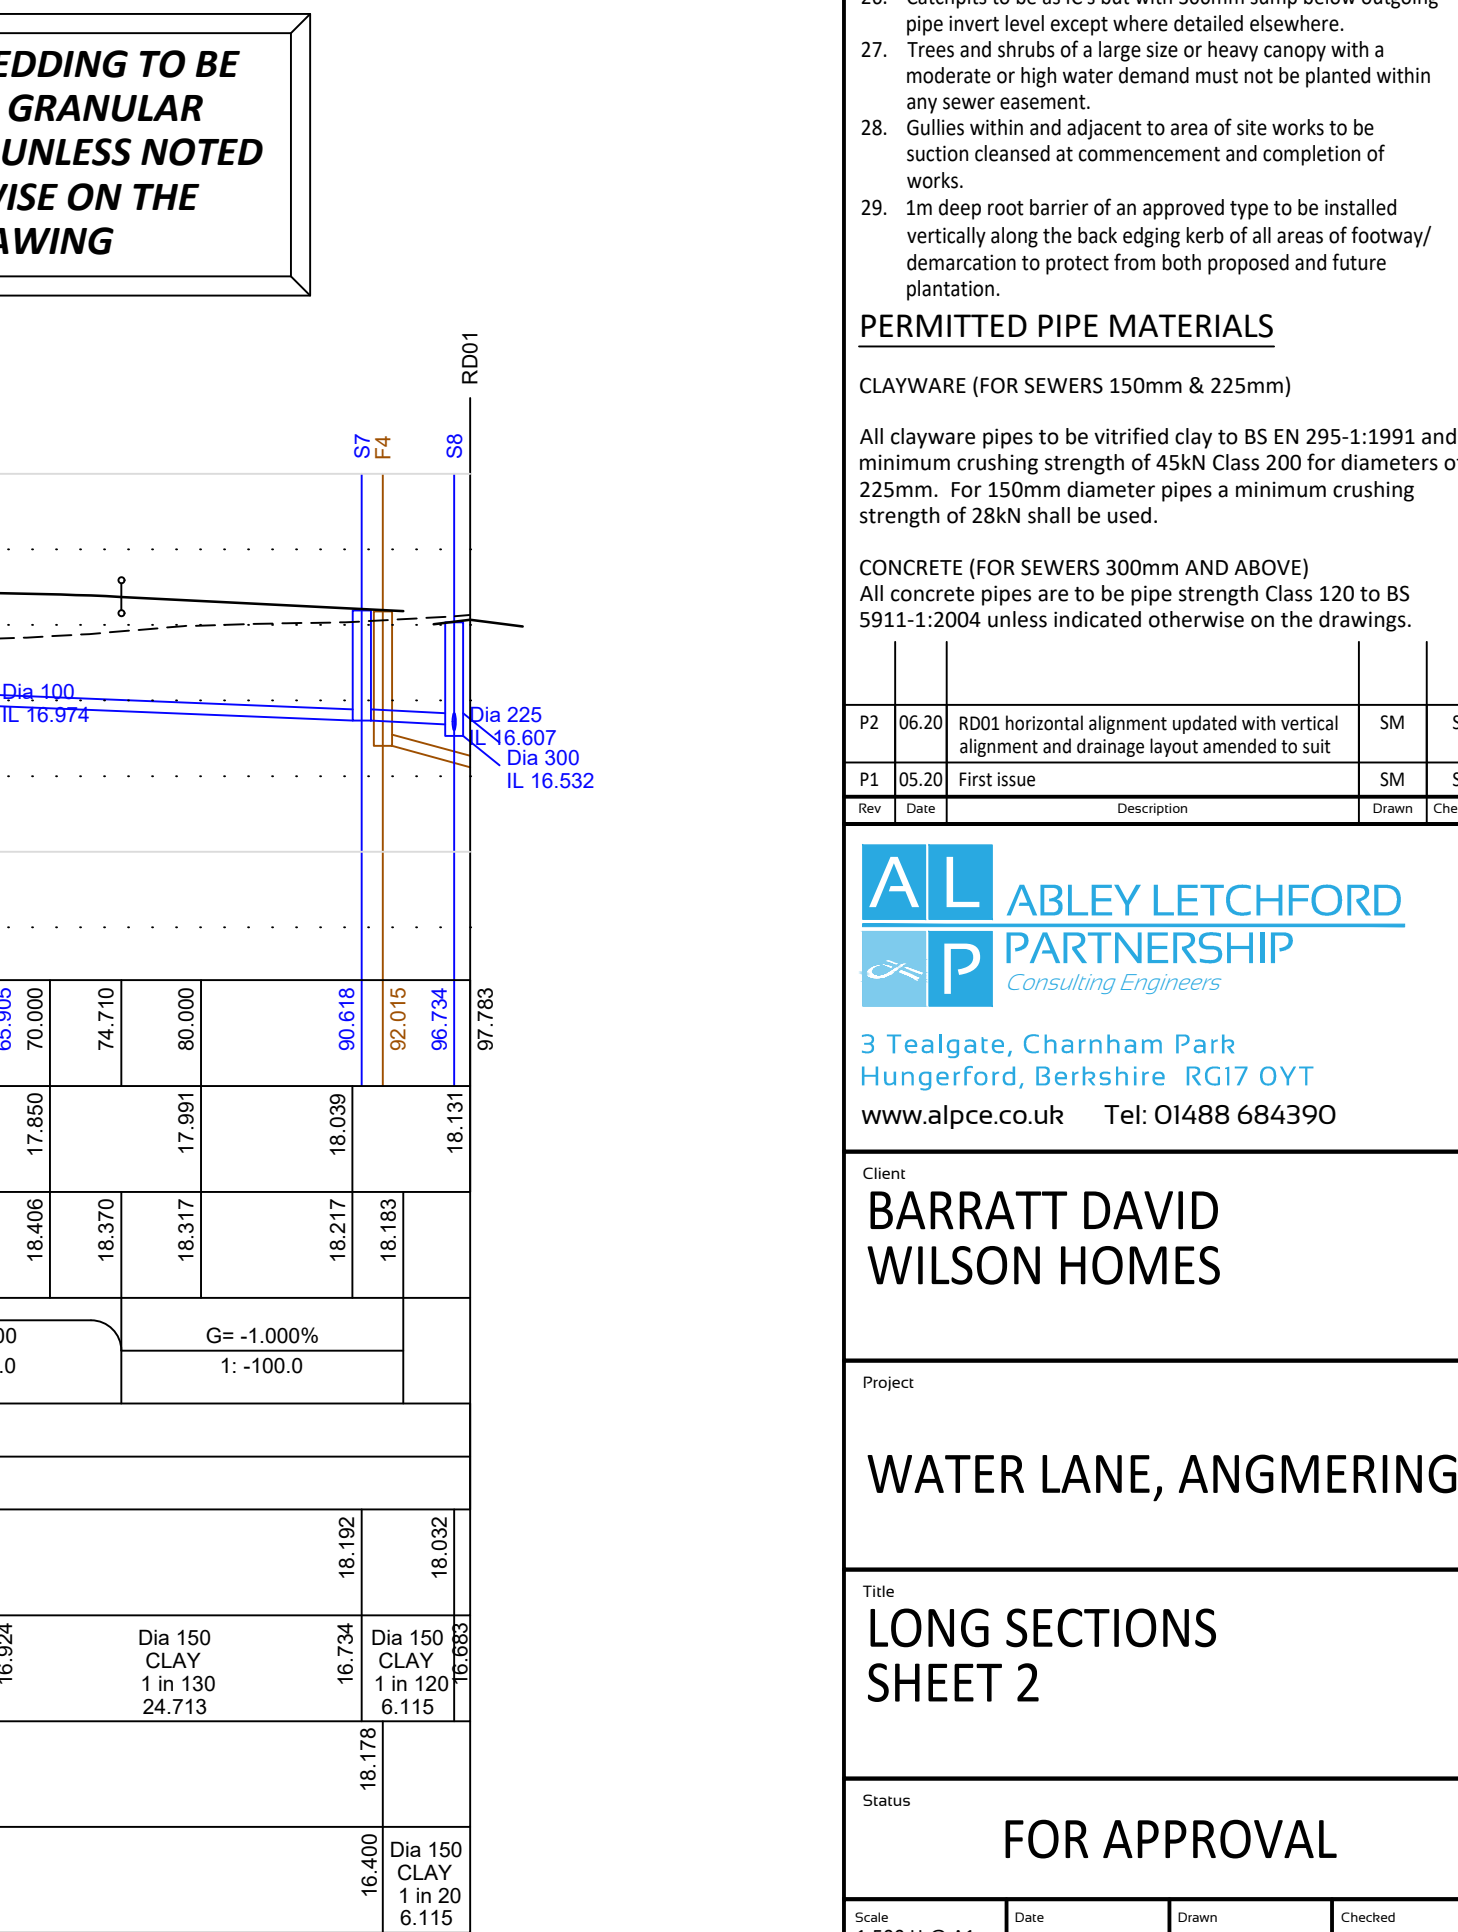
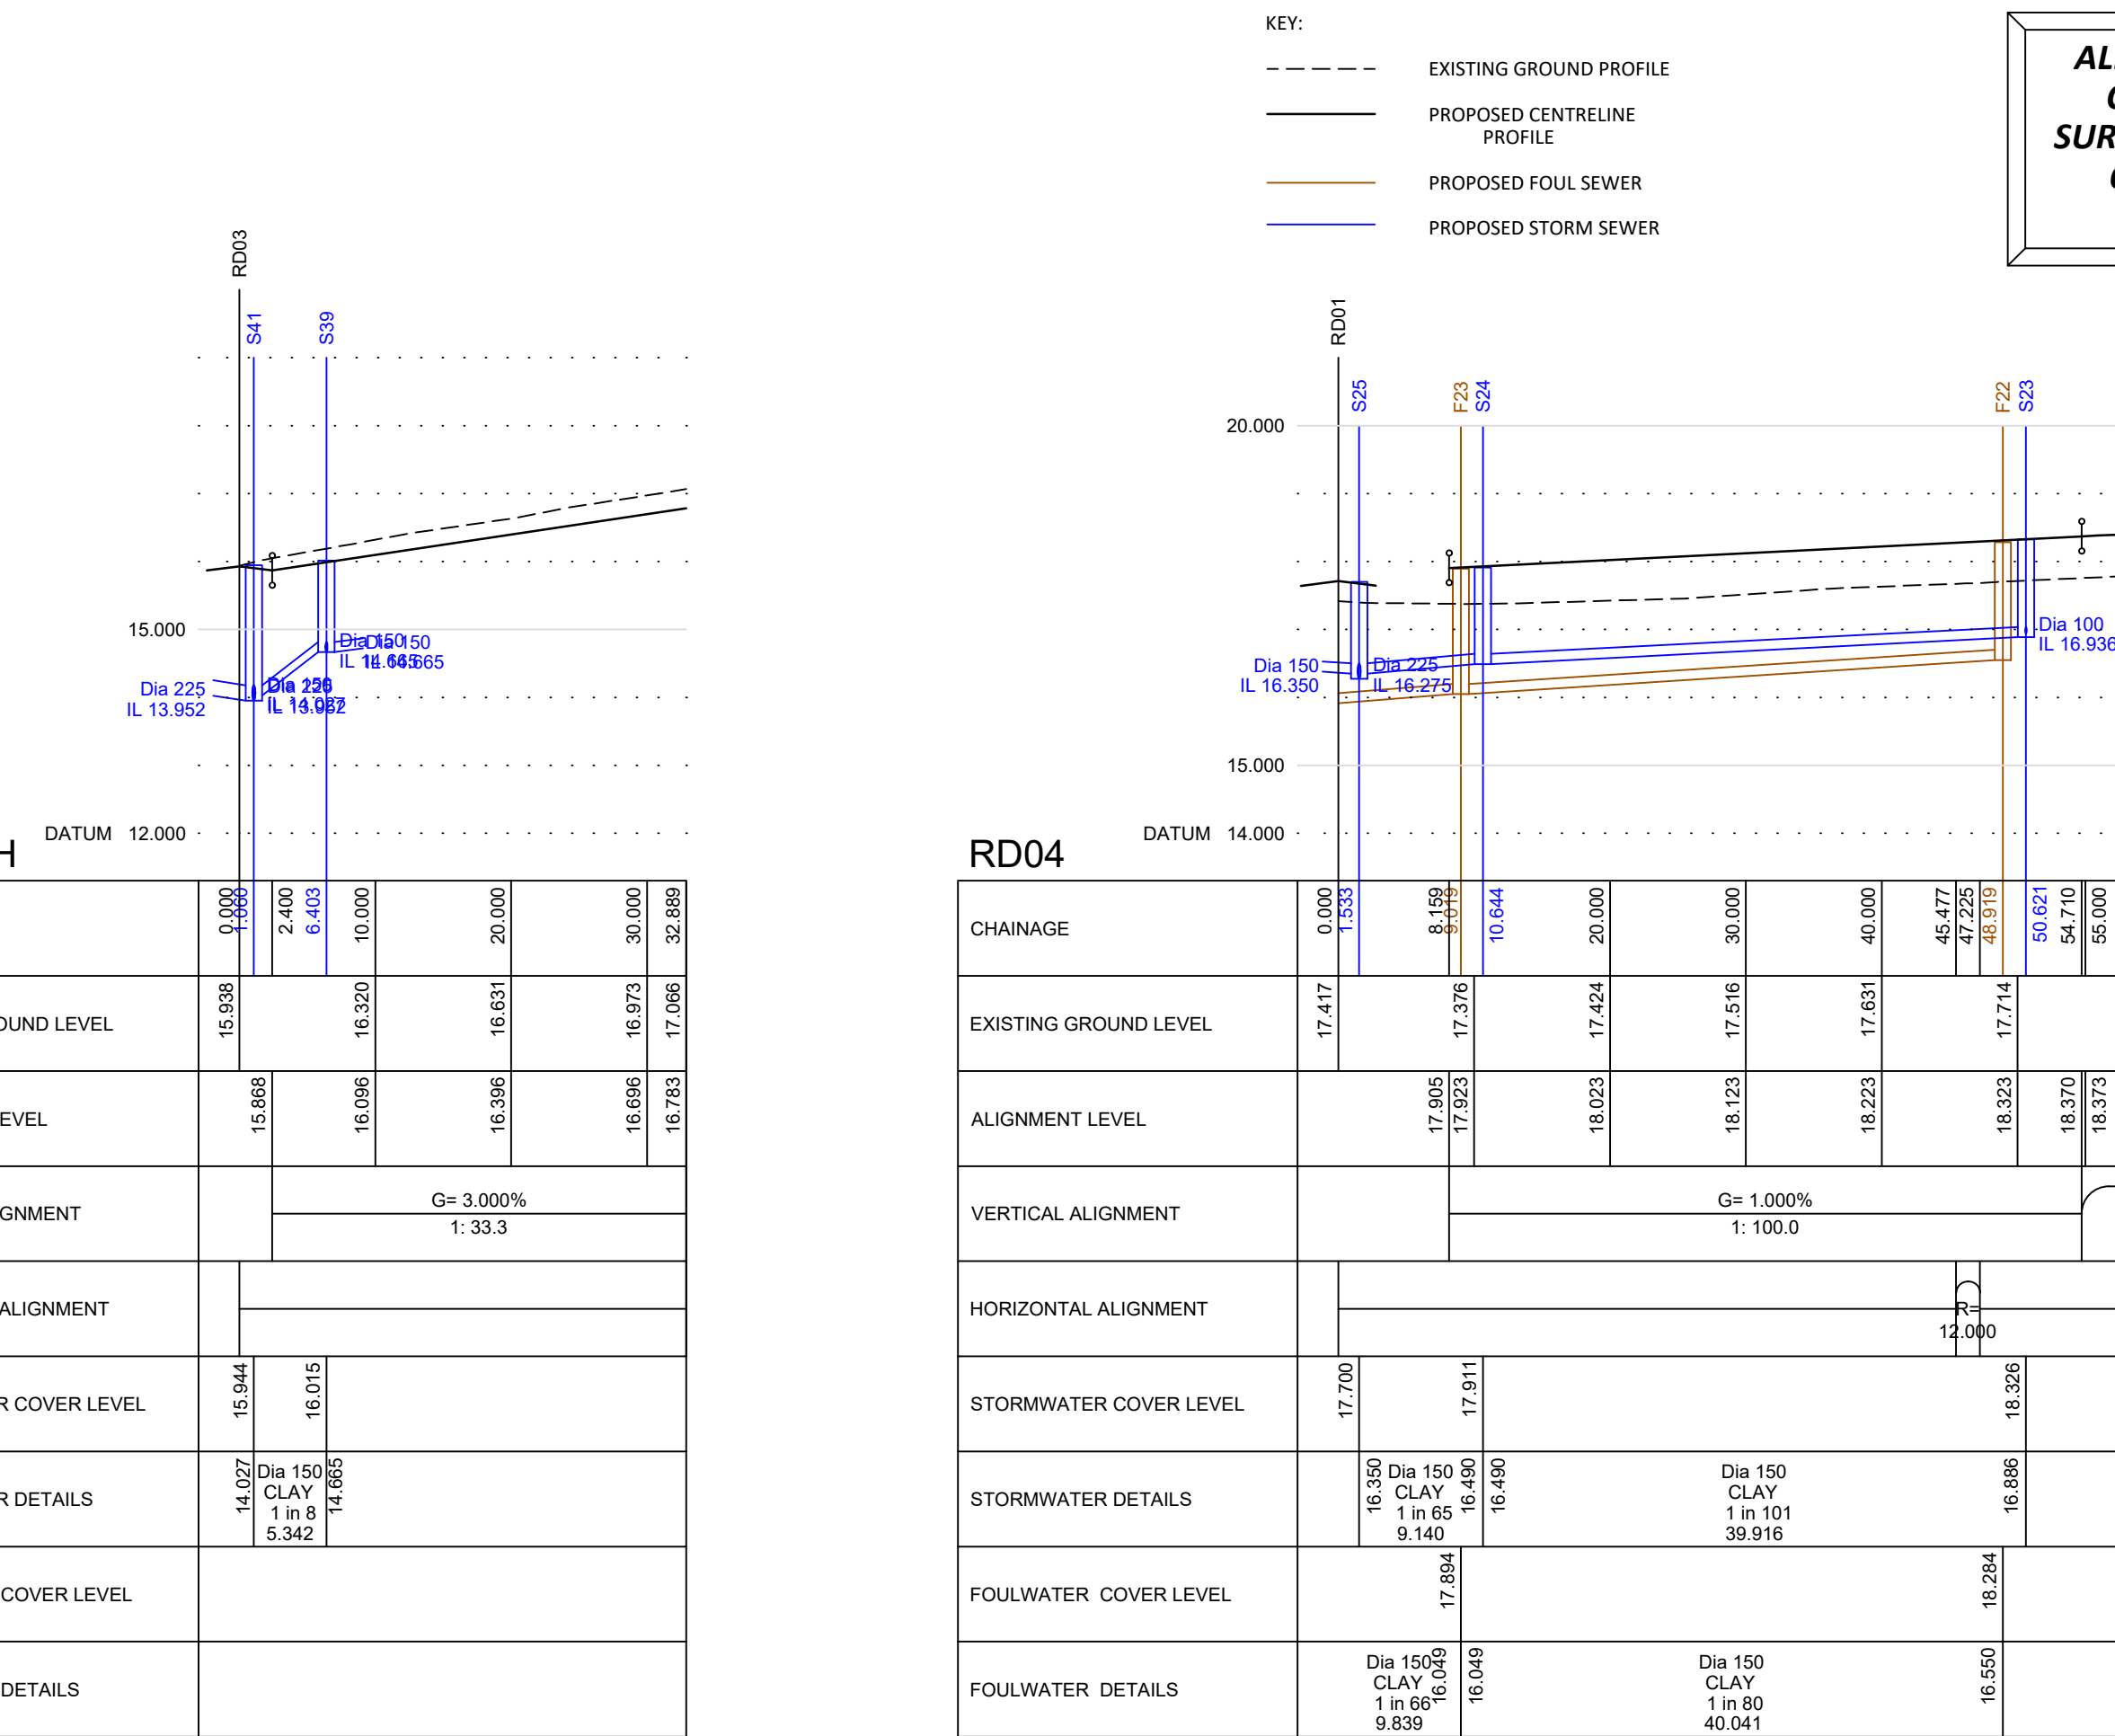


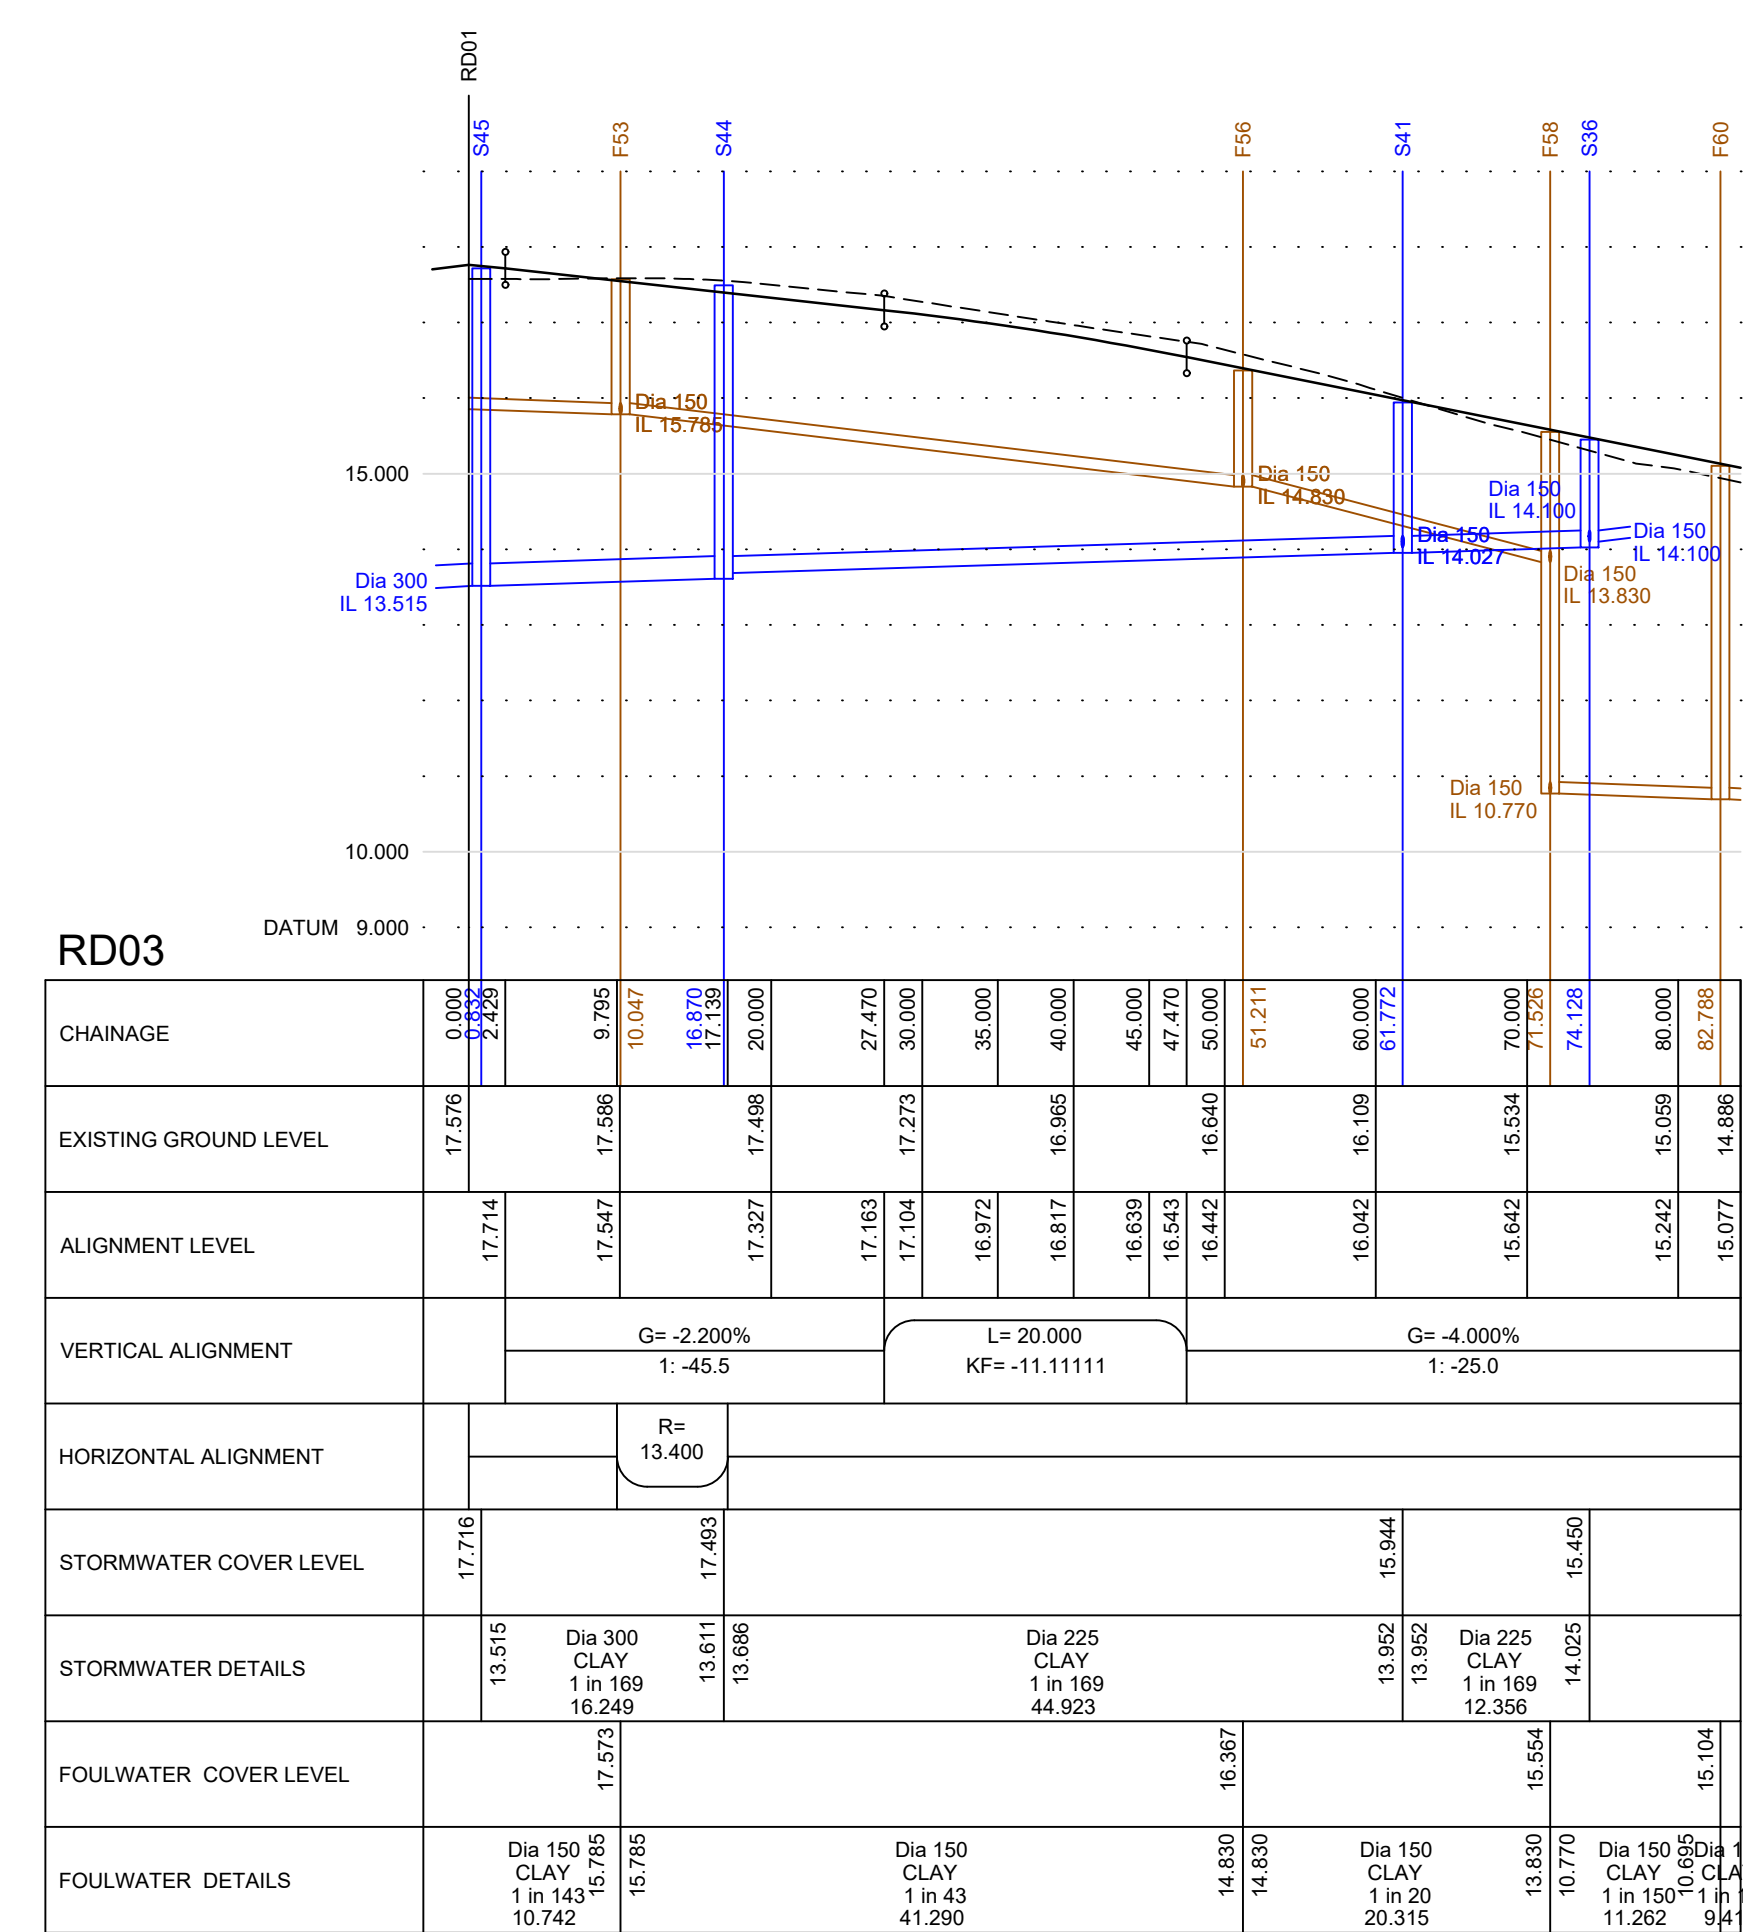

- ## PERMITTED PIPE MATERIALS
- CLAYWARE (FOR SEWERS 150mm & 225mm)
- All clayware pipes to be vitrified clay to BS EN 295-1:1991 and minimum crushing strength of 45kN Class 200 for diameters of 225mm. For 150mm diameter pipes a minimum crushing strength of 28kN shall be used.
- CONCRETE (FOR SEWERS 300mm AND ABOVE)
- All concrete pipes are to be pipe strength Class 120 to BS 5911-1:2004 unless indicated otherwise on the drawings.

P2	06.20	RD01 horizontal alignment updated with vertical alignment and drainage layout amended to suit	SM	9
P1	05.20	First issue	SM	9
Rev	Date	Description	Drawn	Checked

AL ABLEY LETCHFORD
P PARTNERSHIP
Consulting Engineers

3 Tealgate, Charnham Park
Hungerford, Berkshire RG17 0YT
www.alpce.co.uk Tel: 01488 684390

Client
**BARRATT DAVID
WILSON HOMES**

Project

WATER LANE, ANGMERING

Title
LONG SECTIONS
SHEET 2

Status

FOR APPROVAL

Scale 1:500 H @ A1 1:100 V	Date MAY 2020	Drawn SM	Checked SL
Drawing No A290-RM-112			Revision P2