
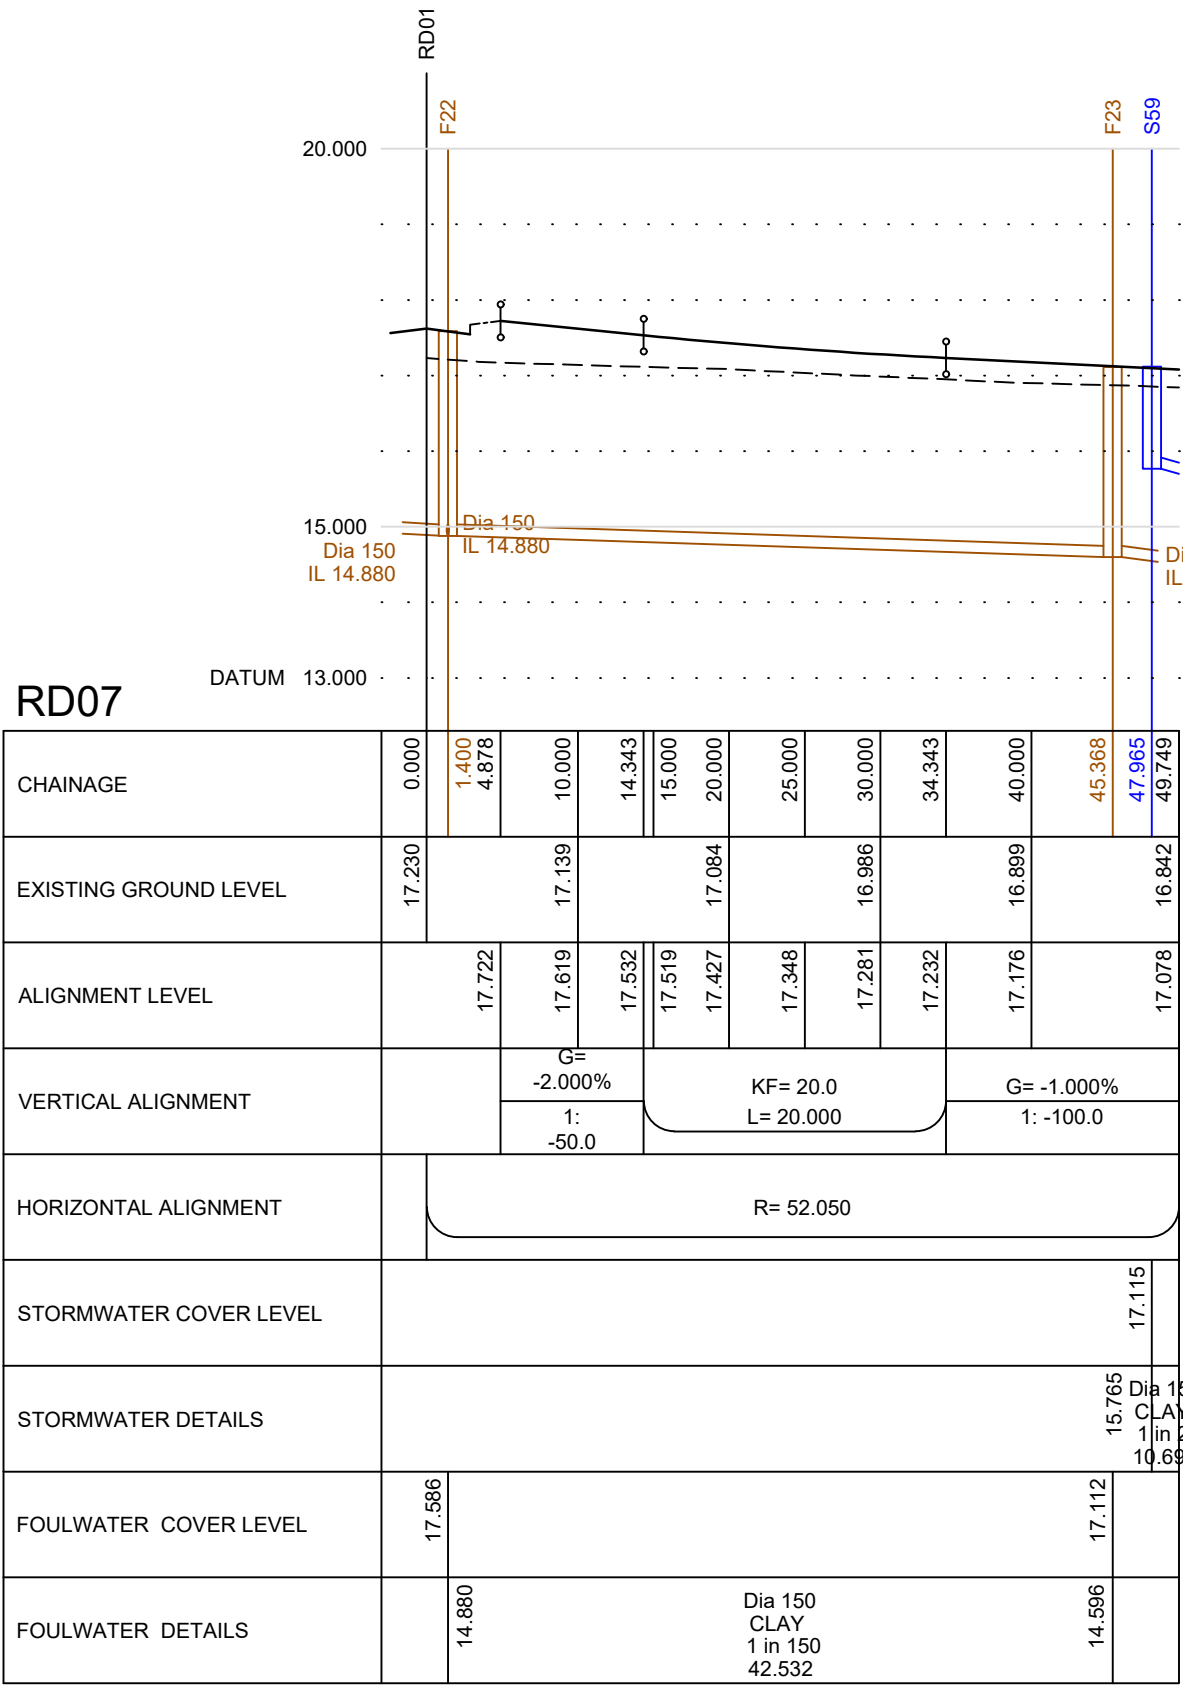
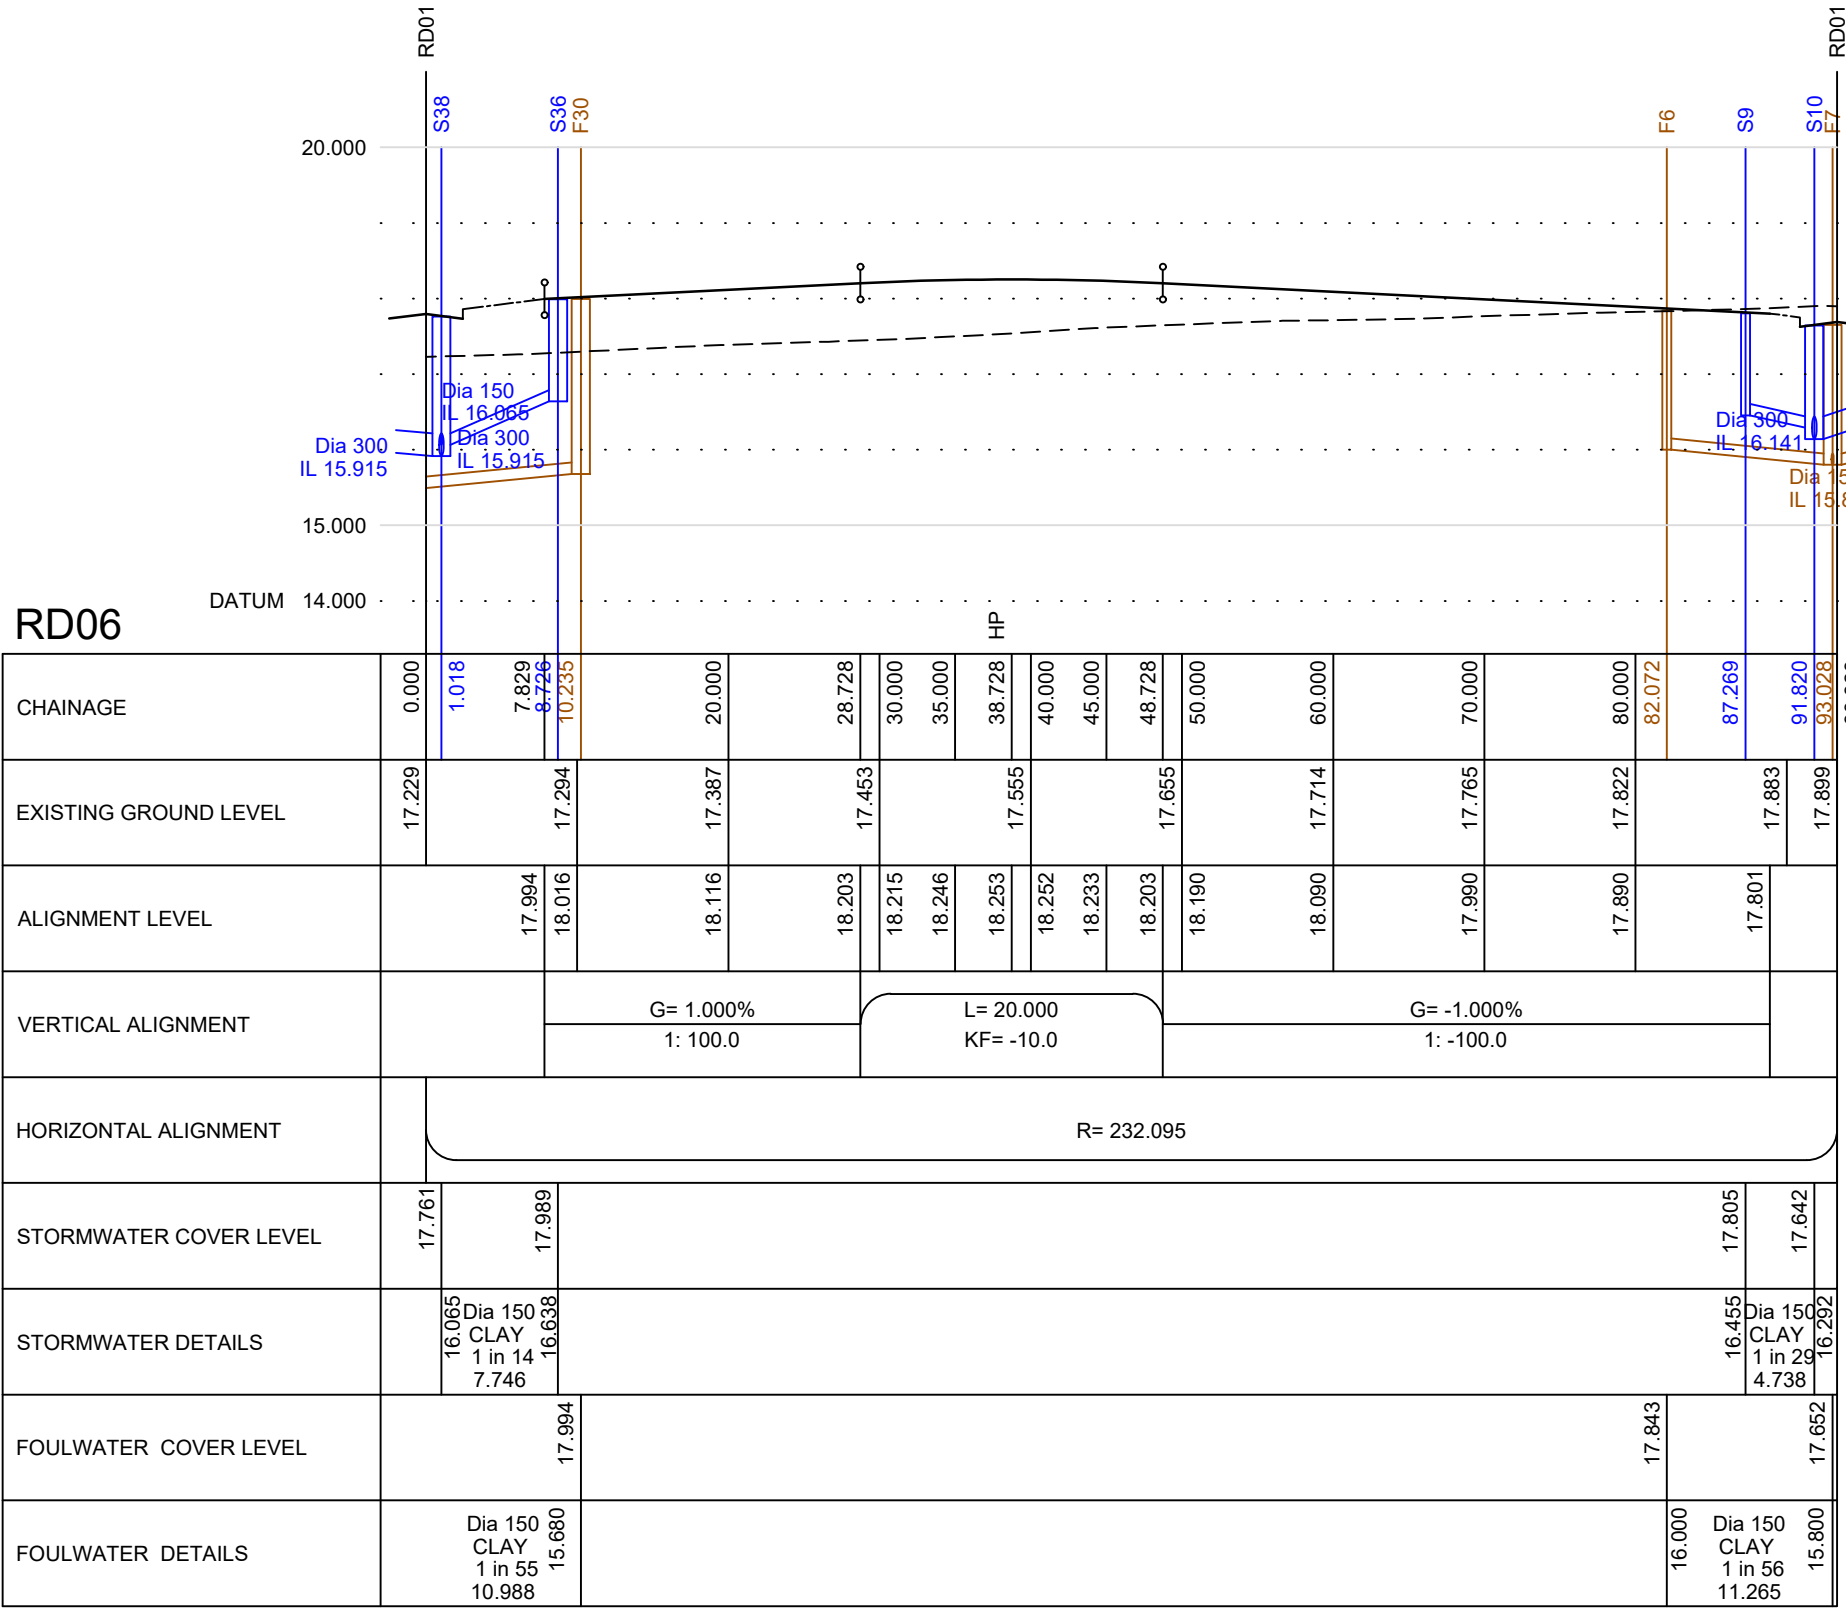


RD05TH

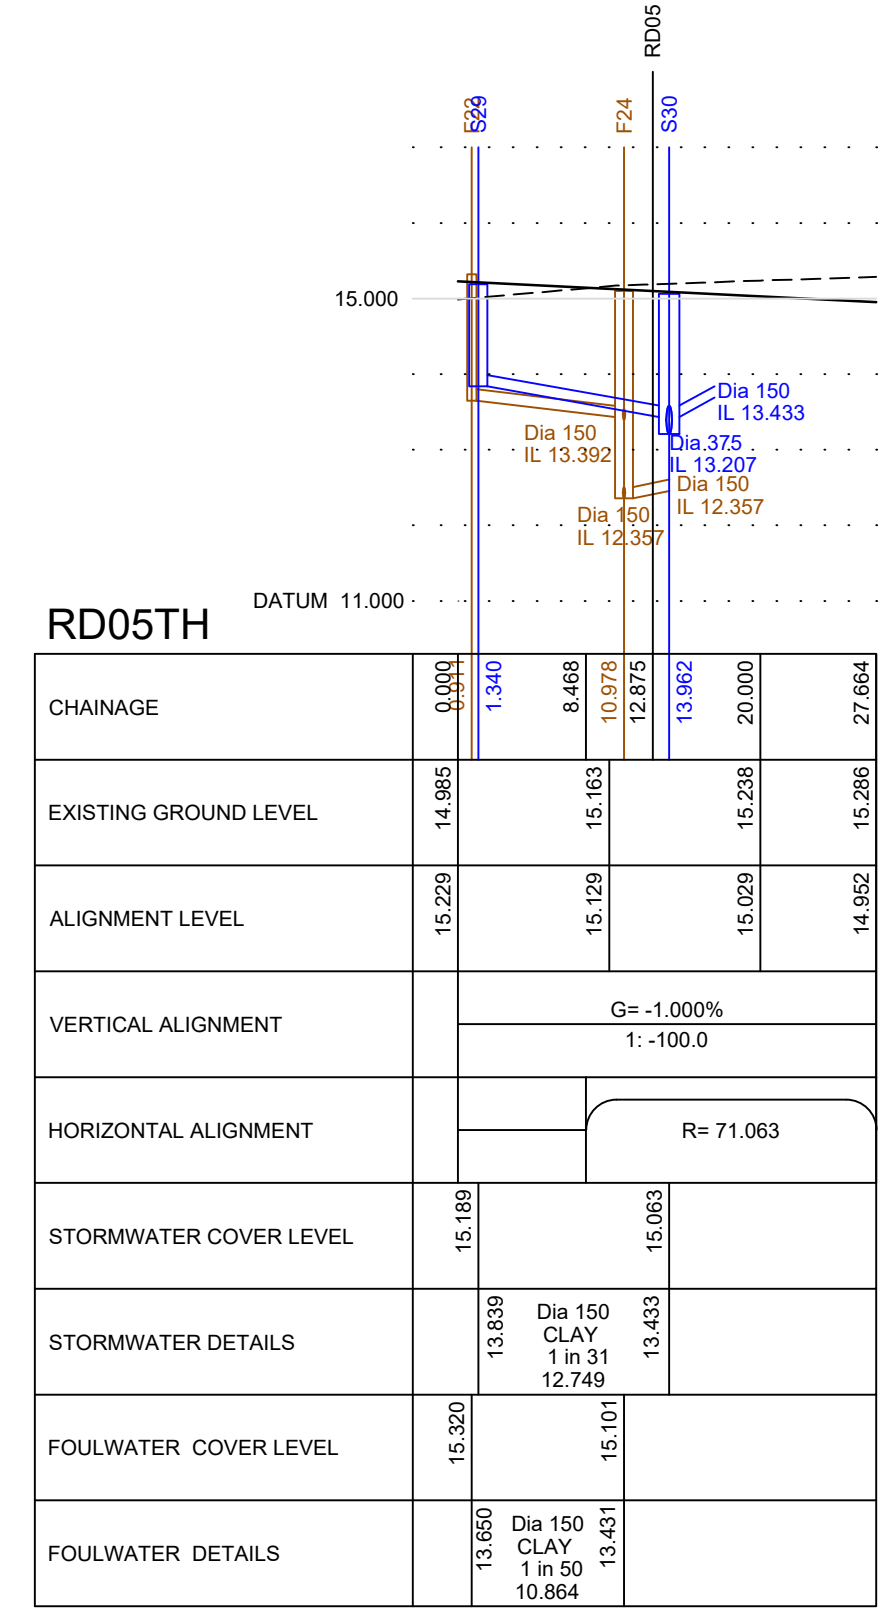

**ALL PIPE BEDDING TO BE
CLASS 'S' GRANULAR
SURROUND UNLESS NOTED
OTHERWISE ON THE
DRAWING**

PERMITTED PIPE MATERIALS

CLAYWARE (FOR SEWERS 150mm & 225mm)

All clayware pipes to be vitrified clay to BS EN 295-1:1991 and a minimum crushing strength of 45kN Class 200 for diameters of 150mm and 225mm. For 150mm diameter pipes a minimum crushing strength of 28kN shall be used.

CONCRETE (FOR SEWERS 300mm AND ABOVE)

All concrete pipes are to be pipe strength Class 120 to BS 5911-1:2004 unless indicated otherwise on the drawings.

P4	11.20	Drainage updated Road 5	SM	SL
P3	10.20	Drainage updated	SM	SL
P2	06.20	RD07 horizontal alignment updated with vertical alignment and drainage layout amended to suit	SM	SL
P1	05.20	First issue	SM	SL
Rev	Date	Description	Drawn	Checked

AL ABLEY LETCHFORD
P PARTNERSHIP
Consulting Engineers

3 Tealgate, Charnham Park
Hungerford, Berkshire RG17 0YT

www.alpce.co.uk Tel: 01488 684390

Client
**BARRATT DAVID
WILSON HOMES**

Project

WATER LANE, ANGMERING

Title
LONG SECTIONS
SHEET 3

FOR APPROVAL

Scale 1:500 H @ A1 1:100 V	Date MAY 2020	Drawn SM	Checked SL
----------------------------------	------------------	-------------	---------------