






EXISTING ELEVATIONS. SCALE 1:100

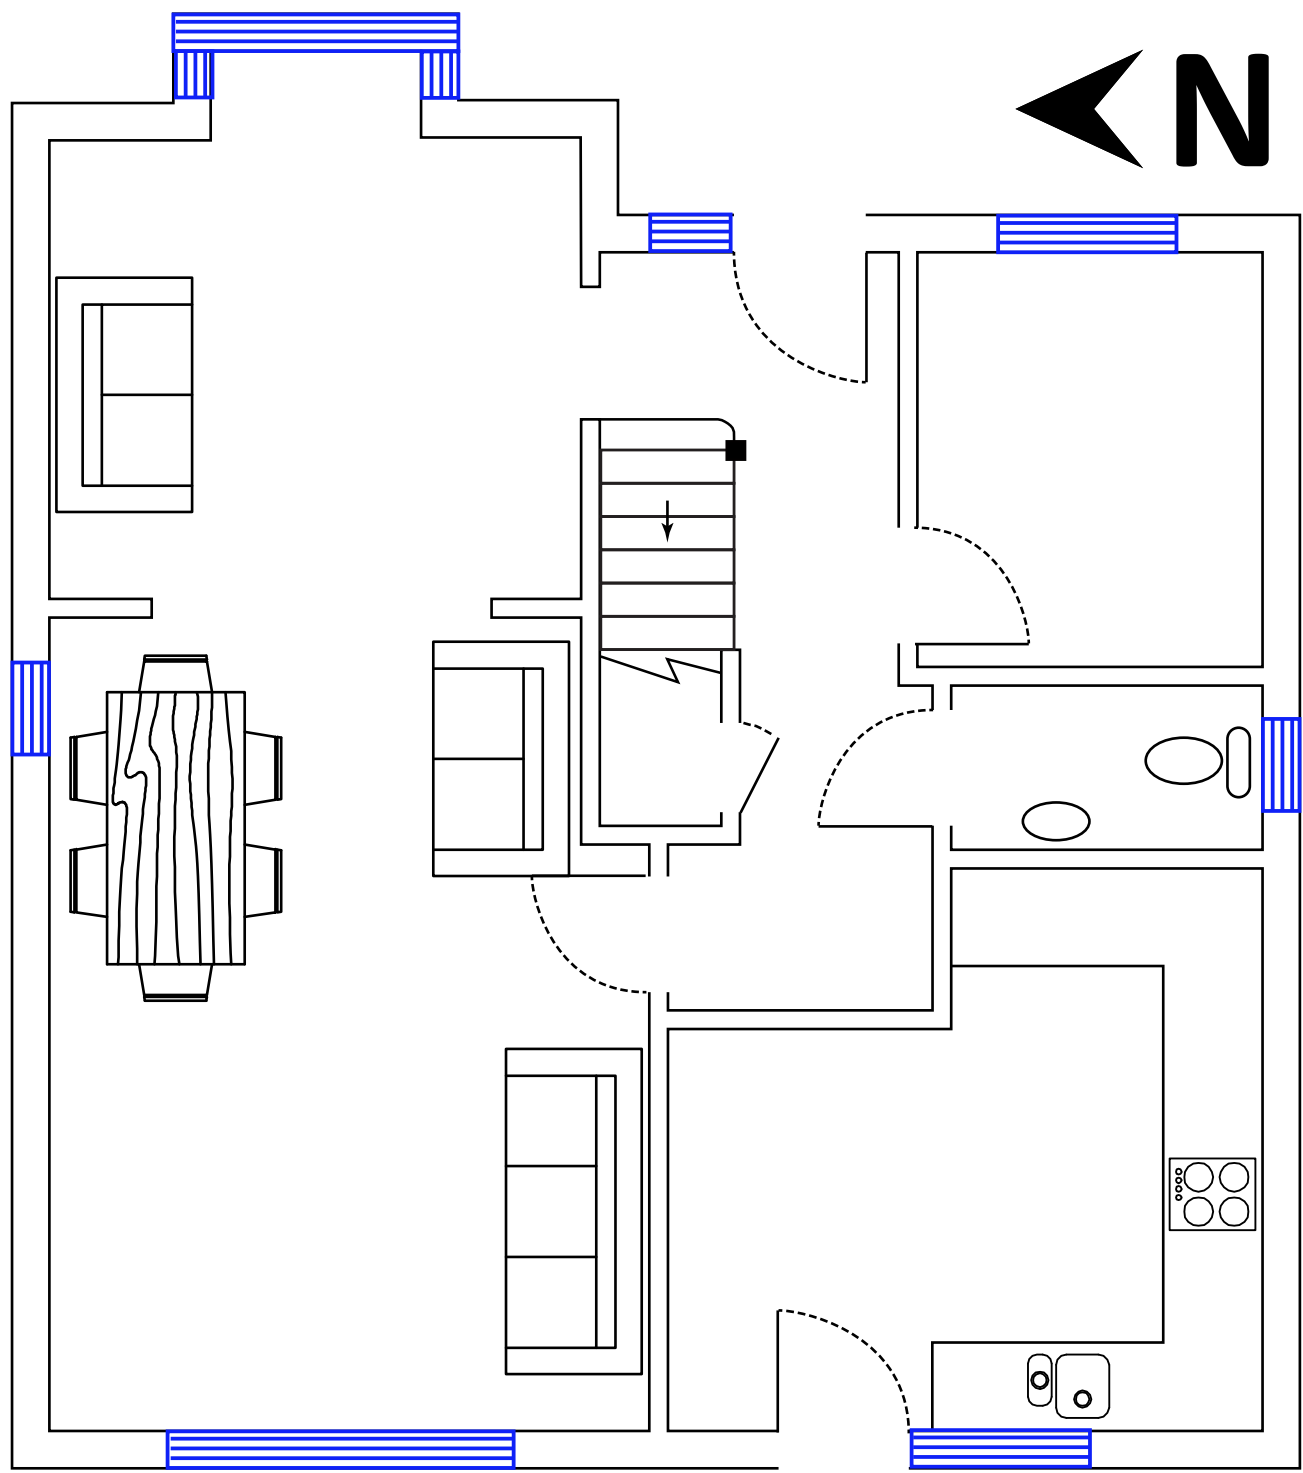


EXISTING GROUND FLOOR - SCALE 1:50

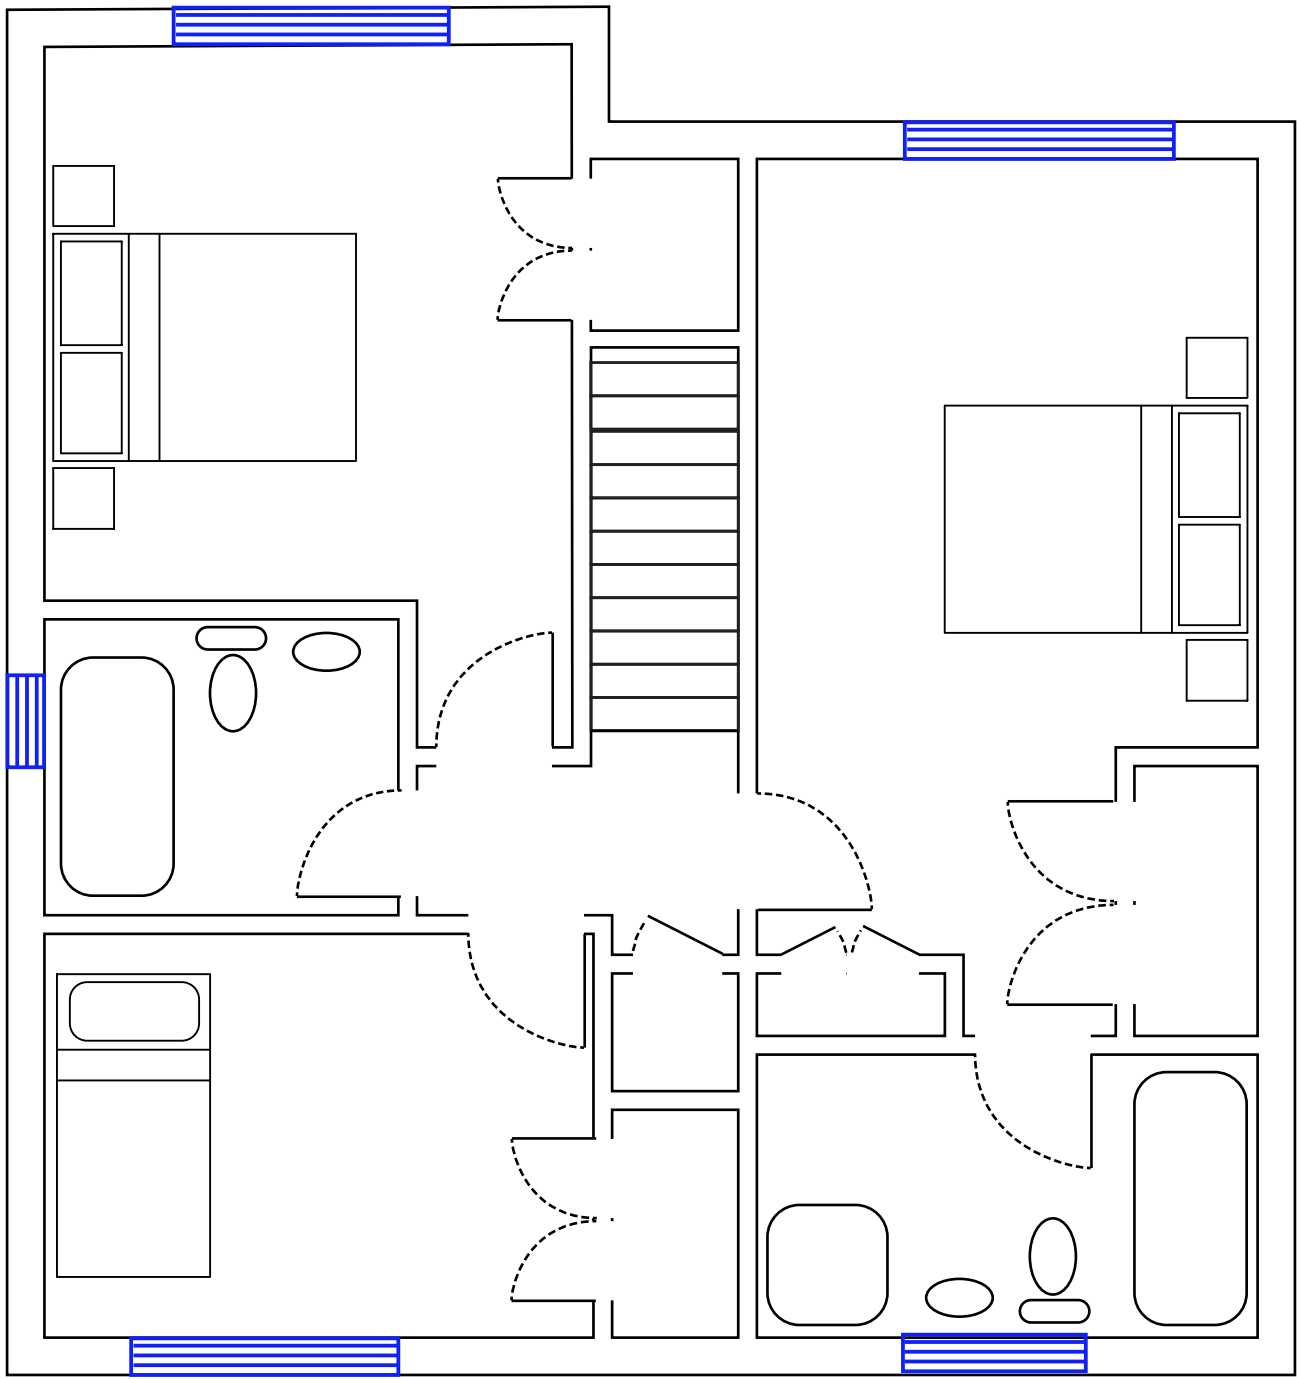


EXISTING FIRST FLOOR - SCALE 1:50

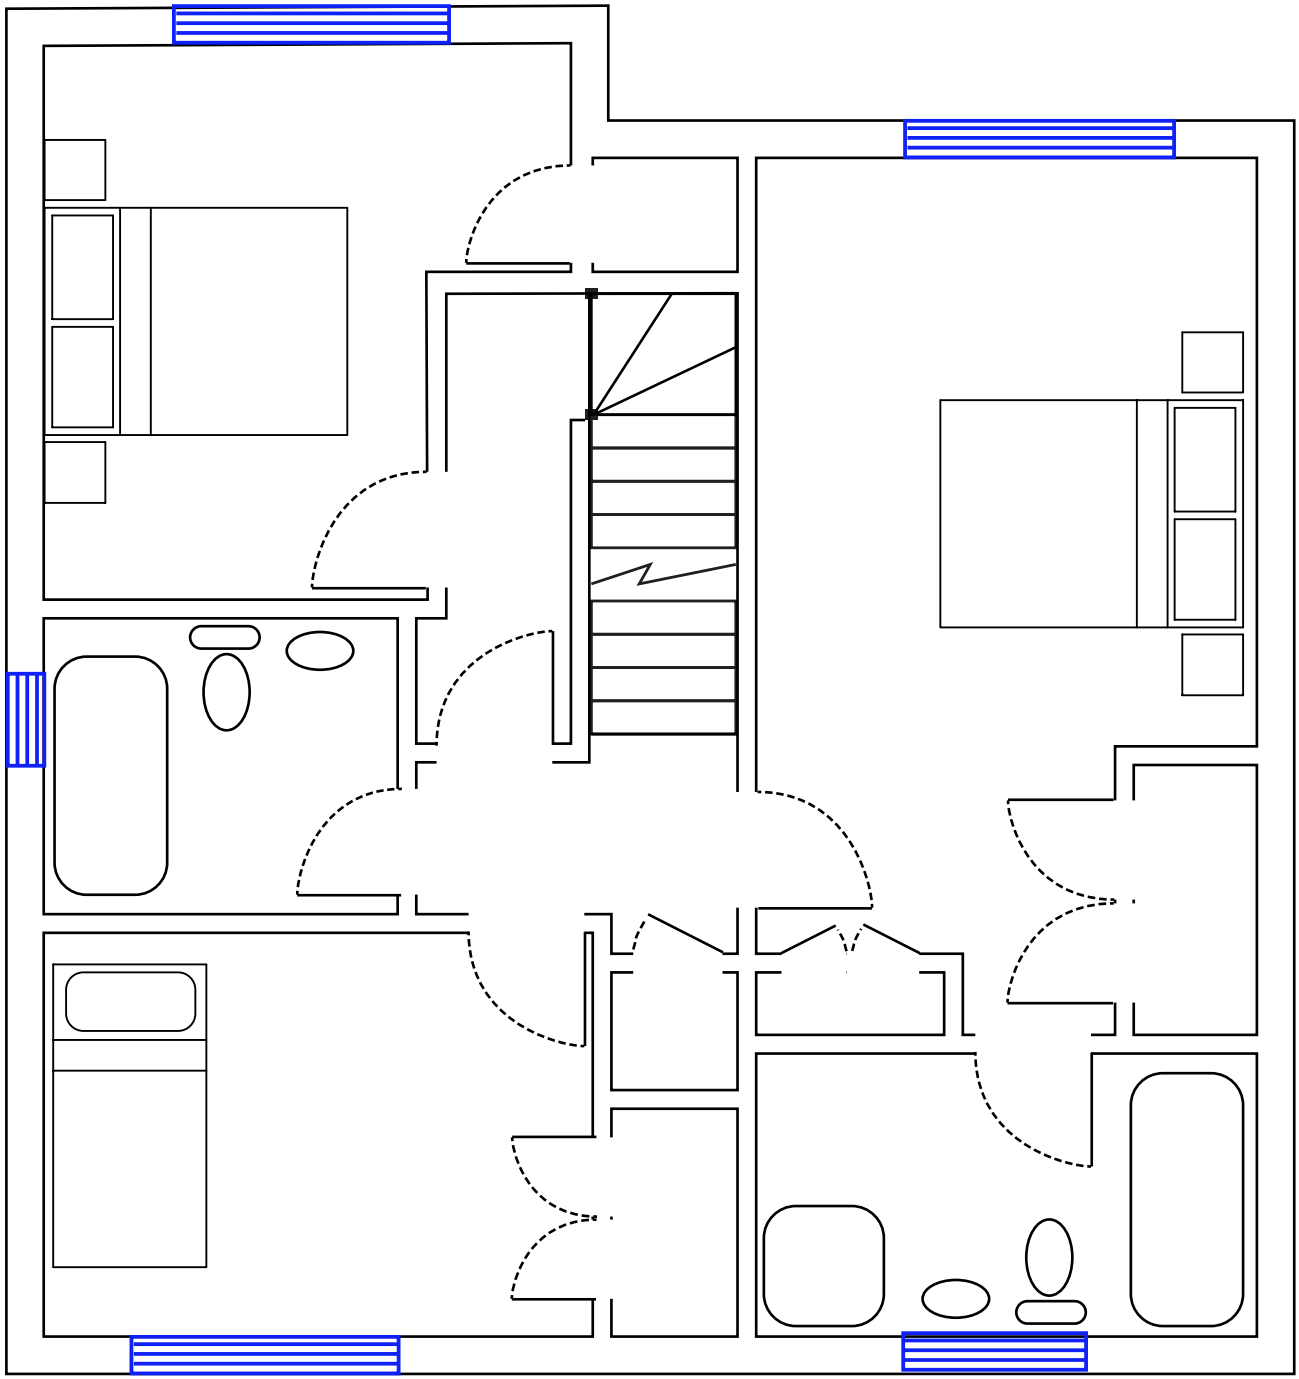


PROPOSED FIRST FLOOR - SCALE 1:50

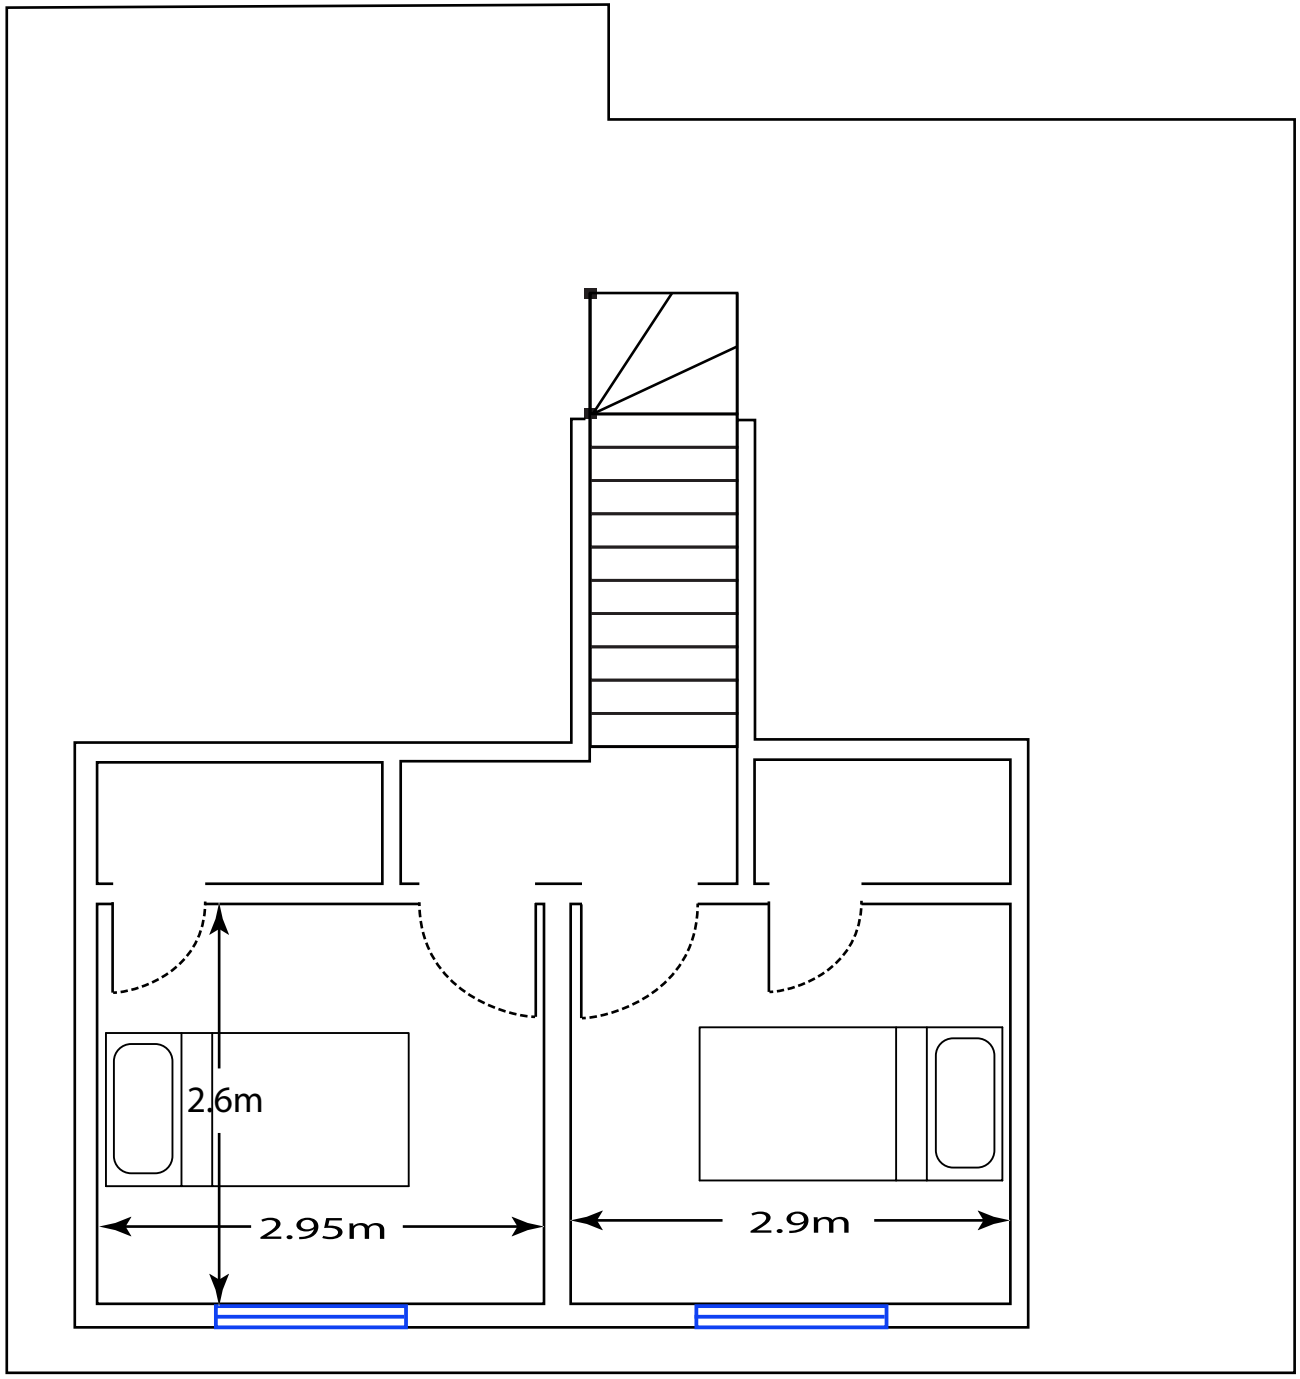


PROPOSED SECOND FLOOR - SCALE 1:50



PROPOSED ELEVATIONS. SCALE 1:100

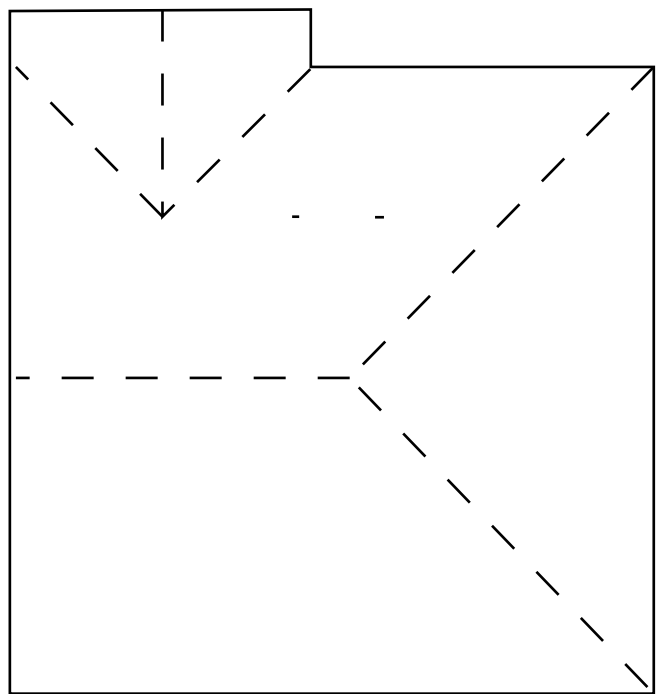

EXISTING ROOF PLAN. SCALE 1:100

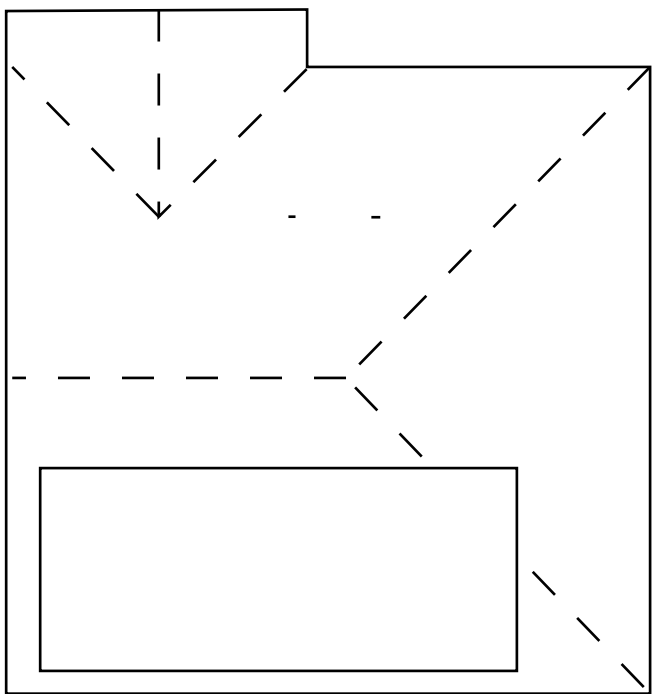

PROPOSED ROOF PLAN. SCALE 1:100

ED63

ELEMENTAL DESIGN

16 Oakwood Drive

Rear flat roof dormer

Dormer walls and cheeks: Vertical tile hanging on treated battens, on breathable paper, on 1/2 hour fireboard, on 11mm OSB, on 100x50 stud framing at 400 centres, infilled with 90mm celotex insulation, with 12mm celotex insulation over, 12mm fireline plasterboard, and skim finish internally. Cheeks within 1000mm of boundary to have half hour fire resistant board. Dormer fully weathered in code 4 lead flashing. Dormer cheeks built off triple 6 x 2 rafters, running from ridge to plate, or to pick up purlin point.

Party Wall: Party wall to have a scratch coat of sand cement.

Dormer roof. Flat: (Warm roof)- Bitumen bedded limestone chippings, (minimum 12.5mm deep), on three layers bitumen roofing felt to BS747 (or alternative suitable flat roofing system) on 18mm OSB decking on 120mm celotex, on vapour control layer, (min 1000gauge polythene), on 11mm OSB, on firing pieces (at 1:40) on 195 roof joists at 400 centres.

Ceilings and skellings: Existing/new rafters to achieve ventilation gap behind 70mm celotex insulation between rafters; 50mm Celotex across rafters, with 12 foil backed plasterboard, and skim finish.

New Floor: Main beams on load bearing walls supporting new and existing structure. Supporting studwork under rafters to have sole plates bolted to top flange of RSI via M6 bolts at 600 centres, carrying GMS joist hangers. Lay rockwool insulation between joists as per requirements for sound and fire resistance. Joists to be minimum 50mm from live chimney breasts. Existing ceiling joists strapped up to new floor beams where binders/truss members removed. New flooring to be 22mm moisture resistant caber floor, or equivalent flooring grade chipboard.

Staircase: Rise=208 Going=228 Number of equal risers=13 Overall width= 800 Maximum pitch=42 degrees. Headroom above the pitch line of the stair should be a minimum of 2m. Floor/pitch line to top of handrail= 900. Spindles at 100 centres. Tapered treads to have min 50 going, and same as straight treads at mid point.

Glazing: All glazing in critical locations to be of toughened or laminated safety glass in accordance with clause

5.3.85 6206:1981. New glazing needs to achieve 1.6W/m2 K.

Electrical work: All electrical work required to meet the latest requirements of electrical Safety, must be designed, installed, inspected, and tested by a person competent to do so. Prior to completion, the Council must be satisfied that an appropriate electrical installation certificate has been issued for the work, and it has been signed by a person competent to do so. Energy efficient lights need to be provided at a rate of 75%.

Ventilation: Provide equivalent to 5mm continuous strip at ridge. Ensure/provide 25mm ventilation strip (or equivalent) to existing eaves. Provide trickle ventilator to give 8000mm2 background ventilation to loft room(s). New roofing to be with breathable membrane throughout.

Means of Warning and Escape: Mains linked interconnected alarm required with heat detection to kitchen, and smoke detection to all landing levels. FD30 doors to be fitted to all habitable rooms on escape route at all floor levels. Habitable rooms to have means of escape windows.

Notes

1. No critical dimensions are to be scaled from this drawing. (except for planning purposes)
2. It is the contractor's responsibility to ensure that all work is carried out in accordance with Local Authority and N.H.B.C requirements and that all plumbing and electrical work complies with the current regulations of the area water board and electricity board.
3. Any works carried out prior to the receipt of the necessary approvals are the responsibility of the client.
4. Whilst every effort has been made to obtain accurate information on the existing structure or site, it is essential that the contractor or client check at every stage and notify the Designer of any discrepancies.

© copyright

ED63
ELEMENTAL DESIGN

elementaldesign63@gmail.com

07799 402 870
07754 093 904

Client: Mr HOWELL

Job Title:
16 OAKWOOD DRIVE
ANGMERING

Drawing Title:
REAR FLAT ROOF DORMER

Scale - 1:50 / 1:100

Date:14-07-2021

Drawn by - A.Ramus

Drg no.-16OD.RD

A1 - 841mm x 594mm