


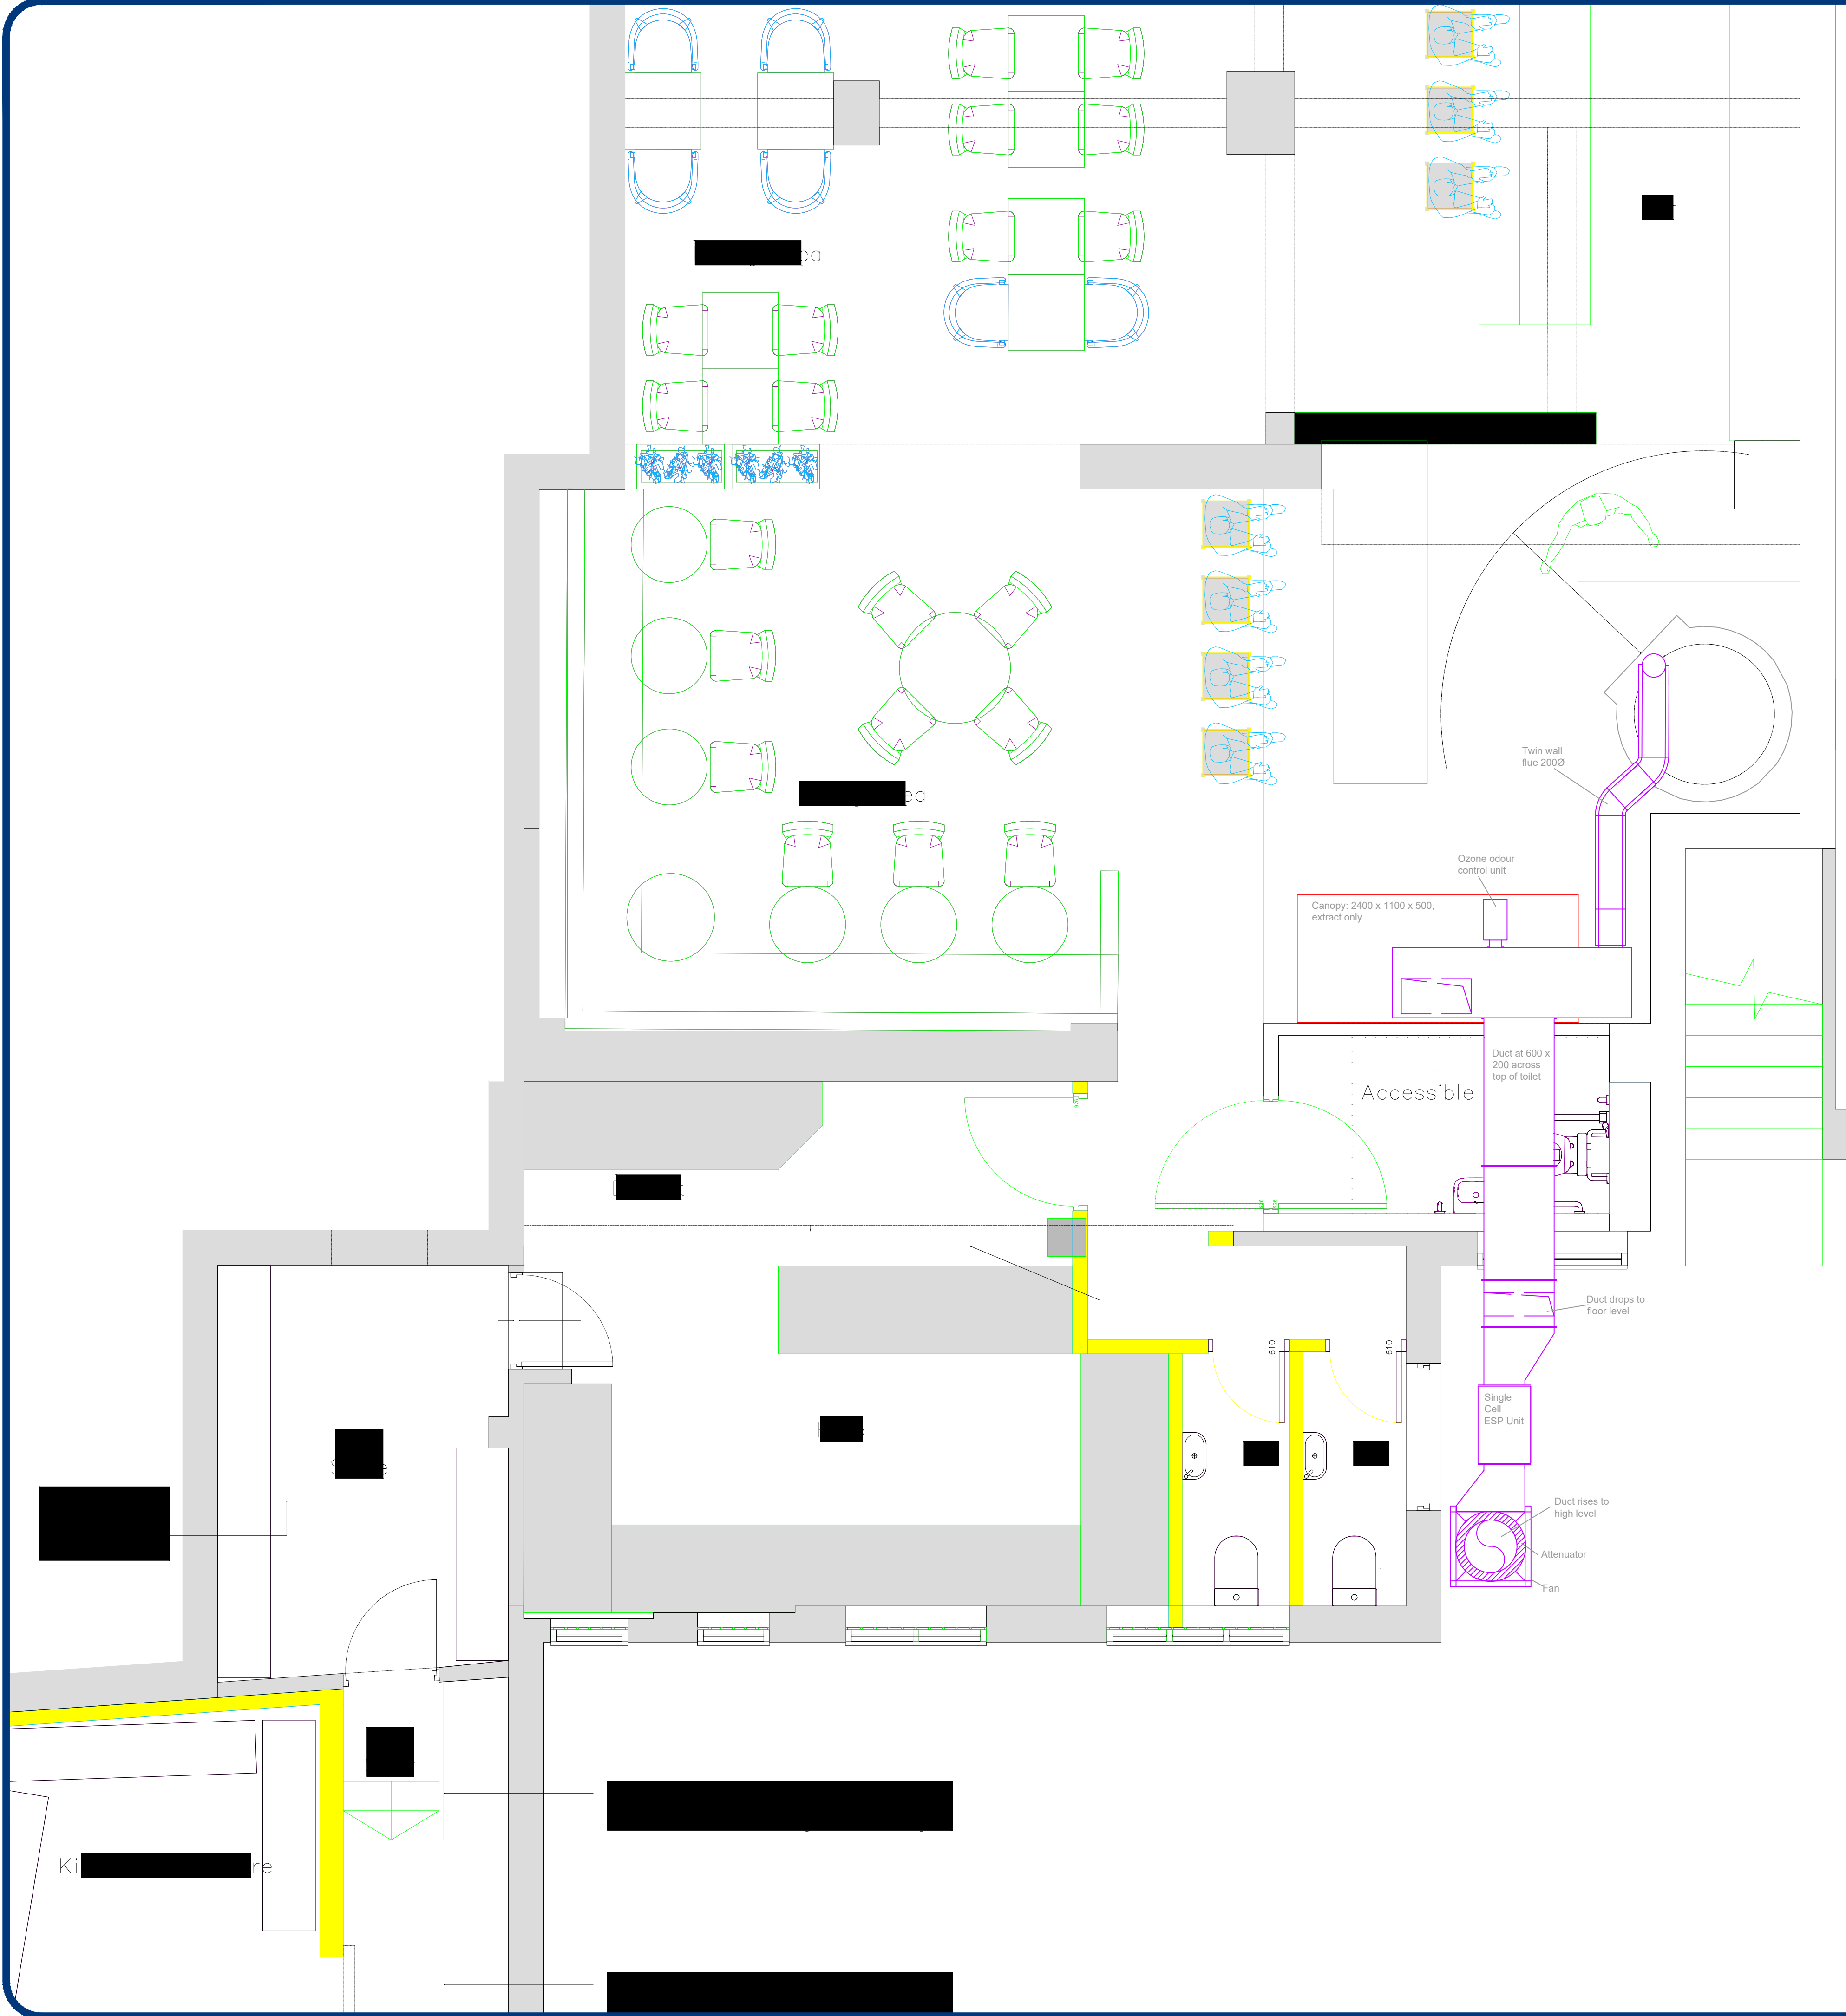

ADDITIONAL INFORMATION

1. Do not scale from this drawing
2. All ductwork is non-fire rated unless specifically indicated
3. Unless Specifically Indicated All Supply Air is Untempered
4. In Accordance with DW172 supply air will be calculated at 70% to 85% of the volume of air being extracted. The remainder of air to be supplied by natural infiltration / non-mechanical grille supplied and installed by others unless otherwise specified.
5. Canopy, duct and fan fitted on drop rods directly to roof above unless otherwise indicated
6. System cleaning and maintenance is vital to ensure long term performance and reliability. BWF's 12 month warranty will be invalidated if maintenance is not carried out in line with BWF's O&M manual provided. BWF will be happy to advise further if required.
7. Future access to all parts of the system is needed to enable maintenance and should be considered as part of building design. BWF are happy to provide further guidance as required

Key

- Canopy
- Extract System
- Supply System

TECHNICAL INFORMATION

USE A0 Version

FOR COMMENT

| Rev | Details | Date |
|-----|---------|------|
| H   |         |      |
| G   |         |      |
| F   |         |      |
| E   |         |      |
| D   |         |      |
| C   |         |      |
| B   |         |      |
| A   |         |      |
| -   |         |      |

© This drawing and its contents are the intellectual property of B W Fabrications Limited and must not be copied or reproduced in part or in full without express written permission.



101 South Liberty Lane, Ashton Vale,Bristol, BS3 2SZ  
t:0117 963 4492 f:0117 329 5454  
e:info@bwffabrications.co.uk  
w:www.bwffabrications.co.uk

CLIENT NAME & PROJECT TITLE

The Stone Room  
Proposed Kitchen Ventilation System

DRAWING TITLE

Indicative Specification  
in Plan View Only

DESIGNED BY

RGB

DRAWING No.

20633

DRAWN BY

XXX

SCALE

1:30@A1