
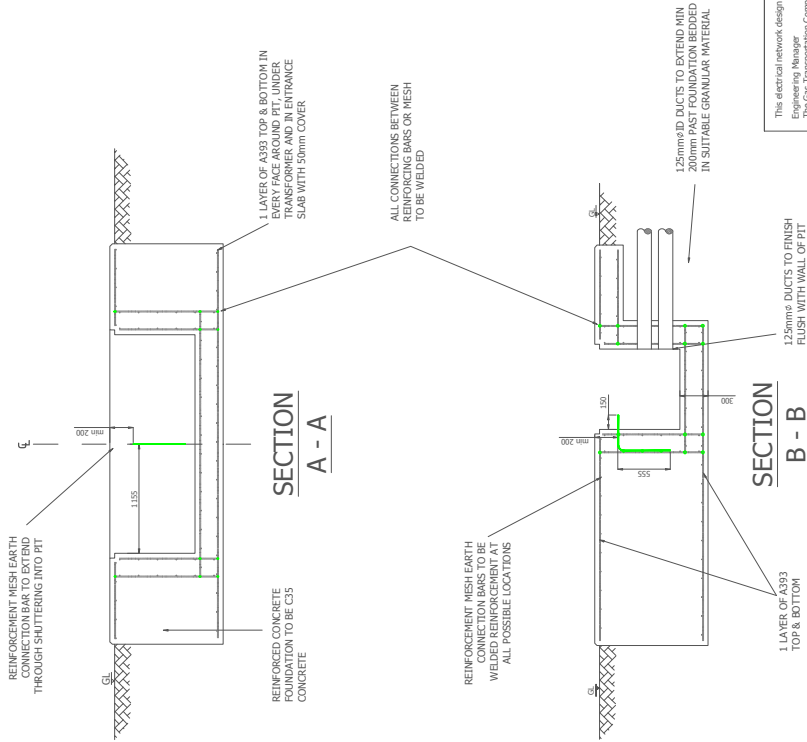


Rev	Revision Note	Date	Drawn by	Approved
1-0	Original drawing	05/04/11	AS	KB
1-1	Duct details amended	29/03/12	AS	MS
1-2	Wording of sub station stamp amended	10/09/14	SW	MS

DESIGN APPROVED BY
THE ELECTRICITY NETWORK CO
21-11-16

FOR FULL BASE DETAIL PLEASE
REFER TO GTC SUBSTATION
DRAWING GTC-E-SS-001X AND
SUBSTATION DOCUMENT
GE-TGI-IG-0032

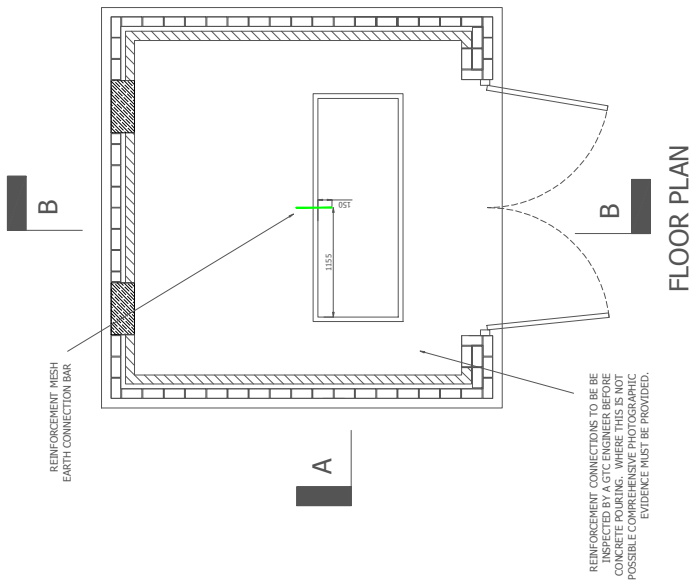

This electrical network design has been carried out by:
Engineering Manager
Electricity Networks Company Ltd
Woodgate Business Park
Bury St Edmunds
Suffolk
IP80 8JP
Tel : 01359 240323
Fax : 01359 244398
www.ene.co.uk

All cables and equipment used on this design are to be in accordance with BS 5838:2005.

© Electricity Networks Company Ltd

ene

Drawing Scale: NOT TO SCALE

O.S.REF: N/A

Drawing Number: GTC-EA-0003_R1-2

Description: REINFORCING MESH EARTH CONNECTION BAR LAYOUT

APPROVED FOR
CONSTRUCTION

THIS DRAWING IS TO BE READ IN
CONJUNCTION WITH DRAWING
GTC-E-EA-0001 OR GTC-E-EA-0002

SHEET
SIZE
A2