


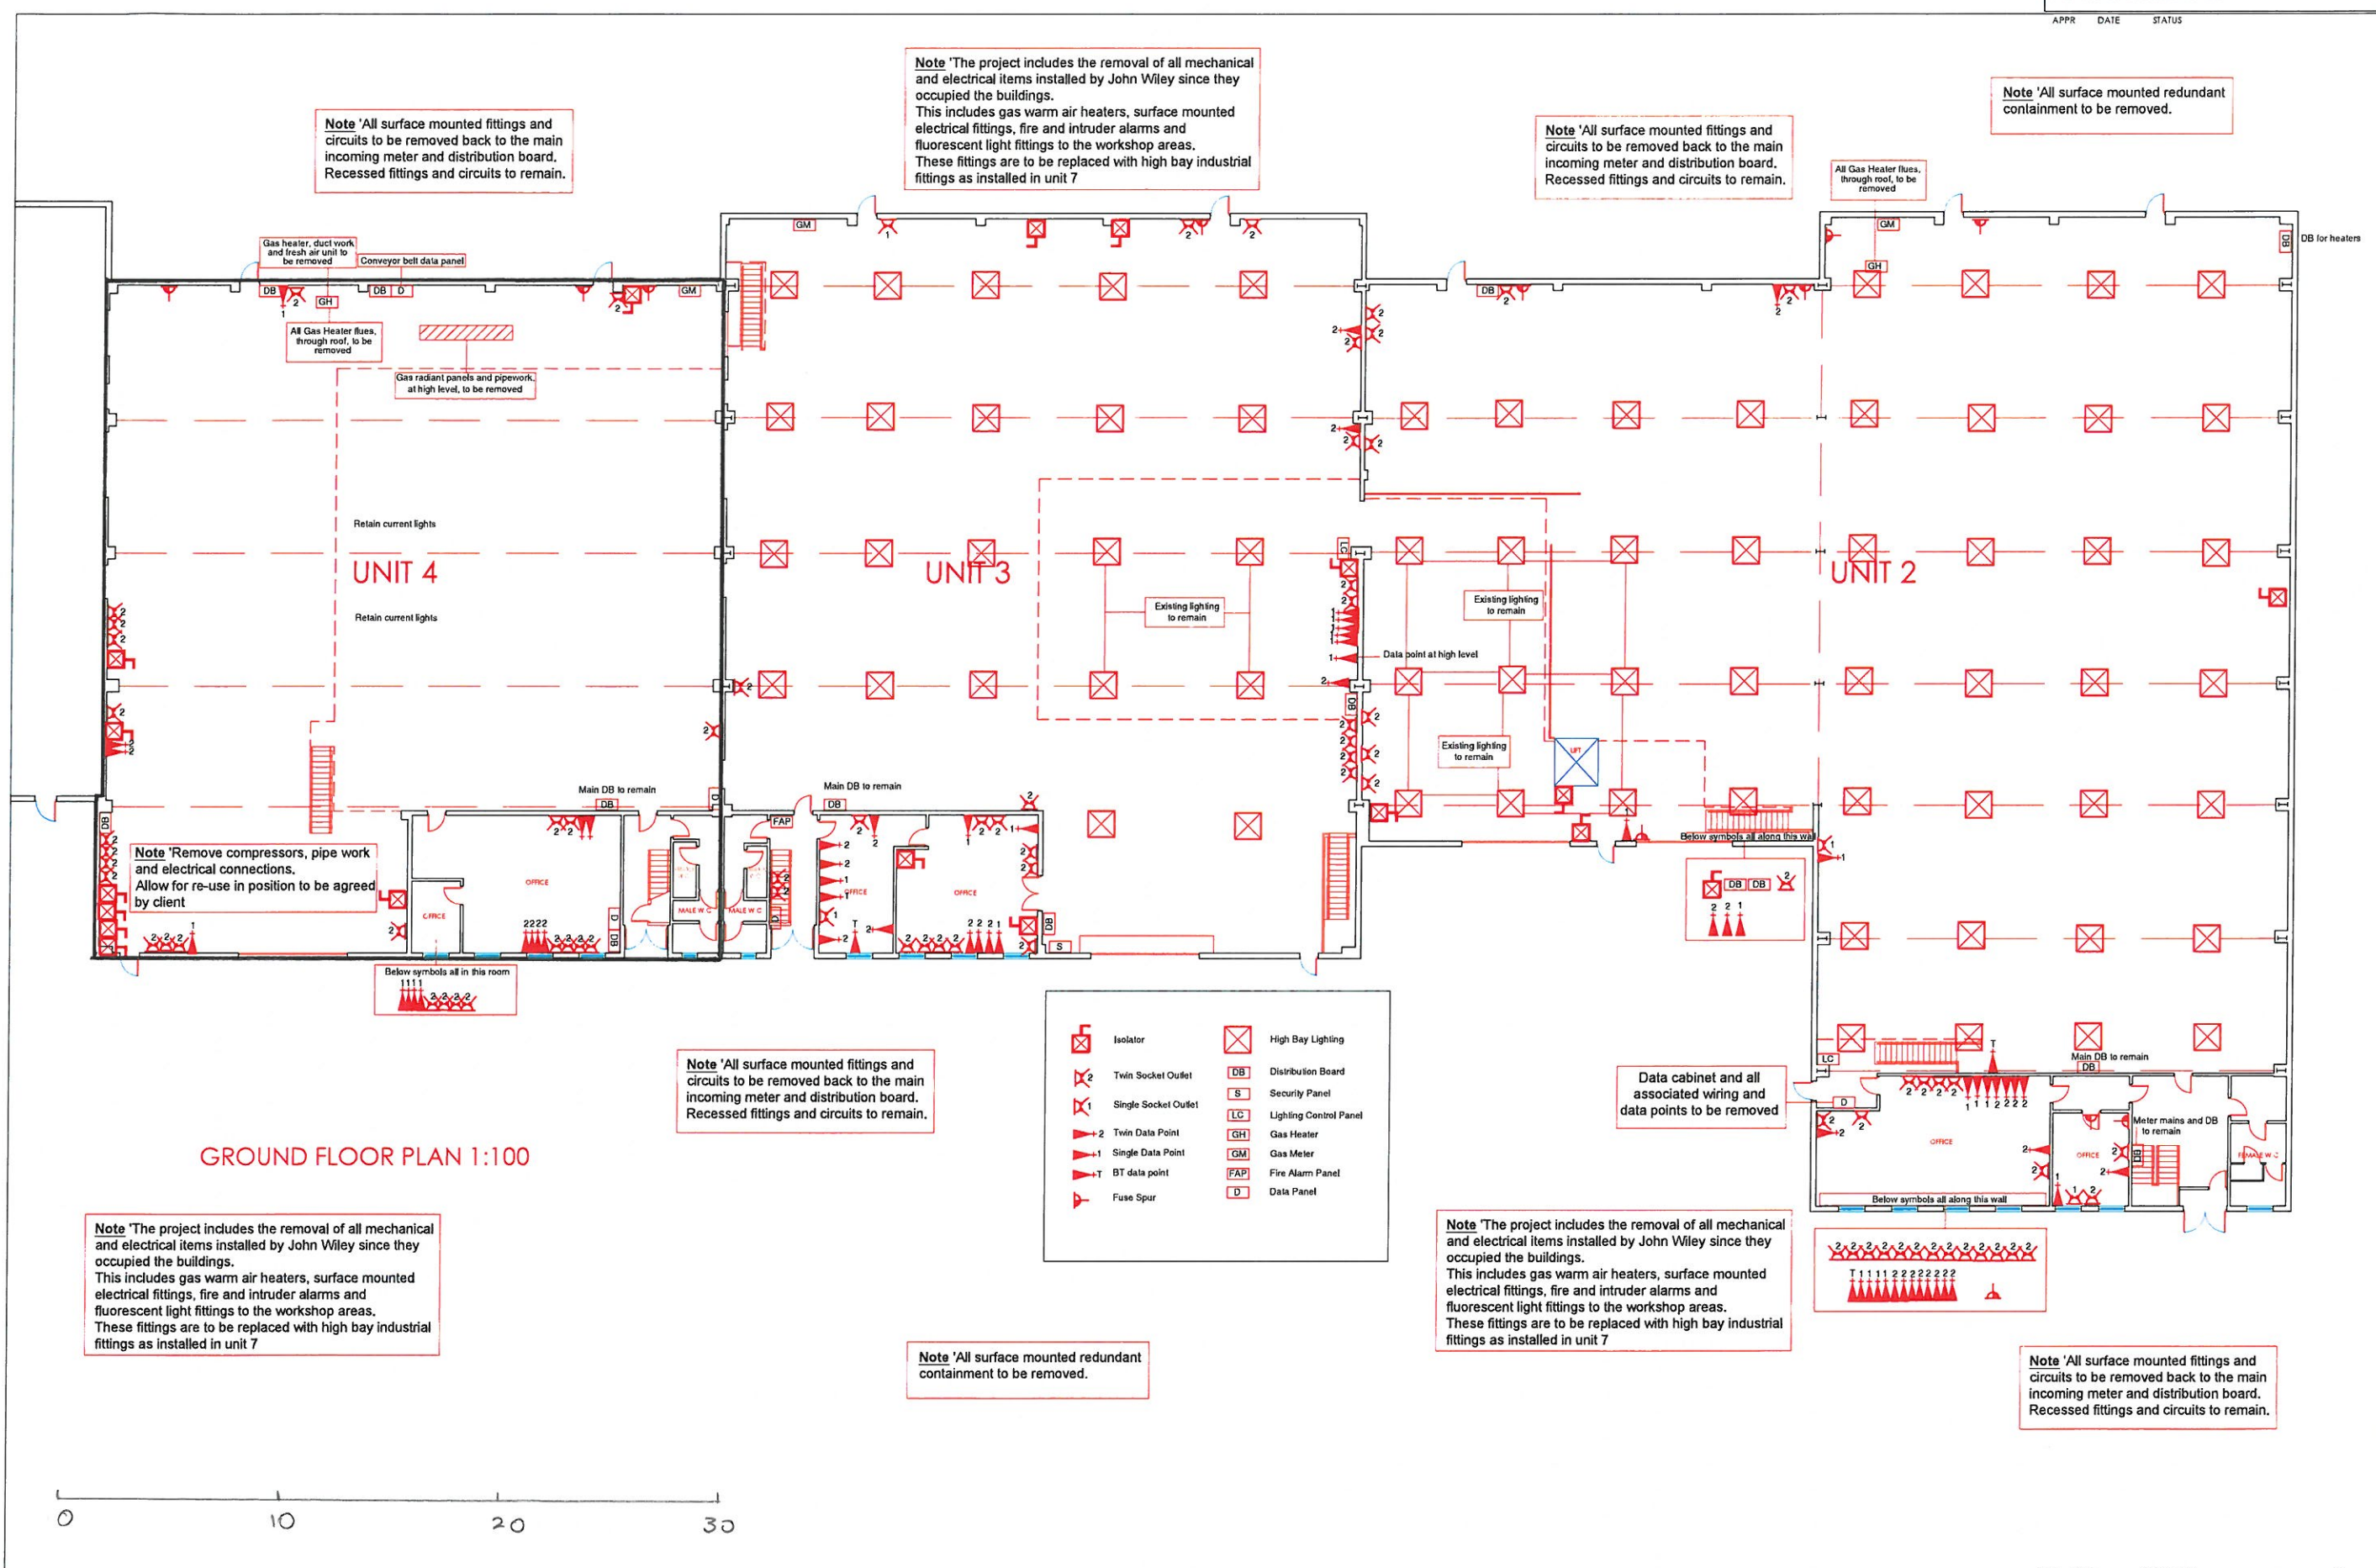

GROUND FLOOR PLAN 1:100

Note 'The project includes the removal of all mechanical and electrical items installed by John Wiley since they occupied the buildings. This includes gas warm air heaters, surface mounted electrical fittings, fire and intruder alarms and fluorescent light fittings to the workshop areas. These fittings are to be replaced with high bay industrial fittings as installed in unit 7

Note 'All surface mounted fittings and circuits to be removed back to the main incoming meter and distribution board. Recessed fittings and circuits to remain.

Note 'The project includes the removal of all mechanical and electrical items installed by John Wiley since they occupied the buildings. This includes gas warm air heaters, surface mounted electrical fittings, fire and intruder alarms and fluorescent light fittings to the workshop areas. These fittings are to be replaced with high bay industrial fittings as installed in unit 7

Note 'All surface mounted fittings and circuits to be removed back to the main incoming meter and distribution board. Recessed fittings and circuits to remain.

Note 'All surface mounted redundant containment to be removed.

Note 'All surface mounted fittings and circuits to be removed back to the main incoming meter and distribution board. Recessed fittings and circuits to remain.

- | | |
|----------------------|------------------------|
| Isolator | High Bay Lighting |
| Twin Socket Outlet | Distribution Board |
| Single Socket Outlet | Security Panel |
| Twin Data Point | Lighting Control Panel |
| Single Data Point | Gas Heater |
| BT data point | Gas Meter |
| Fuse Spur | Fire Alarm Panel |
| | Data Panel |

Note 'The project includes the removal of all mechanical and electrical items installed by John Wiley since they occupied the buildings. This includes gas warm air heaters, surface mounted electrical fittings, fire and intruder alarms and fluorescent light fittings to the workshop areas. These fittings are to be replaced with high bay industrial fittings as installed in unit 7

Note 'All surface mounted fittings and circuits to be removed back to the main incoming meter and distribution board. Recessed fittings and circuits to remain.