

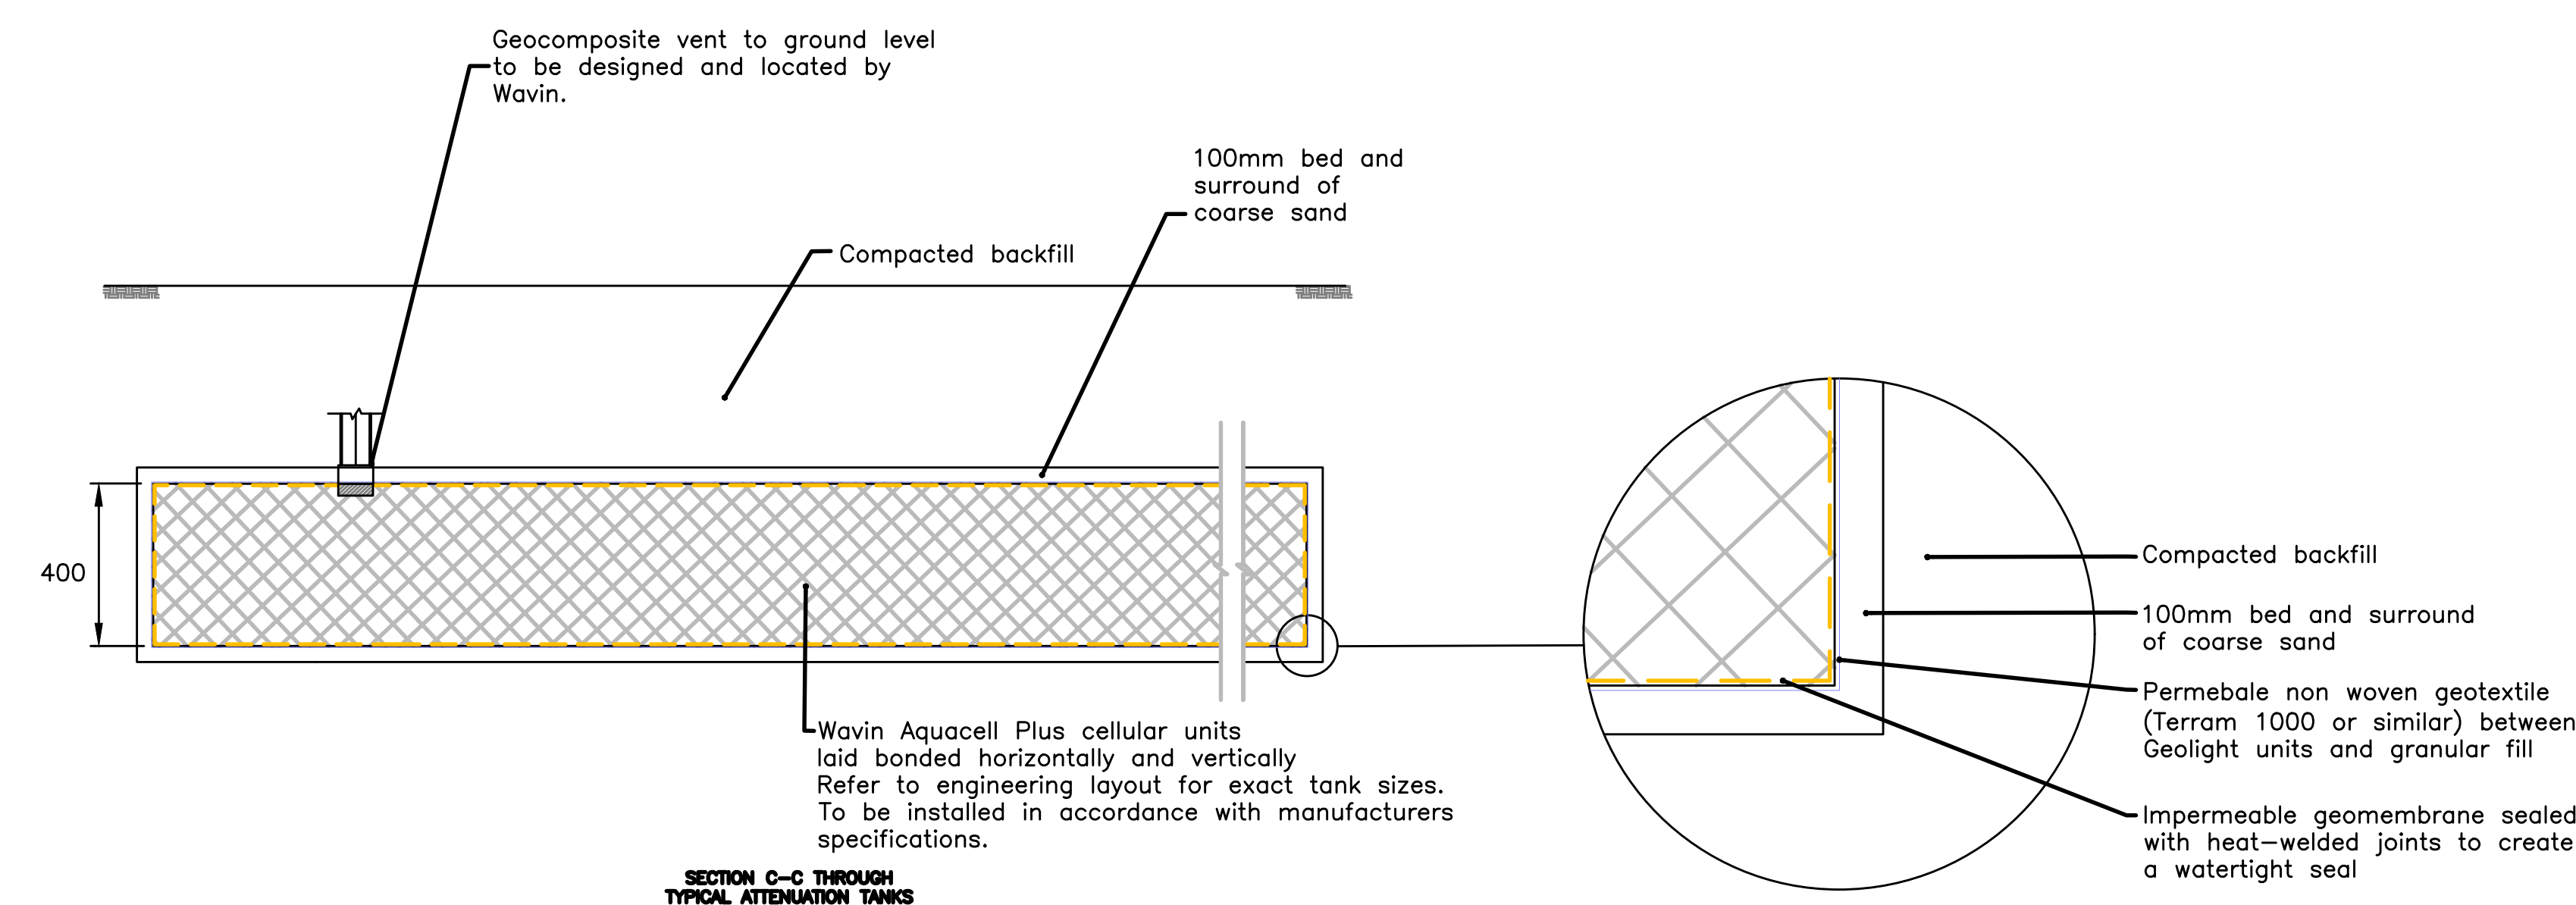
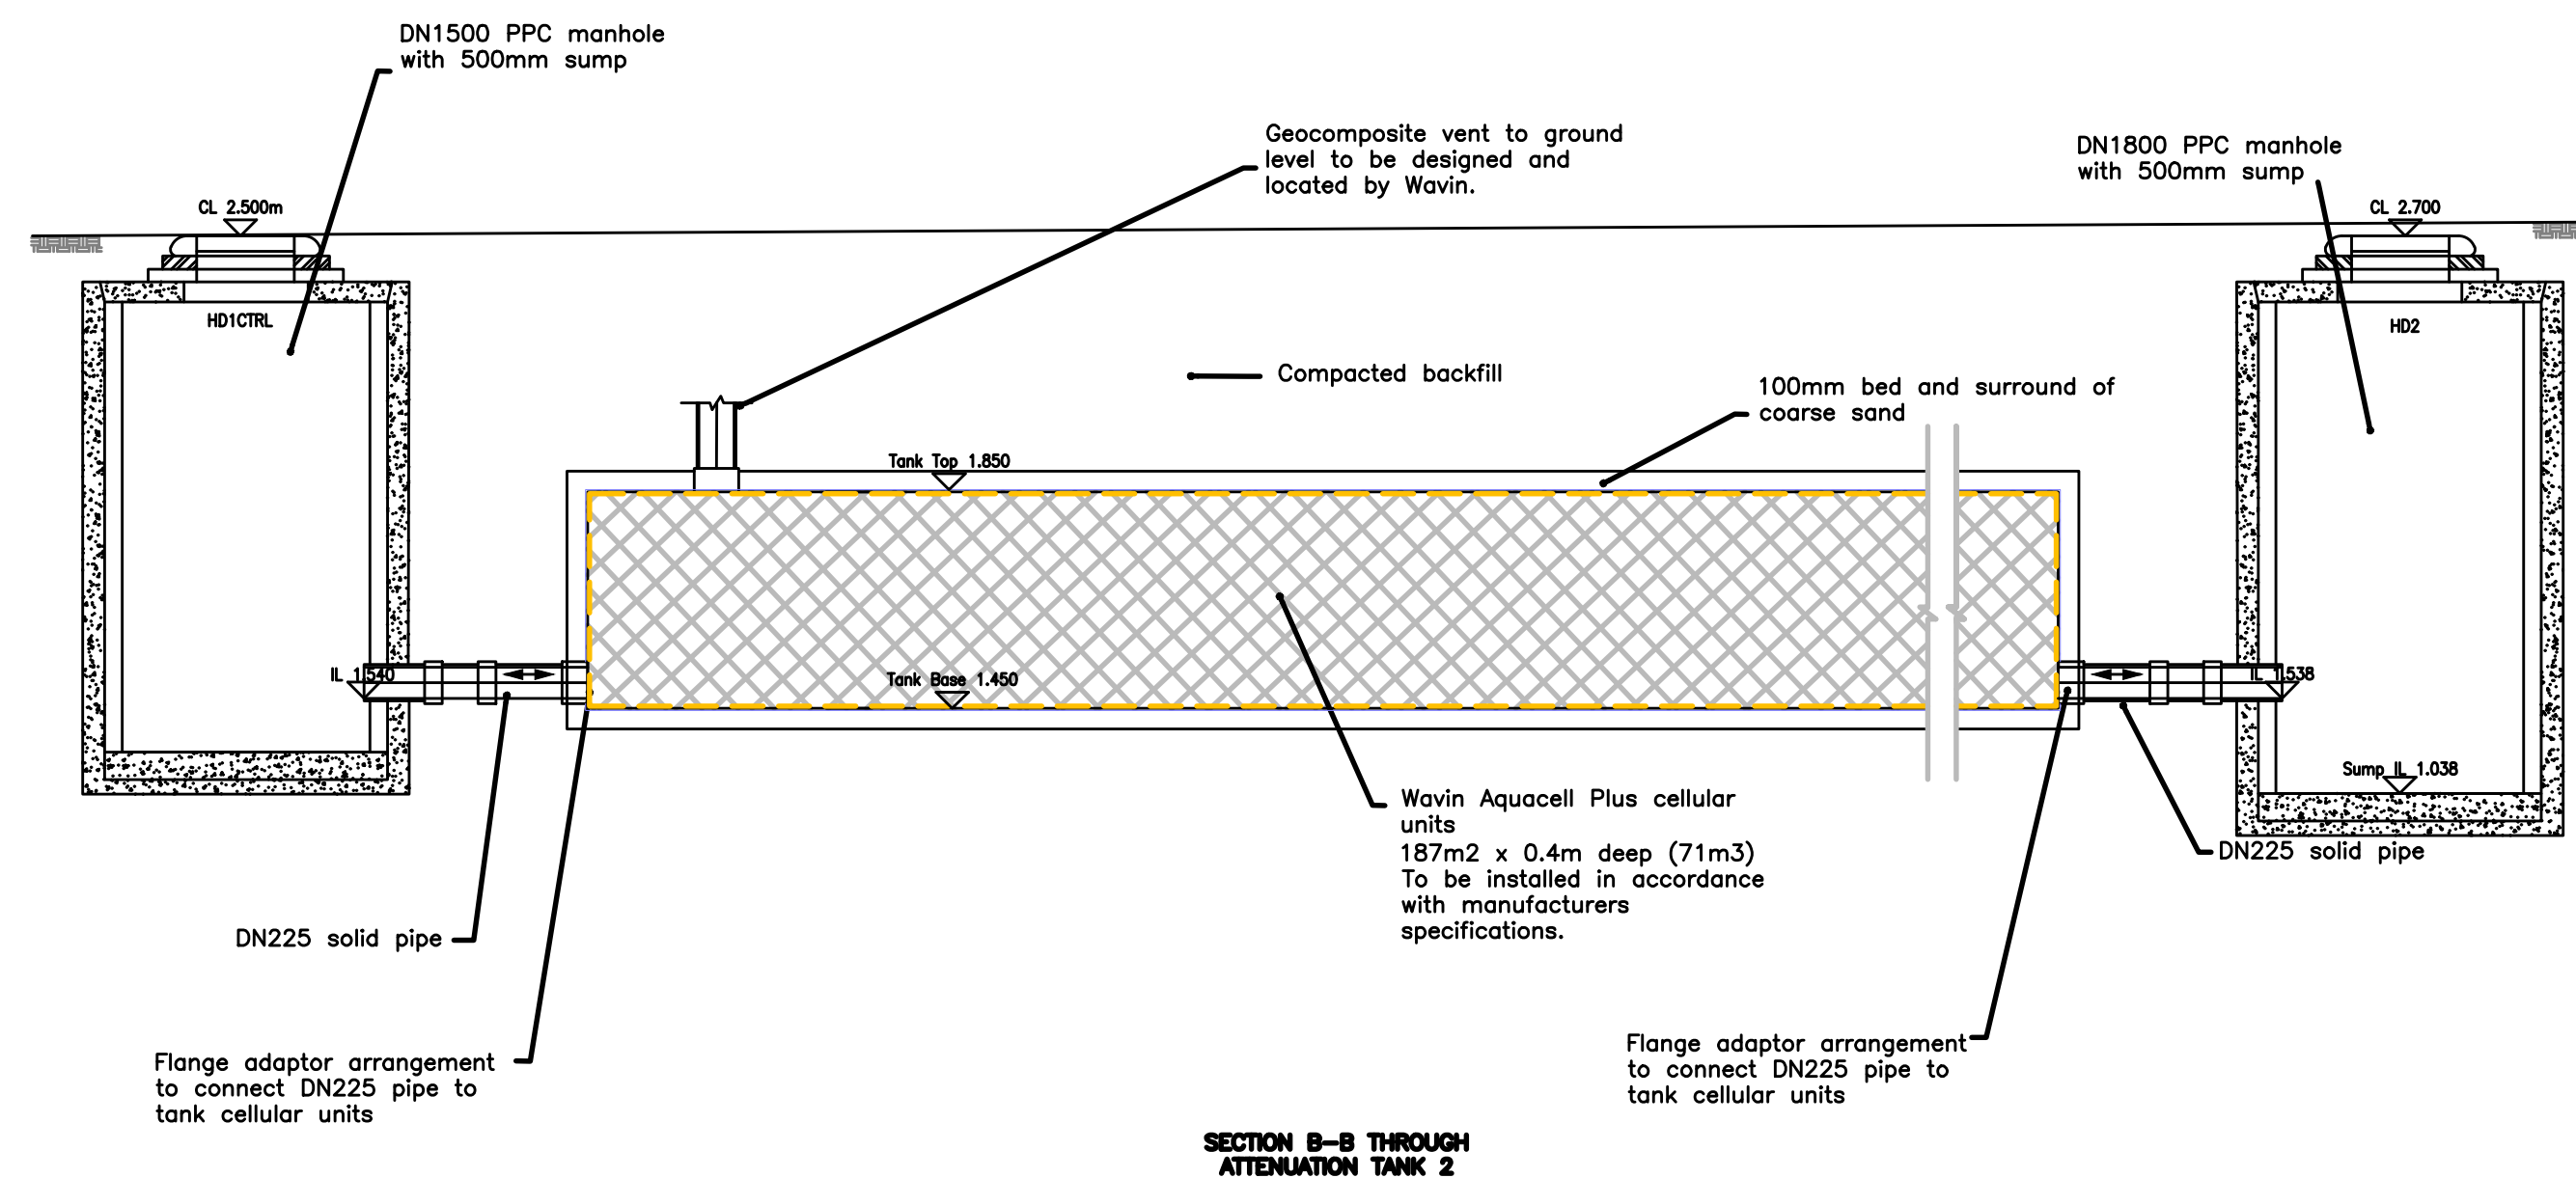
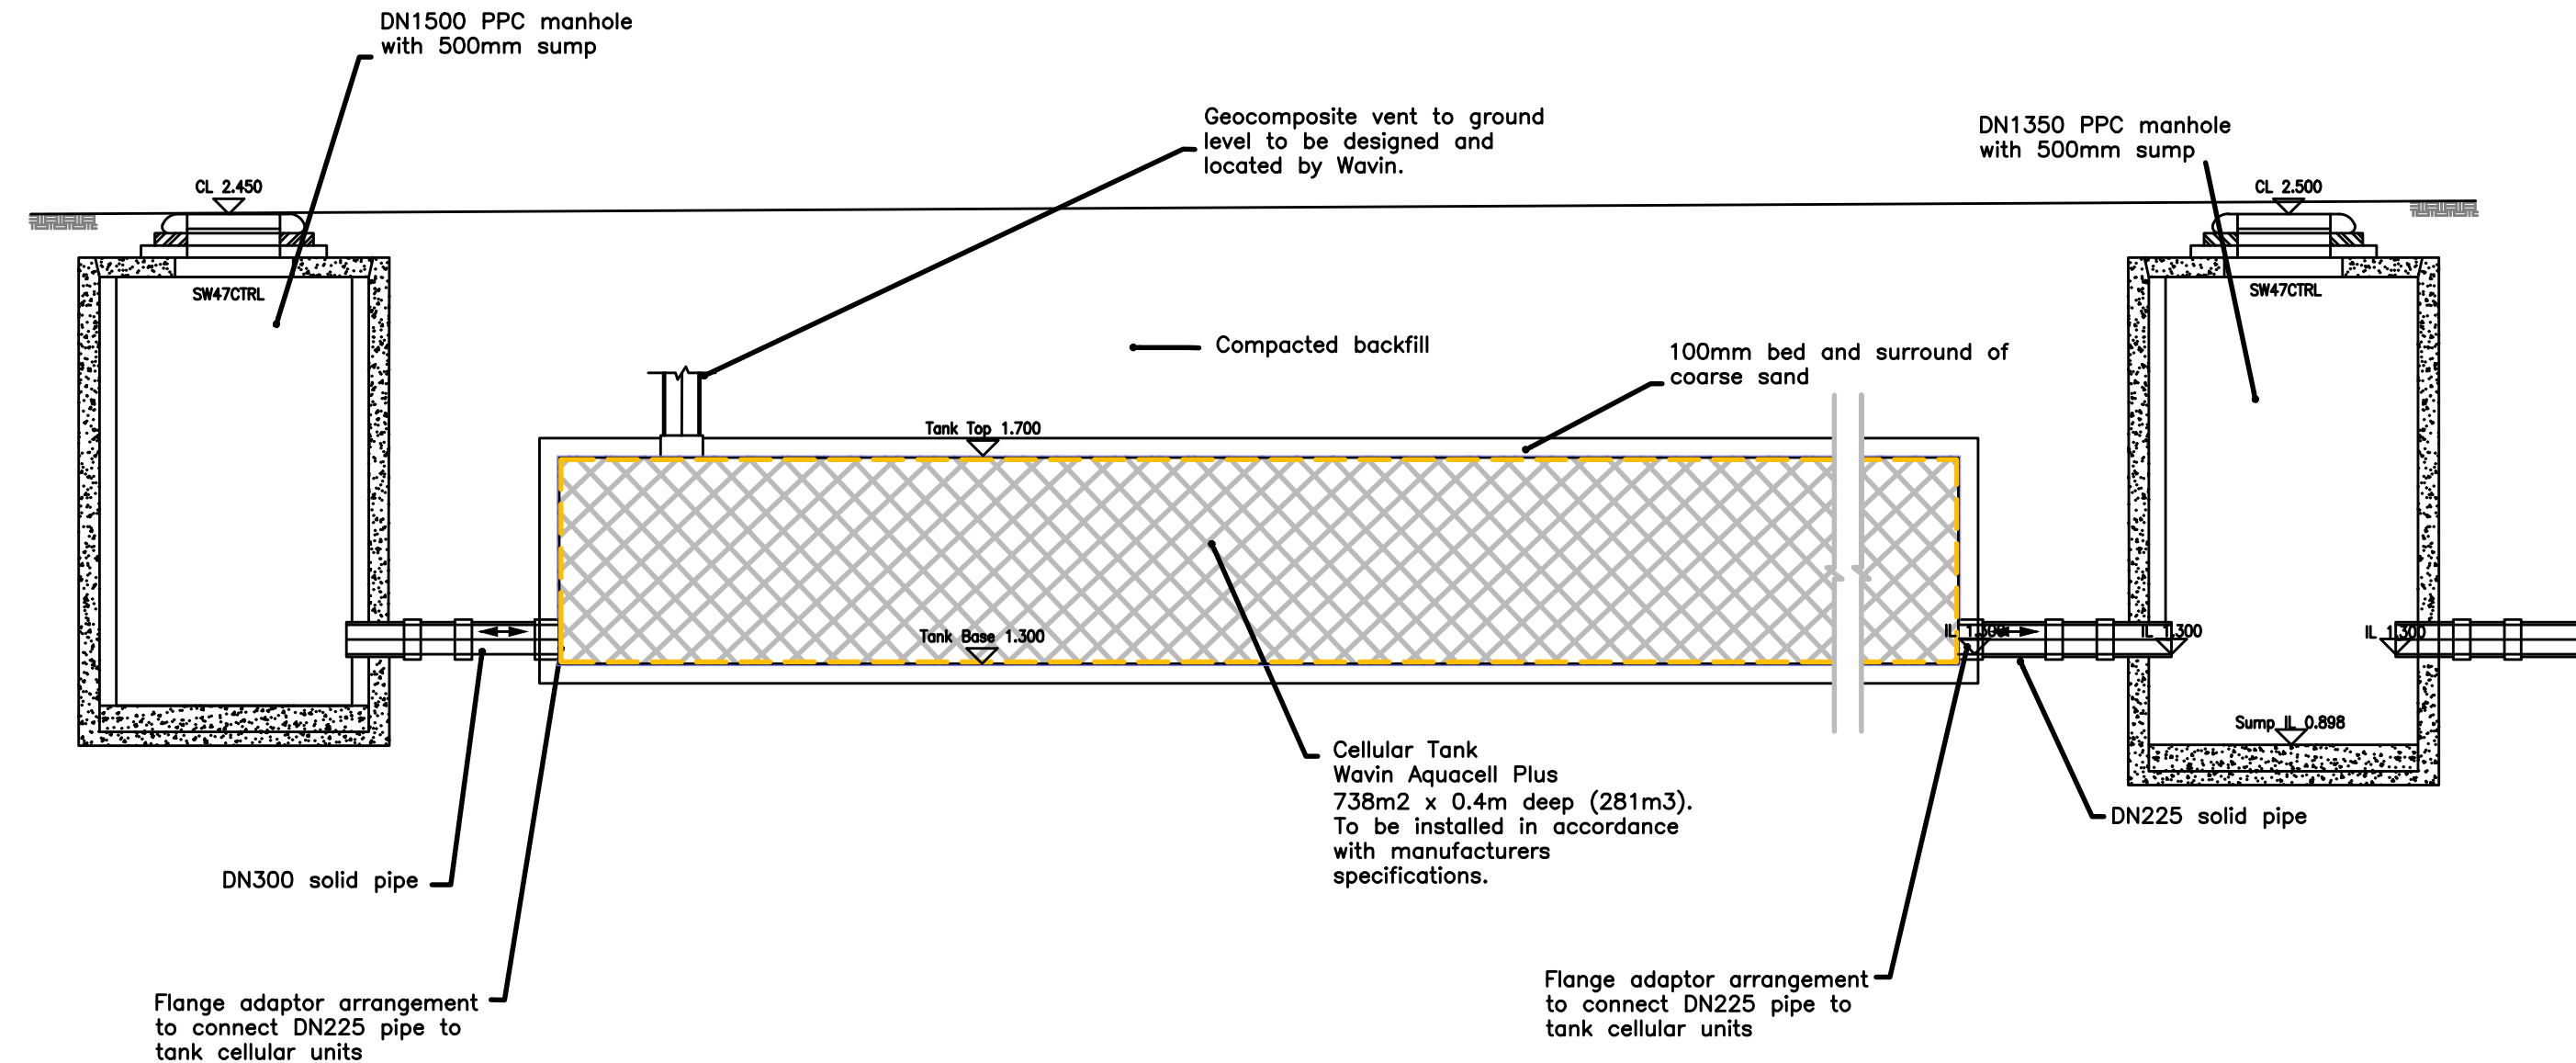


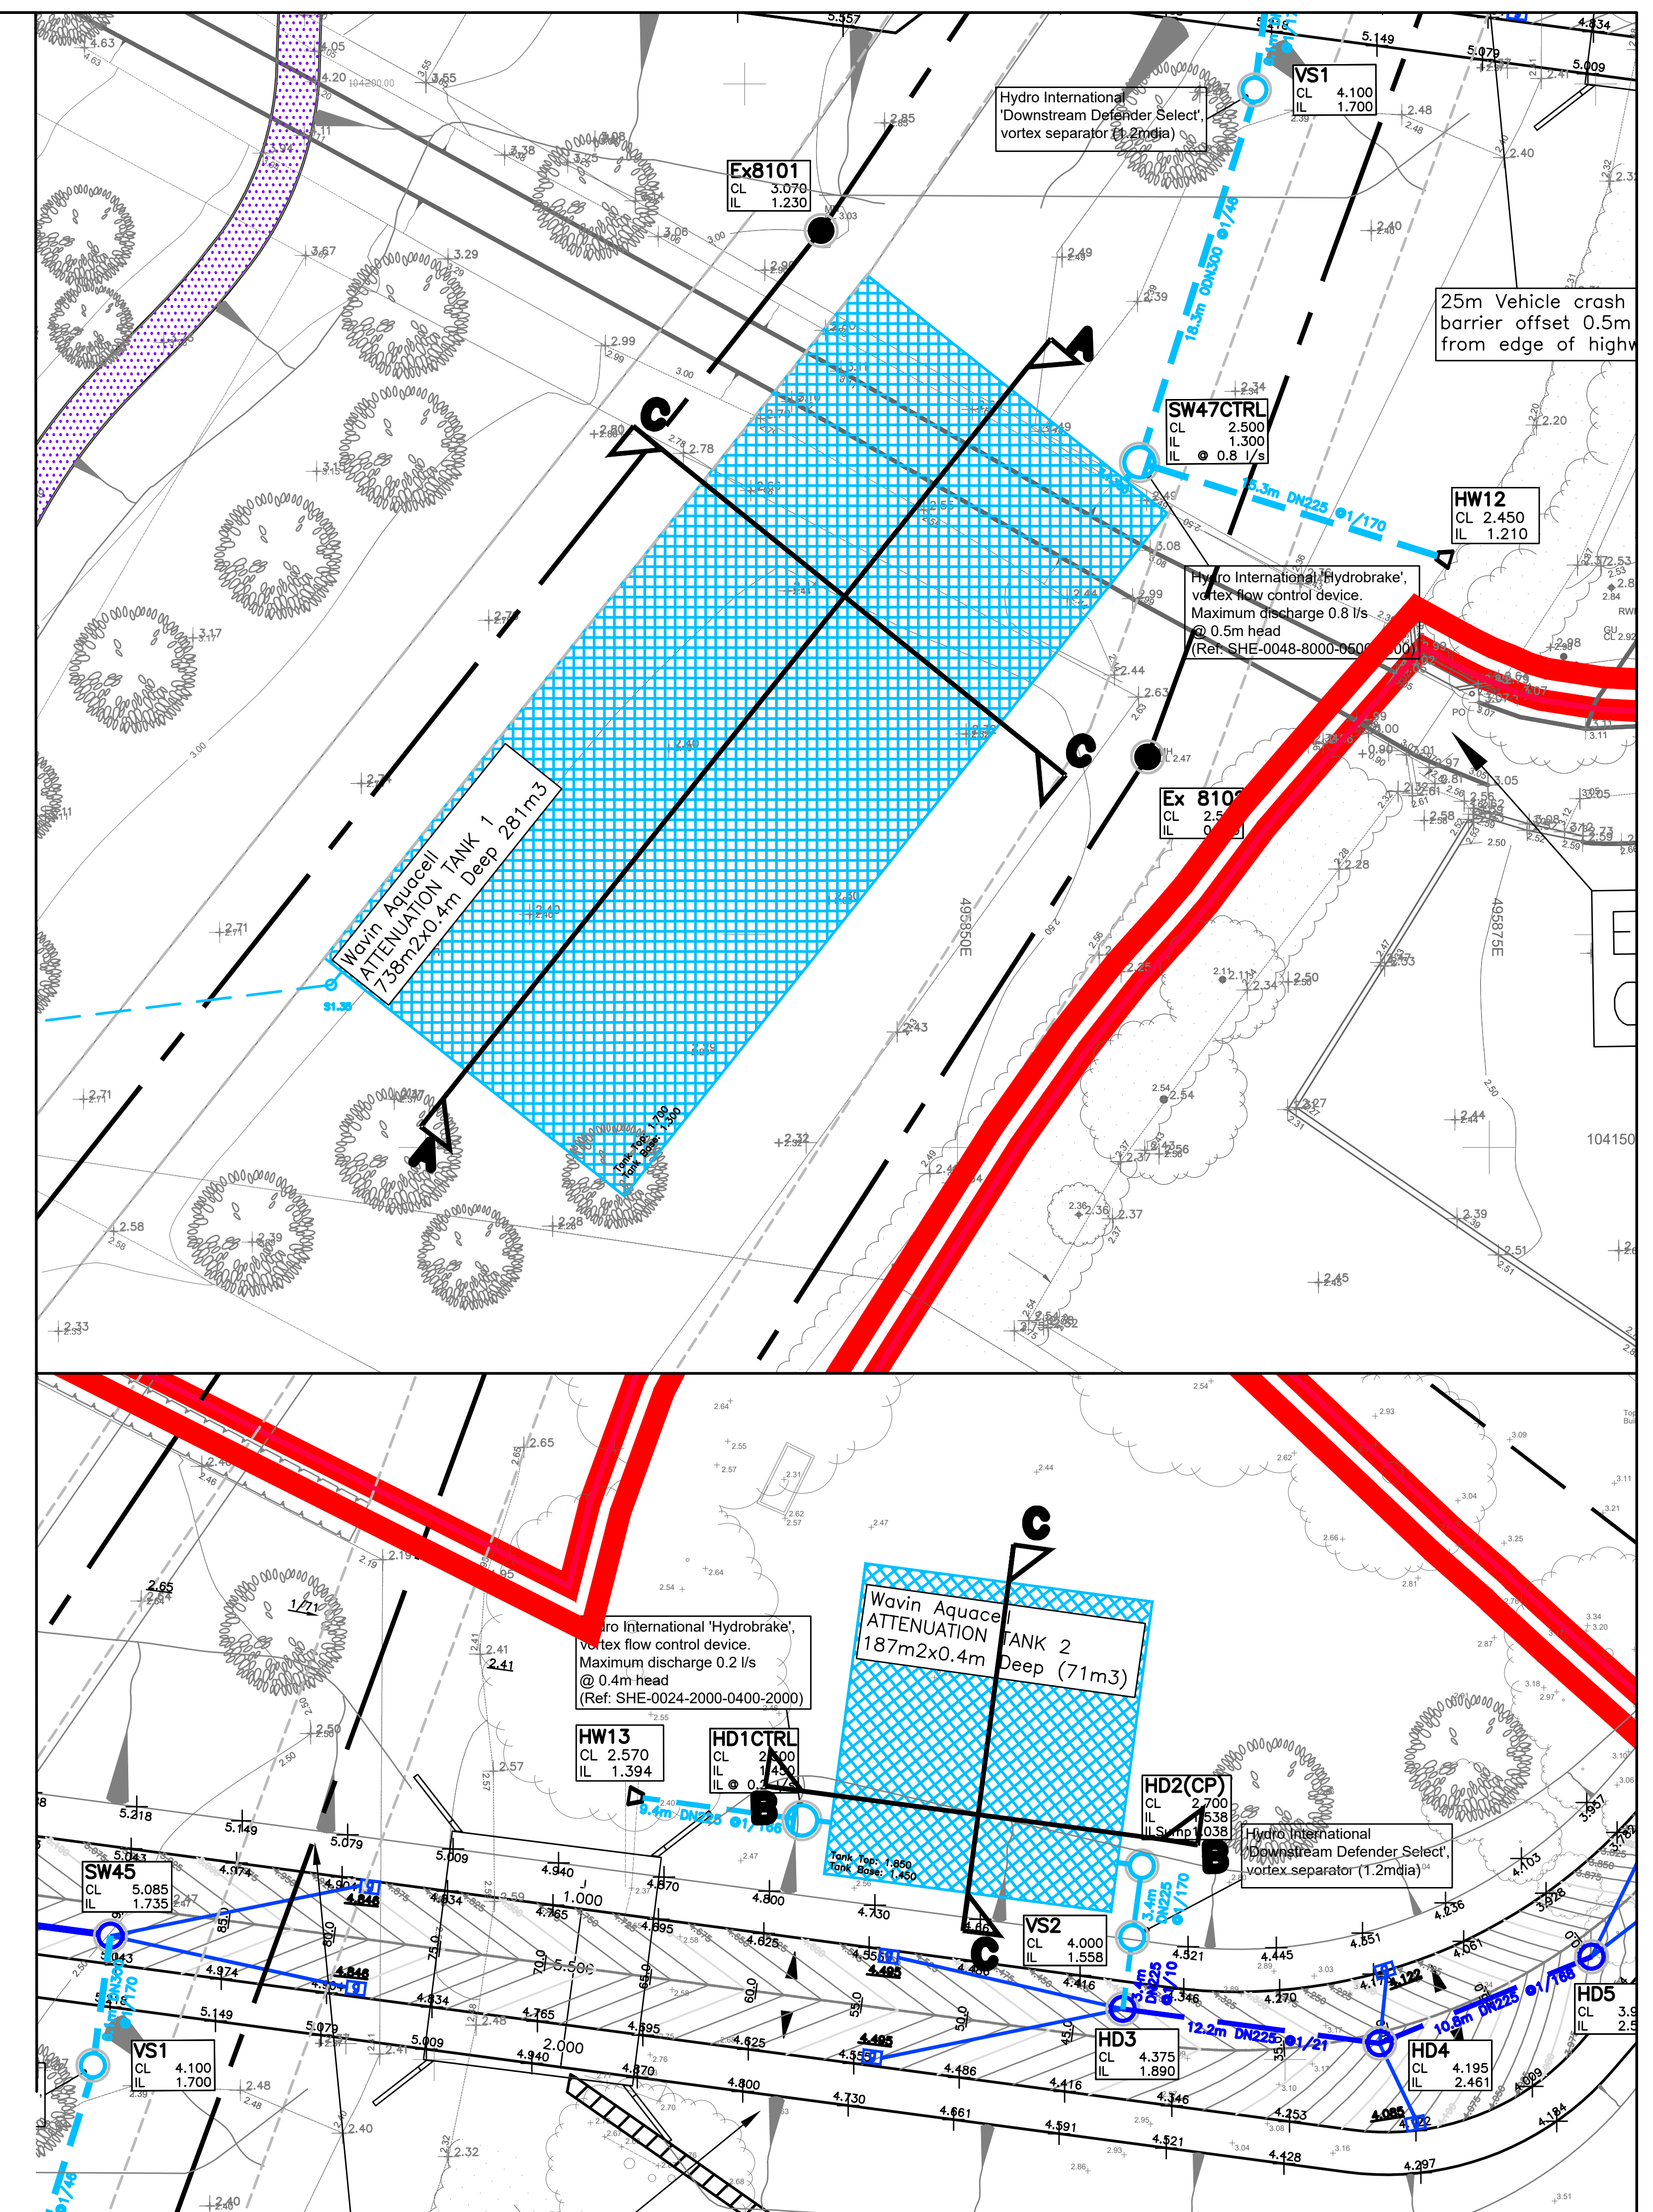

C1	20.05.25	Issued for construction.	CP	TC
P5	12.02.25	Installation note added.	CP	TC
P4	20.11.24	Tanks changed to Aquacell Plus.	TRB	TC
P3	28.08.24	Tanks updated to Aquacell core—R crates. Catchpit amended to suit ICOSA specification.	TMP	TC
P2	15.07.24	Updated to suit revised tank layouts.	TRB	TC
P1	01.02.24	First Issue.	TRB	TC



REV. No.	DATE	DESCRIPTION	DRAWN	CHECKED
Client	 BARRATT DEVELOPMENTS PLC		  MJA CONSULTING CIVIL & STRUCTURAL ENGINEERS Ipsum Court, 24 The Quadrant, Abingdon Science Park, Abingdon Oxon, OX14 3YS <i>Tel:</i> 01235 555173 <i>Email:</i> mail@mjaconsulting.co.uk	
Project	Tars Farm, Barnham			
Title	Attenuation Tanks Details		Scale: NTS @ A3 Status: PRELIMINARY Drawn: Project Engineer MJA Project No: Date: TRB TC 6838 02/2024 Drawing Number: 6838-MJA-SW-XX-DR-C-210 Rev: C1	