



from
**Southern
Water**

Planning and Development Services
Arun District Council
Arun Civic Centre
Maltravers Road
Littlehampton
West Sussex
BN17 5LF

Your ref
BN/18/21/RES

Our ref
PLAN-037983

Date
22/04/2021



Dear Sir/Madam,

Proposal: 5000 sq m of light industrial floor space (ClassB1 (b)/(c) following grant of outline planning permission WA/22/15/OUT (resubmission following BN/57/19/RES). This site is in CIL Zone 1 (Zero Rated) as other development.

Site: BN/18/21/RES: - GTR land east of Fontwell Avenue, Arundel Road, Arundel, BN18 0SB.

Thank you for your letter dated 11/03/2021.

Please see the attached extract from Southern Water records showing the approximate position of our existing foul sewer within the development site. The exact position of the public asset must be determined on site by the applicant in consultation with Southern Water before the layout of the proposed development is finalised.

- The 150 mm diameter gravity sewer requires a clearance of 3 metres on either side of the gravity sewer to protect it from construction works and to allow for future maintenance access.
- No development or tree planting should be carried out within 3 metres of the external edge of the public gravity sewer without consent from Southern Water.
- No soakaways, swales, ponds, watercourses or any other surface water retaining or conveying features should be located within 5 metres of public or adoptable gravity sewers.
- All existing infrastructure should be protected during the course of construction works.

Please refer to: southernwater.co.uk/media/3011/stand-off-distances.pdf

Southern Water, Southern House, Yeoman Road, Worthing, West Sussex, BN13 3NX
southernwater.co.uk

Southern Water Services Ltd, Registered Office: Southern House, Yeoman Road, Worthing, West Sussex, BN13 3NX Registered in England No. 2366670

We have restrictions on the proposed tree planting adjacent to Southern Water sewers, rising mains or water mains and any such proposed assets in the vicinity of existing planting. Reference should be made to Southern Water's publication "A Guide to Tree Planting near water Mains and Sewers" (southernwater.co.uk/media/3027/ds-tree-planting-guide.pdf) and the Sewerage Sector Guidance (water.org.uk/sewerage-sector-guidance-approved-documents/) with regards to any landscaping proposals and our restrictions and maintenance of tree planting adjacent to sewers, rising mains and water mains.

It is possible that a sewer now deemed to be public could be crossing the development site. Therefore, should any sewer be found during construction works, an investigation of the sewer will be required to ascertain its ownership before any further works commence on site.

Southern Water has undertaken a desktop study of the impact that the additional foul sewerage flows from the proposed development will have on the existing public sewer network. This initial study indicates that these additional flows may lead to an increased risk of foul flooding from the sewer network. Any network reinforcement that is deemed necessary to mitigate this will be provided by Southern Water.

Southern Water and the Developer will need to work together in order to review if the delivery of our network reinforcement aligns with the proposed occupation of the development, as it will take time to design and deliver any such reinforcement.

It may be possible for part of the development to connect with the current capacity in the network, pending network reinforcement to provide capacity for the remaining development. Southern Water will review and advise on this following consideration of the development programme and the extent of network reinforcement required.

Southern Water will carry out detailed network modelling as part of this review which may require existing flows to be monitored. This will enable us to establish the extent of any works required.

Southern Water endeavor to provide reinforcement within 24 months of planning consent being granted (Full or Outline) however for large developments our assessment of the timescales needed will require an allowance for the following which may result in an extension of the 24-month period:

- Initial feasibility, detail modelling and preliminary estimates.
- Flow monitoring (If required)
- Detailed design, including land negotiations.
- Construction.

Southern Water hence requests the following condition to be applied: Occupation of the development is to be phased and implemented to align with the delivery by Southern Water of any sewerage network reinforcement required to ensure that adequate waste water network capacity is available to adequately drain the development.

The Council's technical staff and the relevant authority for land drainage should comment on the adequacy of the proposals to discharge surface water to the local watercourse.

Land uses such as general hard standing that may be subject to oil/petrol spillages should be drained by means of appropriate oil trap gullies or petrol/oil interceptors.

Due to surface water inundation issues in the Lidsey Catchment the applicant is advised to adopt, where appropriate, the measures set out in the table "Practical measures to reduce the potential impacts of development". The developer should look to protect the public sewerage system from inundation and infiltration, which contribute to flooding in unfavourable conditions.

We request that should this planning application receive planning approval, the following informative is attached to the consent: Construction of the development shall not commence until details of the proposed means of foul sewerage and surface water disposal have been submitted to, and approved in writing by, the Local Planning Authority in consultation with Southern Water.

For further advice, please contact Southern Water, Southern House, Yeoman Road, Worthing, West Sussex, BN13 3NX [REDACTED]


Website: southernwater.co.uk or by email at: [REDACTED]

Yours sincerely,

Growth Planning Team
Business Channels

southernwater.co.uk/developing-building/planning-your-development

SOUTHERN WATER

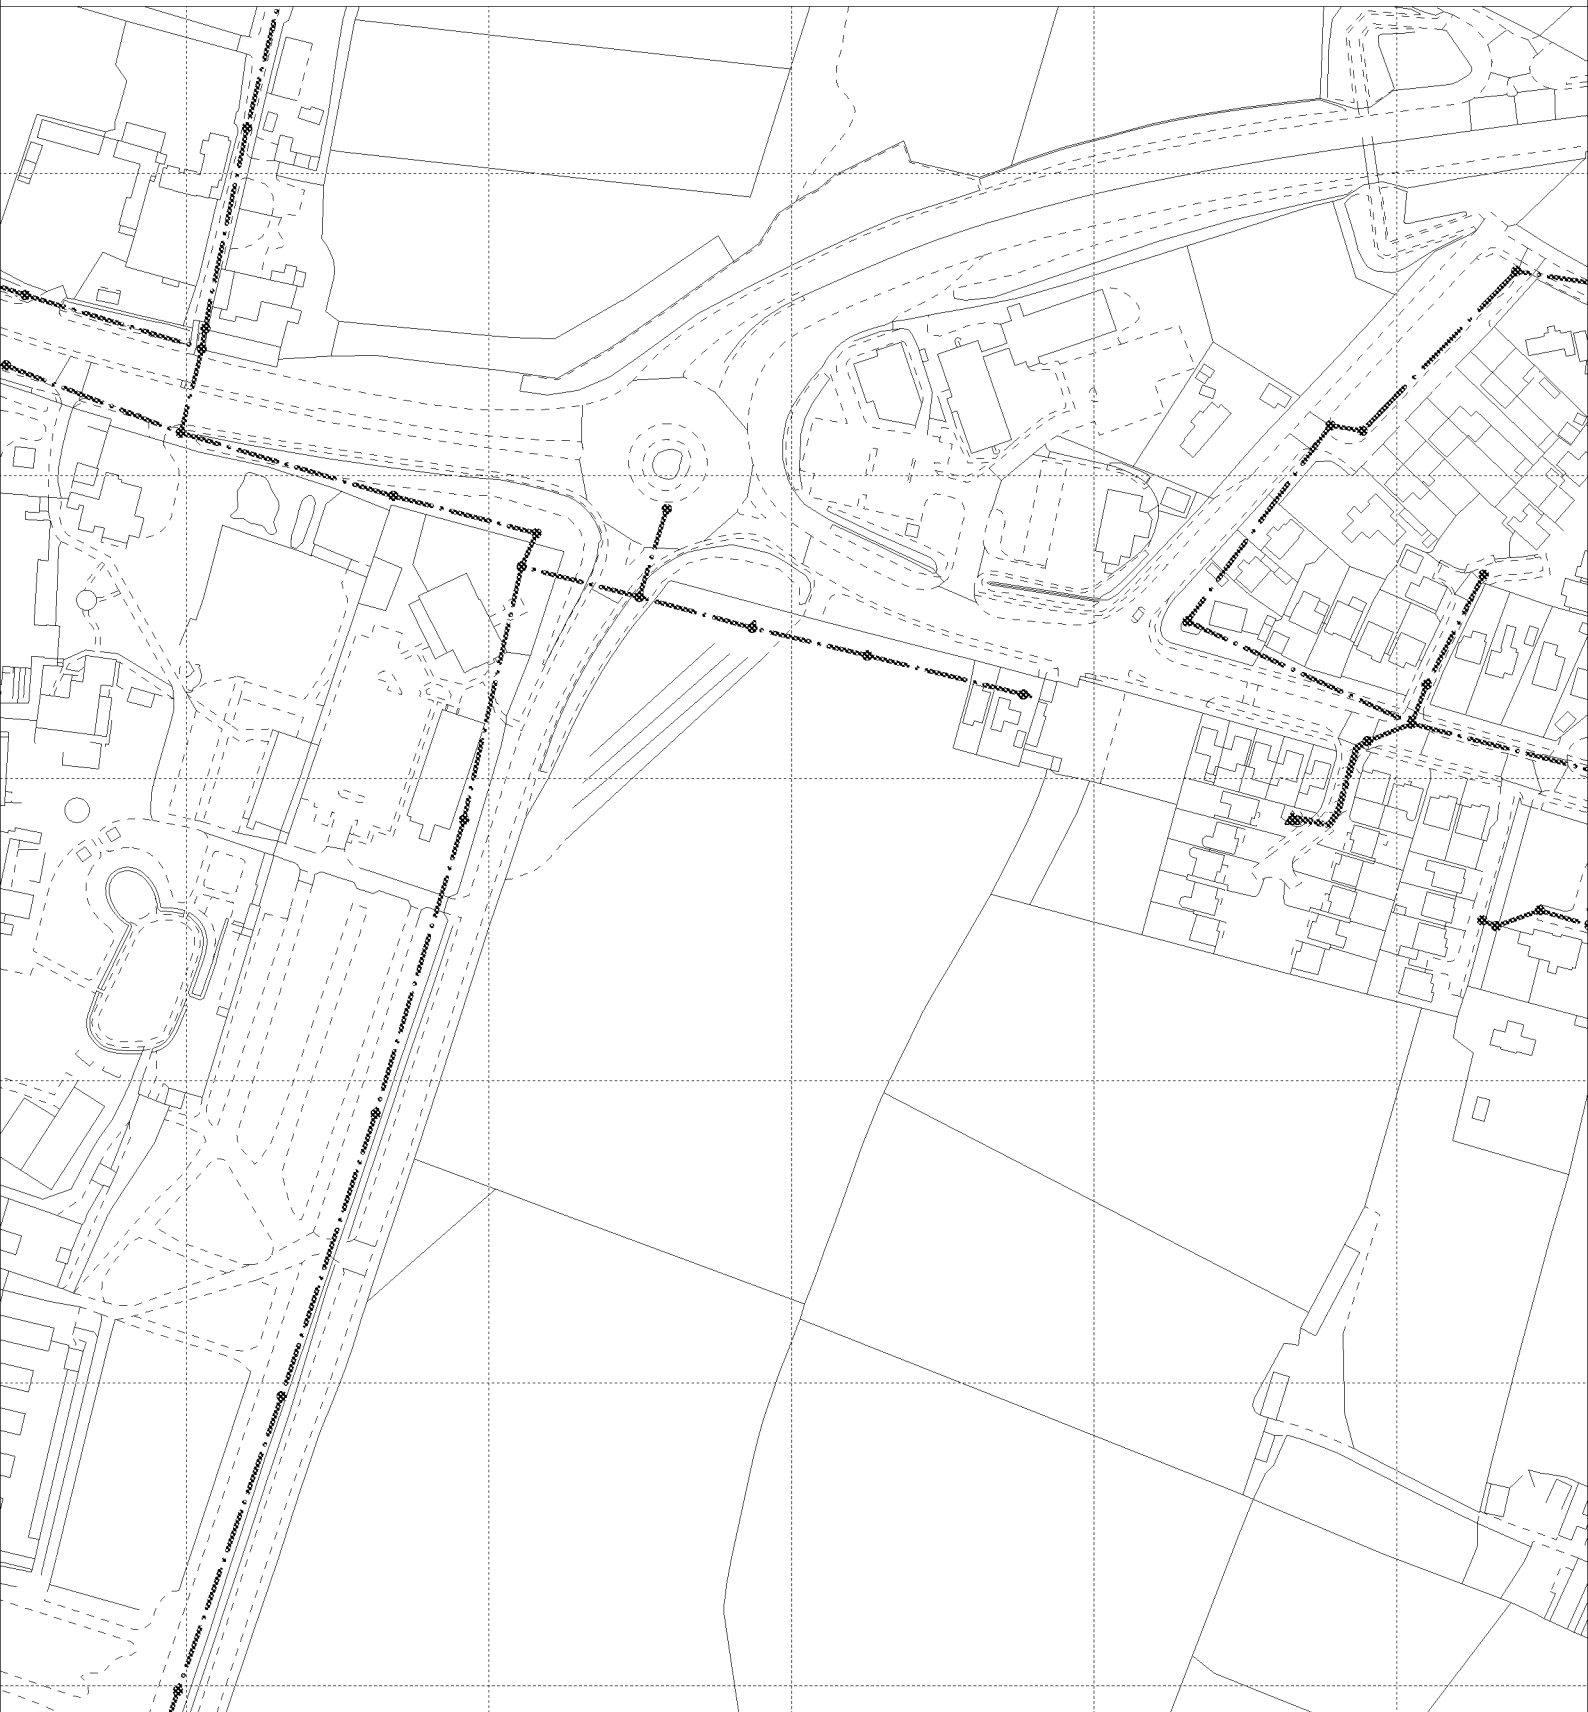

The positions of pipes shown on this plan are believed to be correct, but Southern Water Services Ltd accept no responsibility in the event of inaccuracy. The actual positions should be determined on site.

Based upon Ordnance Survey Digital Data with the permission of the controller of H.M.S.O. Crown Copyright Reserved Licence No. WU 298530

O.S. REF: SU9506NW

Scale: 1:2500

Screen Print

WARNING: BAC pipes are constructed of Bonded Asbestos Cement

WARNING: Unknown (UNK) materials may include Bonded Asbestos Cement

ARUN DISTRICT COUNCIL BN18/21/RES



Printed By: ngravik

Date: 21-4-2021

Southern Water MapGuide Browser

Requested By: