



Your Environment

SURFACE WATER DRAINAGE STRATEGY LAND TO THE NORTH OF FLINT BARN, BARNHAM

For Manorwood Ltd

Your Environment

Head Office, Chilgrove Business Centre, Chilgrove Park Road, Chilgrove, Nr
Chichester, PO18 9HU
Tel: 01243 787150

Report Number: YE4281, Date: June 2018

Tristan Le Butt
tristan@yourenvironment.org

Contents

1.0	Executive Summary	iii
2.0	Introduction	1
3.0	Hierarchy of Preference for Surface Water Disposal	3
4.0	Surface Water runoff disposal	4
5.0	Limitations	6

Appendices

Appendix A:	Proposed development layout plans
Appendix B:	Trial pit logs and photos
Appendix C	Topographical Survey
Appendix D	Microdrainage modelling outputs: QBar calculation
Appendix E	Proposed Drainage Design Layout
Appendix F	Microdrainage modelling outputs: Swale

	Name	Position	Signature	Date
Prepared by:	Paul Timmins	Drainage Consultant		June 2018
Reviewed by:	Tristan Le Butt	Geo Environmental Consultant		June 2018
Approved:	Colin Hiscock	Director		June 2018
For and on behalf of YourEnvironment				

Issue	Date	Description	Prepared	Reviewed	Approved
00	08/06/18	Final Report	PT	TLB	CH
01	11/06/18	Reference to the correct planning application reference added.	PT	TLB	CH

1.0 Executive Summary

YourEnvironment (YE) was instructed by Manorwood Ltd (Quote No: Q4281 Dated: 6th February 2018) to provide a Surface Water Drainage Report to describe the proposed drainage strategy for the proposed development within land to the north of Flint Barn, Barnham. The development of a new dwelling was granted permission by Arun District Council on 1st February 2018 (planning ref. BN/61/16/PL). A revised layout for the development was submitted on 2nd March 2018 and is as yet undecided (planning ref. BN/7/18/PL).

The purpose of this report is to provide a drainage layout plan for the revised development layout. Similar to the previous permission, it is expected that a planning condition relating to surface water drainage will be applied should the application be permitted.

We trust this is sufficient for your requirements and should you have any questions please do not hesitate to contact the undersigned.

For YourEnvironment

Colin Hiscock

Director

2.0 Introduction

YourEnvironment (YE) was instructed by Manorwood Ltd (Quote No: Q4281 Dated: 6th February 2018) to provide a Surface Water Drainage Report to describe the drainage strategy for the proposed development within land to the north of Flint Barn, Barnham.

The development of a new dwelling was granted permission by Arun District Council on 1st February 2018 (planning ref. BN/61/16/PL). A revised layout for the development was submitted on 2nd March 2018 and is as yet undecided (planning ref. BN/7/18/PL).

The location of the site is illustrated on **Figure 1** (below).

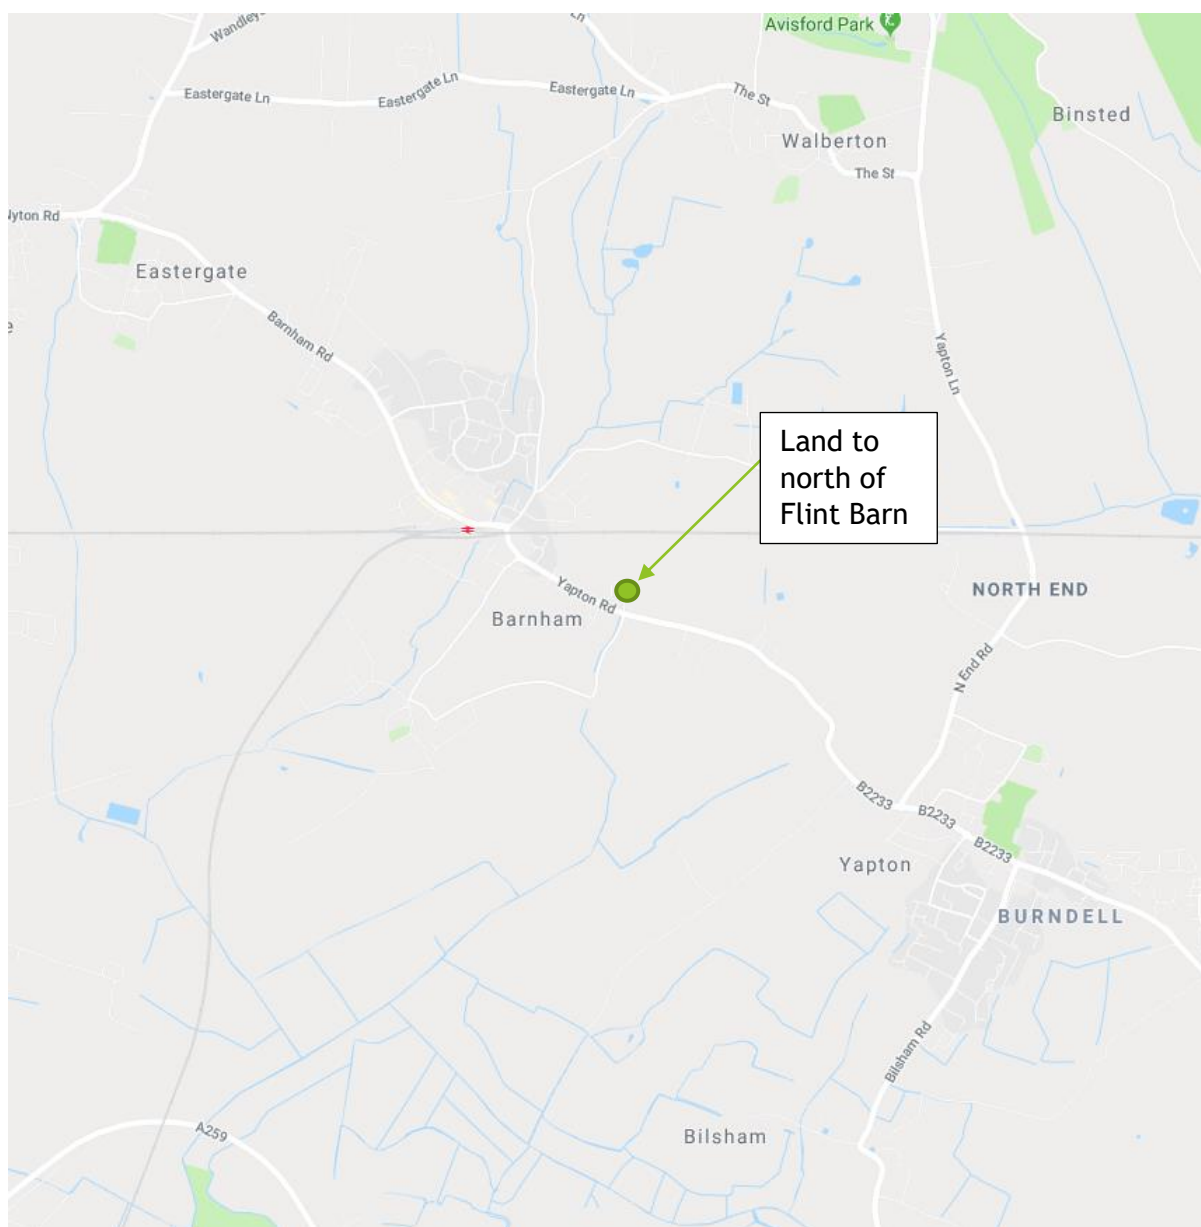


Figure 1: Location of the development site

The development proposes the removal of existing storage building and erection of a single dwelling on a site of around 0.7ha. The new dwelling is 80m² with space for parking and a storage barn/garage to the north (140m²).

Plans and elevations of the proposed development are provided in **Appendix A**.

Should the revised application be permitted, it is expected that a planning condition relating to surface water drainage will be applied to the development similar in wording to Condition 3 from the Decision Notice for the initial application. This condition states the following:

Development shall not commence until full details of the proposed surface water drainage scheme have been submitted to and approved in writing by the Local Planning Authority.

The design should follow the hierarchy of preference for different types of surface water drainage disposal systems as set out in Approved Document H of the Building Regulations, the recommendations of the SUDS Manual produced by CIRIA.

Winter groundwater monitoring to establish highest annual ground water levels and Percolation testing to BRE 365, or similar approved, will be required to support the design of any Infiltration drainage.

No building shall be occupied until the complete surface water drainage system serving the property has been implemented in accordance with the agreed details and the details so agreed shall be maintained in good working order in perpetuity.

Reason: To ensure that the proposed development is satisfactorily drained in accordance with policies GEN7 and GEN9 of the Arun District Council Local Plan. This is required to be a pre-commencement condition because it is necessary to implement the surface water drainage system prior to commencing any building works.

3.0 Hierarchy of Preference for Surface Water Disposal

Part H3 of the Building Regulations sets out the hierarchy of preference for the disposal of surface water from new development as follows:

Rainwater Drainage

H3... (3) Rainwater from a system provided pursuant to sub-paragraphs (1) and (2) shall discharge to one of the following, listed in order of priority:

- a) An adequate soakaway or some other adequate infiltration system; or, where that is not reasonably practicable,*
- b) A watercourse, or, where that is not reasonably practicable,*
- c) A sewer.*

Infiltration potential at the site

Investigations to determine whether the underlying soils at the site were suitable for infiltration were carried out in March 2018. These comprised the excavation of two trial pits in order to carry out permeability testing using the BRE365 test procedure.

However, during excavation of the trial pits it was found that the groundwater table was high and prevented the tests from being undertaken.

The trial pit logs and selected photos of the trial pits excavated are provided in **Appendix B**.

Without permeability test results, it has been concluded that surface water by infiltration means is not possible at the site. Firstly, because of the difficulty of measuring a soil infiltration rate for the underlying soils and secondly because the base of any soakaway structure is likely to be less than 1m above the maximum anticipated groundwater level.

The presence of a watercourse

Inspection of the topographical survey of the site (see **Appendix C**) identifies a drainage ditch located to the west of the proposed location of the new dwelling. This drains in a southerly direction towards the watercourse alongside Hill Lane, which eventually feeds into Lidsey Rife and then to Aldborough Rife and out to sea at Bognor Regis¹.

It is proposed that surface water from the site is disposed to the watercourse alongside the development site.

¹ Environment.data.gov.uk. (2018). Environment Agency - Catchment Data Explorer. [online] Available at: <http://environment.data.gov.uk/catchment-planning/WaterBody/GB107041011980> [Accessed 6 Jun. 2018].

4.0 Surface Water runoff disposal

Surface water runoff shall be managed from roofs, external circulation areas close to the new building and the access roads. Runoff from these areas shall be piped to the site's discharge point and then into the watercourse adjacent to the site.

The method of surface water disposal has been developed with the guidance (Supplementary Requirements for Surface Water Drainage Proposals) published by Arun District Council.²

The guidance document recommends that discharge to a watercourse be restricted to the estimated mean greenfield runoff rate (QBar) by means of a controlled outflow (or restricted to existing runoff rates for brownfield sites).

Calculations for QBar have been undertaken using the Rural Runoff Calculator module within Microdrainage using the ReFH2 method. The results are provided in **Appendix D** (the site-specific point descriptors and rainfall depth data were acquired through the Flood Estimation Handbook Web Service³). As the area to be drained from the site is small (220m²) the calculated values for QBar are very small (0.1l/s). Control of surface water flows at this flow rate is impractical.

As infiltration structures are not feasible due to the high groundwater table and control of runoff impractical due to the low flows, it is proposed that surface water runoff from the parking area, the storage barn and the roof to drain to a planted dry swale which allows some runoff to infiltrate to ground and be disposed by evapotranspiration. The proposed drainage design layout is provided in **Appendix E**. The calculations below have been used to confirm that the swale is sized adequately.

Design Calculations

The swale is designed to drain the parking area (including the storage Barn) and the roof to the new dwelling. This is a total area of 220m².

The parking area will be surfaced in 10mm pea shingle over a Type 1 sub-base. The layers will be graded to fall towards the swale to allow runoff to be drained away. Direct infiltration of rainfall through the Type 1 layer and into the natural ground is clearly possible, however the design calculations will assume that the underlying soils are saturated causing runoff to drain to the swale directly.

The swale will incorporate a 50mm orifice at its outlet to control flows from the site and the swale will be sized to provide storage for the 1:30 year event of critical duration (assumed to be 15 minutes). The swale will discharge into a narrow ditch which will run southwards along the western boundary to the site discharging into the existing watercourse.

The calculations assume that infiltration to ground from the swale will not occur, however clearly both infiltration and evapo-transpiration will occur but at relatively low rates. The presence of the high groundwater table also limits the use of infiltration for surface water disposal in design terms, but in practical terms it will still occur.

² Arun District Council. (2018). Supplementary Requirements for Surface Water Drainage Proposals. [online] Arun.gov.uk. Available at: <https://www.arun.gov.uk/surfacewater> [Accessed 6 Jun. 2018].

³ Fehweb.ceh.ac.uk. (2018). Home Page - FEH Web Service. [online] Available at: <https://fehweb.ceh.ac.uk/> [Accessed 6 Jun. 2018].

Swale Dimensions

The swale shall be formed using the characteristics shown in Table 1 below

Plan Area of system (17m long x 2.1m wide at crest)	35m ²
Bed width	300mm
Side Slopes	1:3
Longitudinal Slope	1:200
Crest Level	9.30m
Invert Level	9.00m

Table 1: Design parameters for the swale

Hydraulic modelling of the drainage design has been undertaken with the Source Control module of the Microdrainage software suite. The results of the modelling are provided in **Appendix F**. The results demonstrate that no flooding occurs during a 1 in 30 return period event of critical duration.

Maintenance and Management

The Swale shall be maintained on a regular basis by the landowner. The maintenance actions recommended by the CIRIA SuDS Manual 2015 (Table 17.1) are reproduced below.

TABLE 17.1 Operation and maintenance requirements for swales			
	Maintenance schedule	Required action	Typical frequency
Regular maintenance		Remove litter and debris	Monthly, or as required
		Cut grass – to retain grass height within specified design range	Monthly (during growing season), or as required
		Manage other vegetation and remove nuisance plants	Monthly at start, then as required
		Inspect inlets, outlets and overflows for blockages, and clear if required	Monthly
		Inspect infiltration surfaces for ponding, compaction, silt accumulation, record areas where water is ponding for > 48 hours	Monthly, or when required
		Inspect vegetation coverage	Monthly for 6 months, quarterly for 2 years, then half yearly
		Inspect inlets and facility surface for silt accumulation, establish appropriate silt removal frequencies	Half yearly
Occasional maintenance		Reseed areas of poor vegetation growth, alter plant types to better suit conditions, if required	As required or if bare soil is exposed over 10% or more of the swale treatment area
Remedial actions		Repair erosion or other damage by re-turfing or reseed	As required
		Relevel uneven surfaces and reinstate design levels	As required
		Scarify and spike topsoil layer to improve infiltration performance, break up silt deposits and prevent compaction of the soil surface	As required
		Remove build-up of sediment on upstream gravel trench, flow spreader or at top of filter strip	As required
		Remove and dispose of oils or petrol residues using safe standard practices	As required

5.0 Limitations

YE have prepared this report with all reasonable skill, care and diligence. The work undertaken to provide the basis of this report comprised a study of available documented information from a variety of sources.

The opinions given in this report have been dictated by the finite data on which are they based and are relevant only to the purpose for which the report was commissioned.

Information reviewed should not be considered exhaustive and has accepted in good faith as providing true and representative data with respect to site conditions. Should additional information become available which may influence the opinion expressed in this report, YE reserves the right to review such information and, if warranted, to alter the opinions accordingly.

It should be noted that any risks identified in this report are perceived risks based on the information reviewed.

The recommendations contained in this report represent our professional opinions. These opinions were arrived at in accordance with currently accepted industry practices at this time and as such are not a guarantee that the study site is free of hazardous conditions.

This report has been prepared solely for the use of the named client, and may not be relied upon by other parties without written consent from YE. YE disclaim any responsibility to the client and others in respect of any matters outside the agreed scope of the work


Appendix A -Proposed Development Layout Plans



Notes:

This drawing is the copyright of
Manorwood
Do not scale from this drawing except
for Local Authority planning purposes


All dimensions must be checked on site
prior to commencement of works

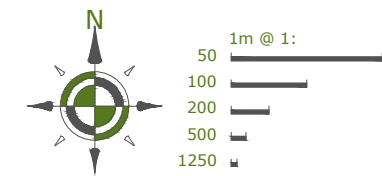

Location Plan
1:1250

Revisions

--

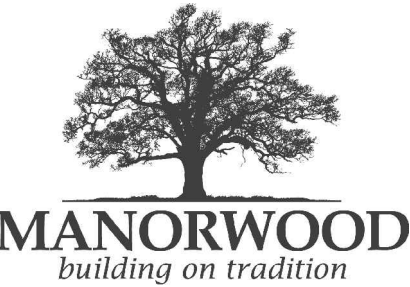

Client
Julie Waite

Job
Land (to the rear of) The Flint Barn
Yapton Road
Barnham

Drawing
Site:
Location Plan

Drawn	Date	Scale @A3
MD	06.07.16	1:1250
Job No.	Drawing No.	Revision
1607FL	000L	1
Status	For comment	

Pair of 1.2m high 5 bar field gates to entrance

Parking and turning area constructed of permeable Type 1 sub base dressed with 10mm pea shingle to a depth of 40mm

Existing hedge removed and replaced with Native species hedge comprising

40% Hawthorn (*Crataegus monogyna*)
30% Blackthorn (*Prunus spinosa*)

interplanted with

10% Hazel (*Corylus avellana*)
10% Dogwood (*Cornus sanguinea*)
10% Wild Privet (*Ligustrum vulgare*)

All Hawthorn and Blackthorn to be planted in two, staggered rows at a density of not less than 5 per meter, with approximately 450mm between plants in the same row, and 300-400mm between rows. Interplanted whips to be planted within hedging in groups of 2 or 3.

Indian sandstone seating area and path bordered by shrubs

previously approved dwelling location shown dotted

Proposed garage, bike and bin store

1.8m high close board fence along east boundary of site

Proposed dwelling


Grass

existing hedges retained

Notes:


This drawing is the copyright of Manorwood
Do not scale from this drawing except for Local Authority planning purposes

All dimensions must be checked on site prior to commencement of works

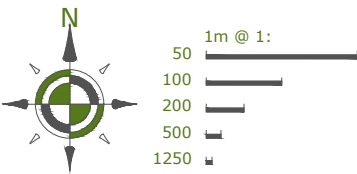

Revisions

--

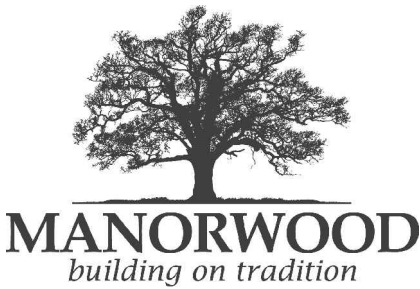

Client
Julie Waite

Job
Land (to the rear of) The Flint Barn
Yapton Road
Barnham

Drawing
Site:


Block Plan

Drawn	Date	Scale @A3
MD	06.07.16	1:200

Job No.	Drawing No.	Revision
1607FL	000	1


Status
For comment

Block Plan
1:200

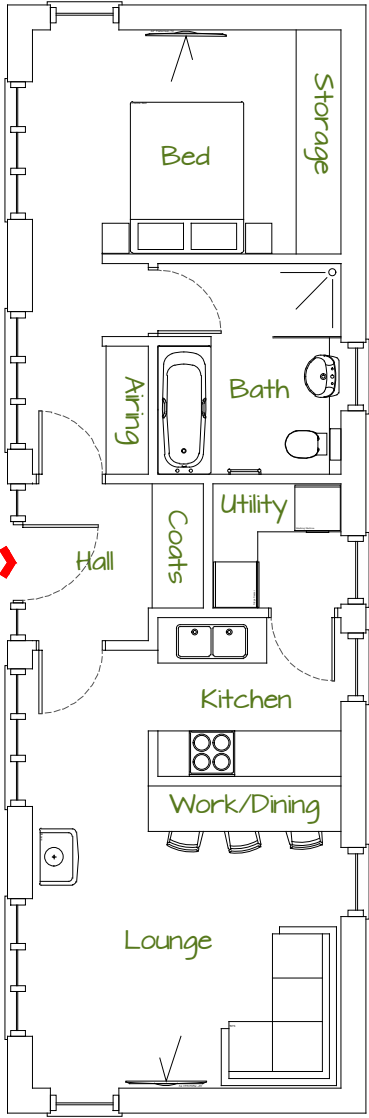


Approved Plan

1:100

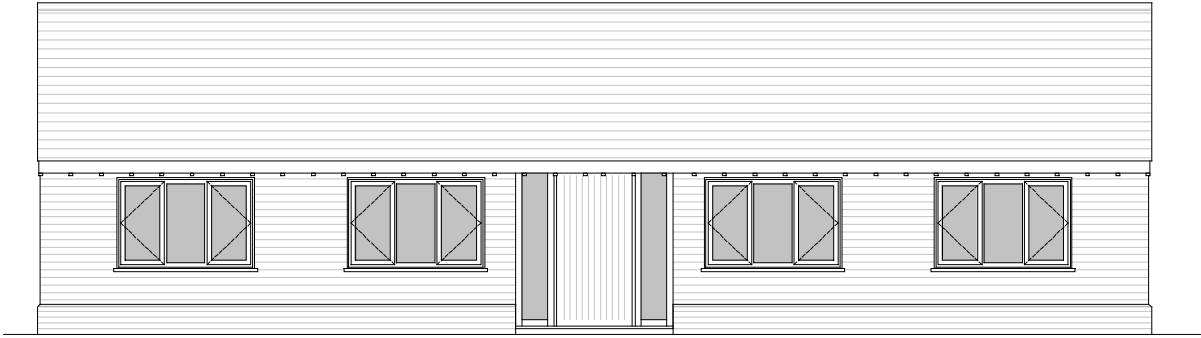


Approved West Elevation

1:100

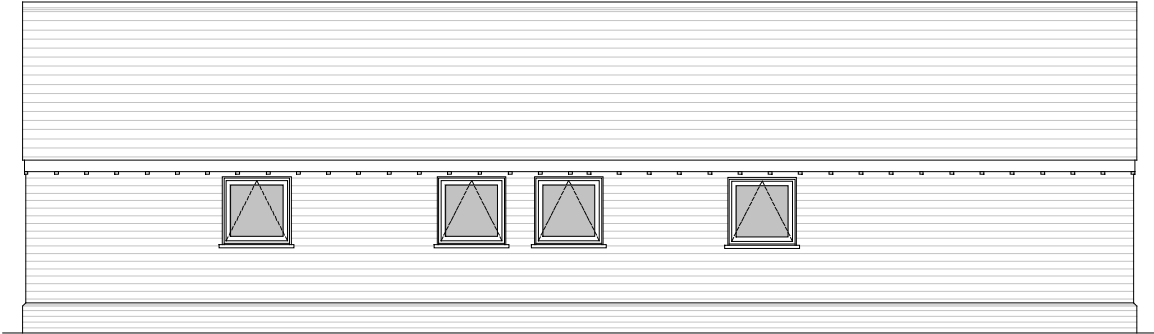


Approved East Elevation

1:100

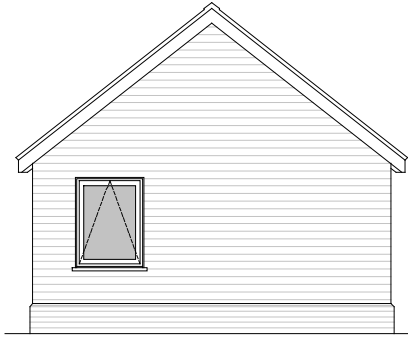

Approved South Elevation

1:100

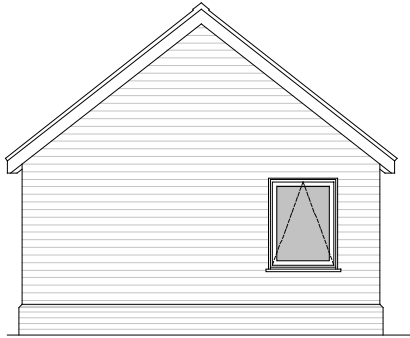


Approved North Elevation

1:100

Notes:


This drawing is the copyright of
Manorwood
Do not scale from this drawing except
for Local Authority planning purposes

All dimensions must be checked on site
prior to commencement of works



Revisions

--

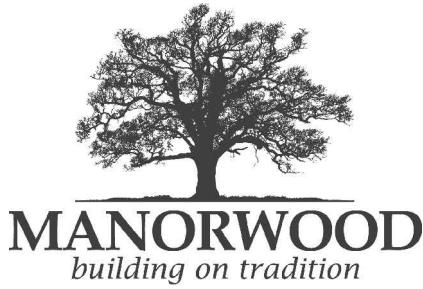

Client

Julie Waite

Job

Land (to the rear of) The Flint Barn
Yapton Road
Barnham

Drawing

Approved
Plan
Elevations


Drawn	Date	Scale @A3
MD	06.07.16	1:100

Job No.	Drawing No.	Revision
1607FL	001	1

Status


For comment

Notes:




This drawing is the copyright of
Manorwood
Do not scale from this drawing except
for Local Authority planning purposes

All dimensions must be checked on site
prior to commencement of works

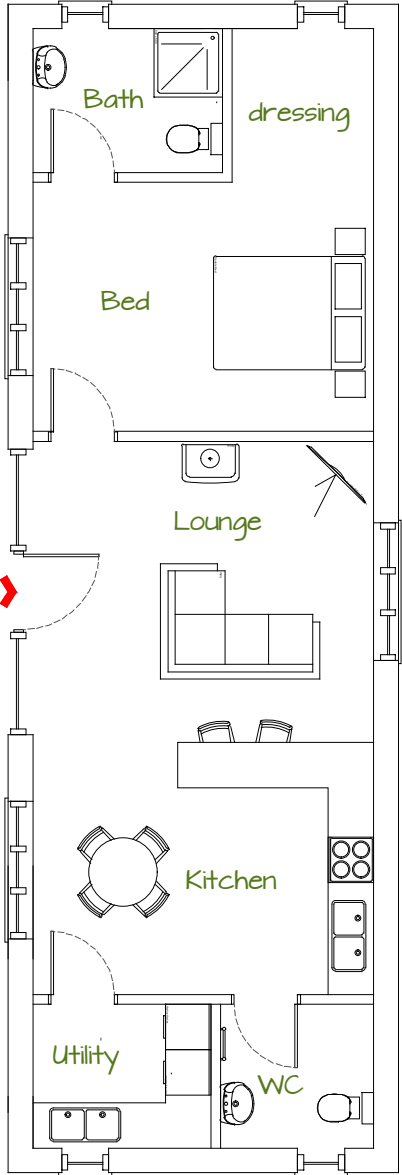


Proposed Plan
1:100

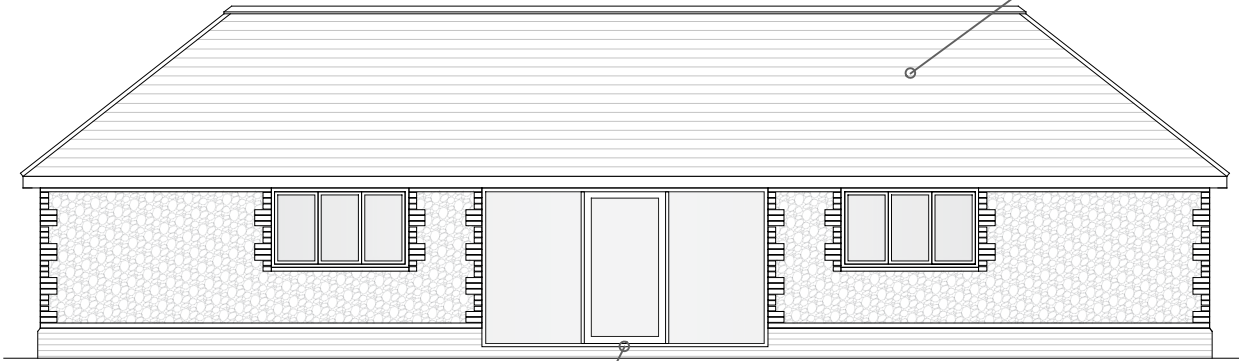



Proposed West Elevation
1:100

Dark stained timber doors and windows

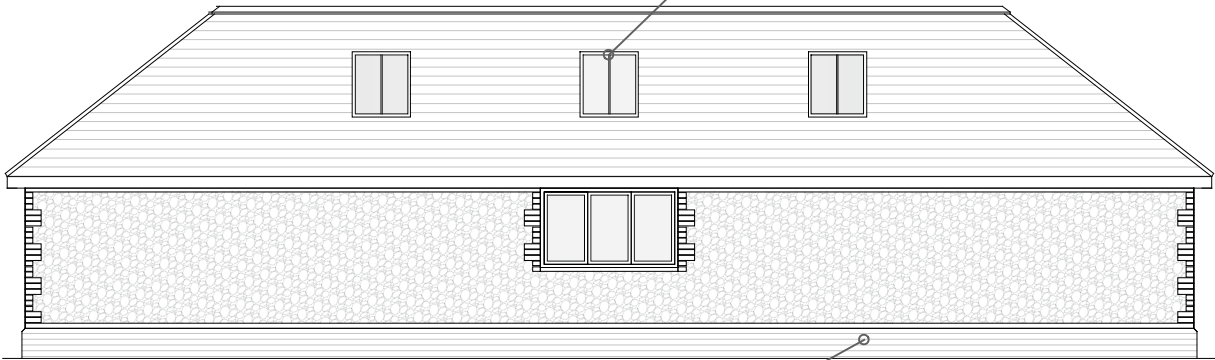

Proposed East Elevation
1:100

Lambs - Chartwell Medium Multi handmade bricks

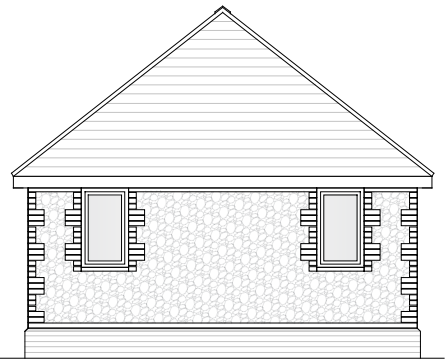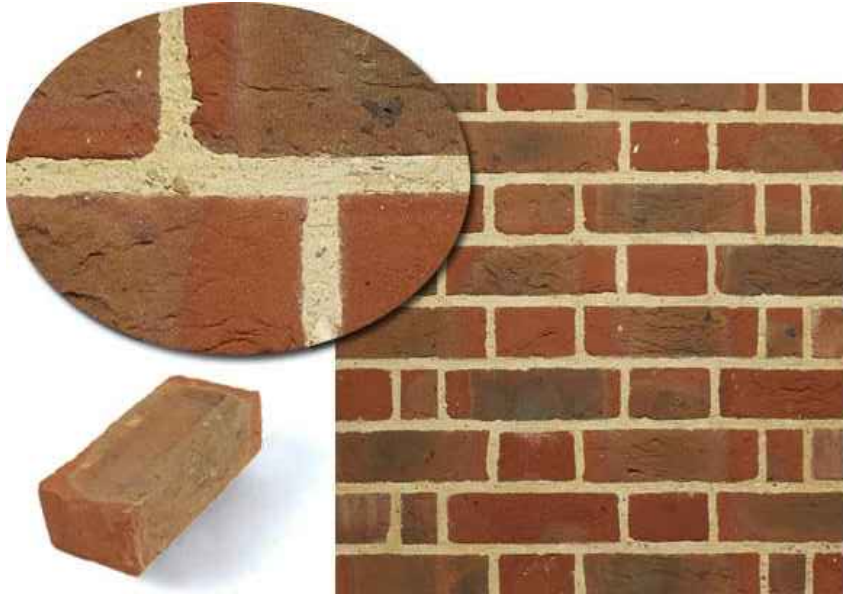

Proposed South Elevation
1:100



Proposed North Elevation
1:100

Flint facing walls to brick quoins and reveals




Spicer - Medium Antique handmade plain clay tiles



Revisions

--

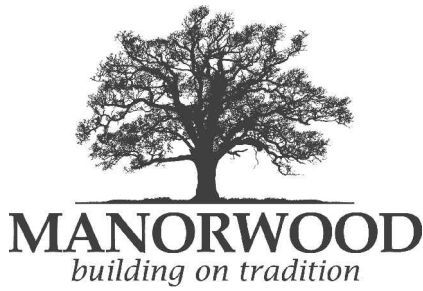

Client
Julie Waite


Job
Land (to the rear of) The Flint Barn
Yapton Road
Barnham

Drawing
Proposed
Plan
Elevations

Drawn	Date	Scale @A3
MD	06.07.16	1:100

Job No.	Drawing No.	Revision
1607FL	002	1


Status
For comment




Notes:

This drawing is the copyright of
Manorwood
Do not scale from this drawing except
for Local Authority planning purposes

All dimensions must be checked on site
prior to commencement of works

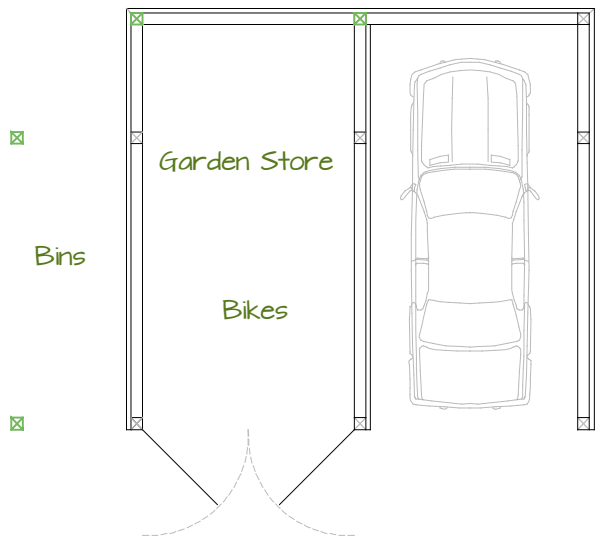

Proposed Plan
1:100

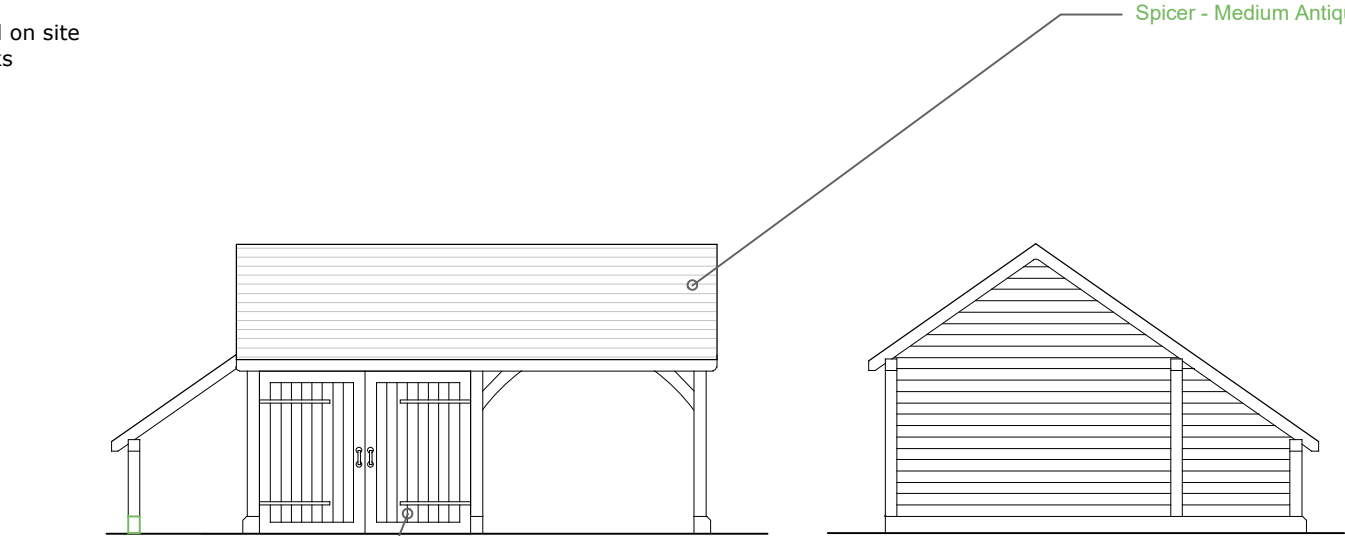


Proposed West Elevation
1:100


Proposed South Elevation
1:100

Dark stained timber doors

Conservation rooflights

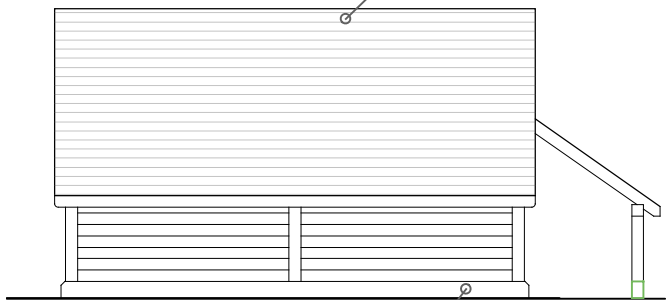

Proposed East Elevation
1:100

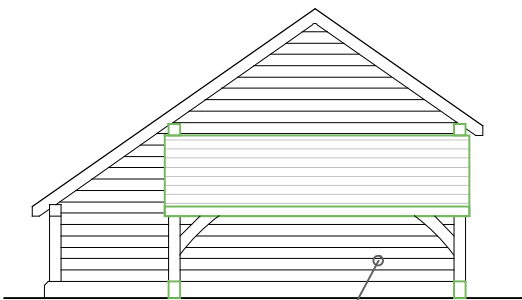

Proposed North Elevation
1:100

unstained oak weatherboard




Lambs - Chartwell Medium Multi handmade bricks



Spicer - Medium Antique handmade plain clay tiles

Revisions
--

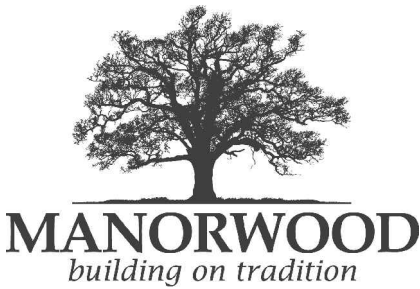

Client
Julie Waite

Job
Land (to the rear of) The Flint Barn
Yapton Road
Barnham

Drawing
Proposed garage, bin and bike store
Plan
Elevations

Drawn	Date	Scale @A3
MD	06.07.16	1:100

Job No.	Drawing No.	Revision
1607FL	003	1

Status
For comment

Appendix B - Trial pit logs and photos



Name

ID

YE4281

Client

Engineer

Nick H

Location

Land to rear of Flint Barn, Barnham

Contractor

Tim Splihurst

Date

21.03.2018

Remarks

Trial Pit Information

[illegible]

Geology Information

Hole ID	Geology Code	Legend Code	Top Depth	Base Depth	General Description of Stratum	Stratum Reference
TP1			0.000	0.250	Made ground - soft medium dark grey SILT with rubble and rubbish	
TP1			0.250	0.850	Dark grey very soft medium SILT	
TP1			0.850	1.700	Light brown stiff CLAY	
TP1			1.700	2.000	Light brown medium sand and stiff clay with loose medium GRAVEL	
TP2			0.000	0.450	Made ground - soft medium dark grey SILT with rubble and rubbish	
TP2			0.450	0.850	Dark grey very soft medium SILT	
TP2			0.850	1.050	Light brown stiff CLAY	
TP2			1.050	2.000	Light brown medium sand and stiff clay with loose medium GRAVEL	



Record Photo of Trial Pit 1



Record Photo of Trial Pit 1



Record Photo of Trial Pit 2



Record Photo of Trial Pit 2

Appendix C - Topographical Survey





Ordnance Survey (c) Crown Copyright 2016. All rights reserved. Licence number 100022432

Appendix D - Microdrainage modelling outputs: QBar calculation



KPT Properties		Page 1
19 Lonsdale Avenue Hutton Essex CM13 1NH		
Date 07/06/2018 09:37 File	Designed by Paul Checked by	
XP Solutions Source Control 2018.1		

ReFH2 Rural Runoff Peak Flows

Input

Return Period (Years)	2
FEH Rainfall Version	2013
Site Location	GB 496538 104129
Data Type	Point
Season	Summer
Country	England/Wales/Northern Ireland
Area (ha)	0.022
SAAR (mm)	757
BFIHOST	0.661
FARL	0.000
SPRHOST	0.000
URBEXT (2000)	0.0000


Results

Return Period (Years)	Rural (l/s)	Urban (l/s)
User	0.1	0.1
Q1	0.1	0.1
Q2	0.1	0.1
Q5	0.1	0.1
Q10	0.1	0.1
Q30	0.1	0.1
Q50	0.2	0.2
Q75	0.2	0.2
Q100	0.2	0.2
Q200	0.2	0.2
Q1000	0.3	0.3

©1982-2018 Innovyze

Appendix E - Proposed Drainage Design Layout



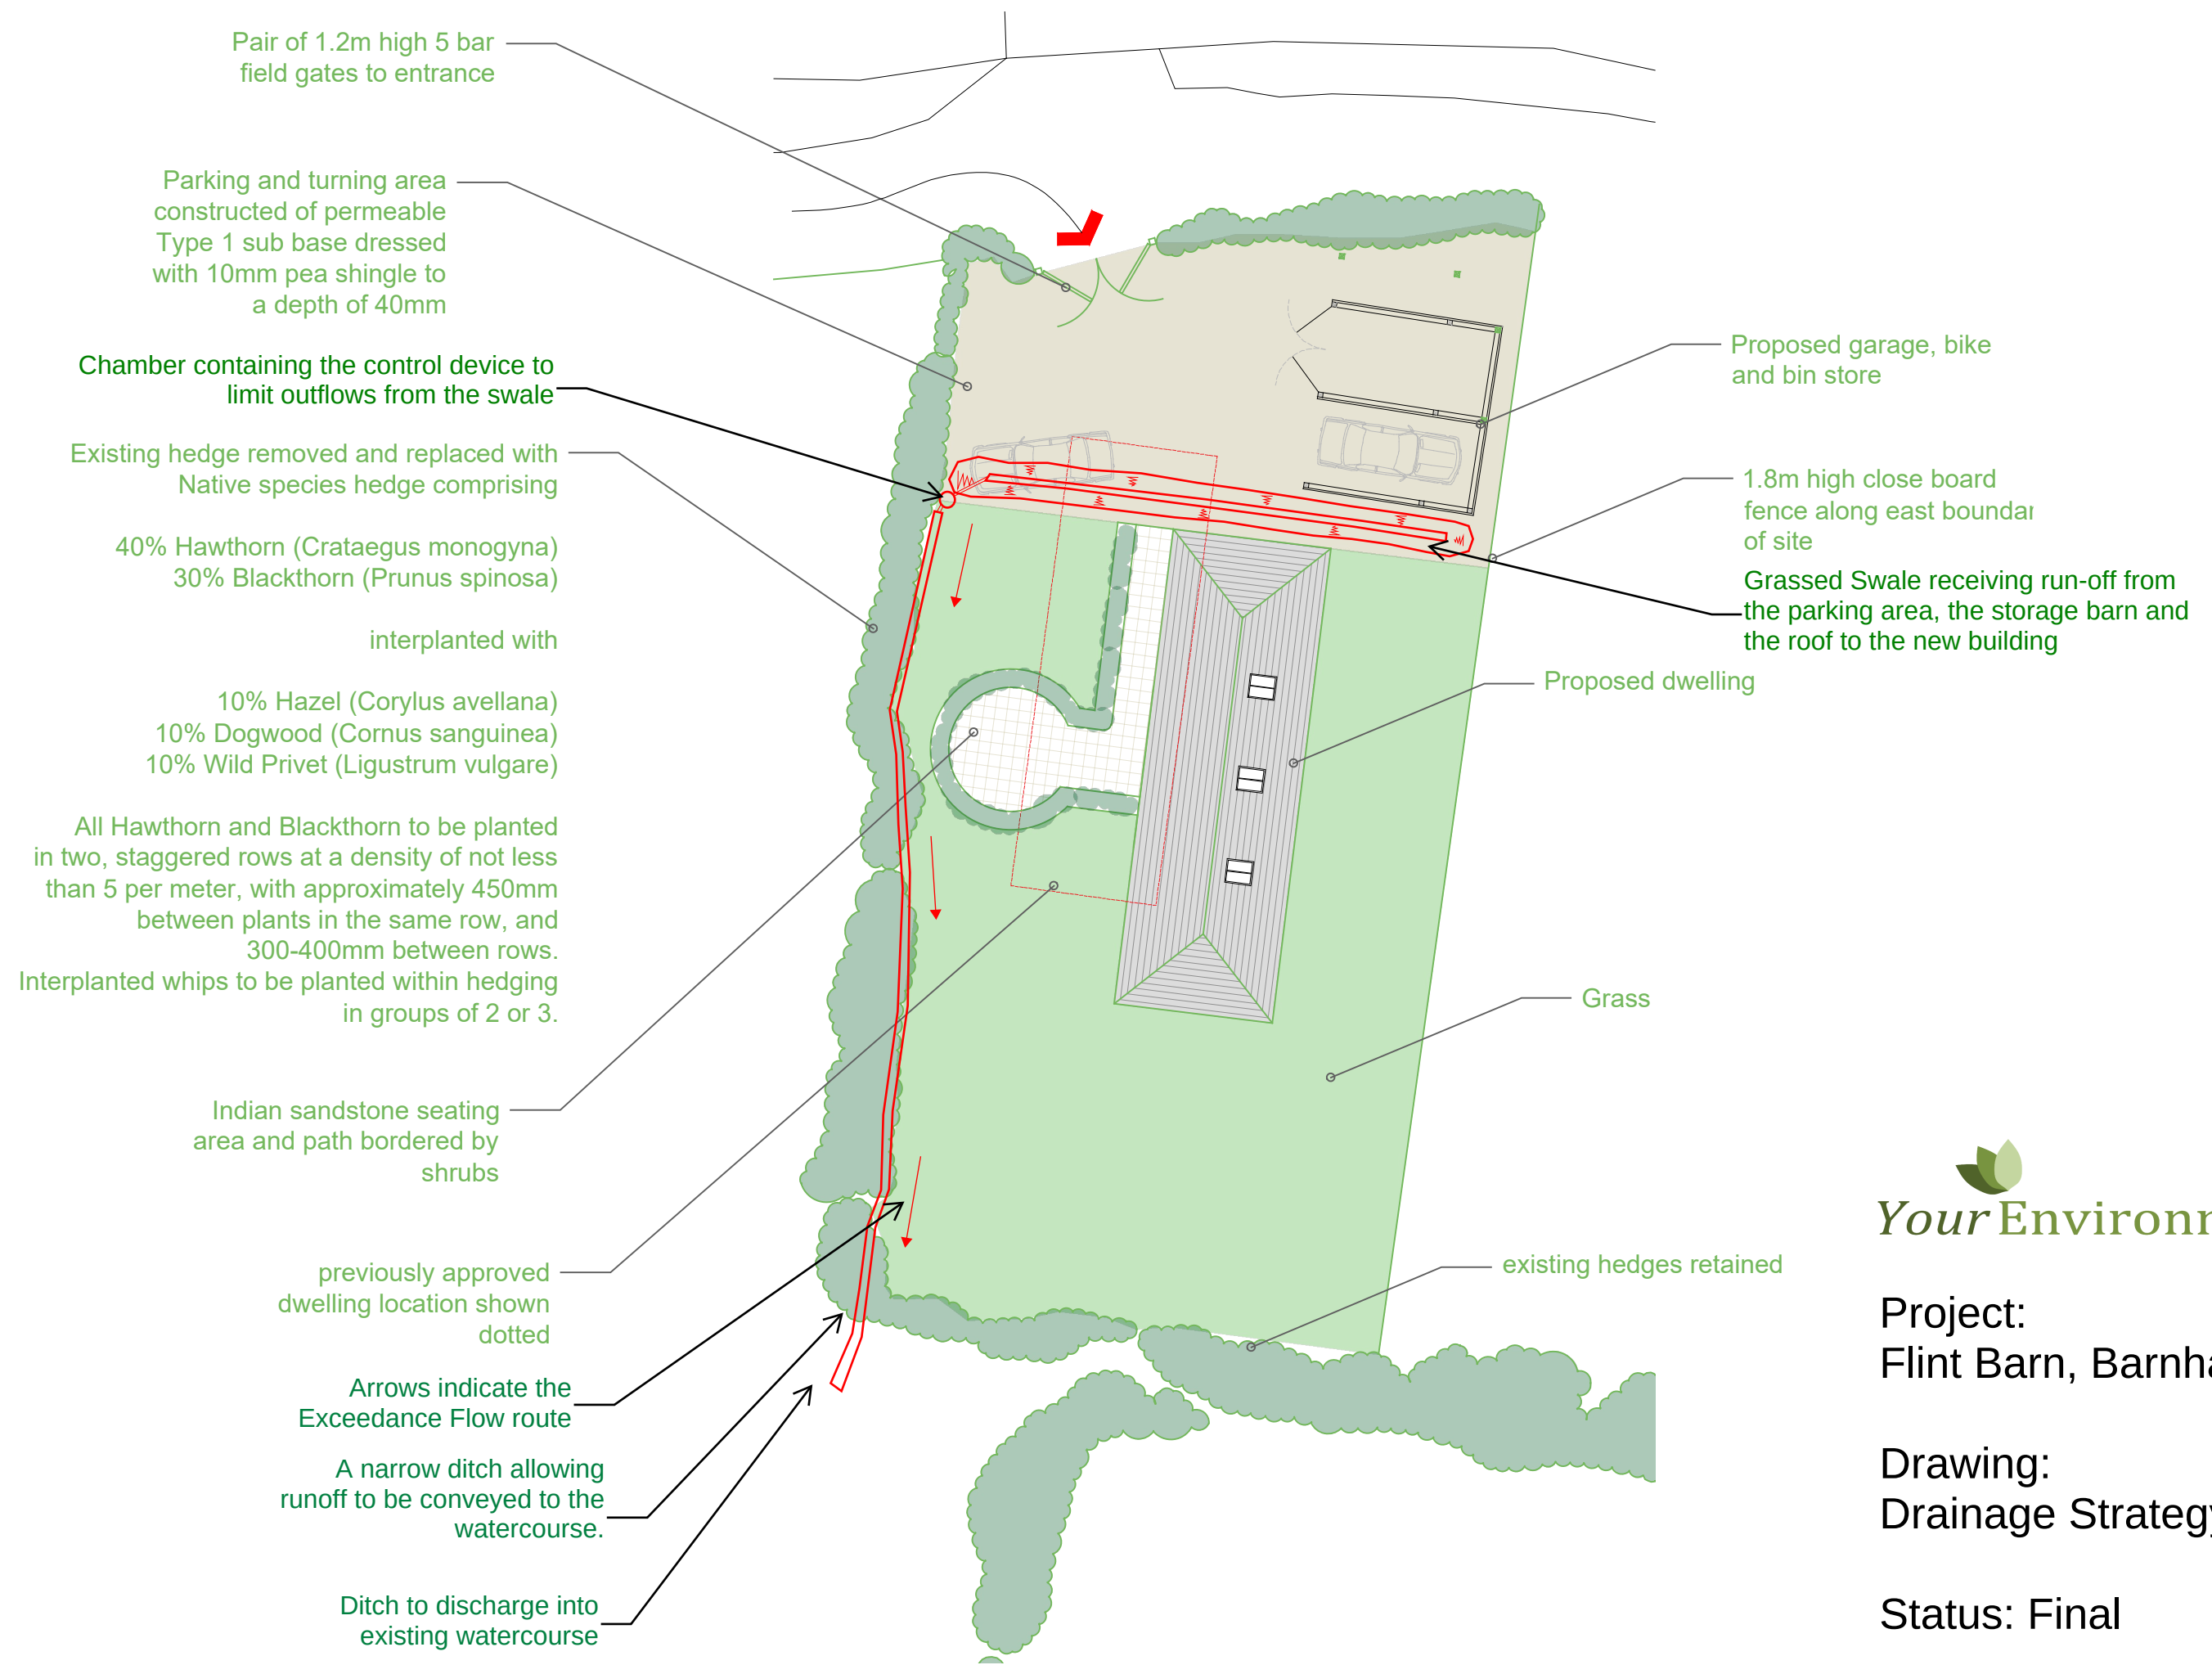

Block Plan
1:200


Your Environment

Project:
Flint Barn, Barnham

Drawing:
Drainage Strategy

Status: Final

Date: June 2018

Appendix F - Microdrainage modelling outputs: Swale



KPT Properties							Page 1																																																																																																																																																																																																																																																																																	
19 Lonsdale Avenue Hutton Essex CM13 1NH																																																																																																																																																																																																																																																																																								
Date 08/06/2018 12:12 File swale_50%.SRCX			Designed by Paul Checked by																																																																																																																																																																																																																																																																																					
XP Solutions			Source Control 2018.1																																																																																																																																																																																																																																																																																					
<u>Summary of Results for 2 year Return Period</u> Half Drain Time : 6 minutes. <table><tr><th>Storm Event</th><th>Max Level (m)</th><th>Max Depth (m)</th><th>Max Infiltration (1/s)</th><th>Max Control (1/s)</th><th>Max E Outflow (1/s)</th><th>Max Volume (m³)</th><th>Status</th></tr><tr><td>15 min Summer</td><td>9.120</td><td>0.120</td><td>0.0</td><td>1.6</td><td>1.6</td><td>0.7</td><td>Flood Risk</td></tr><tr><td>30 min Summer</td><td>9.120</td><td>0.120</td><td>0.0</td><td>1.6</td><td>1.6</td><td>0.7</td><td>Flood Risk</td></tr><tr><td>60 min Summer</td><td>9.108</td><td>0.108</td><td>0.0</td><td>1.5</td><td>1.5</td><td>0.6</td><td>Flood Risk</td></tr><tr><td>120 min Summer</td><td>9.093</td><td>0.093</td><td>0.0</td><td>1.4</td><td>1.4</td><td>0.4</td><td>Flood Risk</td></tr><tr><td>180 min Summer</td><td>9.080</td><td>0.080</td><td>0.0</td><td>1.2</td><td>1.2</td><td>0.3</td><td>Flood Risk</td></tr><tr><td>240 min Summer</td><td>9.071</td><td>0.071</td><td>0.0</td><td>1.1</td><td>1.1</td><td>0.2</td><td>Flood Risk</td></tr><tr><td>360 min Summer</td><td>9.060</td><td>0.060</td><td>0.0</td><td>0.9</td><td>0.9</td><td>0.2</td><td>Flood Risk</td></tr><tr><td>480 min Summer</td><td>9.053</td><td>0.053</td><td>0.0</td><td>0.7</td><td>0.7</td><td>0.1</td><td>Flood Risk</td></tr><tr><td>600 min Summer</td><td>9.048</td><td>0.048</td><td>0.0</td><td>0.6</td><td>0.6</td><td>0.1</td><td>Flood Risk</td></tr><tr><td>720 min Summer</td><td>9.044</td><td>0.044</td><td>0.0</td><td>0.5</td><td>0.5</td><td>0.1</td><td>Flood Risk</td></tr><tr><td>960 min Summer</td><td>9.038</td><td>0.038</td><td>0.0</td><td>0.4</td><td>0.4</td><td>0.1</td><td>Flood Risk</td></tr><tr><td>1440 min Summer</td><td>9.031</td><td>0.031</td><td>0.0</td><td>0.3</td><td>0.3</td><td>0.0</td><td>Flood Risk</td></tr><tr><td>2160 min Summer</td><td>9.026</td><td>0.026</td><td>0.0</td><td>0.2</td><td>0.2</td><td>0.0</td><td>Flood Risk</td></tr><tr><td>2880 min Summer</td><td>9.024</td><td>0.024</td><td>0.0</td><td>0.2</td><td>0.2</td><td>0.0</td><td>Flood Risk</td></tr><tr><td>4320 min Summer</td><td>9.021</td><td>0.021</td><td>0.0</td><td>0.1</td><td>0.1</td><td>0.0</td><td>Flood Risk</td></tr><tr><td>5760 min Summer</td><td>9.019</td><td>0.019</td><td>0.0</td><td>0.1</td><td>0.1</td><td>0.0</td><td>Flood Risk</td></tr><tr><td>7200 min Summer</td><td>9.018</td><td>0.018</td><td>0.0</td><td>0.1</td><td>0.1</td><td>0.0</td><td>Flood Risk</td></tr><tr><td>8640 min Summer</td><td>9.017</td><td>0.017</td><td>0.0</td><td>0.1</td><td>0.1</td><td>0.0</td><td>Flood Risk</td></tr><tr><td>10080 min Summer</td><td>9.017</td><td>0.017</td><td>0.0</td><td>0.1</td><td>0.1</td><td>0.0</td><td>Flood Risk</td></tr><tr><td>15 min Winter</td><td>9.128</td><td>0.128</td><td>0.0</td><td>1.7</td><td>1.7</td><td>0.8</td><td>Flood Risk</td></tr></table> <table><tr><th>Storm Event</th><th>Rain (mm/hr)</th><th>Flooded Volume (m³)</th><th>Discharge Volume (m³)</th><th>Time-Peak (mins)</th></tr><tr><td>15 min Summer</td><td>37.891</td><td>0.0</td><td>1.6</td><td>12</td></tr><tr><td>30 min Summer</td><td>24.772</td><td>0.0</td><td>2.0</td><td>21</td></tr><tr><td>60 min Summer</td><td>15.619</td><td>0.0</td><td>2.6</td><td>36</td></tr><tr><td>120 min Summer</td><td>10.546</td><td>0.0</td><td>3.5</td><td>68</td></tr><tr><td>180 min Summer</td><td>8.171</td><td>0.0</td><td>4.0</td><td>96</td></tr><tr><td>240 min Summer</td><td>6.740</td><td>0.0</td><td>4.4</td><td>126</td></tr><tr><td>360 min Summer</td><td>5.048</td><td>0.0</td><td>5.0</td><td>186</td></tr><tr><td>480 min Summer</td><td>4.070</td><td>0.0</td><td>5.4</td><td>246</td></tr><tr><td>600 min Summer</td><td>3.431</td><td>0.0</td><td>5.7</td><td>306</td></tr><tr><td>720 min Summer</td><td>2.979</td><td>0.0</td><td>5.9</td><td>366</td></tr><tr><td>960 min Summer</td><td>2.377</td><td>0.0</td><td>6.3</td><td>482</td></tr><tr><td>1440 min Summer</td><td>1.733</td><td>0.0</td><td>6.9</td><td>732</td></tr><tr><td>2160 min Summer</td><td>1.274</td><td>0.0</td><td>7.6</td><td>1084</td></tr><tr><td>2880 min Summer</td><td>1.033</td><td>0.0</td><td>8.2</td><td>1436</td></tr><tr><td>4320 min Summer</td><td>0.788</td><td>0.0</td><td>9.4</td><td>2132</td></tr><tr><td>5760 min Summer</td><td>0.661</td><td>0.0</td><td>10.5</td><td>2936</td></tr><tr><td>7200 min Summer</td><td>0.583</td><td>0.0</td><td>11.6</td><td>3584</td></tr><tr><td>8640 min Summer</td><td>0.531</td><td>0.0</td><td>12.6</td><td>4280</td></tr><tr><td>10080 min Summer</td><td>0.493</td><td>0.0</td><td>13.7</td><td>5000</td></tr><tr><td>15 min Winter</td><td>37.891</td><td>0.0</td><td>1.8</td><td>13</td></tr></table>								Storm Event	Max Level (m)	Max Depth (m)	Max Infiltration (1/s)	Max Control (1/s)	Max E Outflow (1/s)	Max Volume (m³)	Status	15 min Summer	9.120	0.120	0.0	1.6	1.6	0.7	Flood Risk	30 min Summer	9.120	0.120	0.0	1.6	1.6	0.7	Flood Risk	60 min Summer	9.108	0.108	0.0	1.5	1.5	0.6	Flood Risk	120 min Summer	9.093	0.093	0.0	1.4	1.4	0.4	Flood Risk	180 min Summer	9.080	0.080	0.0	1.2	1.2	0.3	Flood Risk	240 min Summer	9.071	0.071	0.0	1.1	1.1	0.2	Flood Risk	360 min Summer	9.060	0.060	0.0	0.9	0.9	0.2	Flood Risk	480 min Summer	9.053	0.053	0.0	0.7	0.7	0.1	Flood Risk	600 min Summer	9.048	0.048	0.0	0.6	0.6	0.1	Flood Risk	720 min Summer	9.044	0.044	0.0	0.5	0.5	0.1	Flood Risk	960 min Summer	9.038	0.038	0.0	0.4	0.4	0.1	Flood Risk	1440 min Summer	9.031	0.031	0.0	0.3	0.3	0.0	Flood Risk	2160 min Summer	9.026	0.026	0.0	0.2	0.2	0.0	Flood Risk	2880 min Summer	9.024	0.024	0.0	0.2	0.2	0.0	Flood Risk	4320 min Summer	9.021	0.021	0.0	0.1	0.1	0.0	Flood Risk	5760 min Summer	9.019	0.019	0.0	0.1	0.1	0.0	Flood Risk	7200 min Summer	9.018	0.018	0.0	0.1	0.1	0.0	Flood Risk	8640 min Summer	9.017	0.017	0.0	0.1	0.1	0.0	Flood Risk	10080 min Summer	9.017	0.017	0.0	0.1	0.1	0.0	Flood Risk	15 min Winter	9.128	0.128	0.0	1.7	1.7	0.8	Flood Risk	Storm Event	Rain (mm/hr)	Flooded Volume (m³)	Discharge Volume (m³)	Time-Peak (mins)	15 min Summer	37.891	0.0	1.6	12	30 min Summer	24.772	0.0	2.0	21	60 min Summer	15.619	0.0	2.6	36	120 min Summer	10.546	0.0	3.5	68	180 min Summer	8.171	0.0	4.0	96	240 min Summer	6.740	0.0	4.4	126	360 min Summer	5.048	0.0	5.0	186	480 min Summer	4.070	0.0	5.4	246	600 min Summer	3.431	0.0	5.7	306	720 min Summer	2.979	0.0	5.9	366	960 min Summer	2.377	0.0	6.3	482	1440 min Summer	1.733	0.0	6.9	732	2160 min Summer	1.274	0.0	7.6	1084	2880 min Summer	1.033	0.0	8.2	1436	4320 min Summer	0.788	0.0	9.4	2132	5760 min Summer	0.661	0.0	10.5	2936	7200 min Summer	0.583	0.0	11.6	3584	8640 min Summer	0.531	0.0	12.6	4280	10080 min Summer	0.493	0.0	13.7	5000	15 min Winter	37.891	0.0	1.8	13
Storm Event	Max Level (m)	Max Depth (m)	Max Infiltration (1/s)	Max Control (1/s)	Max E Outflow (1/s)	Max Volume (m³)	Status																																																																																																																																																																																																																																																																																	
15 min Summer	9.120	0.120	0.0	1.6	1.6	0.7	Flood Risk																																																																																																																																																																																																																																																																																	
30 min Summer	9.120	0.120	0.0	1.6	1.6	0.7	Flood Risk																																																																																																																																																																																																																																																																																	
60 min Summer	9.108	0.108	0.0	1.5	1.5	0.6	Flood Risk																																																																																																																																																																																																																																																																																	
120 min Summer	9.093	0.093	0.0	1.4	1.4	0.4	Flood Risk																																																																																																																																																																																																																																																																																	
180 min Summer	9.080	0.080	0.0	1.2	1.2	0.3	Flood Risk																																																																																																																																																																																																																																																																																	
240 min Summer	9.071	0.071	0.0	1.1	1.1	0.2	Flood Risk																																																																																																																																																																																																																																																																																	
360 min Summer	9.060	0.060	0.0	0.9	0.9	0.2	Flood Risk																																																																																																																																																																																																																																																																																	
480 min Summer	9.053	0.053	0.0	0.7	0.7	0.1	Flood Risk																																																																																																																																																																																																																																																																																	
600 min Summer	9.048	0.048	0.0	0.6	0.6	0.1	Flood Risk																																																																																																																																																																																																																																																																																	
720 min Summer	9.044	0.044	0.0	0.5	0.5	0.1	Flood Risk																																																																																																																																																																																																																																																																																	
960 min Summer	9.038	0.038	0.0	0.4	0.4	0.1	Flood Risk																																																																																																																																																																																																																																																																																	
1440 min Summer	9.031	0.031	0.0	0.3	0.3	0.0	Flood Risk																																																																																																																																																																																																																																																																																	
2160 min Summer	9.026	0.026	0.0	0.2	0.2	0.0	Flood Risk																																																																																																																																																																																																																																																																																	
2880 min Summer	9.024	0.024	0.0	0.2	0.2	0.0	Flood Risk																																																																																																																																																																																																																																																																																	
4320 min Summer	9.021	0.021	0.0	0.1	0.1	0.0	Flood Risk																																																																																																																																																																																																																																																																																	
5760 min Summer	9.019	0.019	0.0	0.1	0.1	0.0	Flood Risk																																																																																																																																																																																																																																																																																	
7200 min Summer	9.018	0.018	0.0	0.1	0.1	0.0	Flood Risk																																																																																																																																																																																																																																																																																	
8640 min Summer	9.017	0.017	0.0	0.1	0.1	0.0	Flood Risk																																																																																																																																																																																																																																																																																	
10080 min Summer	9.017	0.017	0.0	0.1	0.1	0.0	Flood Risk																																																																																																																																																																																																																																																																																	
15 min Winter	9.128	0.128	0.0	1.7	1.7	0.8	Flood Risk																																																																																																																																																																																																																																																																																	
Storm Event	Rain (mm/hr)	Flooded Volume (m³)	Discharge Volume (m³)	Time-Peak (mins)																																																																																																																																																																																																																																																																																				
15 min Summer	37.891	0.0	1.6	12																																																																																																																																																																																																																																																																																				
30 min Summer	24.772	0.0	2.0	21																																																																																																																																																																																																																																																																																				
60 min Summer	15.619	0.0	2.6	36																																																																																																																																																																																																																																																																																				
120 min Summer	10.546	0.0	3.5	68																																																																																																																																																																																																																																																																																				
180 min Summer	8.171	0.0	4.0	96																																																																																																																																																																																																																																																																																				
240 min Summer	6.740	0.0	4.4	126																																																																																																																																																																																																																																																																																				
360 min Summer	5.048	0.0	5.0	186																																																																																																																																																																																																																																																																																				
480 min Summer	4.070	0.0	5.4	246																																																																																																																																																																																																																																																																																				
600 min Summer	3.431	0.0	5.7	306																																																																																																																																																																																																																																																																																				
720 min Summer	2.979	0.0	5.9	366																																																																																																																																																																																																																																																																																				
960 min Summer	2.377	0.0	6.3	482																																																																																																																																																																																																																																																																																				
1440 min Summer	1.733	0.0	6.9	732																																																																																																																																																																																																																																																																																				
2160 min Summer	1.274	0.0	7.6	1084																																																																																																																																																																																																																																																																																				
2880 min Summer	1.033	0.0	8.2	1436																																																																																																																																																																																																																																																																																				
4320 min Summer	0.788	0.0	9.4	2132																																																																																																																																																																																																																																																																																				
5760 min Summer	0.661	0.0	10.5	2936																																																																																																																																																																																																																																																																																				
7200 min Summer	0.583	0.0	11.6	3584																																																																																																																																																																																																																																																																																				
8640 min Summer	0.531	0.0	12.6	4280																																																																																																																																																																																																																																																																																				
10080 min Summer	0.493	0.0	13.7	5000																																																																																																																																																																																																																																																																																				
15 min Winter	37.891	0.0	1.8	13																																																																																																																																																																																																																																																																																				
©1982-2018 Innovyze																																																																																																																																																																																																																																																																																								

KPT Properties							Page 2
19 Lonsdale Avenue Hutton Essex CM13 1NH							
Date 08/06/2018 12:12 File swale_50%.SRCX			Designed by Paul Checked by				
XP Solutions			Source Control 2018.1				
<u>Summary of Results for 2 year Return Period</u>							
Storm Event	Max Level (m)	Max Depth (m)	Max Infiltration (l/s)	Max Control (l/s)	Max Σ Outflow (l/s)	Max Volume (m³)	Status
30 min Winter	9.123	0.123	0.0	1.6	1.6	0.8	Flood Risk
60 min Winter	9.103	0.103	0.0	1.5	1.5	0.5	Flood Risk
120 min Winter	9.081	0.081	0.0	1.2	1.2	0.3	Flood Risk
180 min Winter	9.067	0.067	0.0	1.0	1.0	0.2	Flood Risk
240 min Winter	9.059	0.059	0.0	0.9	0.9	0.1	Flood Risk
360 min Winter	9.050	0.050	0.0	0.7	0.7	0.1	Flood Risk
480 min Winter	9.044	0.044	0.0	0.5	0.5	0.1	Flood Risk
600 min Winter	9.040	0.040	0.0	0.4	0.4	0.1	Flood Risk
720 min Winter	9.036	0.036	0.0	0.4	0.4	0.0	Flood Risk
960 min Winter	9.031	0.031	0.0	0.3	0.3	0.0	Flood Risk
1440 min Winter	9.026	0.026	0.0	0.2	0.2	0.0	Flood Risk
2160 min Winter	9.023	0.023	0.0	0.2	0.2	0.0	Flood Risk
2880 min Winter	9.020	0.020	0.0	0.1	0.1	0.0	Flood Risk
4320 min Winter	9.018	0.018	0.0	0.1	0.1	0.0	Flood Risk
5760 min Winter	9.016	0.016	0.0	0.1	0.1	0.0	Flood Risk
7200 min Winter	9.015	0.015	0.0	0.1	0.1	0.0	Flood Risk
8640 min Winter	9.015	0.015	0.0	0.1	0.1	0.0	Flood Risk
10080 min Winter	9.014	0.014	0.0	0.1	0.1	0.0	Flood Risk
Storm Event	Rain (mm/hr)	Flooded Volume (m³)	Discharge Volume (m³)	Time-Peak (mins)			
30 min Winter	24.772	0.0	2.3	22			
60 min Winter	15.619	0.0	2.9	38			
120 min Winter	10.546	0.0	3.9	68			
180 min Winter	8.171	0.0	4.5	96			
240 min Winter	6.740	0.0	5.0	126			
360 min Winter	5.048	0.0	5.6	188			
480 min Winter	4.070	0.0	6.0	244			
600 min Winter	3.431	0.0	6.3	304			
720 min Winter	2.979	0.0	6.6	366			
960 min Winter	2.377	0.0	7.0	482			
1440 min Winter	1.733	0.0	7.7	732			
2160 min Winter	1.274	0.0	8.5	1072			
2880 min Winter	1.033	0.0	9.2	1456			
4320 min Winter	0.788	0.0	10.5	2120			
5760 min Winter	0.661	0.0	11.7	2856			
7200 min Winter	0.583	0.0	12.9	3568			
8640 min Winter	0.531	0.0	14.1	4472			
10080 min Winter	0.493	0.0	15.3	5216			
©1982-2018 Innovyze							

KPT Properties		Page 3
19 Lonsdale Avenue Hutton Essex CM13 1NH		
Date 08/06/2018 12:12 File swale_50%.SRCX	Designed by Paul Checked by	
XP Solutions Source Control 2018.1		

Rainfall Details

Rainfall Model	FEH	Winter Storms	Yes
Return Period (years)	2	Cv (Summer)	0.750
FEH Rainfall Version	2013	Cv (Winter)	0.840
Site Location	GB 496538 104129	Shortest Storm (mins)	15
Data Type	Point	Longest Storm (mins)	10080
Summer Storms	Yes	Climate Change %	+0

Time Area Diagram

Total Area (ha) 0.022

Time (mins)		Area
From:	To:	(ha)
0	4	0.022

©1982-2018 Innovyze

KPT Properties		Page 4
19 Lonsdale Avenue Hutton Essex CM13 1NH		
Date 08/06/2018 12:12 File swale_50%.SRCX	Designed by Paul Checked by	
XP Solutions Source Control 2018.1		

Model Details

Storage is Online Cover Level (m) 9.300

Swale Structure

Infiltration Coefficient Base (m/hr)	0.00000	Length (m)	17.0
Infiltration Coefficient Side (m/hr)	0.00000	Side Slope (1:X)	3.0
Safety Factor	2.0	Slope (1:X)	200.0
Porosity	1.00	Cap Volume Depth (m)	0.000
Invert Level (m)	9.000	Cap Infiltration Depth (m)	0.000
Base Width (m)	0.3		

Orifice Outflow Control

Diameter (m) 0.050 Discharge Coefficient 0.600 Invert Level (m) 9.000

©1982-2018 Innovyze

KPT Properties						Page 1																																																																																																																																																																																																																																																																																		
19 Lonsdale Avenue Hutton Essex CM13 1NH																																																																																																																																																																																																																																																																																								
Date 08/06/2018 12:10 File swale_3.3%.SRCX			Designed by Paul Checked by																																																																																																																																																																																																																																																																																					
XP Solutions			Source Control 2018.1																																																																																																																																																																																																																																																																																					
<u>Summary of Results for 30 year Return Period</u> Half Drain Time : 10 minutes. <table><thead><tr><th>Storm Event</th><th>Max Level (m)</th><th>Max Depth (m)</th><th>Max Infiltration (1/s)</th><th>Max Control (1/s)</th><th>Max Σ Outflow (1/s)</th><th>Max Volume (m³)</th><th>Status</th></tr></thead><tbody><tr><td>15 min Summer</td><td>9.196</td><td>0.196</td><td>0.0</td><td>2.2</td><td>2.2</td><td>2.0</td><td>Flood Risk</td></tr><tr><td>30 min Summer</td><td>9.204</td><td>0.204</td><td>0.0</td><td>2.2</td><td>2.2</td><td>2.2</td><td>Flood Risk</td></tr><tr><td>60 min Summer</td><td>9.196</td><td>0.196</td><td>0.0</td><td>2.2</td><td>2.2</td><td>2.0</td><td>Flood Risk</td></tr><tr><td>120 min Summer</td><td>9.169</td><td>0.169</td><td>0.0</td><td>2.0</td><td>2.0</td><td>1.5</td><td>Flood Risk</td></tr><tr><td>180 min Summer</td><td>9.145</td><td>0.145</td><td>0.0</td><td>1.8</td><td>1.8</td><td>1.1</td><td>Flood Risk</td></tr><tr><td>240 min Summer</td><td>9.125</td><td>0.125</td><td>0.0</td><td>1.6</td><td>1.6</td><td>0.8</td><td>Flood Risk</td></tr><tr><td>360 min Summer</td><td>9.095</td><td>0.095</td><td>0.0</td><td>1.4</td><td>1.4</td><td>0.4</td><td>Flood Risk</td></tr><tr><td>480 min Summer</td><td>9.077</td><td>0.077</td><td>0.0</td><td>1.2</td><td>1.2</td><td>0.3</td><td>Flood Risk</td></tr><tr><td>600 min Summer</td><td>9.067</td><td>0.067</td><td>0.0</td><td>1.0</td><td>1.0</td><td>0.2</td><td>Flood Risk</td></tr><tr><td>720 min Summer</td><td>9.061</td><td>0.061</td><td>0.0</td><td>0.9</td><td>0.9</td><td>0.2</td><td>Flood Risk</td></tr><tr><td>960 min Summer</td><td>9.052</td><td>0.052</td><td>0.0</td><td>0.7</td><td>0.7</td><td>0.1</td><td>Flood Risk</td></tr><tr><td>1440 min Summer</td><td>9.043</td><td>0.043</td><td>0.0</td><td>0.5</td><td>0.5</td><td>0.1</td><td>Flood Risk</td></tr><tr><td>2160 min Summer</td><td>9.034</td><td>0.034</td><td>0.0</td><td>0.4</td><td>0.4</td><td>0.0</td><td>Flood Risk</td></tr><tr><td>2880 min Summer</td><td>9.030</td><td>0.030</td><td>0.0</td><td>0.3</td><td>0.3</td><td>0.0</td><td>Flood Risk</td></tr><tr><td>4320 min Summer</td><td>9.026</td><td>0.026</td><td>0.0</td><td>0.2</td><td>0.2</td><td>0.0</td><td>Flood Risk</td></tr><tr><td>5760 min Summer</td><td>9.024</td><td>0.024</td><td>0.0</td><td>0.2</td><td>0.2</td><td>0.0</td><td>Flood Risk</td></tr><tr><td>7200 min Summer</td><td>9.022</td><td>0.022</td><td>0.0</td><td>0.2</td><td>0.2</td><td>0.0</td><td>Flood Risk</td></tr><tr><td>8640 min Summer</td><td>9.021</td><td>0.021</td><td>0.0</td><td>0.1</td><td>0.1</td><td>0.0</td><td>Flood Risk</td></tr><tr><td>10080 min Summer</td><td>9.020</td><td>0.020</td><td>0.0</td><td>0.1</td><td>0.1</td><td>0.0</td><td>Flood Risk</td></tr><tr><td>15 min Winter</td><td>9.210</td><td>0.210</td><td>0.0</td><td>2.2</td><td>2.2</td><td>2.3</td><td>Flood Risk</td></tr></tbody></table> <table><thead><tr><th>Storm Event</th><th>Rain (mm/hr)</th><th>Flooded Volume (m³)</th><th>Discharge Volume (m³)</th><th>Time-Peak (mins)</th></tr></thead><tbody><tr><td>15 min Summer</td><td>80.362</td><td>0.0</td><td>3.3</td><td>14</td></tr><tr><td>30 min Summer</td><td>53.611</td><td>0.0</td><td>4.4</td><td>22</td></tr><tr><td>60 min Summer</td><td>34.116</td><td>0.0</td><td>5.6</td><td>40</td></tr><tr><td>120 min Summer</td><td>20.615</td><td>0.0</td><td>6.8</td><td>70</td></tr><tr><td>180 min Summer</td><td>15.218</td><td>0.0</td><td>7.5</td><td>102</td></tr><tr><td>240 min Summer</td><td>12.208</td><td>0.0</td><td>8.1</td><td>132</td></tr><tr><td>360 min Summer</td><td>8.870</td><td>0.0</td><td>8.8</td><td>190</td></tr><tr><td>480 min Summer</td><td>7.026</td><td>0.0</td><td>9.3</td><td>248</td></tr><tr><td>600 min Summer</td><td>5.851</td><td>0.0</td><td>9.7</td><td>306</td></tr><tr><td>720 min Summer</td><td>5.033</td><td>0.0</td><td>10.0</td><td>368</td></tr><tr><td>960 min Summer</td><td>3.963</td><td>0.0</td><td>10.5</td><td>488</td></tr><tr><td>1440 min Summer</td><td>2.832</td><td>0.0</td><td>11.2</td><td>730</td></tr><tr><td>2160 min Summer</td><td>2.040</td><td>0.0</td><td>12.1</td><td>1068</td></tr><tr><td>2880 min Summer</td><td>1.630</td><td>0.0</td><td>12.9</td><td>1464</td></tr><tr><td>4320 min Summer</td><td>1.210</td><td>0.0</td><td>14.4</td><td>2128</td></tr><tr><td>5760 min Summer</td><td>0.993</td><td>0.0</td><td>15.7</td><td>2936</td></tr><tr><td>7200 min Summer</td><td>0.862</td><td>0.0</td><td>17.1</td><td>3608</td></tr><tr><td>8640 min Summer</td><td>0.774</td><td>0.0</td><td>18.4</td><td>4256</td></tr><tr><td>10080 min Summer</td><td>0.710</td><td>0.0</td><td>19.7</td><td>4984</td></tr><tr><td>15 min Winter</td><td>80.362</td><td>0.0</td><td>3.7</td><td>14</td></tr></tbody></table>								Storm Event	Max Level (m)	Max Depth (m)	Max Infiltration (1/s)	Max Control (1/s)	Max Σ Outflow (1/s)	Max Volume (m³)	Status	15 min Summer	9.196	0.196	0.0	2.2	2.2	2.0	Flood Risk	30 min Summer	9.204	0.204	0.0	2.2	2.2	2.2	Flood Risk	60 min Summer	9.196	0.196	0.0	2.2	2.2	2.0	Flood Risk	120 min Summer	9.169	0.169	0.0	2.0	2.0	1.5	Flood Risk	180 min Summer	9.145	0.145	0.0	1.8	1.8	1.1	Flood Risk	240 min Summer	9.125	0.125	0.0	1.6	1.6	0.8	Flood Risk	360 min Summer	9.095	0.095	0.0	1.4	1.4	0.4	Flood Risk	480 min Summer	9.077	0.077	0.0	1.2	1.2	0.3	Flood Risk	600 min Summer	9.067	0.067	0.0	1.0	1.0	0.2	Flood Risk	720 min Summer	9.061	0.061	0.0	0.9	0.9	0.2	Flood Risk	960 min Summer	9.052	0.052	0.0	0.7	0.7	0.1	Flood Risk	1440 min Summer	9.043	0.043	0.0	0.5	0.5	0.1	Flood Risk	2160 min Summer	9.034	0.034	0.0	0.4	0.4	0.0	Flood Risk	2880 min Summer	9.030	0.030	0.0	0.3	0.3	0.0	Flood Risk	4320 min Summer	9.026	0.026	0.0	0.2	0.2	0.0	Flood Risk	5760 min Summer	9.024	0.024	0.0	0.2	0.2	0.0	Flood Risk	7200 min Summer	9.022	0.022	0.0	0.2	0.2	0.0	Flood Risk	8640 min Summer	9.021	0.021	0.0	0.1	0.1	0.0	Flood Risk	10080 min Summer	9.020	0.020	0.0	0.1	0.1	0.0	Flood Risk	15 min Winter	9.210	0.210	0.0	2.2	2.2	2.3	Flood Risk	Storm Event	Rain (mm/hr)	Flooded Volume (m³)	Discharge Volume (m³)	Time-Peak (mins)	15 min Summer	80.362	0.0	3.3	14	30 min Summer	53.611	0.0	4.4	22	60 min Summer	34.116	0.0	5.6	40	120 min Summer	20.615	0.0	6.8	70	180 min Summer	15.218	0.0	7.5	102	240 min Summer	12.208	0.0	8.1	132	360 min Summer	8.870	0.0	8.8	190	480 min Summer	7.026	0.0	9.3	248	600 min Summer	5.851	0.0	9.7	306	720 min Summer	5.033	0.0	10.0	368	960 min Summer	3.963	0.0	10.5	488	1440 min Summer	2.832	0.0	11.2	730	2160 min Summer	2.040	0.0	12.1	1068	2880 min Summer	1.630	0.0	12.9	1464	4320 min Summer	1.210	0.0	14.4	2128	5760 min Summer	0.993	0.0	15.7	2936	7200 min Summer	0.862	0.0	17.1	3608	8640 min Summer	0.774	0.0	18.4	4256	10080 min Summer	0.710	0.0	19.7	4984	15 min Winter	80.362	0.0	3.7	14
Storm Event	Max Level (m)	Max Depth (m)	Max Infiltration (1/s)	Max Control (1/s)	Max Σ Outflow (1/s)	Max Volume (m³)	Status																																																																																																																																																																																																																																																																																	
15 min Summer	9.196	0.196	0.0	2.2	2.2	2.0	Flood Risk																																																																																																																																																																																																																																																																																	
30 min Summer	9.204	0.204	0.0	2.2	2.2	2.2	Flood Risk																																																																																																																																																																																																																																																																																	
60 min Summer	9.196	0.196	0.0	2.2	2.2	2.0	Flood Risk																																																																																																																																																																																																																																																																																	
120 min Summer	9.169	0.169	0.0	2.0	2.0	1.5	Flood Risk																																																																																																																																																																																																																																																																																	
180 min Summer	9.145	0.145	0.0	1.8	1.8	1.1	Flood Risk																																																																																																																																																																																																																																																																																	
240 min Summer	9.125	0.125	0.0	1.6	1.6	0.8	Flood Risk																																																																																																																																																																																																																																																																																	
360 min Summer	9.095	0.095	0.0	1.4	1.4	0.4	Flood Risk																																																																																																																																																																																																																																																																																	
480 min Summer	9.077	0.077	0.0	1.2	1.2	0.3	Flood Risk																																																																																																																																																																																																																																																																																	
600 min Summer	9.067	0.067	0.0	1.0	1.0	0.2	Flood Risk																																																																																																																																																																																																																																																																																	
720 min Summer	9.061	0.061	0.0	0.9	0.9	0.2	Flood Risk																																																																																																																																																																																																																																																																																	
960 min Summer	9.052	0.052	0.0	0.7	0.7	0.1	Flood Risk																																																																																																																																																																																																																																																																																	
1440 min Summer	9.043	0.043	0.0	0.5	0.5	0.1	Flood Risk																																																																																																																																																																																																																																																																																	
2160 min Summer	9.034	0.034	0.0	0.4	0.4	0.0	Flood Risk																																																																																																																																																																																																																																																																																	
2880 min Summer	9.030	0.030	0.0	0.3	0.3	0.0	Flood Risk																																																																																																																																																																																																																																																																																	
4320 min Summer	9.026	0.026	0.0	0.2	0.2	0.0	Flood Risk																																																																																																																																																																																																																																																																																	
5760 min Summer	9.024	0.024	0.0	0.2	0.2	0.0	Flood Risk																																																																																																																																																																																																																																																																																	
7200 min Summer	9.022	0.022	0.0	0.2	0.2	0.0	Flood Risk																																																																																																																																																																																																																																																																																	
8640 min Summer	9.021	0.021	0.0	0.1	0.1	0.0	Flood Risk																																																																																																																																																																																																																																																																																	
10080 min Summer	9.020	0.020	0.0	0.1	0.1	0.0	Flood Risk																																																																																																																																																																																																																																																																																	
15 min Winter	9.210	0.210	0.0	2.2	2.2	2.3	Flood Risk																																																																																																																																																																																																																																																																																	
Storm Event	Rain (mm/hr)	Flooded Volume (m³)	Discharge Volume (m³)	Time-Peak (mins)																																																																																																																																																																																																																																																																																				
15 min Summer	80.362	0.0	3.3	14																																																																																																																																																																																																																																																																																				
30 min Summer	53.611	0.0	4.4	22																																																																																																																																																																																																																																																																																				
60 min Summer	34.116	0.0	5.6	40																																																																																																																																																																																																																																																																																				
120 min Summer	20.615	0.0	6.8	70																																																																																																																																																																																																																																																																																				
180 min Summer	15.218	0.0	7.5	102																																																																																																																																																																																																																																																																																				
240 min Summer	12.208	0.0	8.1	132																																																																																																																																																																																																																																																																																				
360 min Summer	8.870	0.0	8.8	190																																																																																																																																																																																																																																																																																				
480 min Summer	7.026	0.0	9.3	248																																																																																																																																																																																																																																																																																				
600 min Summer	5.851	0.0	9.7	306																																																																																																																																																																																																																																																																																				
720 min Summer	5.033	0.0	10.0	368																																																																																																																																																																																																																																																																																				
960 min Summer	3.963	0.0	10.5	488																																																																																																																																																																																																																																																																																				
1440 min Summer	2.832	0.0	11.2	730																																																																																																																																																																																																																																																																																				
2160 min Summer	2.040	0.0	12.1	1068																																																																																																																																																																																																																																																																																				
2880 min Summer	1.630	0.0	12.9	1464																																																																																																																																																																																																																																																																																				
4320 min Summer	1.210	0.0	14.4	2128																																																																																																																																																																																																																																																																																				
5760 min Summer	0.993	0.0	15.7	2936																																																																																																																																																																																																																																																																																				
7200 min Summer	0.862	0.0	17.1	3608																																																																																																																																																																																																																																																																																				
8640 min Summer	0.774	0.0	18.4	4256																																																																																																																																																																																																																																																																																				
10080 min Summer	0.710	0.0	19.7	4984																																																																																																																																																																																																																																																																																				
15 min Winter	80.362	0.0	3.7	14																																																																																																																																																																																																																																																																																				
©1982-2018 Innovyze																																																																																																																																																																																																																																																																																								

KPT Properties							Page 2
19 Lonsdale Avenue Hutton Essex CM13 1NH							
Date 08/06/2018 12:10 File swale_3.3%.SRCX				Designed by Paul Checked by			
XP Solutions				Source Control 2018.1			
<u>Summary of Results for 30 year Return Period</u>							
Storm Event	Max Level (m)	Max Depth (m)	Max Infiltration (l/s)	Max Control (l/s)	Max Σ Outflow (l/s)	Max Volume (m³)	Status
30 min Winter	9.216	0.216	0.0	2.3	2.3	2.5	Flood Risk
60 min Winter	9.202	0.202	0.0	2.2	2.2	2.1	Flood Risk
120 min Winter	9.161	0.161	0.0	1.9	1.9	1.3	Flood Risk
180 min Winter	9.127	0.127	0.0	1.7	1.7	0.8	Flood Risk
240 min Winter	9.102	0.102	0.0	1.5	1.5	0.5	Flood Risk
360 min Winter	9.072	0.072	0.0	1.1	1.1	0.2	Flood Risk
480 min Winter	9.061	0.061	0.0	0.9	0.9	0.2	Flood Risk
600 min Winter	9.055	0.055	0.0	0.8	0.8	0.1	Flood Risk
720 min Winter	9.050	0.050	0.0	0.7	0.7	0.1	Flood Risk
960 min Winter	9.043	0.043	0.0	0.5	0.5	0.1	Flood Risk
1440 min Winter	9.035	0.035	0.0	0.4	0.4	0.0	Flood Risk
2160 min Winter	9.028	0.028	0.0	0.3	0.3	0.0	Flood Risk
2880 min Winter	9.026	0.026	0.0	0.2	0.2	0.0	Flood Risk
4320 min Winter	9.022	0.022	0.0	0.2	0.2	0.0	Flood Risk
5760 min Winter	9.020	0.020	0.0	0.1	0.1	0.0	Flood Risk
7200 min Winter	9.019	0.019	0.0	0.1	0.1	0.0	Flood Risk
8640 min Winter	9.018	0.018	0.0	0.1	0.1	0.0	Flood Risk
10080 min Winter	9.017	0.017	0.0	0.1	0.1	0.0	Flood Risk
Storm Event	Rain (mm/hr)	Flooded Volume (m³)	Discharge Volume (m³)	Time-Peak (mins)			
30 min Winter	53.611	0.0	5.0	24			
60 min Winter	34.116	0.0	6.3	42			
120 min Winter	20.615	0.0	7.6	74			
180 min Winter	15.218	0.0	8.4	104			
240 min Winter	12.208	0.0	9.0	132			
360 min Winter	8.870	0.0	9.8	188			
480 min Winter	7.026	0.0	10.4	248			
600 min Winter	5.851	0.0	10.8	306			
720 min Winter	5.033	0.0	11.2	366			
960 min Winter	3.963	0.0	11.7	484			
1440 min Winter	2.832	0.0	12.6	728			
2160 min Winter	2.040	0.0	13.6	1100			
2880 min Winter	1.630	0.0	14.5	1464			
4320 min Winter	1.210	0.0	16.1	2164			
5760 min Winter	0.993	0.0	17.6	2792			
7200 min Winter	0.862	0.0	19.1	3592			
8640 min Winter	0.774	0.0	20.6	4304			
10080 min Winter	0.710	0.0	22.0	5096			
©1982-2018 Innovyze							

KPT Properties		Page 3
19 Lonsdale Avenue Hutton Essex CM13 1NH		
Date 08/06/2018 12:10 File swale_3.3%.SRCX	Designed by Paul Checked by	
XP Solutions Source Control 2018.1		

Rainfall Details

Rainfall Model	FEH	Winter Storms	Yes
Return Period (years)	30	Cv (Summer)	0.750
FEH Rainfall Version	2013	Cv (Winter)	0.840
Site Location	GB 496538 104129	Shortest Storm (mins)	15
Data Type	Point	Longest Storm (mins)	10080
Summer Storms	Yes	Climate Change %	+0

Time Area Diagram

Total Area (ha) 0.022

Time (mins)		Area
From:	To:	(ha)
0	4	0.022

©1982-2018 Innovyze

KPT Properties		Page 4
19 Lonsdale Avenue Hutton Essex CM13 1NH		
Date 08/06/2018 12:10 File swale_3.3%.SRCX	Designed by Paul Checked by	
XP Solutions Source Control 2018.1		

Model Details

Storage is Online Cover Level (m) 9.300

Swale Structure

Infiltration Coefficient Base (m/hr) 0.00000	Length (m) 17.0
Infiltration Coefficient Side (m/hr) 0.00000	Side Slope (1:X) 3.0
Safety Factor 2.0	Slope (1:X) 200.0
Porosity 1.00	Cap Volume Depth (m) 0.000
Invert Level (m) 9.000	Cap Infiltration Depth (m) 0.000
Base Width (m) 0.3	

Orifice Outflow Control

Diameter (m) 0.050 Discharge Coefficient 0.600 Invert Level (m) 9.000

©1982-2018 Innovyze

