

Appendix D Sewer Asset Map Data

Order received: 1 November 2021
Order completed: 11 November 2021

Drainage and water enquiry

Residential

Order reference: LS/U1638972

Your reference: 49 Warren Way


Search address:

49 Warren Way
Bognor Regis
West Sussex
PO22 0JX

Ordered by:

Sohan Ghimire
49 Warren Way
Dartford
Kent
DA1 2NL

For enquiries regarding the information provided in this report, please contact the LandSearch team:



LandSearch
Southern Water Services
Southern House
Capstone Road
Chatham
Kent
ME5 7QA

Web: www.southernwater.co.uk

Private sewer transfer

For further information please visit our website: www.southernwater.co.uk/sewer-ownership-changes.

The following records were searched in compiling this report: the Map of Public Sewers, the Map of Waterworks, water and sewerage billing records, the Register of Properties subject to Internal Foul Flooding, the Register of Properties subject to Poor Water Pressure and the Drinking Water Register. Should the property not fall entirely within Southern Water's region, a copy of the records held by the relevant water company was searched.

All customers

There can be a lot to do and remember when you're moving home. Our online forms make it easy for you to let us know about your move. Whether you are moving within our area, moving into our area or moving out of the area, please let us know by visiting: www.southernwater.co.uk/moving-house.

Wastewater-only customers

Your water might be supplied by a separate company. If so, you'll only receive a wastewater bill from us. If your water is not supplied by Southern Water, you can find out how to contact your water company by visiting our website: www.southernwater.co.uk/wastewater-only-customers.



Your order summary

Maps		
1.1	Where relevant, please include a copy of an extract from the public sewer map.	Map provided
1.2	Where relevant, please include a copy of an extract from the map of waterworks	Map provided
Drainage		
2.1	Does foul water from the property drain to a public sewer?	Yes
2.2	Does surface water from the property drain to a public sewer?	Yes
2.3	Is a surface water drainage charge payable?	Yes
2.4	Does the public sewer map indicate any public sewer, disposal main or lateral drain within the boundaries of the property?	No
2.4.1	Does the public sewer map indicate any public pumping station or any other ancillary apparatus within the boundaries of the property?	No
2.5	Does the public sewer map indicate any public sewer within 30.48 metres (100 feet) of any buildings within the property?	Yes
2.5.1	Does the public sewer map indicate any public pumping station or any other ancillary apparatus within 50 metres of any buildings within the property?	No
2.6	Are any sewers or lateral drains serving, or which are proposed to serve the property, the subject of an existing adoption agreement or an application for such an agreement?	No
2.7	Has any sewerage undertaker approved or been consulted about any plans to erect a building or extension on the property over or in the vicinity of a public sewer, disposal main or drain?	No
2.8	Is the building which is or forms part of the property at risk of internal flooding due to overloaded public sewers?	No
2.9	Please state the distance from the property to the nearest boundary of the nearest sewage treatment works.	See answer
Water		
3.1	Is the property connected to mains water supply?	Yes
3.2	Are there any water mains, resource mains or discharge pipes within the boundaries of the property?	No
3.3	Is any water main or service pipe serving, or which is proposed to serve the property, the subject of an existing adoption agreement or an application for such an agreement?	No
3.4	Is the property at risk of receiving low water pressure or flow?	No
3.5	What is the classification of the water supply for the property?	See answer
3.6	Please include details of the location of any water meter serving the property.	See answer
Charging		
4.1.1	Who is responsible for providing the sewerage services for the property?	Southern Water
4.1.2	Who is responsible for providing the water services for the property?	Portsmouth Water
4.2	Who bills the property for sewerage services?	Southern Water
4.3	Who bills the property for water services?	Portsmouth Water
4.4	What is the current basis for charging for sewerage and/or water services at the property?	Rateable value
4.5	Will the basis for charging for sewerage and water services at the property change as a consequence of change of occupation?	See answer

Maps

Public sewer map

Q. 1.1: Where relevant, please include a copy of an extract from the public sewer map.

A.: A copy of an extract from the public sewer map is included in which the location of the property is identified.

Guidance Notes:

The Water Industry Act 1991 defines public sewers as those which the Company has responsibility for. Other assets and rivers, watercourses, ponds, culverts or highway drains may be shown for information purpose only.

Any private sewers or lateral drains which are indicated on the extract of the public sewer map as being subject to an agreement under Section 104 of the Water Industry Act 1991 are not an "as constructed" record. It is recommended these details be checked with the developer.

Map of waterworks

Q. 1.2: Where relevant, please include a copy of an extract from the map of waterworks.

A.: A copy of an extract from the map of waterworks is included in which the location of the property is identified.

Guidance Notes:

The "water mains" in this context are those which are vested in and maintainable by the water company under statute.

Assets other than public water mains may be shown on the plan for information only.

Water companies are not responsible for the private supply pipes connecting the property to the public water main and do not hold details of these. These may pass through land outside of the control of the seller, or may be shared with adjacent properties. The buyer may wish to investigate whether separate rights or easements are needed for their inspection, repair or renewal.

The copy extract will show known public water mains in the vicinity of the property. It should be possible to estimate the likely length and route of any private water supply pipe connecting the property to the public water network.

Drainage

Foul water

Q. 2.1: Does foul water from the property drain to a public sewer?

A.: Records indicate that foul water from the property drains to a public sewer.

Guidance Notes:

Water companies are not normally responsible for any private drains and sewers which connect the property to the public sewerage system, and do not hold details of these.

The property owner will normally have sole responsibility for private drains serving the property and may have shared responsibility, with other users, if the property is served by a private sewer which also serves other properties. These may pass through land outside of the control of the seller and the buyer may wish to investigate whether separate rights or easements are needed for their inspection, repair or renewal.

The copy extract will show known public sewers in the vicinity of the property. It should be possible to estimate the likely length and route of any private drains and/or sewers connecting the property to the public sewerage system.

If foul water does not drain to the public sewerage system the property may have private facilities in the form of a cesspit, septic tank or other type of treatment plant.

The connection status of the property may have been determined by reference to billing records.

Surface water

Q. 2.2: Does surface water from the property drain to a public sewer?

A.: Records indicate that surface water from the property drains to a public sewer.

Guidance Notes:

Water companies are not normally responsible for private drains and sewers that connect the property to the public sewerage system and do not hold details of these.

The property owner will normally have sole responsibility for private drains serving the property and may have shared responsibility, with other users, if the property is served by a private sewer which also serves other properties. These may pass through land outside of the control of the seller and the buyer may wish to investigate whether separate rights or easements are needed for their inspection, repair or renewal.

In some cases water company records do not distinguish between foul and surface water connections to the public sewerage system. If on inspection the buyer finds that the property is not connected for surface water drainage, the property may be eligible for a rebate of the surface water drainage charge. Details can be obtained from the Company.

The copy extract will show known public sewers in the vicinity of the property. It should be possible to estimate the likely length and route of any private drains and/or sewers connecting the property to the public sewerage system.

If surface water does not drain to the public sewerage system the property may have private facilities in the form of a soakaway or private connection to a watercourse.

The connection status of the property may have been determined by reference to billing records.

Surface water drainage charge

Q. 2.3: Is a surface water drainage charge payable?

A.: Records confirm that a surface water drainage charge is payable for the property at £21.08 for each financial year.

Guidance Notes:

Where surface water from a property does not drain to the public sewerage system no surface water drainage charges are payable.

Where surface water drainage charges are payable but if on inspection the buyer finds that the property is not connected for surface water drainage, the property may be eligible for rebate of the surface water drainage charge. Details can be obtained from the Company.

Public sewers within the boundary of the property

Q. 2.4: Does the public sewer map indicate any public sewer, disposal main or lateral drain within the boundaries of the property?

A.: The public sewer map indicates that there are no public sewers, disposal mains or lateral drains within the boundaries of the property. However, from 1 October 2011 there may be additional public sewers, disposal mains or lateral drains which are not recorded on the public sewer map but which may further prevent or restrict development of the property. It is therefore recommended that investigations are made into the drainage arrangements of the property as the owner may be liable for repairs to the drainage system.

Guidance Notes:

The approximate boundary of the property has been determined by reference to the Ordnance Survey record or the map supplied.

The presence of a public sewer within the boundary of the property may restrict further development within it.

Southern Water Services has a statutory right of access to carry out work on their assets, subject to notice. This may result in employees of Southern Water Services or its contractors needing to enter the property to carry out work.

Please note if the property was constructed after 1 July 2011 any sewers and/or lateral drain within the boundary of the property are the responsibility of the householder.

Public pumping station within the boundary of the property

Q. 2.4.1: Does the public sewer map indicate any public pumping station or any other ancillary apparatus within the boundaries of the property?

A.: The public sewer map included indicates that there is no public pumping station within the boundaries of the property. Any other ancillary apparatus is shown on the public sewer map and referenced on the legend.

Guidance Notes:

The approximate boundary of the property has been determined by reference to the Ordnance Survey record or the map supplied.

The presence of a pumping station within the boundary of the property may restrict further development within it.

Southern Water Services has a statutory right of access to carry out work on their assets, subject to notice. This may result in employees of Southern Water Services or its contractors needing to enter the property to carry out work.

It should be noted that only private pumping stations installed before 1 July 2011 will be transferred into the ownership of Southern Water Services.

Public sewers near to the property

Q. 2.5: Does the public sewer map indicate any public sewer within 30.48 metres (100 feet) of any buildings within the property?

A.: The public sewer map included indicates that there is a public sewer within 30.48 metres (100 feet) of a building within the property.

Guidance Notes:

From 1 October 2011 there may be additional lateral drains and/or public sewers which are not recorded on the public sewer map but are also within 30.48 metres (100 feet) of a building within the property.

The presence of a public sewer within 30.48 metres (100 feet) of a building within the property can result in the local authority requiring a property to be connected to the public sewer.

The measure is estimated from the Ordnance Survey record, between a building within the boundary of the property and the nearest public sewer.

Public pumping station near to the property

Q. 2.5.1: Does the public sewer map indicate any public pumping station or any other ancillary apparatus within 50 metres of any buildings within the property?

A.: The public sewer map included indicates that there is no public pumping station within 50 metres of any buildings within the property. Any other ancillary apparatus is shown on the public sewer map and referenced on the legend.

Guidance Notes:

The measure is estimated from the Ordnance Survey record, between a building within the boundary of the property and the nearest pumping station.

It should be noted that only private pumping stations installed before 1 July 2011 will be transferred into the ownership of Southern Water Services.

Public adoption of sewers and lateral drains

Q. 2.6: Are any sewers or lateral drains serving, or which are proposed to serve the property, the subject of an existing adoption agreement or an application for such an agreement?

A.: Records indicate that the sewers serving the development, of which this property forms part, are not the subject of an application for adoption under Section 104 of the Water Industry Act 1991. Where the property is part of an established development it would not normally be subject to an adoption agreement under Section 104 of the Water Industry Act 1991.

Guidance Notes:

This enquiry is of interest to purchasers of new homes who will want to know whether or not the property will be linked to a public sewer.

Where the property is part of a very recent or ongoing development and the sewers are not the subject of an adoption application, buyers should consult with the developer to ascertain the extent of private drains and sewers for which they will hold maintenance and renewal liabilities.

Final adoption is subject to the developer complying with the terms of the adoption agreement under Section 104 of the Water Industry Act 1991.

Any sewers and/or lateral drains within the boundary of the property are not the subject of an adoption agreement and remain the responsibility of the householder. Adoptable sewers are normally those situated in the public highway.

Building over a public sewer, disposal main or drain

Q. 2.7: Has the sewerage undertaker approved or been consulted about any plans to erect a building or extension on the property over or in the vicinity of a public sewer, disposal main or drain?

A.: There are no records in relation to any approval or consultation about any plans to erect a building or extension on the property over or in the vicinity of a public sewer, disposal main or drain. However, the sewerage undertaker might not be aware of a building or extension on the property over or in the vicinity of a public sewer, disposal main or drain.

Guidance Notes:

Buildings or extensions erected over a sewer in contravention of Building Control may have to be removed or altered.

From 1 October 2011 private sewers, disposal mains and lateral drains were transferred into public ownership and the sewerage undertaker may not have approved or been consulted about any plans to erect a building or extension on the property or in the vicinity of these.

Risk of flooding due to overloading public sewers

Q. 2.8: Is the building which is or forms part of the property at risk of internal flooding due to overloaded public sewers?

A.: The building is not recorded as being at risk of internal flooding due to overloaded public sewers. From 1 October 2011 private sewers, disposal mains and lateral drains were transferred into public ownership. It is therefore possible that a building may be at risk of internal flooding due to an overloaded public sewer which the sewerage undertaker is not aware of. For further information it is recommended that enquiries are made of the vendor.

Guidance Notes:

A sewer is "overloaded" when the flow from a storm is unable to pass through it due to a permanent problem (e.g. flat gradient, small diameter). Flooding as a result of temporary problems such as blockages, siltation, collapses and equipment or operational failures are excluded.

"Internal flooding" from the public sewers is defined as flooding, which enters a building or passes below a suspended floor.

For reporting purposes, buildings are restricted to those normally occupied and used for residential, public, commercial, business or industrial purposes.

"At Risk" buildings are defined as buildings that have suffered or are likely to suffer internal flooding from the public foul, combined or surface water sewers due to overloading of the sewerage system more frequently than the relevant reference period (either once or twice in ten years) as determined by the sewerage undertaker's reporting procedure.

Flooding as a result of storm events proven to be exceptional and beyond the reference period of one in ten years are not included.

Buildings may be at risk of flooding but not identified where flooding incidents have not been reported to the sewerage undertaker.

Public sewers are defined as those for which the sewerage undertaker holds statutory responsibility under the Water Industry Act 1991.

It should be noted that flooding can occur from private sewers and drains which are not the responsibility of the sewerage undertaker. This report excludes flooding from the private sewers and drains and the sewerage undertaker makes no comment upon this matter.

Sewage treatment works

Q. 2.9: Please state the distance from the property to the nearest boundary of the nearest sewage treatment works.

A.: The nearest sewage treatment works is 1.94 kilometres South West of the property. The name of the sewage treatment works is LIDSEY WTW, which is the responsibility of Southern Water Services, Southern House, Yeoman Road, Worthing, West Sussex, BN13 3NX.

Guidance Notes:

The nearest sewage treatment works will not always be the sewage treatment works serving the catchment within which the property is situated.

The sewerage undertaker's records were inspected to determine the nearest sewage treatment works.

It should be noted that there may be a private sewage treatment works closer than the one detailed above that have not been identified.

Water

Connection to mains water supply

Q. 3.1: Is the property connected to mains water supply?

A.: Records indicate that the property is connected to mains water supply.

Guidance Notes:

The situation should be checked with the current owner of the property.

The connection status of the property may have been determined by reference to billing records.

Details of private supplies are not kept by the water undertaker.

Water mains, resource mains or discharge pipes

Q. 3.2: Are there any water mains, resource mains or discharge pipes within the boundaries of the property?

A.: The map of waterworks is provided by Portsmouth Water whose records do not indicate any water mains, resource mains or discharge pipes within the boundaries of the property.

Guidance Notes:

The boundary of the property has been determined by reference to the Ordnance Survey record or the map supplied.

The presence of a public water main within the boundary of the property may restrict further development within it.

Water undertakers have a statutory right of access to carry out work on their assets, subject to notice. This may result in employees of the water undertaker or its contractors needing to enter the property to carry out work.

Adoption of water mains and services pipes

Q. 3.3: Is any water main or service pipe serving, or which is proposed to serve the property, the subject of an existing adoption agreement or an application for such an agreement?

A.: Records confirm that water mains or service pipes serving the property are not the subject of an existing adoption agreement or an application for such an agreement.

Guidance Notes:

This enquiry is of interest to purchasers of new homes who will want to know whether or not the property will be linked to the mains water supply.

Risk of low water pressure or flow

Q. 3.4: Is the property at risk of receiving low water pressure or flow?

A.: Records confirm that the property is not recorded on a register kept by the water undertaker as being at risk of receiving low water pressure or flow.

Guidance Notes:

"Low water pressure" means water pressure below the regulatory reference level which is the minimum pressure when demand on the system is not abnormal.

The reference level of service is a flow of 9 litres/minute at a pressure of 10 metres head on the customer's side of the main stop tap (mst). The reference level of service must be applied on the customer's side of a meter or any other company fittings that are on the customer's side of the main stop tap.

The reference level applies to a single property. Where more than one property is served by a common service pipe, the flow assumed in the reference level must be appropriately increased to take account of the total number of properties served.

For two properties, a flow of 18 litres/minute at a pressure of 10 metres head on the customers' side of the mst is appropriate. For three or more properties the appropriate flow should be calculated from the standard loadings provided in BS6700 or Institute of Plumbing handbook.

Water companies include properties receiving pressure below the reference level, provided that allowable exclusions do not apply (i.e. events which can cause pressure to temporarily fall below the reference level). Refer to list below:

Abnormal demand: This exclusion is intended to cover abnormal peaks in demand and not the daily, weekly or monthly peaks in demand which are normally expected. Companies exclude properties which are affected by low pressure only on those days with the highest peak demands. During the year companies may exclude, for each property, up to five days of low pressure caused by peak demand.

Planned maintenance: Companies exclude low pressures caused by planned maintenance. It is not intended that companies identify the number of properties affected in each instance. However, companies must maintain sufficiently accurate records to verify that low pressure incidents that are excluded because of planned maintenance are actually caused by maintenance.

One-off incidents: This exclusion covers a number of causes of low pressure; mains bursts; failures of company equipment (such as PRVs or booster pumps); firefighting; and action by a third party. However, if problems of this type affect a property frequently, they cannot be classed as one-off events and further investigation will be required before they can be excluded.

Low pressure incidents of short duration: Properties affected by low pressures which only occur for a short period, and for which there is evidence that incidents of a longer duration would not occur during the course of the year, may be excluded.

Water hardness

Q. 3.5: What is the classification of the water supply for the property?

A.: The water supplied to the property has an average water hardness of 295 mg/l calcium carbonate which is defined as "not defined" by Portsmouth Water.

Guidance Notes:

The hardness of water depends on the amount of calcium in it – the more it contains, the harder the water is.

There is no UK or European standard set for the hardness of drinking water. More information on water hardness can be found on the Drinking Water Inspectorates' website: <http://www.dwi.gov.uk/>

Water hardness can be expressed in various indices for example the hardness settings for dishwashers are commonly expressed in Clark's degrees, but check with the manufacturer as there are also other units. The following table explains how to convert mg/l calcium and mg/l calcium carbonate classifications.

To convert from:	to Clark degrees	to French degrees	to German degrees
mg/l calcium	multiply by 0.18	multiply by 0.25	multiply by 0.14
mg/l calcium carbonate	multiply by 0.07	multiply by 0.10	multiply by 0.056

Water meters

Q. 3.6: Please include details of the location of any water meter serving the property.

A.: Records indicate that the property is not served by a water meter.

Guidance Notes:

Where the property is not served by a water meter and the customer wishes to consider this method of charging they should contact the water undertaker for their area.

If a property is measured (metered) upon change of occupation this property will remain as a metered property.

Charging

Sewerage undertakers

Q. 4.1.1: Who is responsible for providing the sewerage services for the property?

A.: Southern Water is responsible for providing the sewerage services for the property.

Water undertakers

Q. 4.1.2: Who is responsible for providing the water services for the property?


A.: Portsmouth Water is responsible for providing the water services for the property.

Sewerage bills

Q. 4.2: Who bills the property for sewerage services?

A.: The property is billed for sewerage services by:

Southern Water Services Ltd
Southern House
Yeoman Road
Worthing
West Sussex
BN13 3NX



Water bills

Q. 4.3: Who bills the property for water services?

A.: The property is billed for water services by:

Portsmouth Water
PO Box 8
West Street
Havant
Hampshire
PO9 1LG



Current basis for sewerage and water charges

Q. 4.4: What is the current basis for charging for sewerage and/or water services at the property?

A.: The charges are based on the rateable value of the property of 148 and the charge for the current financial year 

Guidance Notes:

The water undertaker may install a meter at the premises where a buyer makes a change of use of the property or where the buyer uses water: for watering the garden other than by hand (this includes the use of sprinklers); for automatically replenishing a pond or swimming pool with a capacity greater than 10,000 litres; in a bath with a capacity in excess of 230 litres; in a power shower.

If a property is measured (metered) upon change of occupation this property will remain as a metered property.

Where the property is not served by a water meter and the customer wishes to consider this method of charging they should contact the water undertaker for their area.

Water and sewerage undertakers' full charges are set out in their charges schemes which are available from the companies free of charge upon request.

The Water Industry Act 1991 Section 150, The Water Resale Order 2001, provides protection for people who buy their water and sewerage services from a person or company instead of directly from a water or sewerage company. Details are available from the Office of Water Services (Ofwat) website: www.ofwat.gov.uk.

Charges following change of occupation

Q. 4.5: Will the basis for charging for sewerage and water services at the property change as a consequence of a change of occupation?

A.: The basis for the charges will change and will be based on a metered supply.

Guidance Notes:

Water and sewerage undertakers' full charges are set out in their charges schemes which are available from the relevant undertaker free of charge upon request.

It is Southern Water's policy to meter all new water connections which would result in charges being levied according to the measured tariff.

If a property is measured (metered) upon change of occupation this property will remain as a metered property.

Where the property is not served by a water meter and the customer wishes to consider this method of charging they should contact the water undertaker for their area.

The water undertaker may install a meter at the premises where a buyer makes a change of use of the property or where the buyer uses water: for watering the garden other than by hand (this includes the use of sprinklers); for automatically replenishing a pond or swimming pool with a capacity greater than 10,000 litres; in a bath with a capacity in excess of 230 litres; in a power shower.

Appendix one: Terms and expressions

"the 1991 Act" means the Water Industry Act 1991(i);

"the 2000 Regulations" means the Water Supply (Water Quality) Regulations 2000(ii);

"the 2001 Regulations" means the Water Supply (Water Quality) Regulations 2001(iii);

"adoption agreement" means an agreement made or to be made under Section 51A (1) or 104(1) of the 1991 Act (iv);

"bond" means a surety granted by a developer who is a party to an adoption agreement;

"bond waiver" means an agreement with a developer for the provision of a form of financial security as a substitute for a bond;

"calendar year" means the twelve months ending with 31 December;

"discharge pipe" means a pipe from which discharges are made or are to be made under Section 165(1) of the 1991 Act;

"disposal main" means (subject to Section 219(2) of the 1991 Act) any outfall pipe or other pipe which:

- (a) Is a pipe for the conveyance of effluent to or from any sewage disposal works, whether of a sewerage undertaker or of any other person; and
- (b) is not a public sewer;

"drain" means (subject to Section 219(2) of the 1991 Act) a drain used for the drainage of one building or any buildings or yards appurtenant to buildings within the same curtilage;

"effluent" means any liquid, including particles of matter and other substances in suspension in the liquid;

"financial year" means the twelve months ending with 31 March;

"lateral drain" means:

- (a) That part of a drain which runs from the curtilage of a building (or buildings or yards within the same curtilage) to the sewer with which the drain communicates or is to communicate; or
- (b) (if different and the context so requires) the part of a drain identified in a declaration of vesting made under Section 102 of the 1991 Act or in an agreement made under Section 104 of that Act(v);

"licensed water supplier" means a company which is the holder for the time being of a water supply licence under Section 17A(1) of the 1991 Act(vi);

"maintenance period" means the period so specified in an adoption agreement as a period of time:

- (a) From the date of issue of a certificate by a sewerage undertaker to the effect that a developer has built (or substantially built) a private sewer or lateral drain to that undertaker's satisfaction; and
- (b) Until the date that private sewer or lateral drain is vested in the sewerage undertaker;

"map of waterworks" means the map made available under section 198(3) of the 1991 Act(vii) in relation to the information specified in subsection (1A);

"private sewer" means a pipe or pipes which drain foul or surface water, or both, from premises, and are not vested in a sewerage undertaker;

"public sewer" means, subject to Section 106(1A) of the 1991 Act (viii), a sewer for the time being vested in a sewerage undertaker in its capacity as such, whether vested in that undertaker:

- (a) By virtue of a scheme under Schedule 2 to the Water Act 1989(ix);
- (b) By virtue of a scheme under Schedule 2 to the 1991 Act(x);
- (c) Under Section 179 of the 1991 Act (xi); or
- (d) Otherwise;

"public sewer map" means the map made available under Section 199(5) of the 1991 Act (xii);

"resource main" means (subject to Section 219(2) of the 1991 Act) any pipe, not being a trunk main, which is or is to be used for the purpose of:

- (a) Conveying water from one source of supply to another, from a source of supply to a regulating reservoir or from a regulating reservoir to a source of supply; or
- (b) Giving or taking a supply of water in bulk;

"sewerage services" includes the collection and disposal of foul and surface water and any other services which are required to be provided by a sewerage undertaker for the purpose of carrying out its functions;

"sewerage undertaker" means the Company appointed to be the sewerage undertaker under Section 6(1) of the 1991 Act for the area in which the property is or will be situated;

"surface water" includes water from roofs and other impermeable surfaces within the curtilage of the property;

"water main" means (subject to Section 219(2) of the 1991 Act) any pipe, not being a pipe for the time being vested in a person other than the water undertaker, which is used or to be used by a water undertaker or licensed water supplier for the purpose of making a general supply of water available to customers or potential customers of the undertaker or supplier, as distinct from for the purpose of providing a supply to particular customers;

"water meter" means any apparatus for measuring or showing the volume of water supplied to, or of effluent discharged from any premises;

"water supplier" means the Company supplying water in the water supply zone, whether a water undertaker or licensed water supplier;

"water supply zone" means the names and areas designated by a water undertaker within its area of supply that are to be its water supply zones for that year; and

"water undertaker" means the Company appointed to be the water undertaker under Section 6(1) of the 1991 Act for the area in which the property is or will be situated.

In this report, references to a pipe, including references to a main, a drain or a sewer, shall include references to a tunnel or conduit which serves or is to serve as the pipe in question and to any accessories for the pipe.

- (i) 1991 c.56.
- (ii) S.I. 2000/3184. These Regulations apply in relation to England.
- (iii) S.I. 2001/3911. These Regulations apply in relation to Wales.
- (iv) Section 51A was inserted by Section 92(2) of the Water Act 2003 (c. 37). Section 104(1) was amended by Section 96(4) of that Act.
- (v) Various amendments have been made to Sections 102 and 104 by section 96 of the Water Act 2003.
- (vi) Inserted by Section 56 of and Schedule 4 to the Water Act 2003.
- (vii) Subsection (1A) was inserted by Section 92(5) of the Water Act 2003.
- (viii) Section 106(1A) was inserted by Section 99 of the Water Act 2003.
- (ix) 1989 c.15.
- (x) To which there are various amendments made by Section 101(1) of and Schedule 8 to the Water Act 2003.
- (xi) To which there are various amendments made by Section 101(1) of and Schedule 8 to the Water Act 2003.
- (xii) Section 199 was amended by Section 97(1) and (8) of the Water Act 2003.

Appendix two: Terms and conditions

The Customer the Client and the Purchaser are asked to note these terms, which govern the basis on which this drainage and water report is supplied.

Definitions

"The Company" means Southern Water Services Limited who produces the Report.

"Order" means any request completed by the Customer requesting the Report.

"Report" means the drainage and/or water report prepared by The Company in respect of the Property.

"Property" means the address or location supplied by the Customer in the Order.

"Customer" means the person, company, firm or other legal body placing the Order, either on their own behalf as Client, or, as an agent for a Client.

"Client" means the person, company or body who is the intended recipient of the Report with an actual or potential interest in the Property.

"Purchaser" means the actual or potential purchaser of the Property including their mortgage lender.

1.0 Agreement

- 1.1 The Company agrees to supply the Report to the Customer and the Client subject to these terms. The scope and limitations of the Report are described in paragraph 2 of these terms. Where the Customer is acting as an agent for the Client then the Customer shall be responsible for bringing these terms to the attention of the Client and the Purchaser.
- 1.2 The Customer the Client and the Purchaser agree that the placing of an Order for a Report and the subsequent provision of a copy of the Report to the Purchaser indicates their acceptance of these terms.

2.0 The Report

Whilst the Company will use reasonable care and skill in producing the Report, it is provided to the Customer the Client and the Purchaser on the basis that they acknowledge and agree to the following:

- 2.1 The information contained in the Report can change on a regular basis so The Company cannot be responsible to the Customer the Client and the Purchaser for any change in the information contained in the Report after the date on which the Report was produced and sent to the Client.
- 2.2 The Report does not give details about the actual state or condition of the Property nor should it be used or taken to indicate or exclude actual suitability or unsuitability of the Property for any particular purpose, or relied upon for determining saleability or value, or used as a substitute for any physical investigation or inspection. Further advice and information from appropriate experts and professionals should always be obtained.
- 2.3 The information contained in the Report is based upon the accuracy of the address supplied by the Customer or Client.
- 2.4 The Report provides information as to the location and connection of existing services and other information in relation to drainage and water enquiries and should not be relied on for any other purpose. The Report may contain opinions or general advice to the Customer the Client and the Purchaser. The Company cannot ensure that any such opinion or general advice is accurate, complete or valid and accepts no liability therefore.
- 2.5 The position and depth of apparatus shown on any maps attached to the Report are approximate, and are furnished as a general guide only, and no warranty as to its correctness is given or implied. The exact positions and depths should be obtained by excavation trial holes and the maps must not be relied on in the event of excavation or other works made in the vicinity of The Company's apparatus.

3.0 Liability

- 3.1 The Company shall not be liable to the Client or the Purchaser for any failure defect or non-performance of its obligations arising from any failure of or defect in any machine, processing system or transmission link or anything beyond The Company's reasonable control or the acts or omissions of any party for whom The Company are not responsible.
- 3.2 Where a report is requested for an address falling within a geographical area where two different companies separately provide Water and Sewerage Services, then it shall be deemed that liability for the information given by either company will remain with that company in respect of the accuracy of the information supplied. A company supplying information which has been provided to it by another company for the purposes outlined in this agreement will therefore not be liable in any way for the accuracy of that information and will supply that information as agent for the company from which the information was obtained.
- 3.3 The Report is produced only for use in relation to individual domestic property transactions and cannot be used for commercial development of domestic properties or commercial properties for intended occupation by third parties.
- 3.4 The Company shall accept liability for death or personal injury arising from its negligence.

4.0 Copyright and confidentiality

- 4.1 The Customer the Client and the Purchaser acknowledge that the Report is confidential and is intended for the personal use of the Client and the Purchaser. The copyright and any other intellectual property rights in the Report shall remain the property of The Company. No intellectual or other property rights are transferred or licensed to the Customer the Client or the Purchaser except to the extent expressly provided.
- 4.2 The Customer or Client is entitled to make copies of the Report but may only copy Ordnance Survey mapping or data contained in or attached to the Report, if they have an appropriate licence from the originating source of that mapping or data.
- 4.3 The Customer the Client and the Purchaser agree (in respect of both the original and any copies made) to respect and not to alter any trademark, copyright notice or other property marking which appears on the Report.
- 4.4 The maps contained in the Report are protected by Crown Copyright and must not be used for any purpose outside the context of the Report.
- 4.5 The Customer the Client and the Purchaser agree to indemnify The Company against any losses, costs, claims and damage suffered by The Company as a result of any breach by either of them of the terms of paragraphs 4.1 to 4.4 inclusive.
- 4.6 The enquiries contained in the Report are protected by copyright owned by the Law Society of 113 Chancery Lane, London WC2A 1PL and must not be used for any purpose outside the context of the Report.

5.0 Payment

- 5.1 Unless otherwise stated all prices are inclusive of VAT. The Customer shall pay for the price of the Report specified by The Company, without any set off, deduction or counterclaim. Unless the Customer or Client has an account with The Company for payment for Reports, The Company must receive payments for Reports in full before the Report is produced. For Customers or Clients with accounts, payment terms will be as agreed with The Company.

6.0 General

- 6.1 If any provision of these terms is or becomes invalid or unenforceable, it will be taken to be removed from the rest of these terms to the extent that it is invalid or unenforceable. No other provision of these terms shall be affected.
- 6.2 These terms shall be governed by English law and all parties submit to the exclusive jurisdiction of the English courts.
- 6.3 Nothing in these terms and conditions shall in any way restrict the Customer the Clients or the Purchasers statutory or any other rights of access to the information contained in the Report.
- 6.4 These terms and conditions may be enforced by the Customer the Client and the Purchaser.

These Terms and conditions are available in larger print for those with impaired vision.

Appendix three: Complaints procedure

When we get it wrong

You deserve the highest standard of service from us, but sometimes we make mistakes. If we do, please let us know and we will investigate and review your concerns.

Whilst we always try to resolve all complaints straight away, if this is not possible and you are not happy with the course of action taken by us, you can ask us to escalate the issue internally or take your complaint to an independent third party.

How you contact us

Firstly please call us and we will try to sort out your problem straight away.

You can call us between 8am and 5pm, Monday to Friday on 0845 270 0212 or 0330 303 0276 (individual consumers);

Email us at searches@southernwater.co.uk; or

Write to us at LandSearch, Southern Water Services, Southern House, Capstone Road, Chatham, Kent, ME5 7QA.

What you can expect

You will receive a full, fair and courteous response from someone who can effectively deal with your problem.

If we can remedy the problem straight away we will do it but if we cannot immediately resolve your problem we will keep you informed of actions being taken.

The process

We will try to resolve any telephone contact or complaint at the time of the call, however, if that isn't possible, we will take the details of your complaint and we will investigate and get back to you within 10 working days.

We will respond to written complaints within 10 working days of the date received, but we will always aim to respond more quickly. Depending on the scale of investigation required, we will keep you informed of the progress and update you with new timescales if necessary.

If you are still not satisfied with our response or action we will refer the matter to a Senior Manager for resolution. At your request we will liaise with a third party representative acting on your behalf.

Our commitment to you

If we do not respond to your complaint within 10 working days of receipt of your contact, we will compensate you in line with Southern Water's Customer services — Guaranteed standards of service for business customers.

If we find your complaint to be justified, or we have made any errors that substantially change the outcome in your search result, we will refund the search fee. We will also provide you with a revised search and undertake the necessary action to put things right as soon as practically possible. You will be kept informed of the progress of any action required.

If you remain dissatisfied

While we aim to resolve your complaint first time, in the event that we are unable to resolve the issue to your satisfaction, ultimately you can contact a third party. Please make sure that you have followed the process above first, if not, your complaint will be passed back to us.


VAT receipt

Ordered by:

Sohan Ghimire
49 Warren Way
Dartford
Kent
DA1 2NL

VAT registration number: 813 0378 56
Order reference: LS/U1638972
Your reference: 49 Warren Way


Service
Search address: 49 Warren Way Bognor Regis West Sussex PO22 0JX



Thank you for your payment:

Received on: 1 November 2021

For enquiries regarding the information provided in this receipt, please contact the LandSearch team:



LandSearch
Southern Water Services
Southern House
Capstone Road
Chatham
Kent
ME5 7QA

CON29DW terms and conditions

With effect from 1 April 2019 the Terms and Conditions in Appendix Two of this search report have been updated.

The updated CON29DW Terms and Conditions can be viewed at the following link:

<https://www.southernwater.co.uk/media/2367/ls-updated-tscs-250319.pdf>

SOUTHERN WATER



The positions of pipes shown on this plan are believed to be correct, but Southern Water Services Ltd accept no responsibility in the event of inaccuracy. The actual positions should be determined on site.

Based upon Ordnance Survey Digital Data with the permission of the controller of H.M.S.O. Crown Copyright Reserved Licence No. WU 298530

O.S. REF: SU9604NW

Scale: 1:1250

Sewer Plot

WARNING: BAC pipes are constructed of Banded Asbestos Cement

WARNING: Unknown (UNK) materials may include Banded Asbestos Cement



Printed By: RD

Date: 11-11-2021

49 Warren Way

Requested By:








22/24



Land Searches Map Legend

Sewer

Pipe Line Styles/Colours

	Foul Sewer
	Foul Rising Main
	Foul Syphon Sewer
	Foul Vacuum Sewer
	Foul Trunk Sewer
	Foul Tank Sewer
	Surface Water Sewer
	Surface Water Rising Main
	Surface Water Syphon Sewer
	Surface Water Trunk Sewer
	Surface Water Tank Sewer
	Culverted Watercourse
	Combined Sewer
	Combined Rising Main
	Combined Syphon Sewer
	Combined Trunk Sewer
	Combined Tank Sewer
	Treated Effluent
	Treated Effluent Rising Main
	Sludge Rising Main
	Flow Direction Arrows (All Styles)
	As above line styles but decommissioned
	(Yellow) As above line styles but private
	Access Shaft – Personnel Only

Boundary Line Styles/Colours

	Catchment Boundary
	Sub-Catchment Boundary
	Section 104 Agreement Area
	Building Over Agreement Area

Materials

AK Alkathene	GRP Glass Reinforced Plastic
BAC Bonded Asbestos Cement *	MAC Masonry in regular courses
BRE Brick (Engineering)	MAR Masonry in random courses
BRC Brick (Common)	PE Polyethylene
CC Concrete Box Culvert	PF Pitch Fibre
CI Cast Iron	PP Polypropylene
CO Concrete (In-Situ)	PVC Polyvinyl Chloride
CP Concrete (Pre-Cast)	RPM Reinforced Plastic Matrix
CSB Concrete Segments (Bolted)	SI Spun Iron
CSU Concrete Segments (Un-Bolted)	ST Steel
DI Ductile Iron	VC Vitrifed Clay
GRC Glass Reinforced Concrete	UNK Unknown*


*Naming
BRE Pipes are constructed of Bonded Asbestos Cement
UNK Pipes are may be constructed of Bonded Asbestos Cement


Symbols

Surface	Foul	Combined	
			Label Ellipse
			Manhole
			Dummy/S.24 Manhole
			Manhole Backdrop
	n/a	n/a	Catchpit
	n/a	n/a	Soakaway
	n/a	n/a	Balancing Pond
			Rodding Eye
			Washout
			Flushing Chamber Mn-E
			Flushing Chamber No-E
			Hatch Box
			Lamphole
			Interceptor Chamber
			Blind Shaft
			Storm Tank
			Vortex Chamber
			Vent
			Vent Column
			Other/Unknown
			Penstock
	n/a		Cascade
			Change Node
			Pumping Station
			Micro Pumping Station
			Air Valve
			Valve
			Reflux Valve
			Anti-Flood Device
			Blank End
			Head of Public Sewer
	n/a	n/a	Inlet
			Outfall
			Storm Overflow
			Treatment Works

Other symbols or text may be visible which are not shown here.
These are used for Southern Water operational guidance only.

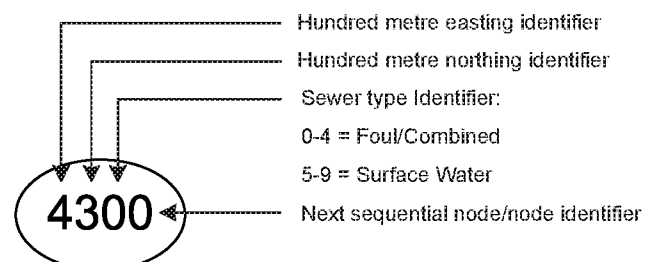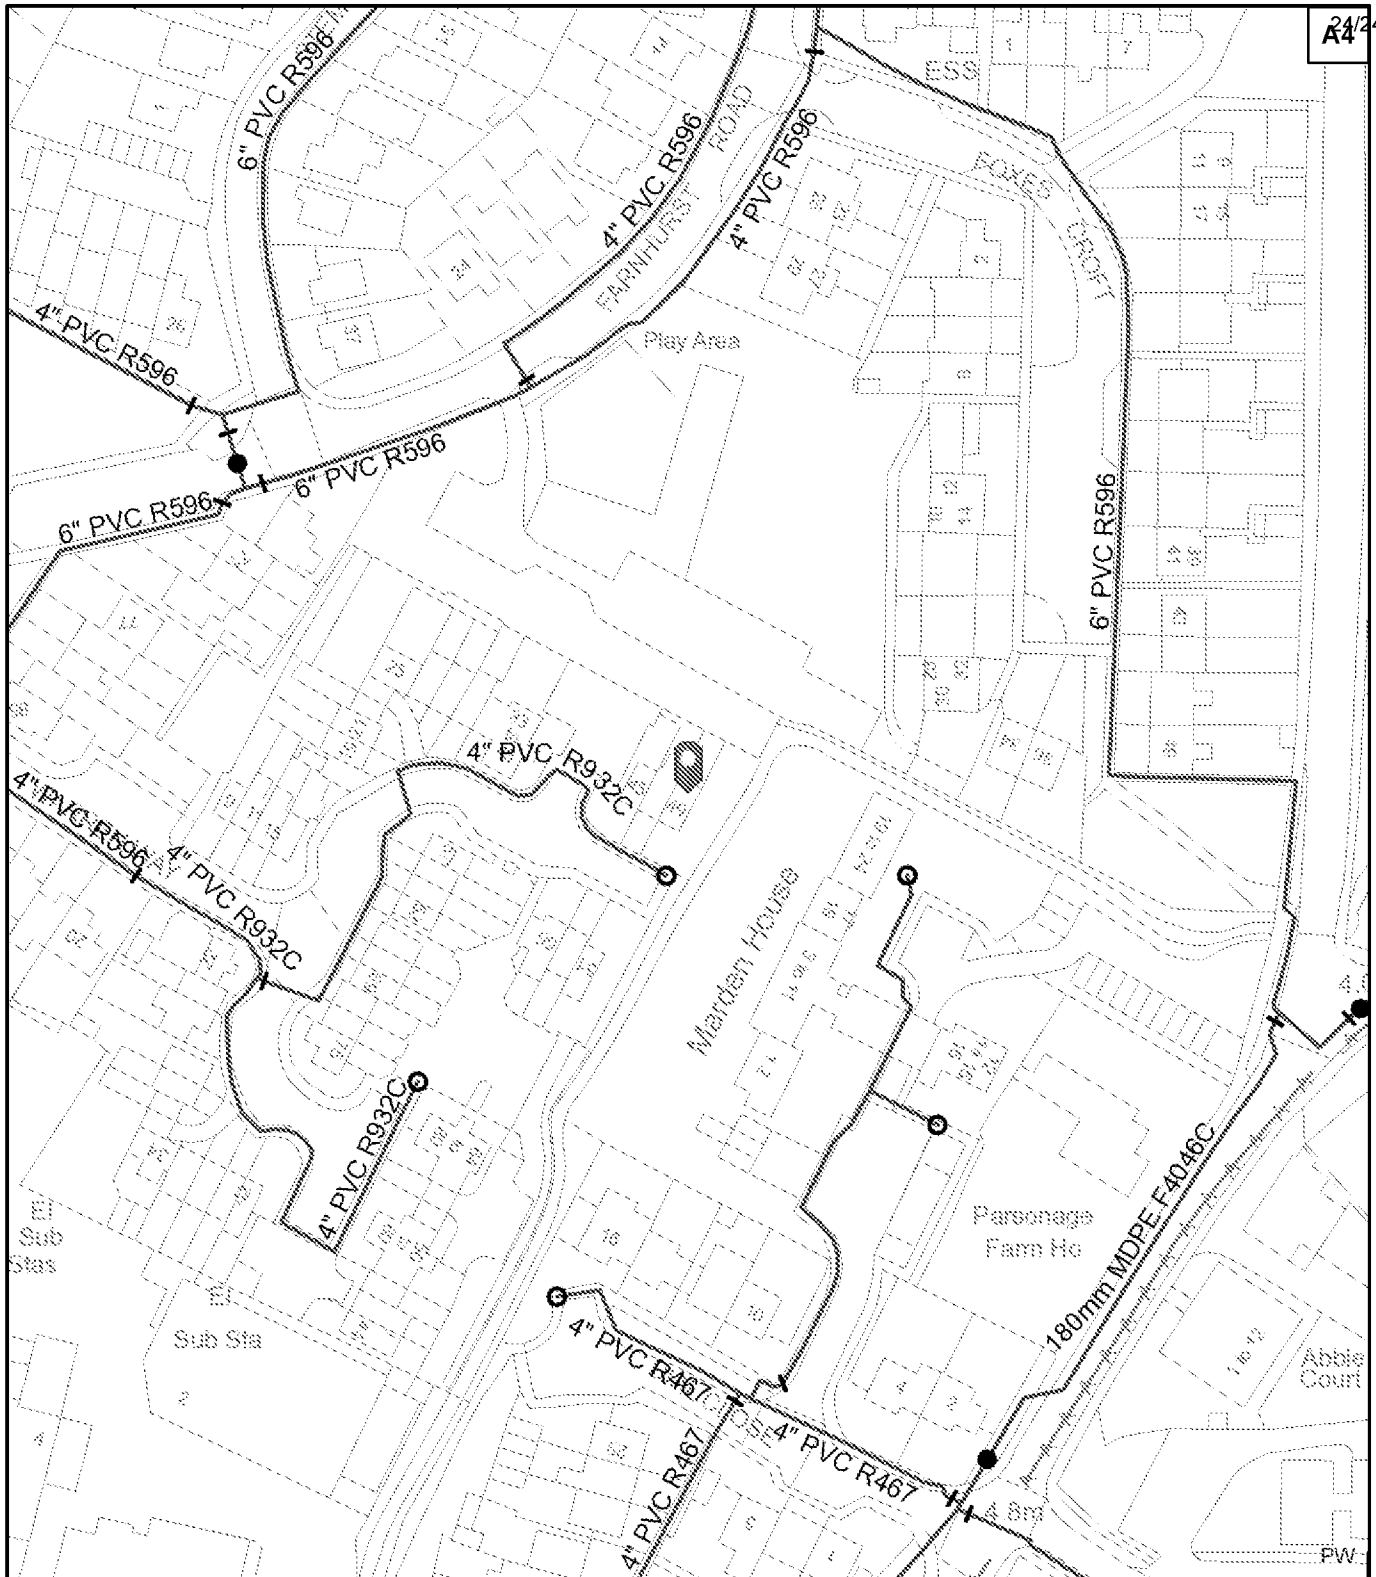Node Referencing System





Water Supply

- Distribution Main
- Communication Pipe
- Fire Main
- Private Main
- Raw Water Main
- Trunk Main
- Abandoned Main

Hydrant

- Company Washout Hydrant(Single)
- Fire Brigade Hydrant(Single)
- Fire Brigade Washout Hydrant

Valves / Fittings

- 3 Capped End
- x Stop Cock
- ✕ Butterfly Valve
- ➔ Pressure Flow Valve
- ➔ Reflux Valve
- ◆ Air Valve
- | Open Valve
- ▨ Closed Valve

The information supplied is given in good faith as a guide to locating underground apparatus. Its accuracy cannot be guaranteed, nor does it include comprehensive information about the existence or location of service pipes or cables to individual premises. The responsibility for locating and avoiding damage to apparatus on site shall be that of the person proposing to excavate in the street who shall be liable to the apparatus owner and any third party who may be affected in any way for any loss or damage caused by their failure to do so.

© Crown copyright and database rights 2021.
Ordnance Survey Licence Number 100018036.

U1638972

Easting/Northing:
496,063 104,560

Scale:
1:1,250

Date:
10/11/2021



Registered Office
P.O. BOX NO. 8, West Street, Havant,
Hampshire. PO9 1LG.
Registered in England No. 2536455
Telephone: (023) 9249 9888
Fax: (023) 9245 3632
Website: www.portsmouthwater.co.uk