




Luminaire Schedule					
Symbol	Qty	Label	Luminaire Lumens	LLF (MF)	Description
	43	A	2100	0.800	CircLED soft single 21W 3000K IP66 IK09 post top luminaire

Calculation Summary								
Label	CalcType	Units	Avg	Max	Min	Uniformity	Diversity	Grid Height Z
Ambulance-Taxi drop	Illuminance	Lux	23.89	69	7	0.30	0.10	0.01
Roadway	Illuminance	Lux	14.08	66	1	0.07	0.02	0.01
Staff Carpark - 3 space bay	Illuminance	Lux	17.81	40	6	0.34	0.15	0.01
Staff Carpark - Left bay	Illuminance	Lux	21.61	41	9	0.42	0.22	0.01
Staff Carpark - Rear bay	Illuminance	Lux	17.18	39	6	0.35	0.15	0.01
Staff Carpark - Roadway	Illuminance	Lux	12.41	53	4	0.32	0.08	0.01
Visitor Carpark - Accessible bay	Illuminance	Lux	17.46	40	6	0.34	0.15	0.01
Visitor Carpark - Bay A	Illuminance	Lux	10.64	40	4	0.38	0.10	0.01
Visitor Carpark - Bay B	Illuminance	Lux	9.53	36	4	0.42	0.11	0.01
Visitor Carpark - Half bay	Illuminance	Lux	8.80	24	5	0.57	0.21	0.01
Visitor Carpark - Left bay	Illuminance	Lux	19.01	41	8	0.42	0.20	0.01
Visitor Carpark Roadway	Illuminance	Lux	13.70	42	4	0.29	0.10	0.01

Carpark lighting mounted @ 4m
Roadway lighting mounted @ 3m
Maintenance factor: 0.8

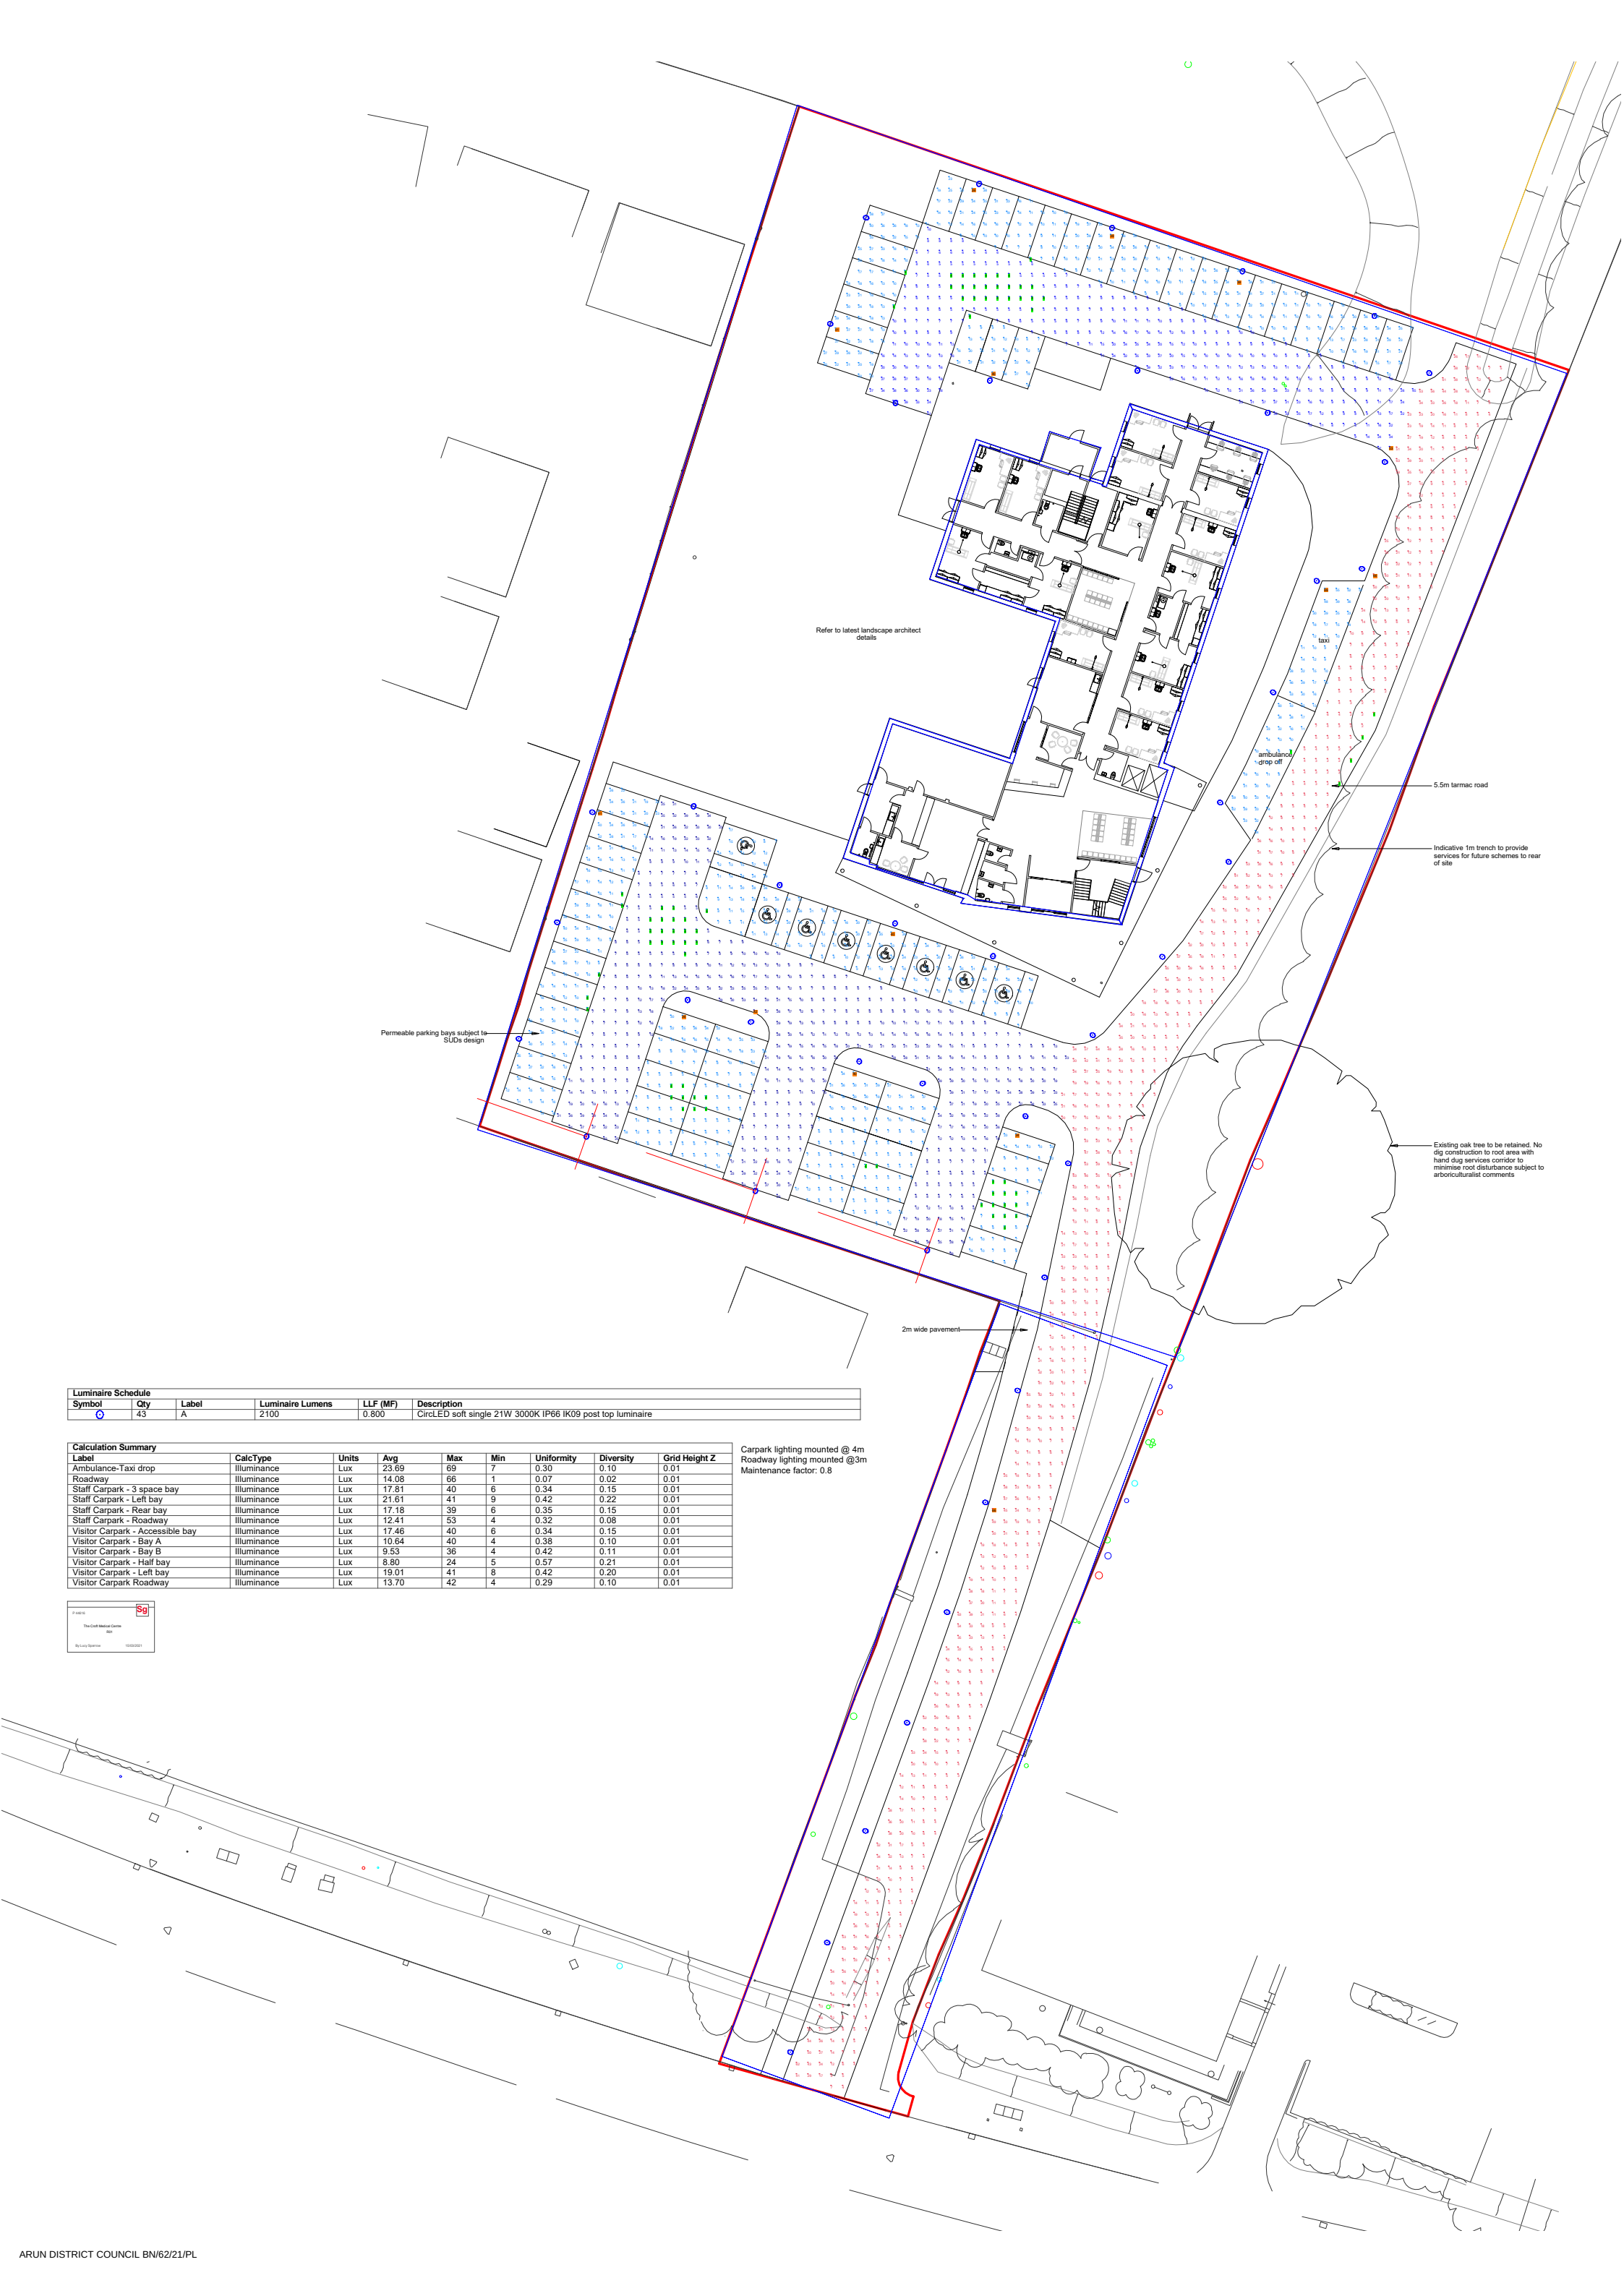