


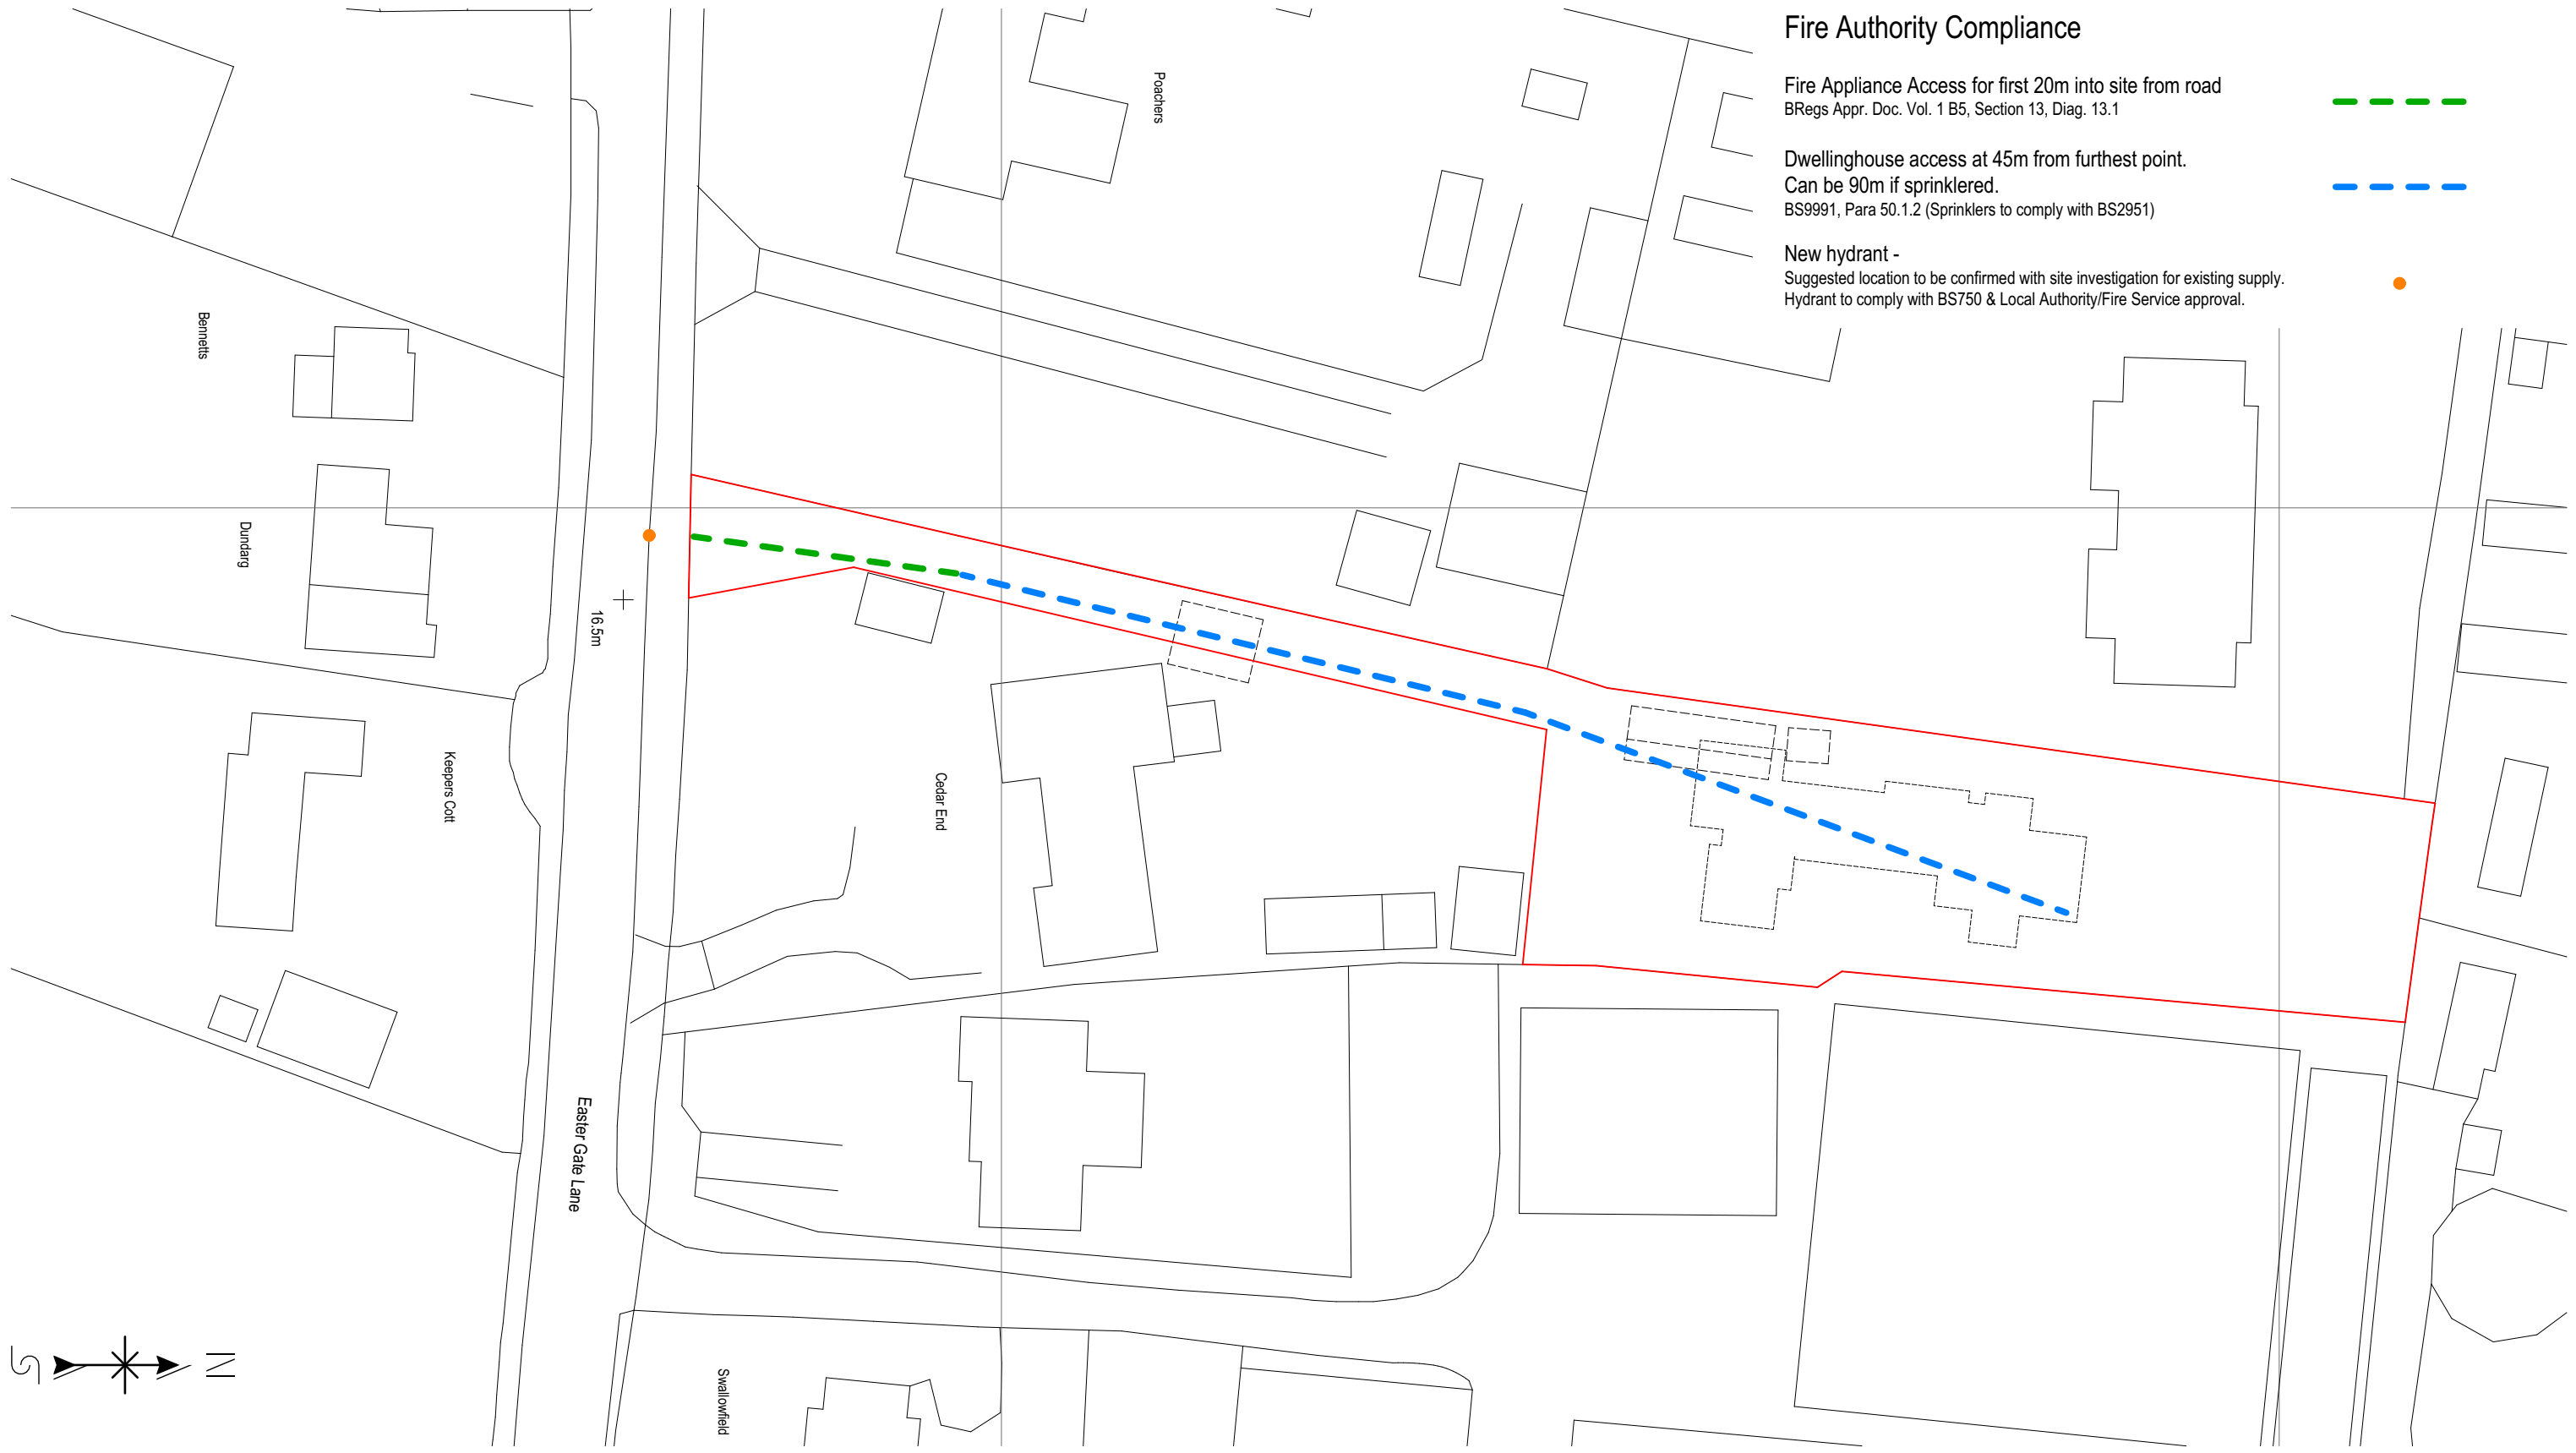

Fire Authority Compliance

Fire Appliance Access for first 20m into site from road
BRegs Appr. Doc. Vol. 1 B5, Section 13, Diag. 13.1

Dwellinghouse access at 45m from furthest point.
Can be 90m if sprinklered.
BS9991, Para 50.1.2 (Sprinklers to comply with BS2951)

New hydrant -
Suggested location to be confirmed with site investigation for existing supply.
Hydrant to comply with BS750 & Local Authority/Fire Service approval.



Fire Authority Compliance

1:500

P01	20/07/2022	MR	First Issue
Rev	Date	By	Description



Land r/o Cedar End, Eastergate ^ Fire Authority Compliance ^ 1:500@A3 ^ 1671-SYM-00-ZZ-DR-A-0213 P01

SYMMETRY
architecture

www.symmetryarchitecture.co.uk
office@symmetryarch.co.uk
3A Station Approach Broadstone Dorset BH18 8AX
01202 973379
This drawing and its design content is copyright © of Symmetry Architecture Ltd. It shall be read in conjunction with all other associated project information. Do not
ARUN DISTRICT COUNCIL 16/07/2022
Date Printed: 20/07/2022