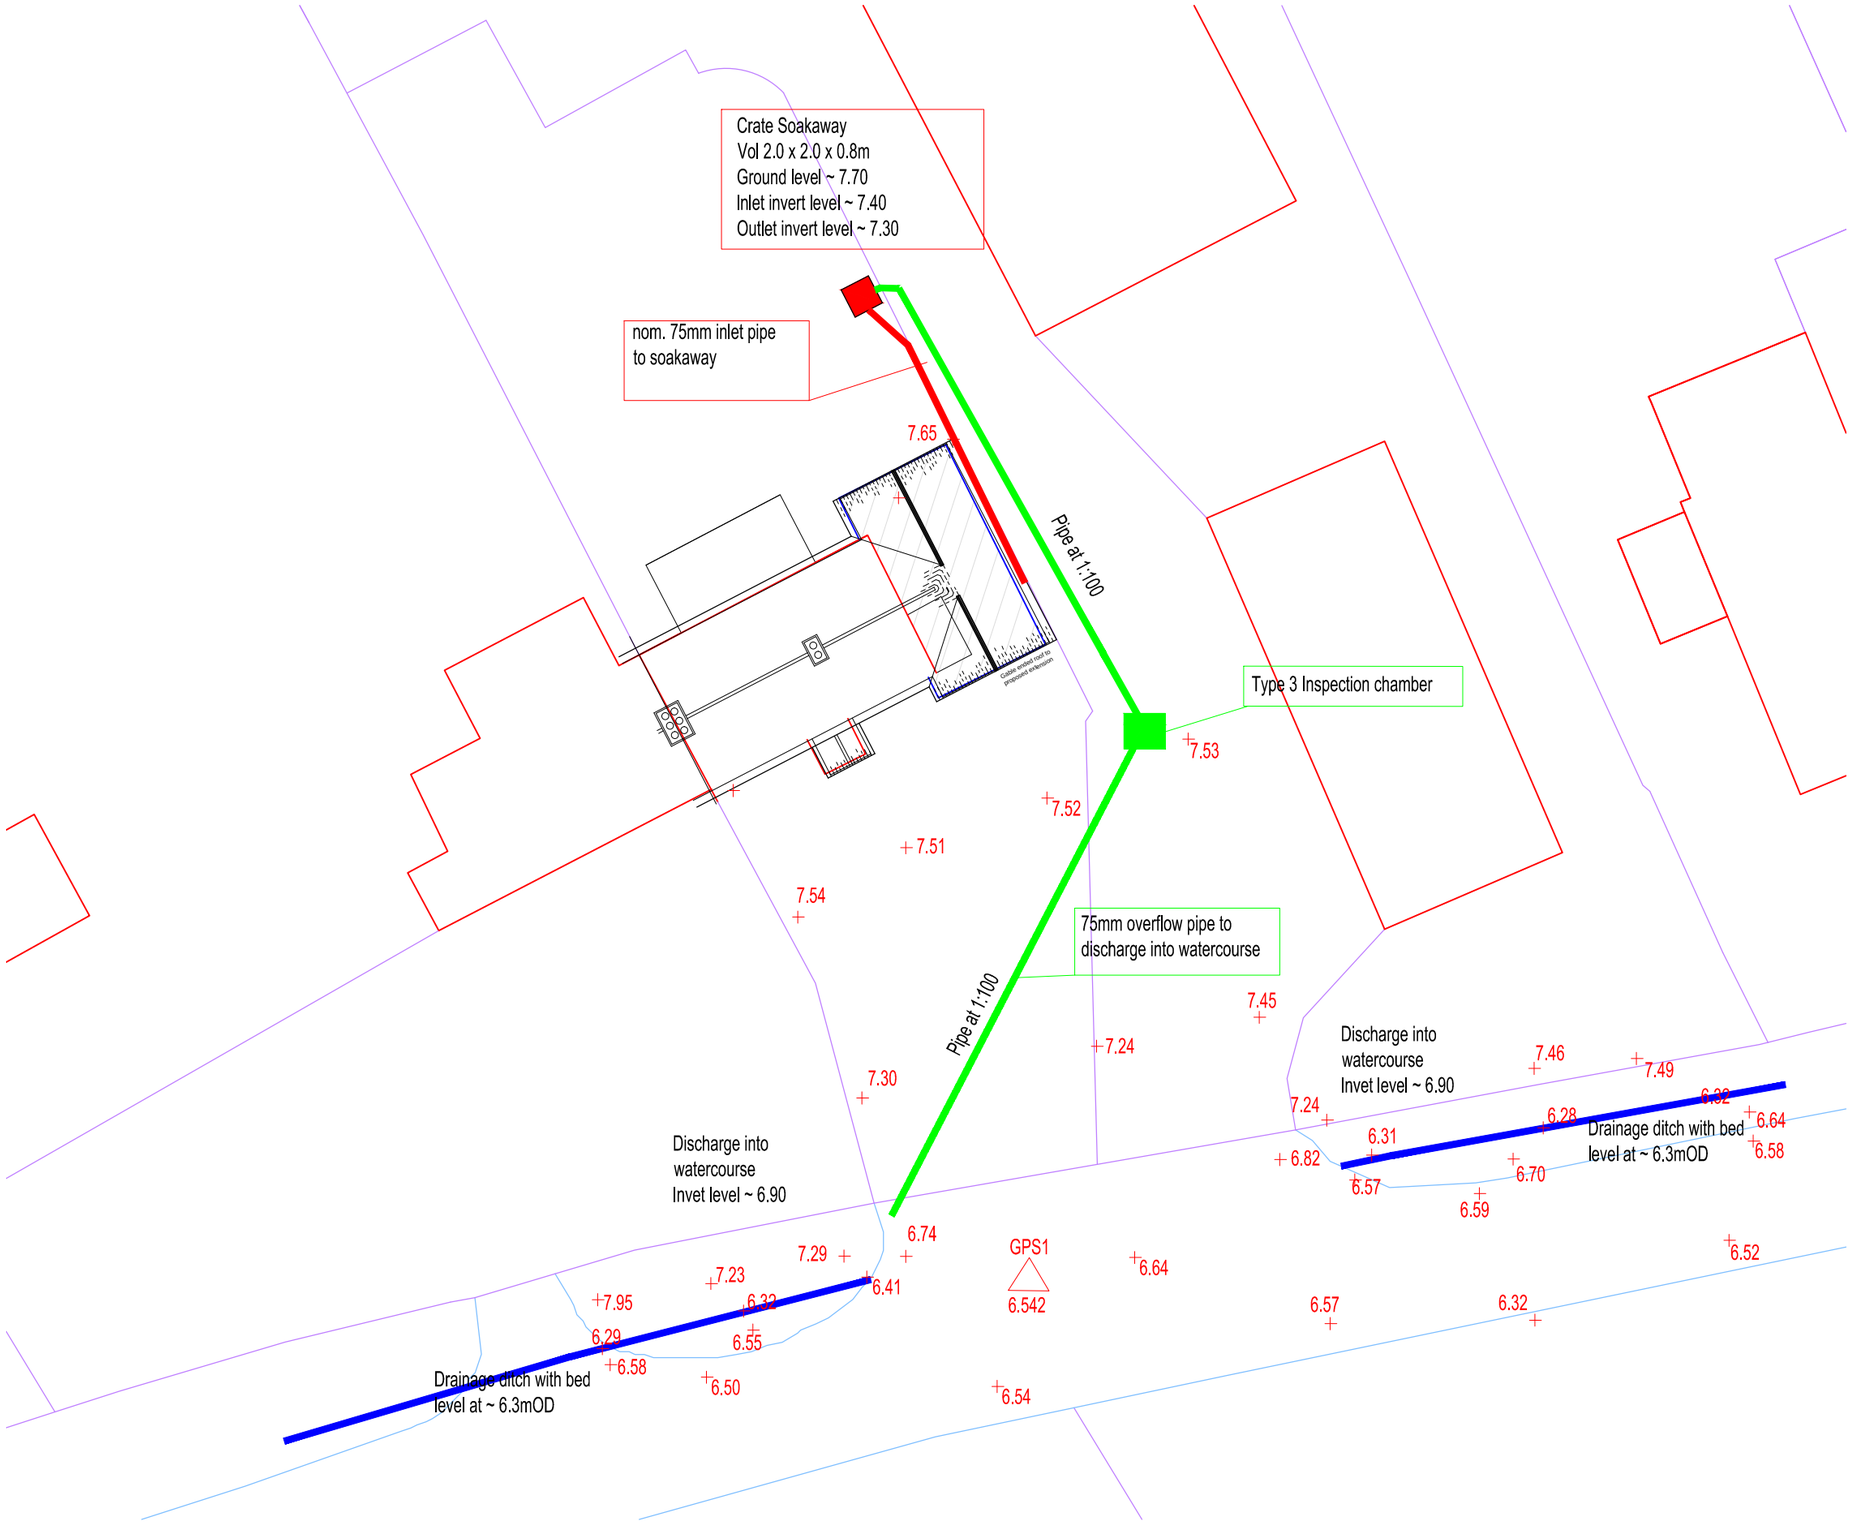

NOTES:

1. Soakaway/attenuation tank sized for 100 yr return period with 40 % increase for climate change (refer to SCEL calculations May 2016)

2. Ground levels from Topographical survey (J Botherton & partners) drawing 18197 A, 10.10.2018.

3. All below ground pipework laid at 1:100

4. Headwall to be formed at discharge location into drainage ditch.

5. Pipe levels are approximate and may vary but adequate falls and cover depths are to be maintained.

6. Soakaway construction in accordance with manufacturers guidelines

Revision	Date	Notes
Rev A	29/07/2019	Additional informatin and levels added

ARUN DISTRICT COUNCIL BN/69/19/DOC

STONE CONSULTING ENGINEERS
Civil and Structural Engineers
117 Barrack Lane, Aldwick, PO21 4ED : (T) 07971 216691; (email) kjlstone@tiscali.co.uk

Drawn by: KS	Title: 37 Hill Lane, Barnham Surface water attenuation scheme
Checked: -	
Date: July 2019	Drawing No: SCEL-1970-01 A
Scale: 1:200	