

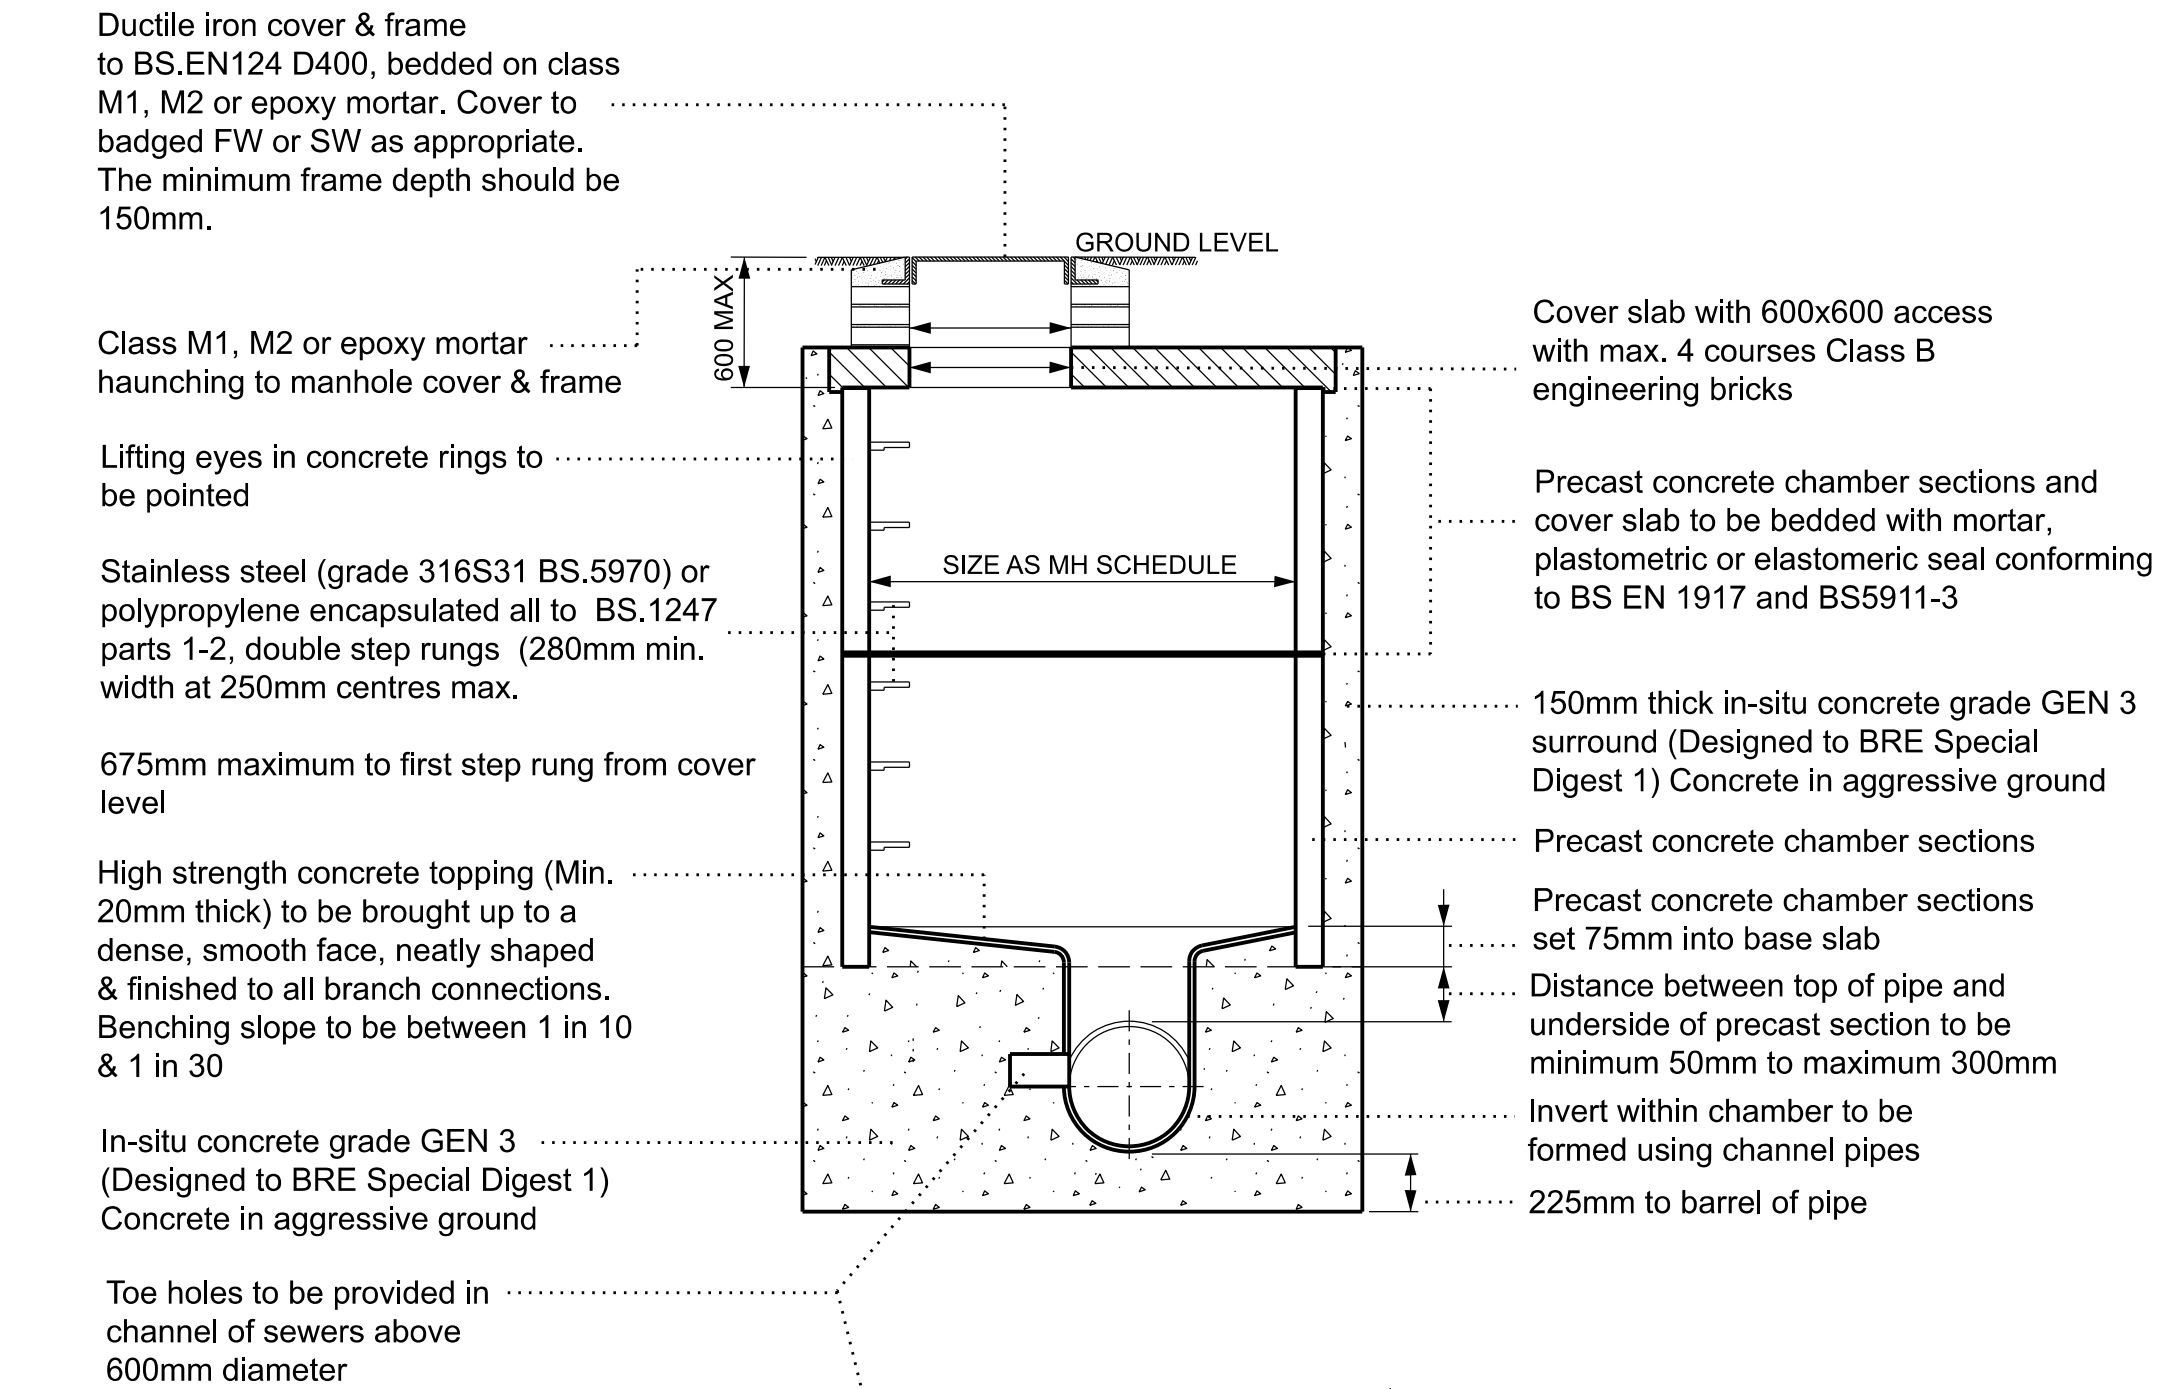


## TYPICAL MANHOLE DETAIL TYPE B

(Maximum depth from cover level to  
soffit of pipe 3m)

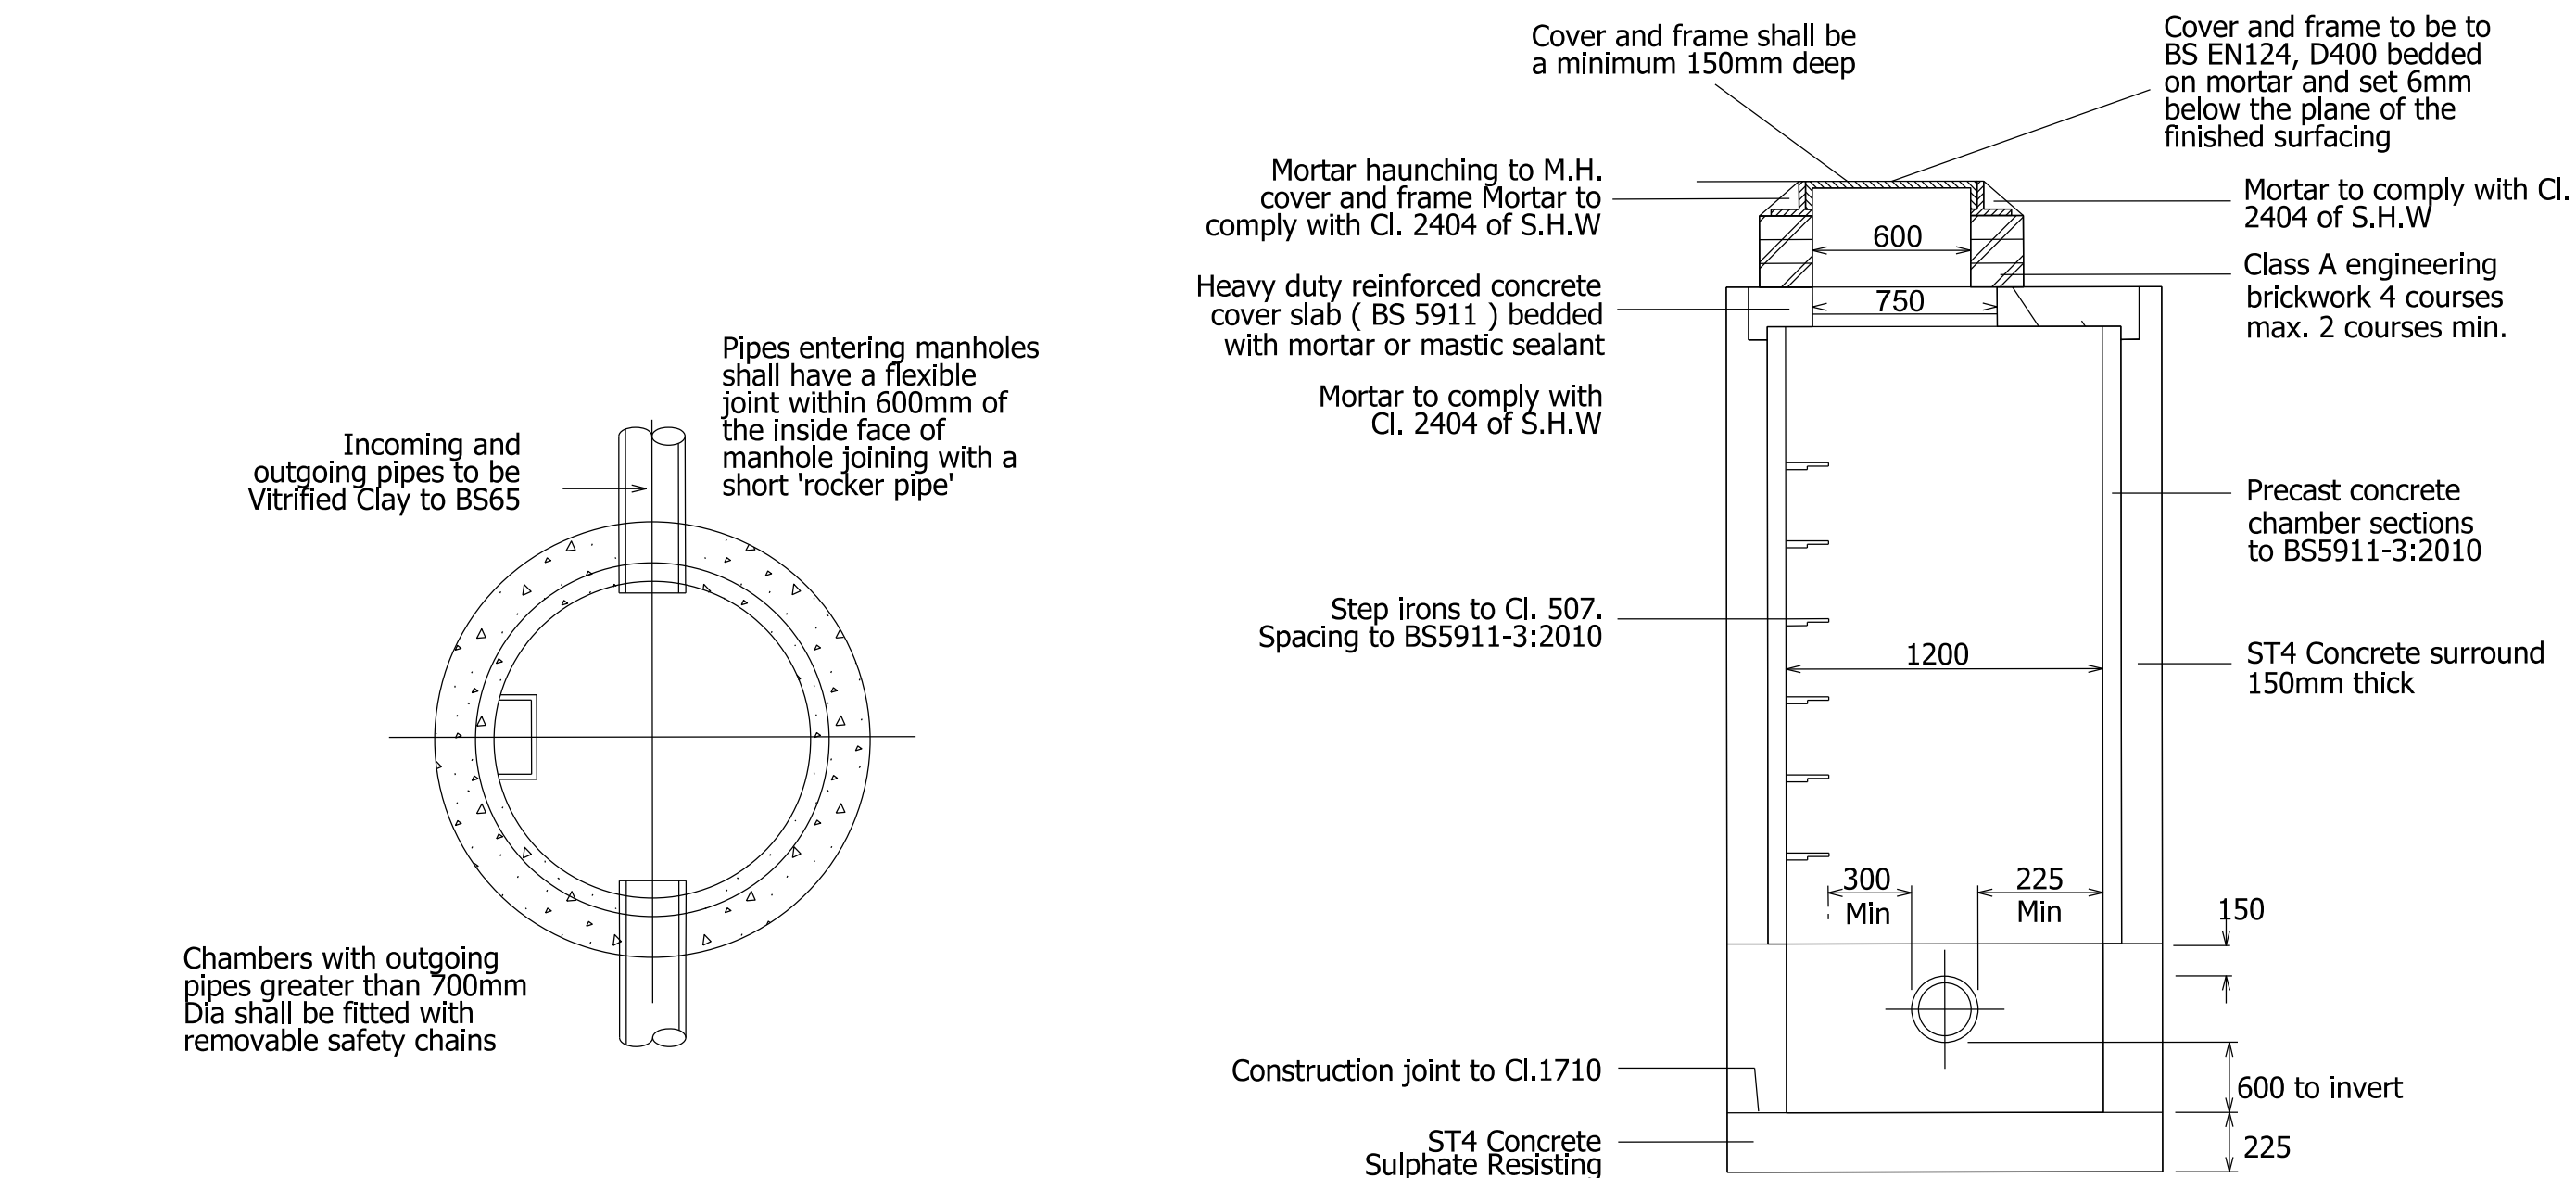

| CHAMBER DIAMETERS                          |                                         |
|--------------------------------------------|-----------------------------------------|
| DIA. OF LARGEST<br>PIPE IN MANHOLE<br>(mm) | INTERNAL DIAMETER<br>OF MANHOLE<br>(mm) |
| LESS THAN 375                              | 1200                                    |
| 375 TO 700                                 | 1500                                    |
| 750 TO 900                                 | 1800                                    |

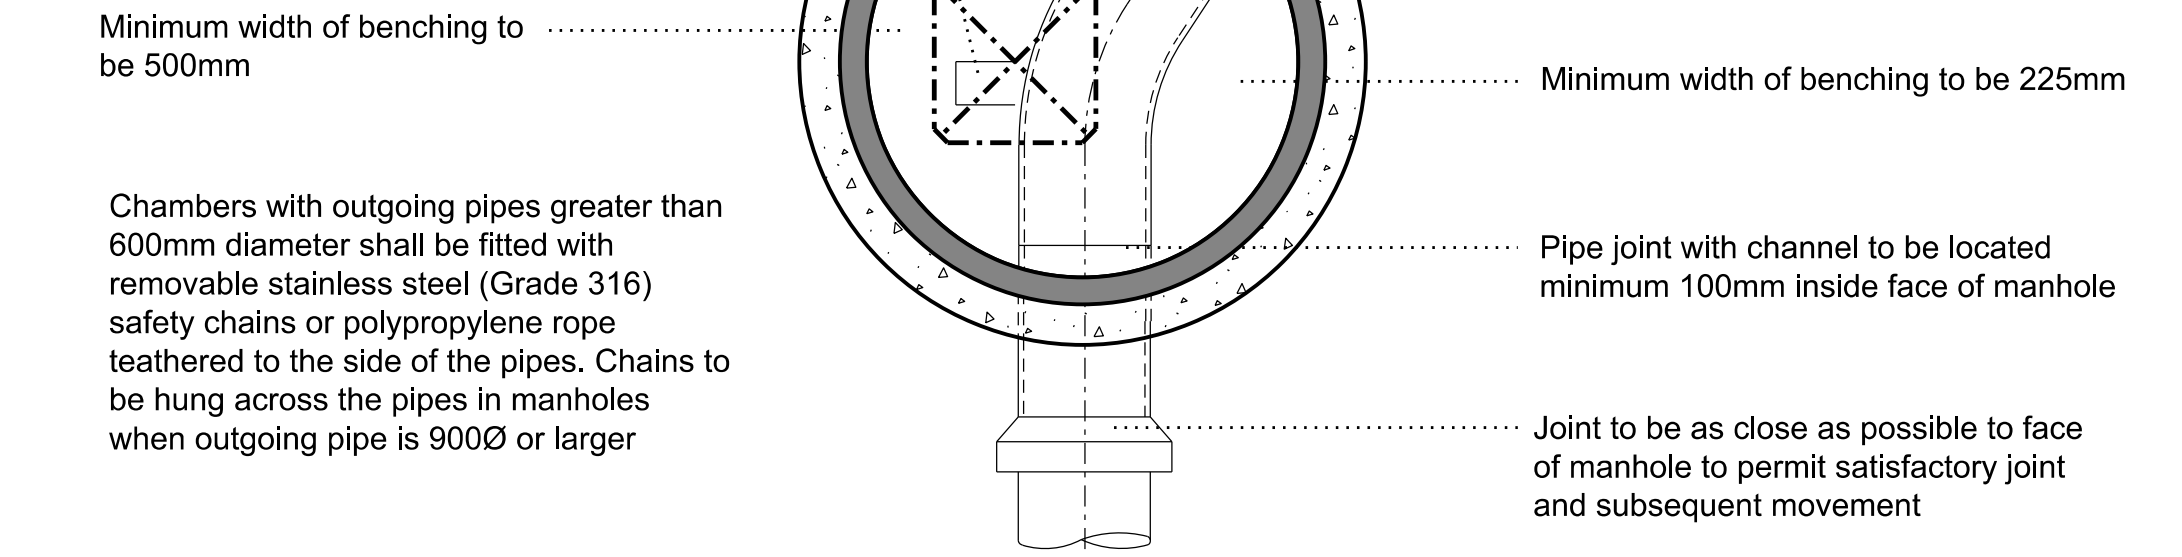

## PRECAST CONCRETE RING CATCHPIT (CLAUSE 507) MH S8A ONLY

Notes.


- Backfilling under roads and paving: Backfill from top of granular bedding up to formation level with Granular Subbase Material Type 1 to Highways Agency specification for Highway Works 1998 Clause 803, laid and compacted in 150mm layers.
- Backfilling under landscaped areas: Backfill from top of granular bedding up to underside of topsoil with selected Class 1B material. Class 1B fill whether selected from locally excavated material or imported, shall consist of uniform readily compactable material, free from vegetable matter, building rubbish and frozen material, or materials susceptible to spontaneous combustion, and excluding clay of liquid limit greater than 80 and/or plastic limit greater than 55 and materials of excessively high moisture content. Clay lumps and stones retained on 75mm and 37.5mm sieves respectively shall be excluded from the fill material. Laid and compacted in layers not exceeding 300mm.
- Do not use heavy compactors before there is 600mm of material over pipe.

Table - Granular bedding and sidefill materials for rigid pipes


| Pipe<br>Nominal<br>Bore (DN) | Maximum<br>Particle<br>Size (mm) | Class of<br>Bedding | Suitable materials                                                   |                                                              |
|------------------------------|----------------------------------|---------------------|----------------------------------------------------------------------|--------------------------------------------------------------|
|                              |                                  |                     | Imported granular materials<br>(Note a)                              | Maximum CF value<br>for as-dug granular<br>material (Note b) |
| 100                          | 10                               | S                   | 10mm nominal single- size                                            | 0.15                                                         |
|                              |                                  | B                   |                                                                      | 0.30 (Note c)                                                |
|                              |                                  | F                   |                                                                      | 0.15                                                         |
|                              |                                  | N                   |                                                                      | Course, Medium or fine sand                                  |
| Over<br>100<br>to<br>150     | 15                               | S                   | 14mm to 5mm graded                                                   | 0.15                                                         |
|                              |                                  | B                   |                                                                      | 0.30 (Note c)                                                |
|                              |                                  | F                   |                                                                      | 0.15                                                         |
|                              |                                  | N                   |                                                                      | Coarse, medium or fine sand                                  |
| Over<br>150<br>to<br>500     | 20                               | S                   | 14mm to 5mm graded<br>or 20mm to 5mm graded                          | 0.15                                                         |
|                              |                                  | B                   |                                                                      | 0.30 (Note c)                                                |
|                              |                                  | F                   |                                                                      | 0.15                                                         |
|                              |                                  | N                   |                                                                      | All in aggregate or coarse medium<br>or fine sand            |
| Over<br>500<br>(Note d)      | 40                               | S                   | 14mm to 5mm graded<br>or 20mm to 5mm graded<br>or 40mm to 5mm graded | 0.15                                                         |
|                              |                                  | B                   |                                                                      | 0.30 (Note c)                                                |
|                              |                                  | F                   |                                                                      | 0.15                                                         |
|                              |                                  | N                   |                                                                      | All in aggregate or coarse medium<br>or fine sand            |

Notes


- Imported granular materials to include aggregates to BS 882, air- cooled blast furnace slag to BS 1047 and sintered pulverized- fuel ash to BS 3797  
Compaction fraction value, See Appendix A  
The higher the CF value for as dug bedding and sidefill materials the greater the required effort for adequate compaction.
- Angular materials should be chosen to ensure sufficient support is provided to these heavier pipes. Crushed rock aggregates to BS 882 are recommended. Air- cooled blast furnace slag to BS 3797 or other granular materials may be used if they show a similar degree of angularity

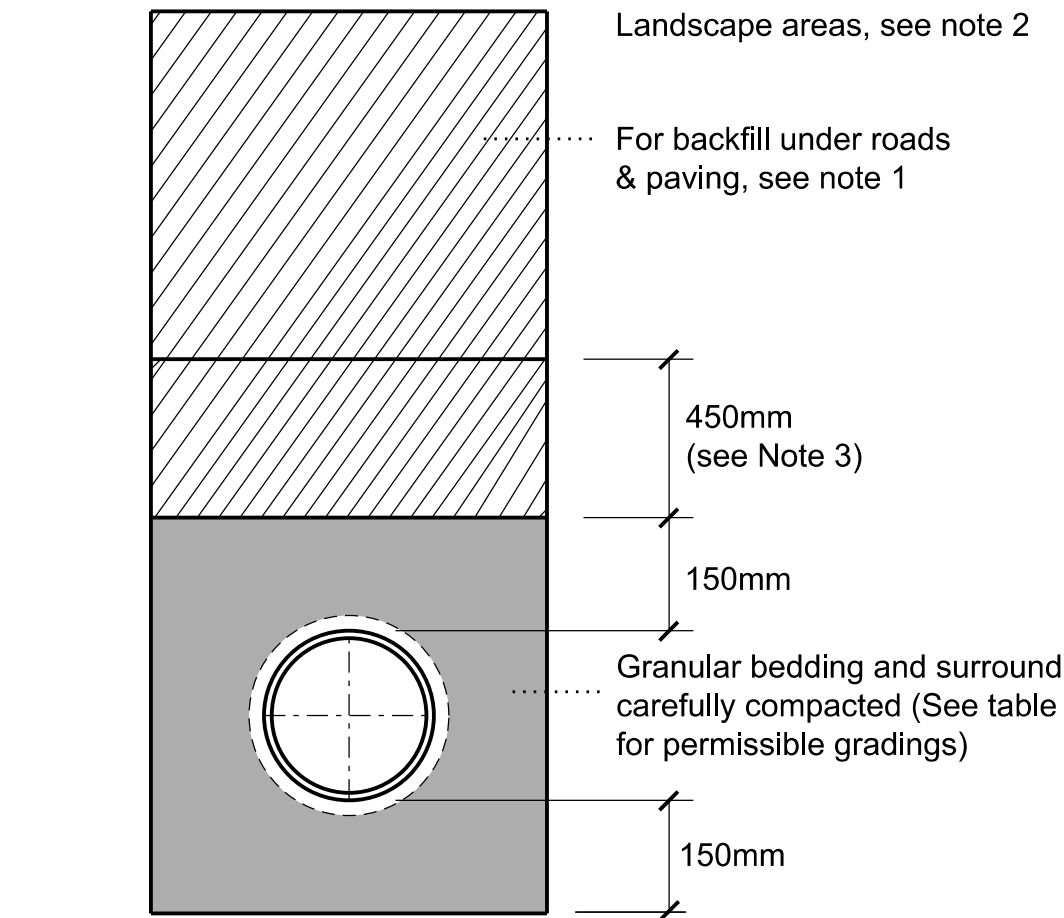

## CLASS S BEDDING DETAIL

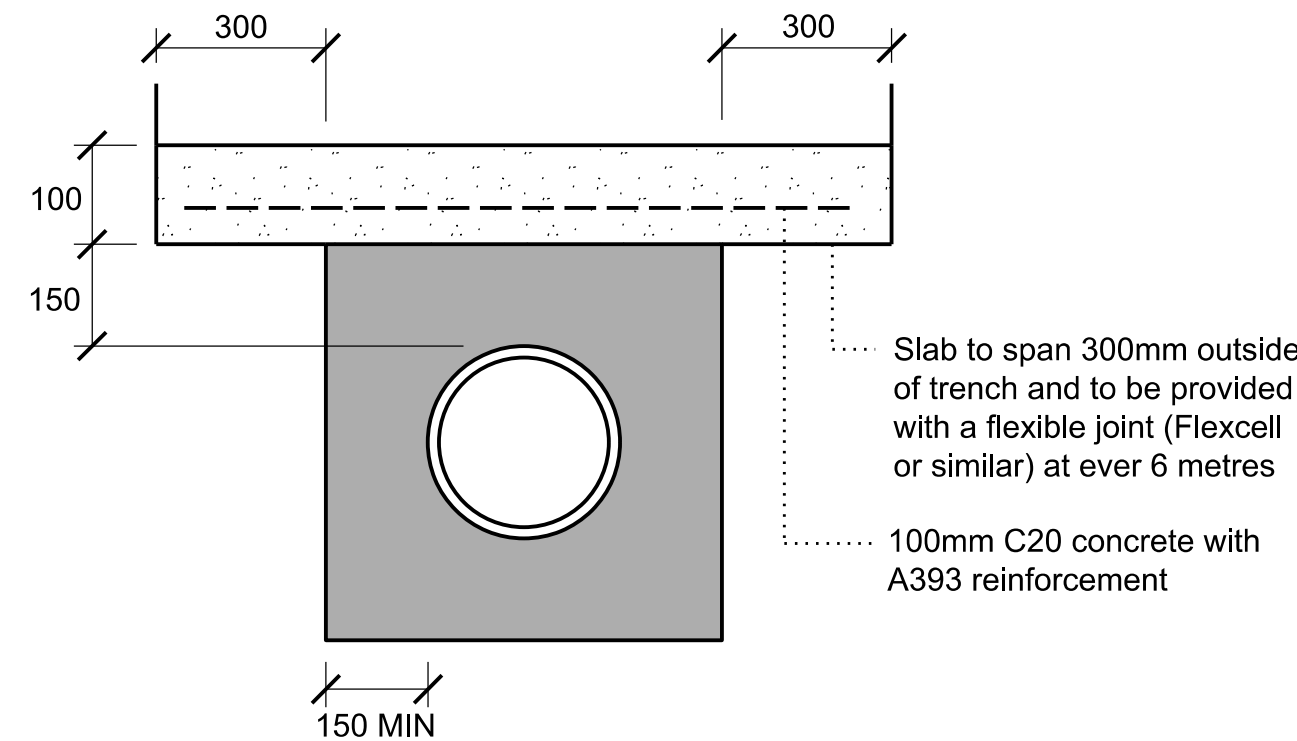

## CLASS S(S) CONCRETE PROTECTION

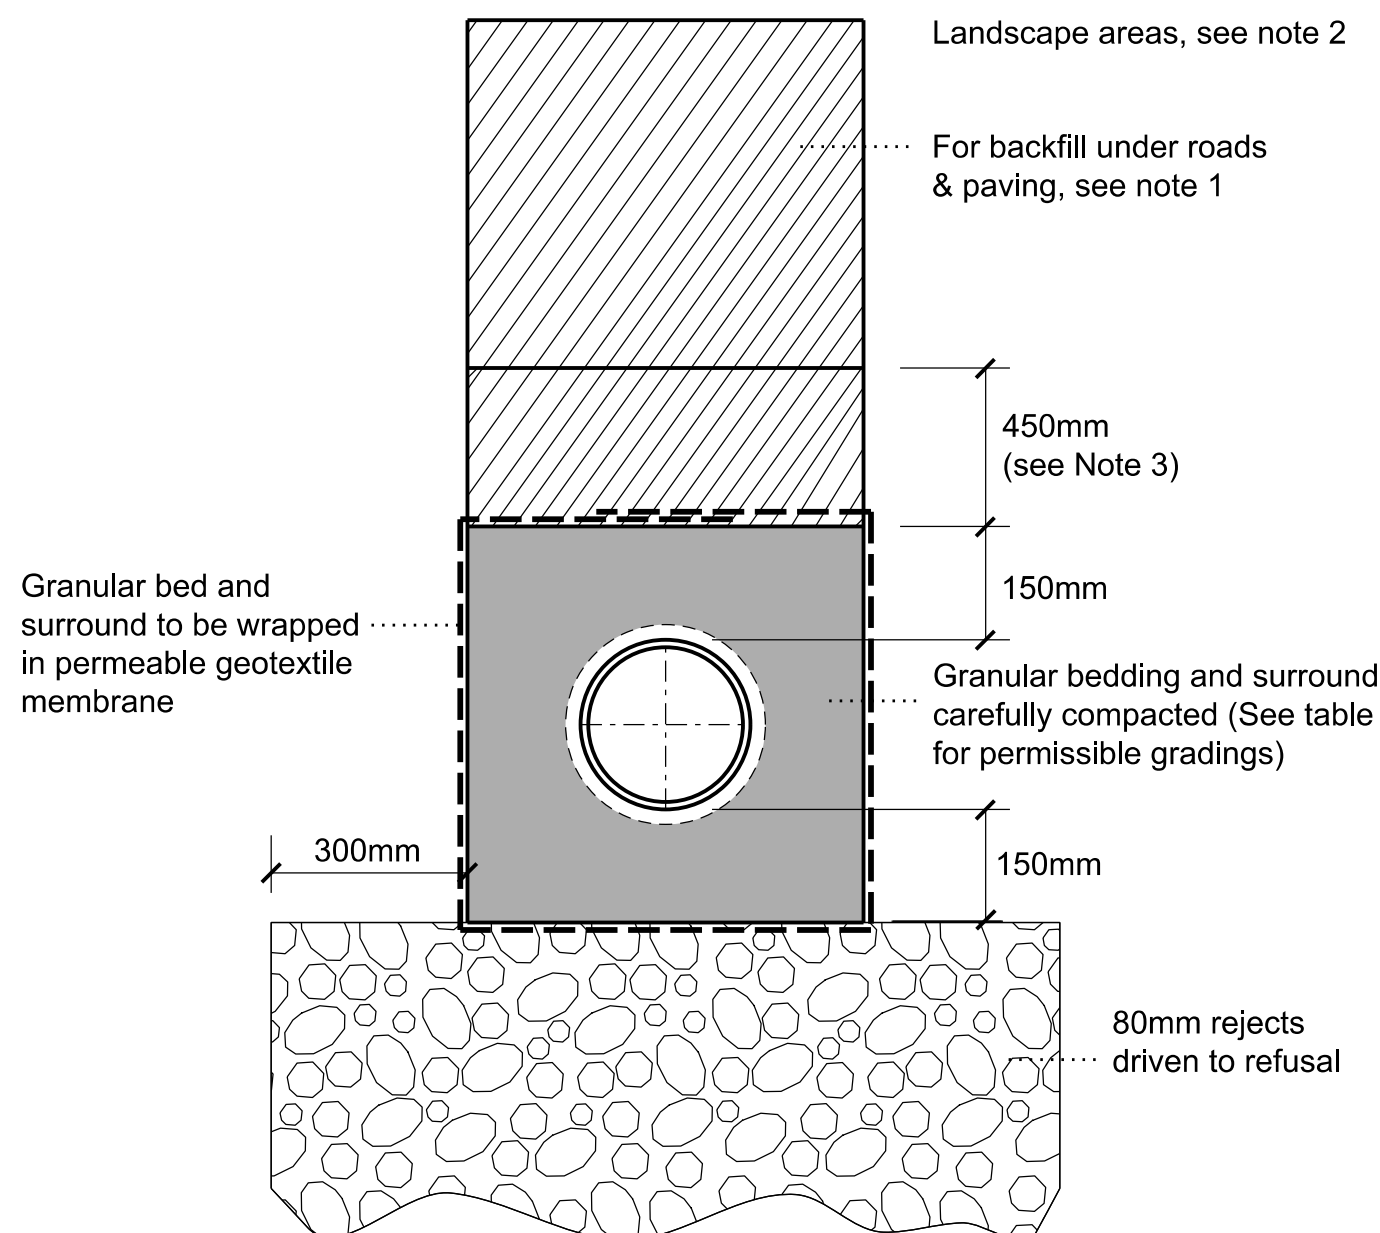

## CLASS S BEDDING DETAIL

For use where unstable sand layers are encountered

NOTES

- Contractors must check all dimensions on site. only figured dimensions are to be worked from. Discrepancies must be reported to the architect or engineer before proceeding. © this drawing is copyright.
- All works to be undertaken in accordance with sewers for adoption 6th addition with any Southern water additions or deletions
- Until technical approval has been obtained from the relevant authorities, all drawings are issued as preliminary and not for construction. should the contractor commence site work prior to approval being given it is entirely at his own risk.
- All adoptable drainage works to be constructed as detailed in sewers for adoption 7th edition, or as stipulated in Southern water's addendum

B Concrete surround & catch pit details retitled. JGF JGF 20-04-20

A Additional details added CLS JGF 02-04-20

REV DESCRIPTION DRN CHD DATE

PRELIMINARY INFORMATION TENDER

CONSTRUCTION AS BUILT

SCALE NTS@ A2 DATE FEB 2020

DRAWN CLS CHK JGF

DRAWING NO. 17748-BARN-5-910 REV B

TITLE YAPTON ROAD  
BARNHAM

DETAILS TYPICAL DRAINAGE DETAILS

 **Woods Hardwick**  
Architecture | Engineering | Planning | Surveying

**BEDFORD : HEAD OFFICE**  
15-17 Goldington Road  
Bedford MK40 3NH  
T: +44 (0) 1234 268862

**BIRMINGHAM**  
Fort Dunlop, Fort Parkway  
Birmingham B24 9FE  
T: +44 (0) 121 6297784

ONLINE: mail@woodshardwick.com | woodshardwick.com

PLEASE CONSIDER THE ENVIRONMENT BEFORE PRINTING THIS DRAWING