


FAO: Mr S Davis

Dear Mr Davis,


Having viewed the plans associated with the planning application for the address given above, evidence will be required that all areas of all domestic flats are within 45 metres of a fire appliance in accordance with Approved Document B (AD-B): Volume 1 2019 Edition para 13.2 (page 97); all points inside each Flat of a block is to be within 45 metres of a fire appliance measured along the route of the hose. If this is not achieved a dry riser fire main will be required in accordance with AD-B Volume 1 section 14 para 14.3 to 14.7, or the installation of domestic sprinkler system, information on the standard and requirement is given in AD-B Appendix E.

Regards

Ian Stocks
Water & Access manager

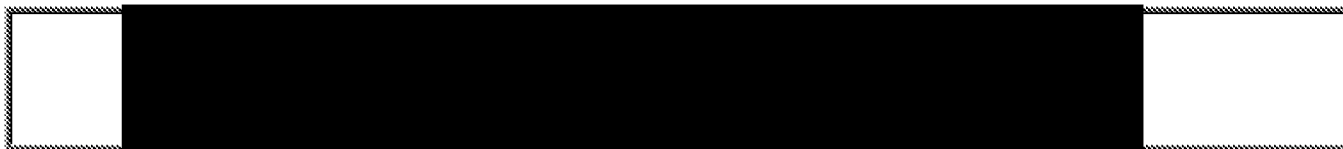

Living Our Values Every Day

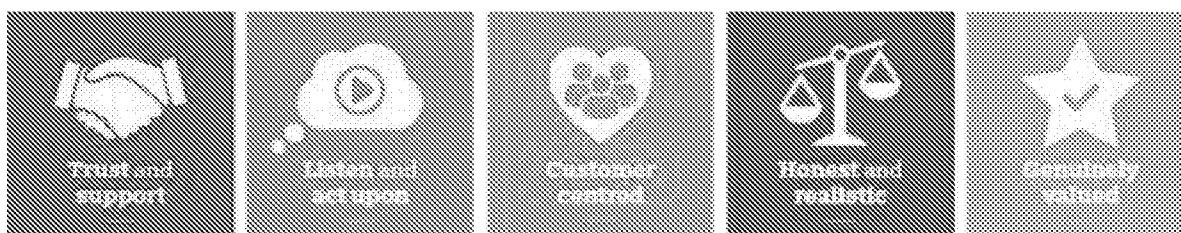

LEGAL DISCLAIMER

This email and any attachments are confidential and intended solely for the persons addressed. If it has come to you in error please reply to advise us but you should not read it, copy it, show it to anyone else nor make any other use of its content. West Sussex County Council takes steps to ensure emails and attachments are virus-free but you should carry out your own checks before opening any attachment.
