



from
**Southern
Water** 

Arun District Council
Maltravers Road
Littlehampton
BN17 5LF

Your ref
CM/19/26/PL

Our ref
DSA000055864

Date
17th July 2026



Dear Sir/Madam,

Proposal: Erection of replacement commercial building, parking and other associated infrastructure, including new attenuation pond. This application is in CIL Zone 5 (Zero Rated) as other development.

Site: Baird Business Park, Grevatt's Lane, Littlehampton, BN17 5RE.

Thank you for your correspondence, please see our comments below regarding the above application.

Development Site is not within Southern Water's Water Supply Area

The development site is not located within Southern Water's statutory area for water supply services. Please contact Portsmouth Water, who are the relevant statutory undertaker.

Tree Planting

We have restrictions on the proposed tree planting adjacent to Southern Water sewers, rising mains or water mains. Reference should be made to Southern Water's publication "A Guide to Tree Planting near water Mains and Sewers" (https://www.southernwater.co.uk/media/pddob0vn/ds-tree-planting-guide-1_nwm.pdf) and the Sewerage Sector Guidance (<https://www.water.org.uk/sewerage-sector-guidance-approved-documents/>) with regards to any landscaping proposals and our restrictions and maintenance of tree planting adjacent to sewers, rising mains and water mains.

Condition

In order to protect public apparatus, Southern Water requests that if consent is granted, the following pre commencement condition is attached to the planning permission; The developer must advise the local authority (in consultation with Southern Water) of the landscaping proposals in proximity of

public apparatus in order to protect it in accordance with Southern Water's guidance, prior to the commencement of the development.

Proposed Disposal to ground from package treatment plant

The Environment Agency should be consulted directly by the applicant regarding the use of a private wastewater treatment works which disposes of effluent to sub-soil irrigation.

Proposed SUDS features

If it is the intention of the developer for Southern Water to adopt the proposed SuDS, the system shall be designed and constructed in line with the Design and Construction Guidance www.water.org.uk/sewerage-sector-guidance-approved-documents/.

No Soakaways should be connected to the public surface water sewer.

The supporting documents make reference to drainage using Sustainable Drainage Systems (SuDS). Where SuDS form part of a continuous sewer system, and are not an isolated end of pipe SuDS component, adoption of SuDS will be considered if requested by the developer if they comply with: Design and Construction Guidance (Appendix C), CIRIA guidance and Southern Water SuDS Guidance available here:

<https://www.water.org.uk/sewerage-sector-guidance-approved-documents/>

<https://www.ciria.org/ItemDetail?iProductCode=C753F&Category=FREEPUBS>

<https://www.southernwater.co.uk/media/l4ndl3db/suds-final-080824.pdf>

Where SuDS rely upon facilities which are not adoptable by sewerage undertakers the applicant will need to ensure that arrangements exist for the long-term maintenance of the SuDS facilities. It is critical that the effectiveness of these systems is maintained in perpetuity. Good management will avoid flooding from the proposed surface water system, which may result in the inundation of the foul sewerage system.

Thus, where a SuDS scheme is to be implemented, the drainage details submitted to the Local Planning Authority should:


- Specify the responsibilities of each party for the implementation of the SuDS scheme.
- Specify a timetable for implementation.
- Provide a management and maintenance plan for the lifetime of the development.

This should include the arrangements for adoption by any public authority or statutory undertaker and any other arrangements to secure the operation of the scheme throughout its lifetime.

This initial assessment does not prejudice any future assessment or commitment to any adoption agreements under Section 104 of the Water Industry Act 1991.

Proposed Development located in Flood plain

From the site location, it appears that the proposed development lies within an area identified as flood zone 2/3. Southern Water supports the Government's requirement to apply the sequential and exception tests to development sites located in flood zones 2 or 3. In flood events, additional surface water can inundate sewers, which may result in the overloading of the sewerage system. Southern Water will rely on the Council's consultations with the Environment Agency to ensure that any

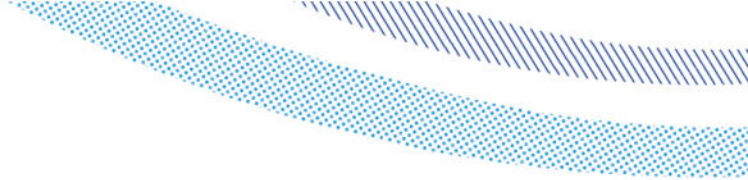

proposed development on a floodplain is appropriately assessed, and necessary mitigation measures adopted.

As this site is in a high-risk flood zone the new foul drainage system must be resilient to the flooding as we do not want flood waters to enter the system which would then impede foul drainage from this area and potentially downstream. The developer must ensure the new foul system draining the development does not create a new low spot on the network. If this is a possibility, then consideration should be given to having a pumped connection or other satisfactory mitigation. It appears the area is also prone to high groundwater. The new system must be constructed to withstand high groundwater and should be watertight at pipe joints; within manholes and at ground level. The integrity of the system with respect to water tightness must be demonstrated by air testing.

Condition

In view of the risk of inundation of the proposed drainage system, Southern Water would request that the consent is subject to the following condition: The proposed drainage system shall be designed and constructed to prevent the ingress of flood water into the sewerage network.

Lidsey comment

Due to surface water inundation issues in the Lidsey Catchment the applicant is advised to adopt, where appropriate, the measures set out in the table "Practical measures to reduce the potential impacts of development". The developer should look to protect the public sewerage system from inundation and infiltration, which contribute to flooding in unfavourable conditions.


It is possible that a sewer now deemed to be public could be crossing the development site. Therefore, should any sewer be found during construction work, an investigation of the sewer will be required to ascertain its ownership before any work commences on site. If this happens, please call our Customer Service Desk on [REDACTED]

For further advice, please contact Southern Water, Southern House, Yeoman Road, Worthing, West Sussex, BN13 3NX [REDACTED]

Website: southernwater.co.uk or by email at: [REDACTED]

Yours faithfully,

Future Growth Planning Team
southernwater.co.uk/developing-building/planning-your-development

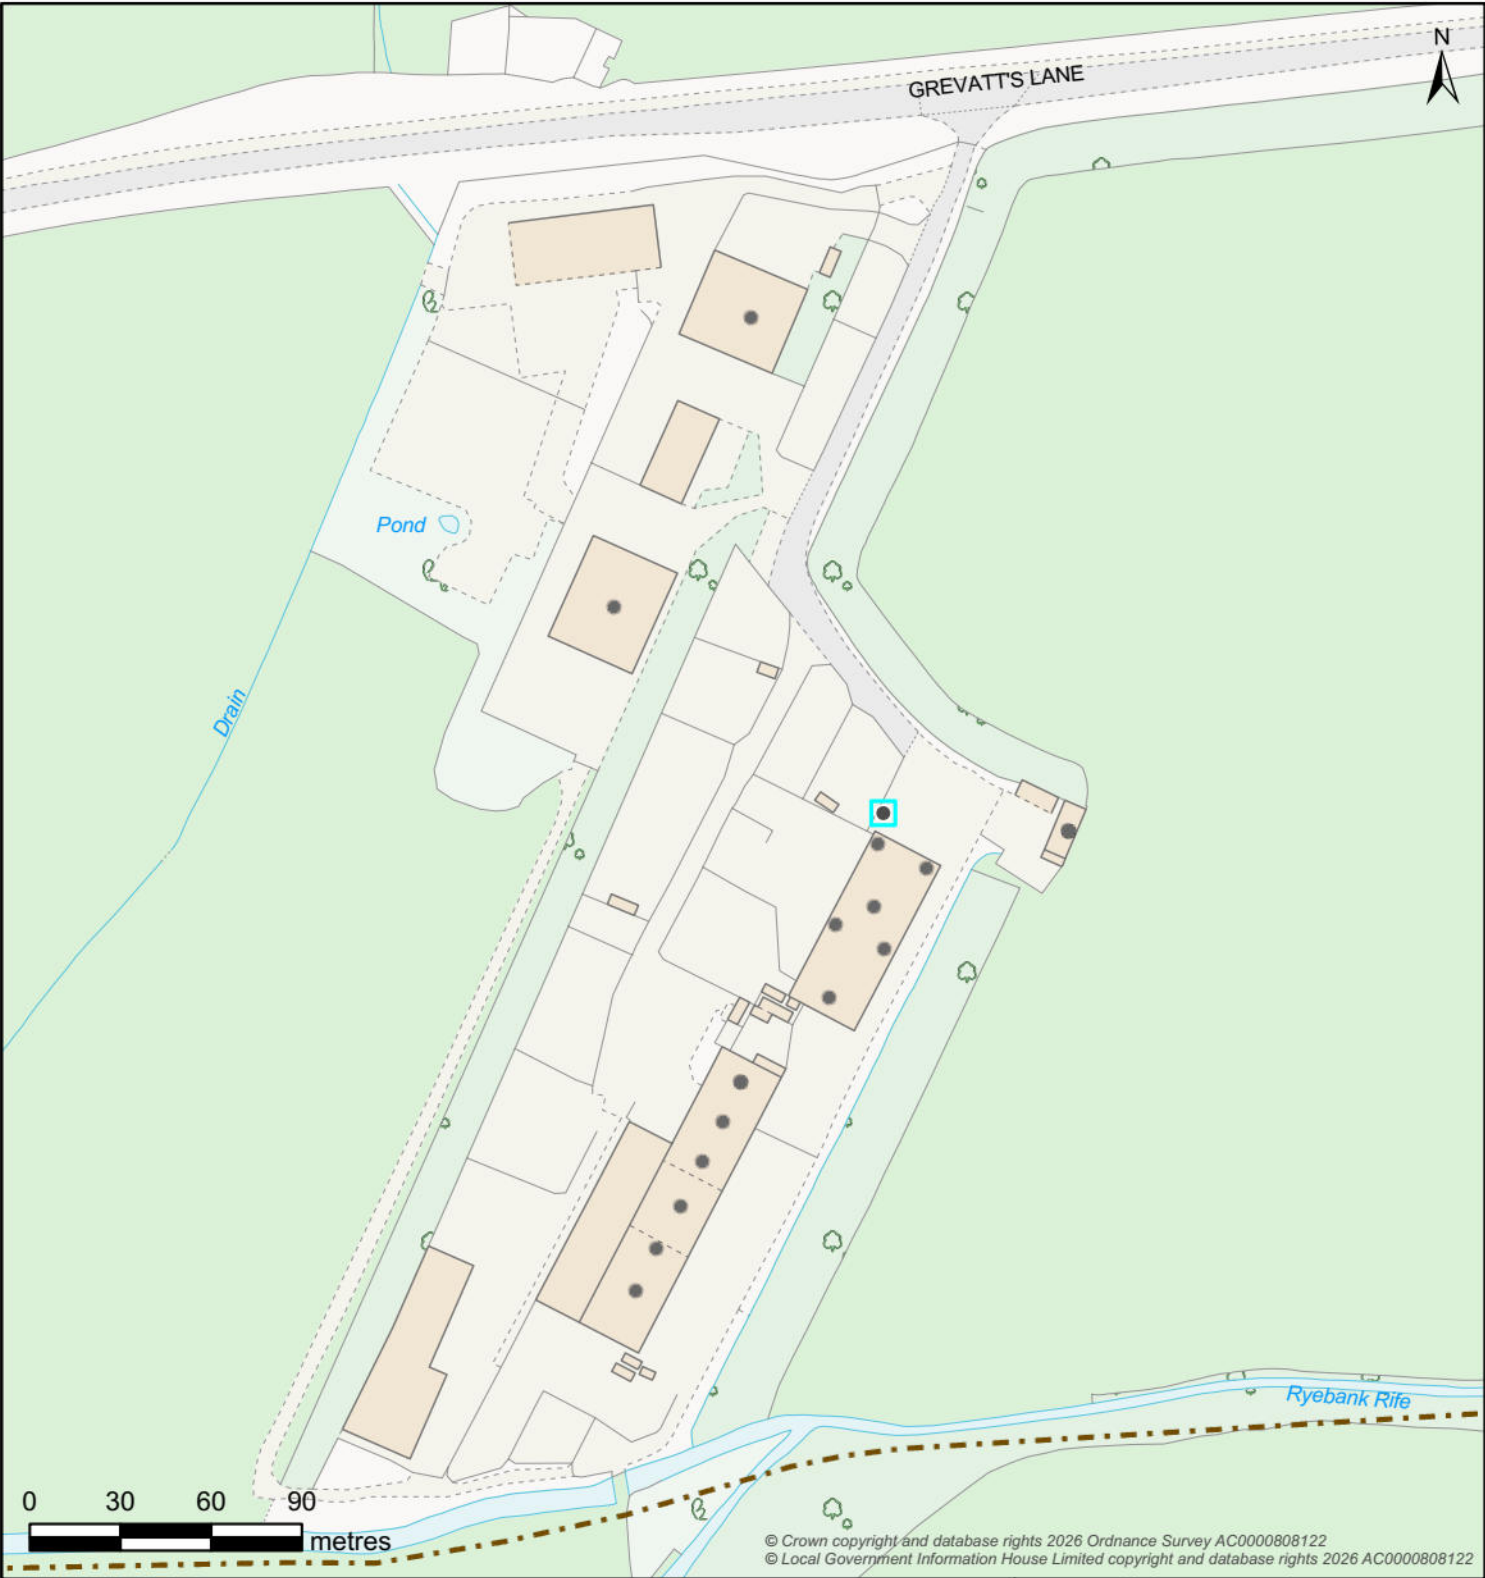

Controllable Valve			Flow Control			Inlet-Outfall	
Damboards	Penstock	Valve	Anti Flood Device	Pumped Anti Flood Device	Reflux Valve	Inlet	Outfall
Manhole							
BIF Bifurcation	Cascade	CP Catchpit	Head Of Public Sewer	IC Interceptor Chamber	Manhole	S Soakaway	WO Washout
Outfall Headworks		Overflow Chamber		Pipe Bridge		Pumping Station	
Outfall Headworks	CSO Combined Sewer Overflow	EMO Emergency Overflow	Pipe Bridge	Micro Pumping Station	Pumping Station		
Sewer Level Monitor		Storage		Treatment Works		Weir	
Sewer Level Monitor	Storm Tank	Tidal Storage Tank	Treatment Works	Weir	Wastewater Site		
Wastewater Pipe				Wastewater Use		Developer Services	
Culverted Water Course	Syphon	Tank Sewer	Trunk Sewer	Foul	Combined	Build Over Agreement	Section 104
Drain	Vacuum Main	Decommissioned Pipe		Sludge	Treated Effluent	Wastewater Area	
Outfall				Surface Water	Private	Catchment	Sub-Catchment
Overflow							
Rising Main							
Sewer							

Map Title: SW Print

Printed By: Anne.McFarlane2
Date Printed: 17/07/2026
Map Scale: 2500

The information provided is believed to be correct but is provided on an 'as is' basis and without any warranty or condition express or implied, statutory or otherwise as to its quality or fitness for purpose. Actual positions of assets should always be determined on site.



PL- Consultation- Southern Water response

Arun District Council, Civic Centre, Maltravers Rd
Littlehampton, West Sussex, BN17 5LF
www.arun.gov.uk

To register to receive notification of planning applications in your area please go to <https://www1.arun.gov.uk/planning-application-finder>

Our priorities...




Improving the wellbeing of Arun



Delivering the right homes in the right places



Supporting our environment to support us



Fulfilling Arun's economic potential



Our core foundations



Connect with us: [Facebook](#) | [X](#) | [Instagram](#)

From: SouthernWater PlanningConsultations [redacted]
Sent: 17 July 2026 15:54
To: Planning.Responses <Planning.Responses@arun.gov.uk>
Subject: CM/19/26/PL - SWS Planning Consultation - DSA000055864

CAUTION: This email originated from outside of the organisation. You should take extra care when clicking links or opening attachments - if you are unsure the content is safe contact the IT Helpdesk before clicking or opening.

Good afternoon,

Please find attached Southern Waters’ response to this planning application.

Yours faithfully,

Anne McFarlane
Future Growth Planning
Developer Services

southernwater.co.uk  

This e-mail is intended solely for the person or organisation to which it is addressed. It may contain privileged and confidential information. If you are not the intended recipient, you are prohibited from copying, disclosing or distributing this e-mail or its contents (as it may be unlawful for you to do so) or taking any action in reliance on it.

If you receive this e-mail by mistake, please delete it then advise the sender immediately.

Without prejudice to the above prohibition on unauthorised copying and disclosure of this e-mail or its contents, it is your responsibility to ensure that any onward transmission, opening or use of this message and any attachments will not adversely affect your or the onward recipients' systems or data. Please carry out such virus and other such checks as you consider appropriate.

An e-mail reply to this address may be subject to monitoring for operational reasons or lawful business practices

This e-mail is issued by Southern Water Services Limited, company number 2366670, registered in England and having its registered office at Southern House, Yeoman Road, Worthing, BN13 3NX, England.

In sending this e-mail the sender cannot be deemed to have specified authority and the contents of the e-mail will have no contractual effect unless (in either case) it is otherwise agreed between Southern Water Services Limited and the recipient.