




Notes:

Sub base to have a minimum porosity of 0.4,
epg Type 4/20 to BS EN 13242 or similar approved
by the engineer before construction works commence

Minimum sub base storage volume = 179.4 cum

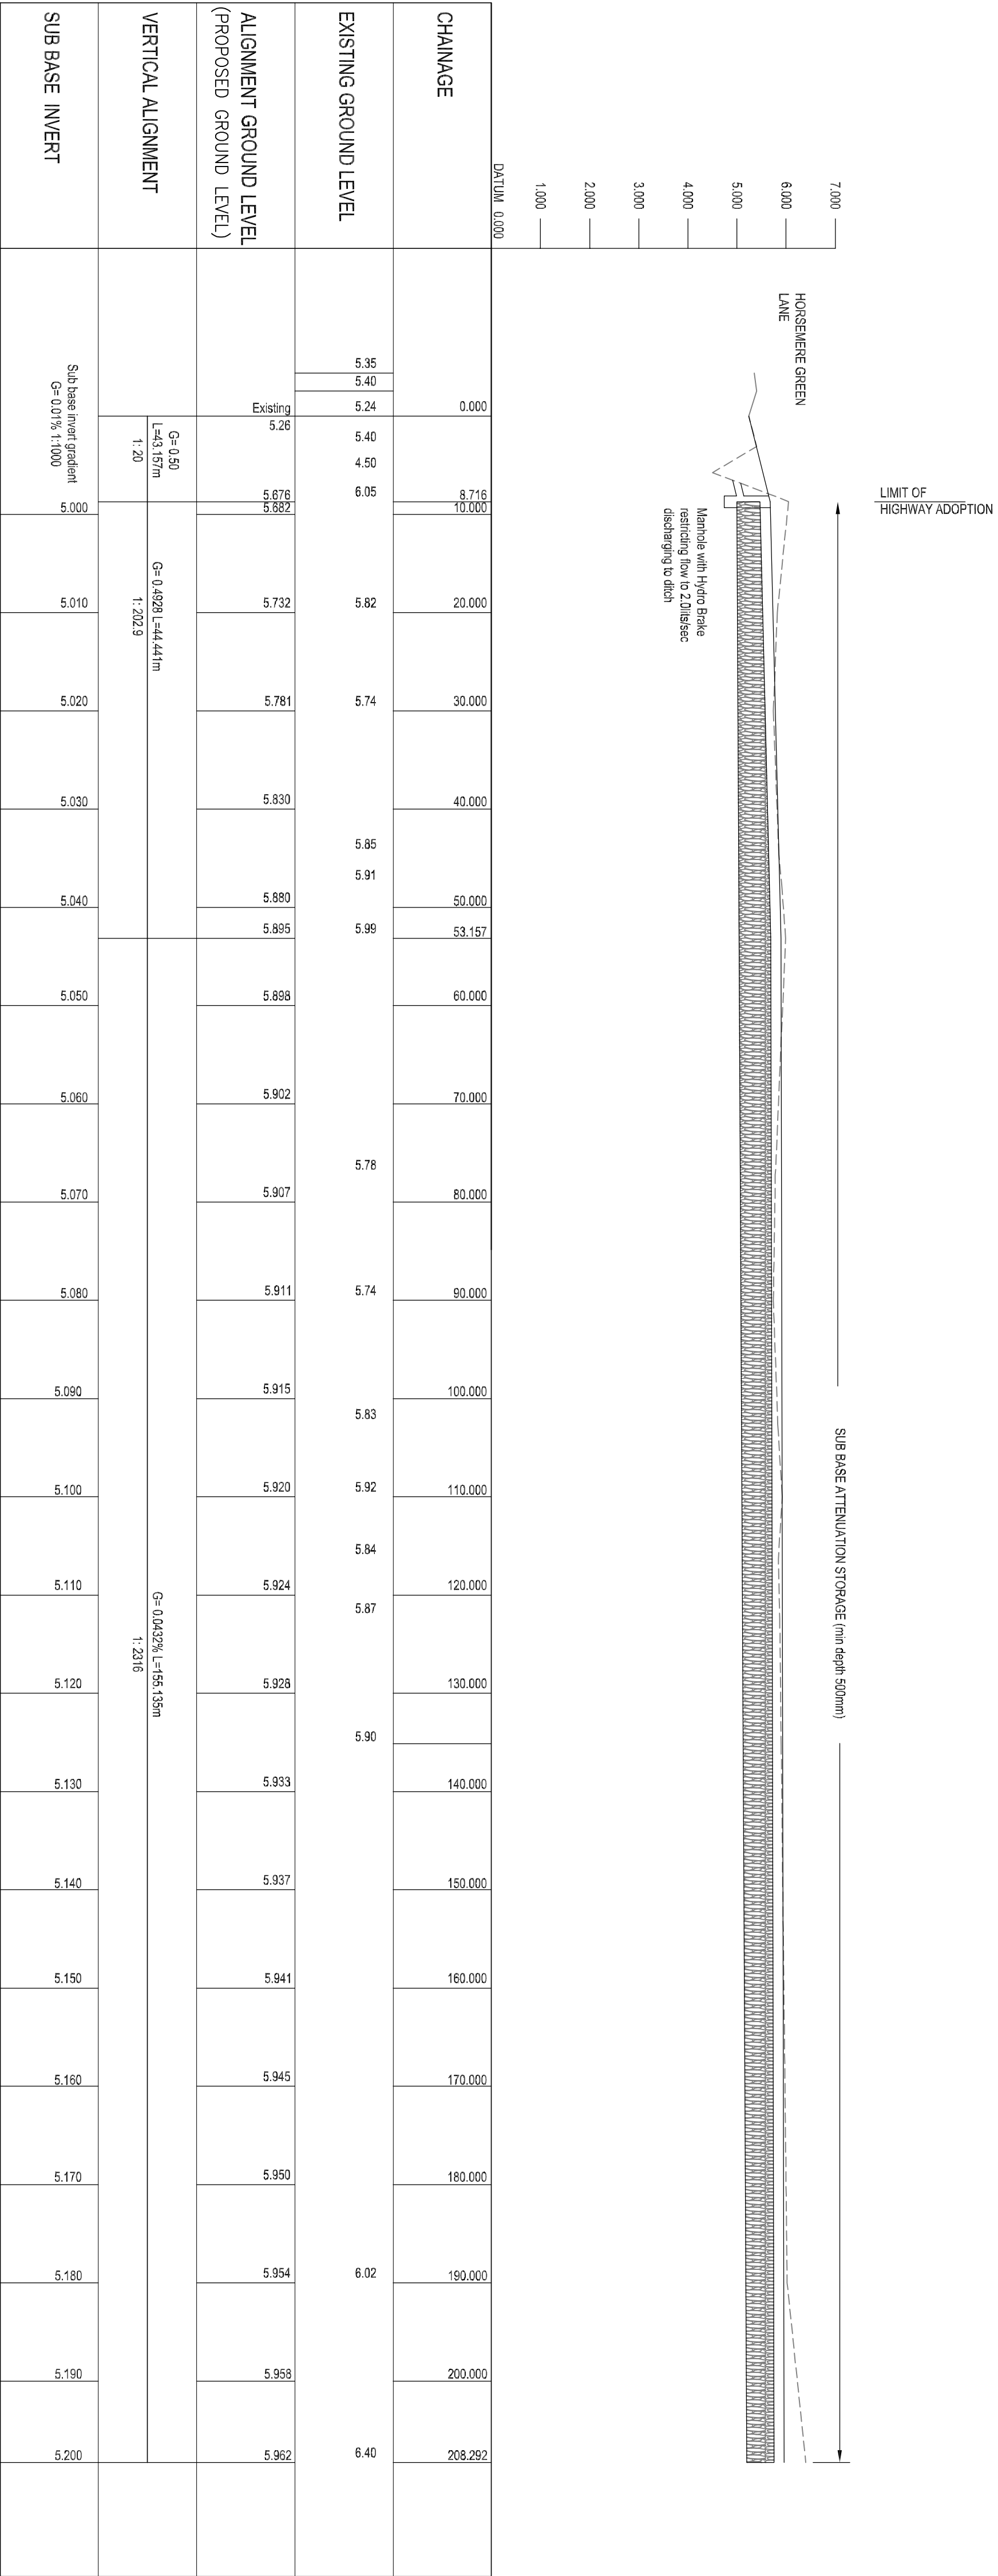