



from
**Southern
Water**

Planning and Development Services
Arun District Council
Arun Civic Centre
Maltravers Road
Littlehampton
West Sussex
BN17 5LF

Your ref
CM/34/21/PL

Our ref
PLAN-040458

Date
10/08/2021

Dear Sir/Madam,

Proposal: Change of use of part of site to car wash including siting of cabin and canopy. This application may affect the setting of a listed building & is in CIL Zone 5 (Zero Rated) as other development.

Site: CM/34/21/PL: - Maidenhead Aquatics, Crookthorn Lane, Climping BN17 5SN.

Thank you for your letter dated 08/07/2021.

Southern Water requires a formal application for any new connection to the public foul and surface water sewer to be made by the applicant or developer.

To make an application visit Southern Water's Get Connected service: developerservices.southernwater.co.uk and please read our New Connections Charging Arrangements documents which are available on our website via the following link: southernwater.co.uk/developing-building/connection-charging-arrangements

Areas used for vehicle washing should only be connected to the public foul sewer upon receipt of a trade effluent discharge licence.

The Trade Effluent application process for non-household (NHH) customers has changed since April 2017. This was a government decision to open the Market to competition.

In order to apply for a consent, you will need to engage a Retailer and submit the application through them.

Southern Water (SWS) is still the owner of assets (Wholesaler), but all administrative or billing matters are conducted by the Retailer of your choice.

Southern Water, Southern House, Yeoman Road, Worthing, West Sussex, BN13 3NX
southernwater.co.uk

Southern Water Services Ltd, Registered Office: Southern House, Yeoman Road, Worthing, West Sussex, BN13 3NX Registered in England No. 2366670

Attached is a link to the Open Water website that lists Retailers available. Please note that not all Retailers will provide a Trade Effluent service. open-water.org.uk/for-customers/find-a-retailer/suppliers/english-water-and-wastewater-retailers

Once we have received an application via your appointed water retailer, we have 2 months to issue a consent or refuse the application. Any requirement to discharge directly to the environment will require a permit/consent from the Environment Agency.

Due to surface water inundation issues in the Lidsey Catchment the applicant is advised to adopt, where appropriate, the measures set out in the table "Practical measures to reduce the potential impacts of development". The developer should look to protect the public sewerage system from inundation and infiltration, which contribute to flooding in unfavourable conditions.

It is possible that a sewer now deemed to be public could be crossing the development site. Therefore, should any sewer be found during construction works, an investigation of the sewer will be required to ascertain its ownership before any further works commence on site.

For further advice, please contact Southern Water, Southern House, Yeoman Road, Worthing, West Sussex, BN13 3NX [REDACTED]


Website: southernwater.co.uk or by email at: [REDACTED]

Yours faithfully,

Growth Planning Team
Business Channels

southernwater.co.uk/developing-building/planning-your-development

SOUTHERN WATER

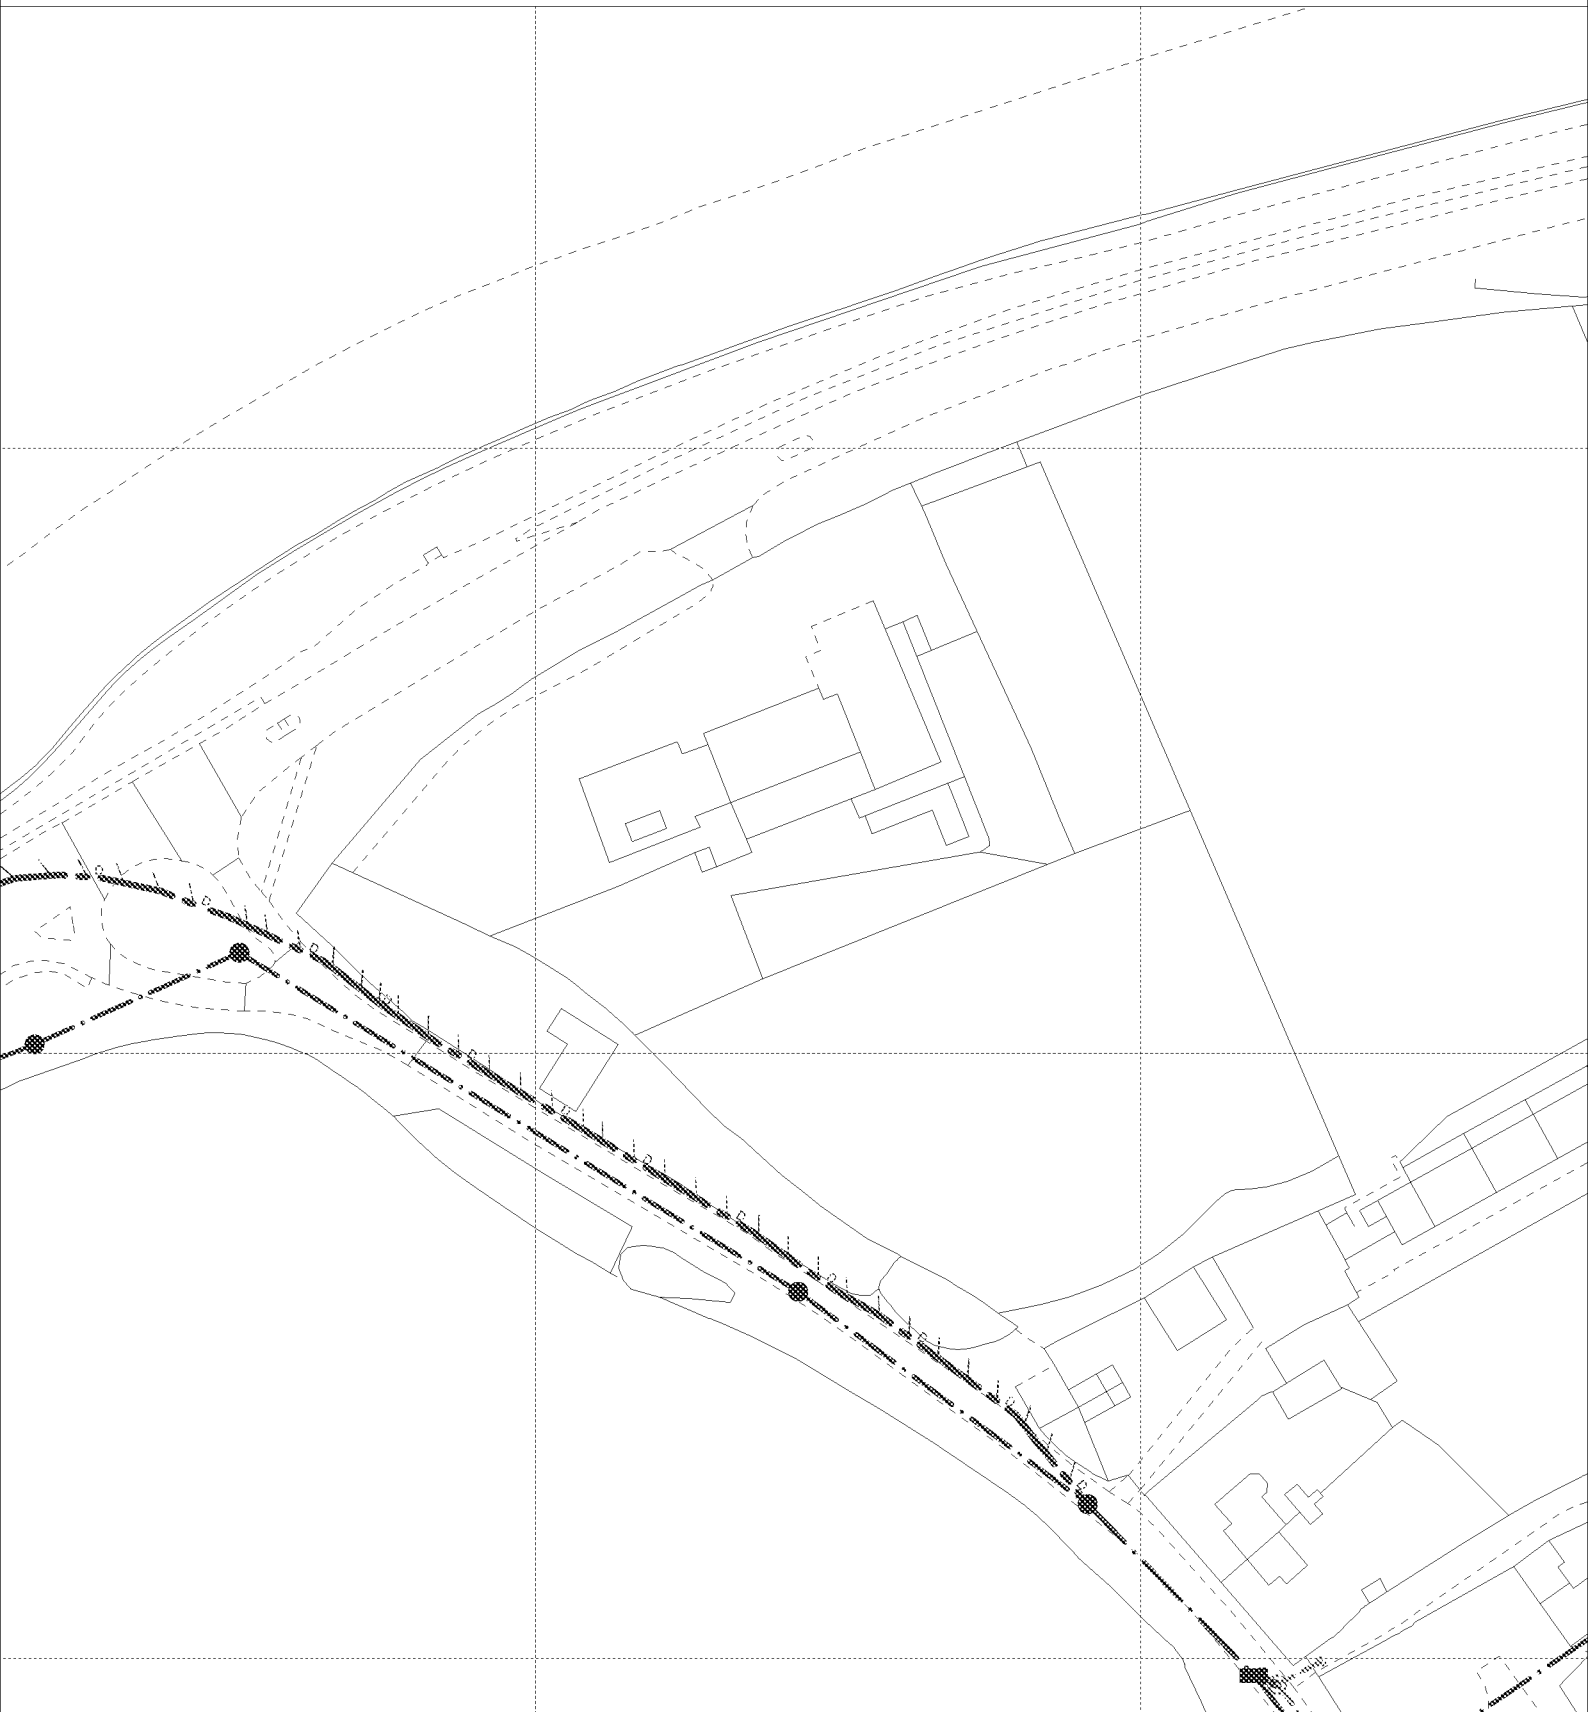

The positions of pipes shown on this plan are believed to be correct, but Southern Water Services Ltd accept no responsibility in the event of inaccuracy. The actual positions should be determined on site.

Based upon Ordnance Survey Digital Data with the permission of the controller of H.M.S.O. Crown Copyright Reserved Licence No. WU 298530

O.S. REF: SU9901NE

Scale: 1:1250

Screen Print

WARNING: BAC pipes are constructed of Bonded Asbestos Cement

WARNING: Unknown (UNK) materials may include Bonded Asbestos Cement

ARUN DISTRICT COUNCIL CM/34/21/PL



Printed By: kishoku

Date: 10-8-2021

Southern Water MapGuide Browser

Requested By:



Practical measures to reduce the potential adverse impacts of development

Reasons	Practical measures
Adequate and sustainable surface water drainage.	No surface water connections to the wastewater system. (See part H of the Building Regulations)
Guard against further groundwater infiltration into the foul drains or sewers serving the development.	The use of fusion jointed MDPE pipes can prevent groundwater infiltration and require a minimum of maintenance. The use of mass concrete surrounds to inspection chambers and manholes can prevent infiltration and require a minimum of maintenance
Guard against surface floodwaters entering the foul system serving the development.	Overland surface water flow routes should be provided for flows greater than those for which pipelines and culverts have been designed. Wherever possible, foul sewer routes, manhole covers, sink waste gullies, etc. should avoid overland surface water flow routes and any areas where surface water ponding may occur. Failing that they should be sealed against potential surface water inflows. Any sink waste gullies in areas of potential surface water inundation should be sealed or defended by raised brickwork or similar Bolt down sealed inspection chamber and manholes covers should be used in areas of potential surface water inundation. Raising the level of the development above the highways which serve it can protect buildings and their drainage systems from potential surface water inundation. However, care should be taken at local low spots in the highway where overland surface water flows may gather and overflow onto properties.

Protect the properties from foul flooding or unusable sanitation should the public sewerage system surcharge.	Part H of the Building Regulations contains suitable practical measures. However, the provision of an external gully is inappropriate where there is a risk of surface water flooding. In these circumstances, non-return valves are more appropriate. Dirgo or similar non-return air valves are now commonly fitted to soil vent pipes thereby allowing them to allow them to vent within the building. This practice can lead to problems with bubbling WCs, the blow out of U bend traps and odour within buildings when the sewerage system surcharges. The use of traditional external vent pipes without air valves can prevent this.
--	---