


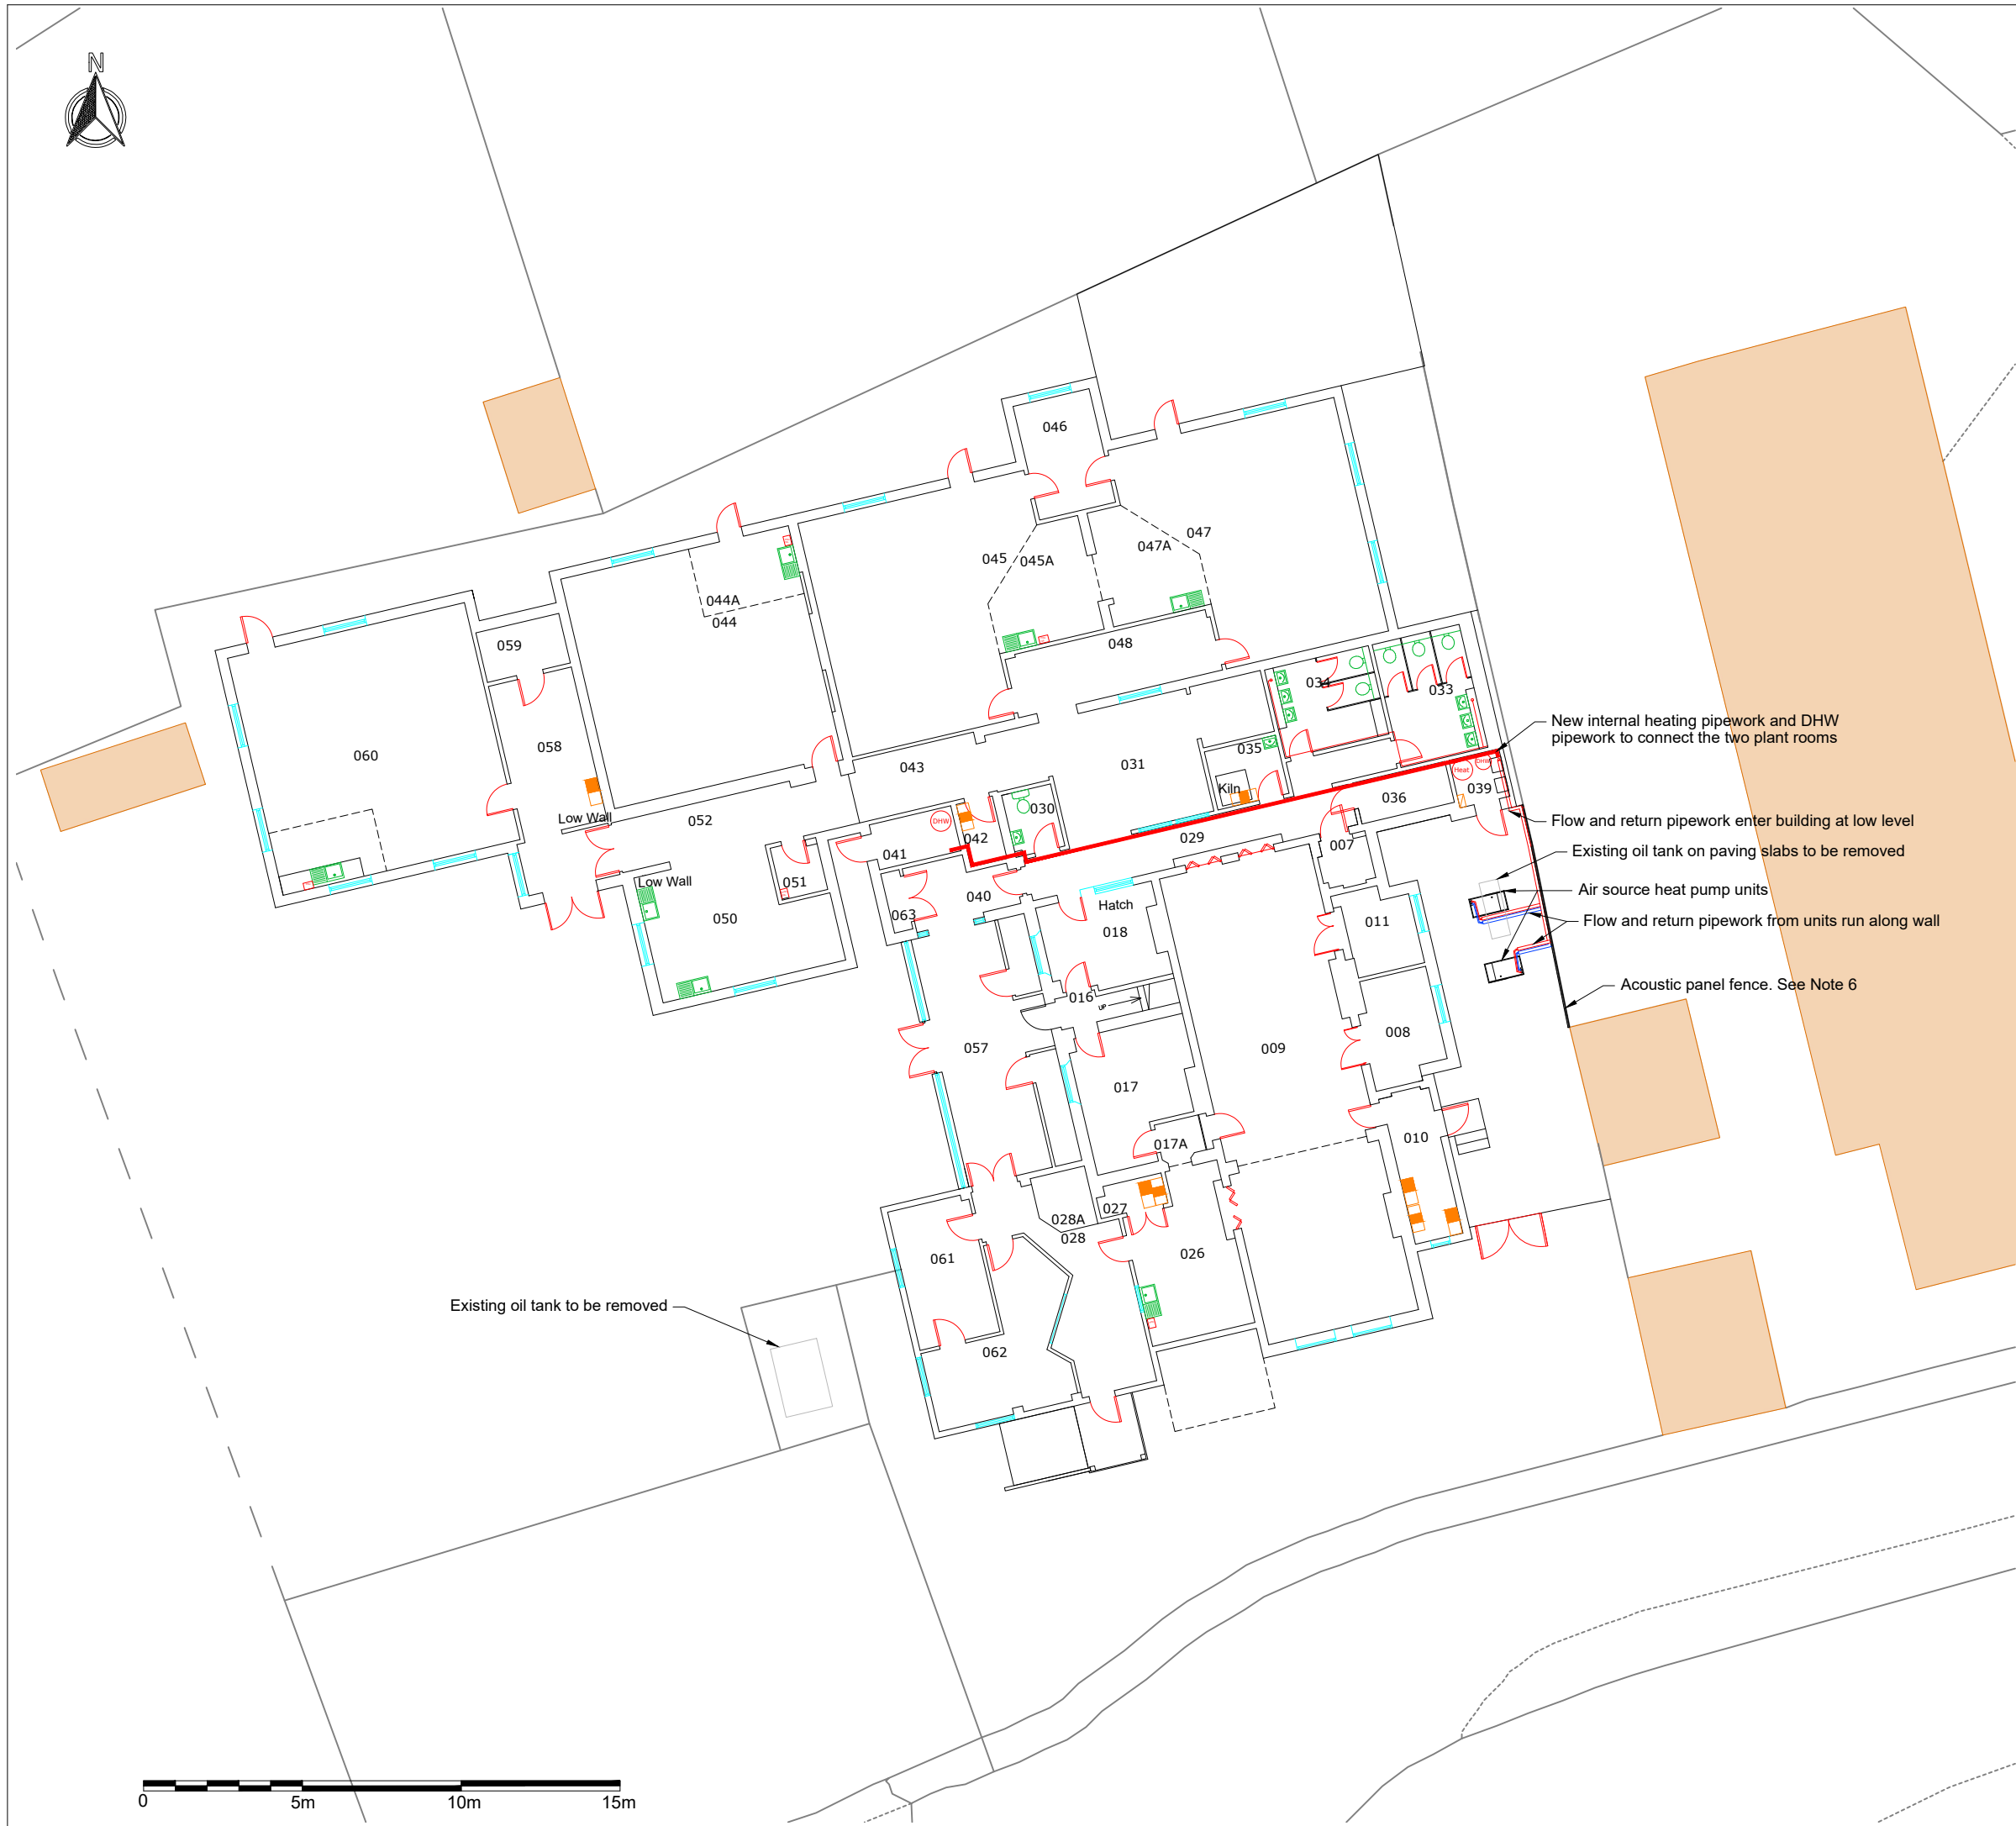

- Notes:
- Existing oil tanks and oil boilers are to be removed.
 - Two Viessmann Vitocal 150-A Pro 16kW air source heat pump (ASHP) units are to be installed and sit on big foot system.
 - Flow and return pipework from the ASHP are to run along the bottom of the existing boundary wall and into Plant Room 039.
 - Internal pipework is to be installed to connect the heating circuits in Plant Room 041 to the main heating buffer tank in 039. New DHW pipework will be installed along the same route.
 - The electrical fuses in the electrical room 010 are to be upgraded.
 - The existing mesh fence on the boundary wall is to be removed and replaced with acoustic panel timber fence to a height of 600mm above the wall.

New internal heating pipework and DHW pipework to connect the two plant rooms

Flow and return pipework enter building at low level

Existing oil tank on paving slabs to be removed

Air source heat pump units

Flow and return pipework from units run along wall

Acoustic panel fence. See Note 6

Existing oil tank to be removed

CLIENT:  DIOCESE OF CHICHESTER TO BEHOLD • LOVE • FOLLOW • JESUS Diocese of Chichester		CONSULTANT: reenergise ReEnergise Projects Limited	
PROJECT: PSDS 4 Decarbonisation Project St Mary's C of E Primary School			
TITLE: Proposed Plan			
DATE: 16-01-2026		DSG/CHK/AP: AML / GJ / IH	
DRAWING NUMBER: 25-1247-02/003		SCALE: 1:200 @ A3	
STATUS: INFORMATION		REVISION: A	