




From: DaSilva, Luis [REDACTED]
Sent: 27 November 2017 10:10
To: Planning.Responses
Subject: planning application consultation - EG/74/17/PL

Dear Sir/ Madam,

Please find attached our response letter to the above planning application consultation.


Kind Regards

Luis Da Silva
Technical Co-ordinator
Developer Services
Southern House, Sparrowgrove, Otterbourne, Hant SO21 2SW




This e-mail is intended solely for the person or organisation to which it is addressed. It may contain privileged and confidential information. If you are not the intended recipient, you are prohibited from copying, disclosing or distributing this e-mail or its contents (as it may be unlawful for you to do so) or taking any action in reliance on it. If you receive this e-mail by mistake, please delete it then advise the sender immediately. Without prejudice to the above prohibition on unauthorised copying and disclosure of this e-mail or its contents, it is your responsibility to ensure that any onward transmission, opening or use of this message and any attachments will not adversely affect your or the onward recipients' systems or data. Please carry out such virus and other such checks as you consider appropriate. An e-mail reply to this address may be subject to monitoring for operational reasons or lawful business practices. This e-mail is issued by Southern Water Services Limited, company number 2366670, registered in England and having its registered office at Southern House, Yeoman Road, Worthing, BN13 3NX, England. In sending this e-mail the sender cannot be deemed to have specified authority and the contents of the e-mail will have no contractual effect unless (in either case) it is otherwise agreed between Southern Water Services Limited and the recipient.

This message has been scanned for malware by Websense. [REDACTED]

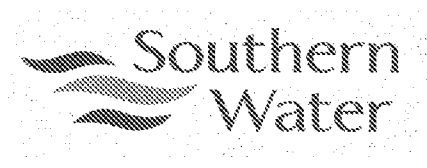

Planning and Development Services
Arun District Council
Arun Civic Centre
Maltravers Road
Littlehampton
West Sussex
BN17 5LF

Developer Services
Southern Water
Sparrowgrove House
Sparrowgrove
Otterbourne
Hampshire
SO21 2SW



EG/74/17/PL

Our Ref

PLAN-020805

Date

27/11/2017

Dear Sirs,

Proposal: Change of use of barn to storage (B8 Storage or Distribution).

Site: Woodfield Farm, Wandleys Lane, Eastergate, PO20 3SE.

EG/74/17/PL

Thank you for your letter of 18/11/2017.

The applicant is advised to consult the Environment Agency directly regarding the use of a private treatment plant which disposes of effluent to sub-soil irrigation and surface water disposal for the site. The owner of the premises will need to maintain the works to ensure its long-term effectiveness.

It may be possible for the flows from the proposed development to be connected to a nearby public sewer, and the applicant may wish to investigate this option. Southern Water requires a formal application for a connection to the public sewer. The applicant is advised to contact Southern Water, Sparrowgrove House, Sparrowgrove, Otterbourne, Hampshire SO21 2SW



The Council's Building Control officers or technical staff should be asked to comment on the adequacy of soakaways to dispose of surface water from the proposed development.

Due to changes in legislation that came in to force on 1st October 2011 regarding the future ownership of sewers it is possible that a sewer now deemed to be public could be crossing the above property. Therefore, should any sewer be found during construction works, an



investigation of the sewer will be required to ascertain its condition, the number of properties served, and potential means of access before any further works commence on site.

The applicant is advised to discuss the matter further with Southern Water, Sparrowgrove House Sparrowgrove, Otterbourne, Hampshire SO21 2SW [REDACTED]
[REDACTED]

The proposed development would lie within a Source Protection Zone as defined under the Environment Agency's Groundwater Protection Policy. The Environment Agency to ensure the protection of the water supply source.

Due to surface water inundation issues in the Lidsey Catchment "The applicant is advised to adopt, where appropriate, the measures in the table "Practical measures to reduce the potential impacts of development".

Developer should look to protect the public sewerage system from inundation and infiltration, which contribute to flooding in unfavourable conditions.

Yours sincerely,

[REDACTED]

Developer Services

Practical measures to reduce the potential adverse impacts of development

Reasons	Practical measures
Adequate and sustainable surface water drainage.	No surface water connections to the wastewater system. (See part H of the Building Regulations)
Guard against further groundwater infiltration into the foul drains or sewers serving the development.	- The use of fusion jointed MDPE pipes can prevent groundwater infiltration and require a minimum of maintenance. - The use of mass concrete surrounds to inspection chambers and manholes can prevent infiltration and require a minimum of maintenance
Guard against surface floodwaters entering the foul system serving the development.	- Overland surface water flow routes should be provided for flows greater than those for which pipelines and culverts have been designed. - Wherever possible, foul sewer routes, manhole covers, sink waste gullies, etc. should avoid overland surface water flow routes and any areas where surface water ponding may occur. Failing that they should be sealed against potential surface water inflows. - Any sink waste gullies in areas of potential surface water inundation should be sealed or defended by raised brickwork or similar - Bolt down sealed inspection chamber and manholes covers should be used in areas of potential surface water inundation. - Raising the level of the development above the highways which serve it can protect buildings and their drainage systems from potential surface water inundation. However, care should be taken at local low spots in the highway where overland surface water flows may gather and overflow onto properties.
Protect the properties from foul flooding or unusable sanitation should the public sewerage system surcharge.	- Part H of the Building Regulations contains suitable practical measures. However, the provision of an external gully is inappropriate where there is a risk of surface water flooding. In these circumstances, non-return valves are more appropriate. - Dirigo or similar non-return air valves are now commonly fitted to soil vent pipes thereby allowing them to allow them to vent within the building. This practice can lead to problems with bubbling WCs, the blow out of U bend traps and odour within buildings when the sewerage system surcharges. The use of traditional external vent pipes without air valves can prevent this.

SOUTHERN WATER



The positions of pipes shown on this plan are believed to be correct, but Southern Water Services Ltd accept no responsibility in the event of inaccuracy. The actual positions should be determined on site.

Based upon Ordnance Survey Digital Data with the permission of the controller of H.M.S.O. Crown Copyright Reserved Licence No. WU 298530

O.S. REF: SU9506SW

Scale: 1:1250

Screen Print

ARUN DISTRICT COUNCIL EG/74/17/PL

WARNING: BAC pipes are constructed of Banded Asbestos Cement

WARNING: Unknown (HOK) materials may include Banded Asbestos Cement



Printed By: banuh

Date: 26-10-2017

Southern Water MapGuide Browser

Requested By:

N