


Drawing No: X:\PROJECTS\4501_Marmont_EastPreston\Plans\4501_Marmont_EastPreston_DrainageLayout.dwg

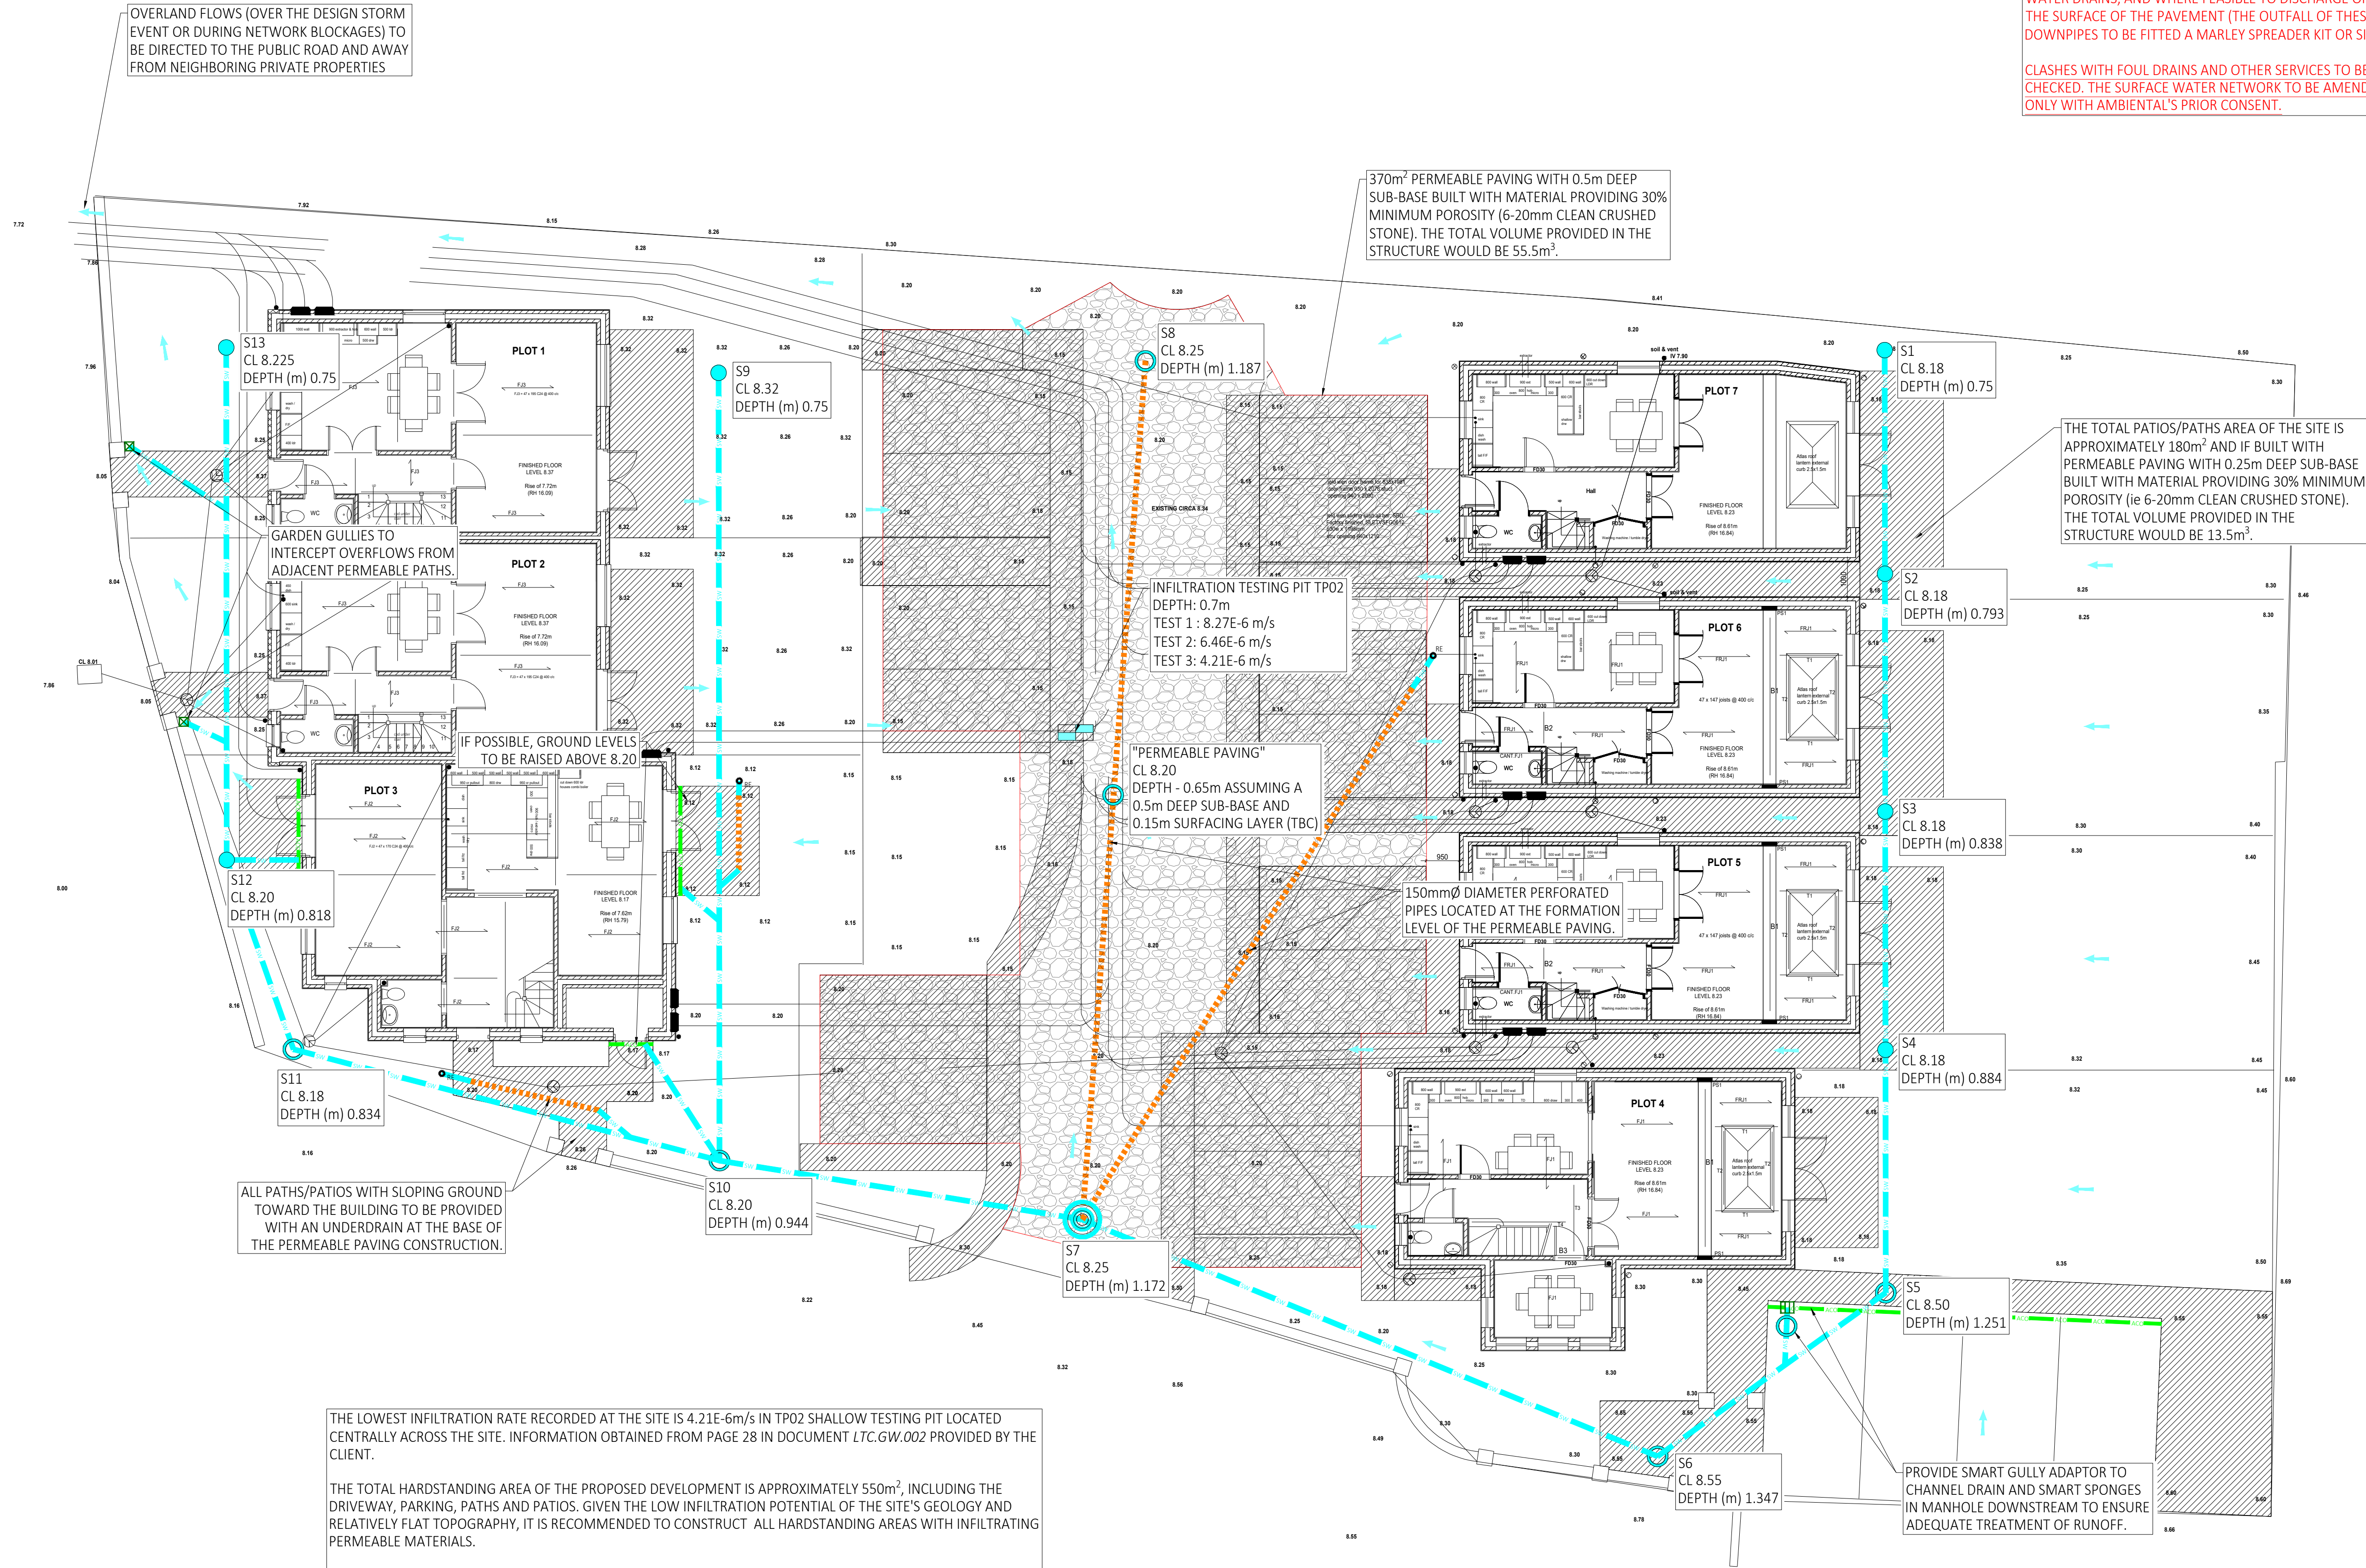

DRAINAGE SCHEME SUBJECT TO CONFIRMATION OF SITE LEVELS, WIDER CONSTRUCTION DETAILS AND APPROVAL BY LPA.

ALL SURFACE WATER DRAINS TO BE LAID AT 1 IN 150 GRADIENT AND HAVE A DIAMETER OF 150mm, UNLESS OTHERWISE NOTED ON THE ELEMENT.

ALL RWPs TO CONNECT TO THE NEAREST INDICATED SURFACE WATER DRAINS, AND WHERE FEASIBLE TO DISCHARGE ONTO THE SURFACE OF THE PAVEMENT (THE OUTFALL OF THESE DOWNPIPES TO BE FITTED A MARLEY SPREADER KIT OR SIMILAR)

CLASHES WITH FOUL DRAINS AND OTHER SERVICES TO BE CHECKED. THE SURFACE WATER NETWORK TO BE AMENDED ONLY WITH AMBIENTAL'S PRIOR CONSENT.

- GENERAL
a. THIS DRAWING IS NOT TO BE SCALED, WORK TO FIGURED DIMENSIONS ONLY, CONFIRMED ON SITE.
b. THIS DRAWING IS TO BE READ IN CONJUNCTION WITH ALL RELEVANT ARCHITECTURAL DRAWINGS, DETAILED SPECIFICATIONS WHERE APPLICABLE AND ALL ASSOCIATED DRAWINGS IN THIS SERIES.
c. ANY DISCREPANCY ON THIS DRAWING IS TO BE REPORTED IMMEDIATELY TO THE PARTNERSHIP FOR CLARIFICATION.
d. THE CONTRACTOR IS RESPONSIBLE FOR ALL TEMPORARY WORKS AND FOR THE STABILITY OF THE WORKS IN PROGRESS.
e. CDM REGULATIONS 2015. ALL CURRENT DRAWINGS AND SPECIFICATIONS MUST BE READ IN CONJUNCTION WITH THE DESIGNER'S HAZARD RISK AND ENVIRONMENTAL ASSESSMENT RECORD. DESIGN HAS BEEN PRODUCED BASED ON INFORMATION PROVIDED BY THE CLIENT/PRINCIPLE DESIGNER AVAILABLE AT TIME OF ISSUE. CONTRACTOR TO REVIEW DRAWING AND SPECIFICATION IN CONTEXT WITH THE WIDER SITE AND SPECIFIC SITE INVESTIGATION, CONTAMINATION ASSESSMENT, ASBESTOS SURVEY, ENVIRONMENTAL SURVEY, LVO SURVEY AND ANY OTHER RELEVANT INFORMATION AND MANAGE RISKS RELATING TO THE WORKS OUTLINED IN THE DRAWINGS AND SPECIFICATION. PRINCIPLE CONTRACTOR TO MAKE DESIGNER AND CLIENT AWARE OF SITE SPECIFIC RISKS THAT MAY AFFECT THE DRAWING AND SPECIFICATION.
f. CDM REGULATIONS 2015. FOR GENERIC MAINTENANCE AND MANAGEMENT RISKS REFER TO CHAPTER 36 OF CIRIA 752 SUDS MANUAL FOR PROPRIETARY SYSTEMS. SEE MANUFACTURER'S MANAGEMENT AND MAINTENANCE DETAILS AND RISK ASSESSMENT WITH REGARDS TO MAINTENANCE OF PROPRIETARY SYSTEMS.
- CONSTRUCTION NOTE
a. THE MAIN CONTRACTOR IS RESPONSIBLE FOR THE DESIGN OF ALL TEMPORARY WORKS, AND IS ALSO RESPONSIBLE FOR THE SAFE MAINTENANCE AND STABILITY OF EXISTING BUILDINGS AT ALL TIMES.
b. THE MAIN CONTRACTOR IS RESPONSIBLE FOR ALL OCCURRENCES OF GROUND WATER DURING THE CONSTRUCTION PERIOD.
c. ANY INFORMATION GIVEN REGARDING EXISTING UNDERGROUND SERVICES IS GIVEN IN GOOD FAITH AFTER CONSULTATION WITH THE RELEVANT AUTHORITY, HOWEVER ACCURACY IS NOT CERTAIN. THE MAIN CONTRACTOR IS RESPONSIBLE FOR CHECKING ALL INFORMATION ON SITE PRIOR TO WORK COMMENCING AND TAKING DUE CARE AND ATTENTION WHILST UNDERTAKING THE WORKS.
d. THE CONTRACTOR MUST COMPLY WITH ALL CURRENT LEGISLATION RELATING TO HEALTH & SAFETY.
e. ALL PRODUCTS SPECIFIED SHALL BE INSTALLED IN STRICT ACCORDANCE WITH THE MANUFACTURERS RECOMMENDATIONS AND INSTRUCTIONS. IF THERE ARE DISCREPANCIES BETWEEN THAT INFORMATION AND THE DETAILS ON ANY AMBIENTAL DRAWINGS, THE MANUFACTURERS INSTRUCTIONS MUST BE USED.
- BELOW GROUND DRAINAGE
a. PIPEWORK TO BE UPVC/D PIPES TO BS 4660 : 2000 AND INSPECTION CHAMBERS TO BS 7158 : 2001.
b. ALL ADAPTABLE DRAINAGE TO BE CONSTRUCTED IN ACCORDANCE WITH 'SEWERS FOR ADOPTION' 7TH EDITION AND THE RELEVANT COUNCIL DESIGN GUIDE.
c. ALL PRIVATE SURFACE WATER SEWERS TO BE LAID AT 1 IN 100 UNLESS OTHERWISE STATED ON THE DRAWING.
d. ALL PRIVATE FOUL WATER SEWERS TO BE LAID AT 1 IN 40 AT THE HEAD OF PIPE RUNS AND 1 IN 80 ELSEWHERE UNLESS OTHERWISE STATED.
e. ALL PRIVATE FOUL SEWER PIPES TO BE 150MM DIAMETER UNLESS OTHERWISE STATED ON THE DRAWING. ALL PRIVATE SURFACE WATER SEWER PIPES TO BE 100MM DIAMETER FROM DOWNPIPES AND 150MM DIAMETER ELSEWHERE UNLESS OTHERWISE STATED ON THE DRAWING.
f. ALLOW FOR RODDING ACCESS ABOVE GROUND WHERE RAINWATER DOWNPIPES DO NOT HAVE A DIRECT CONNECTION TO AN INSPECTION CHAMBER. EXISTING SEWER PIPE TO BE RE-USED TO BE SURVEYED AND LEVELLED PRIOR TO COMMENCEMENT OF THE DRAINAGE WORKS AND REFURBISHED IF NECESSARY.
g. CONNECTIONS TO AN ADOPTED SEWER ONLY TO BE MADE FOLLOWING APPROVAL FROM THE RELEVANT ADOPTING AUTHORITY.
h. ALL DRAINS, SEWER PIPES AND MANHOLES TO BE CLEANED AND TESTED FOR WATER TIGHTNESS ON COMPLETION OF CONSTRUCTION.
- MANHOLE COVERS AND FRAMES
a. MANHOLE COVERS TO BE CLASS D400 IN HIGHWAYS, CLASS B125 IN FOOTWAYS AND VERGES, CLASS A15 IN NON-TRAFFICKED AREAS.
b. MANHOLE COVER AND FRAME TO BE BEDDED AND SURROUNDED IN 1:3 MORTAR.

LEGEND

- PRIVATE SURFACE WATER DRAIN
- PERFORATED SURFACE WATER DRAIN
- SLOT/CHANNEL DRAIN
- TYPE 2 MANHOLE
- TYPE 3 INSPECTION CHAMBER
- TYPE 4 INSPECTION CHAMBER
- RODDING EYE
- ROAD GULLY
- BOTTLE GULLY
- MAIN STORAGE AREA
- OVERLAND FLOW ROUTE

REV	DATE	CKD	APPD	BY	DESCRIPTION
PRELIMINARY DRAWING FOR INFORMATION ONLY. NOT FOR CONSTRUCTION.					
Client MARMONT DEVELOPMENTS LTD					
Project 9 LIME CLOSE TREE, EAST PRESTON, BN16 1JA PROJECT NO. 4501					
Drawing SURFACE WATER DRAINAGE DESIGN PROPOSED LAYOUT					
Drawn by: SD				Date: MAY-2019	
Drawing No. 4501-01				Revision -	
Drawing Scale: 1:100 @ A1 0 1m 2m 3m 4m 5m					