


Under all hardstanding areas backfill with 40mm down graded stone , hard- core. elsewhere (ie soft landscaped areas) backfill with approved selected material.




Class 's' pipe bedding detail

DIMENSION a :- in rock or material containing hard spots sleeved jointed pipes - 150mm min. socketed pipes - 200mm min . elsewhere esleeve djointed pipes - 150mm min socketed pipes - 150mm


PIPE NOMINAL BORE (DN)	MAX. PARTICLE SIZE (mm)	CLASS OF BEDDING	SUITABLE IMPORTED GRANULAR MATERIALS
100 dia	10	S	10mm NOMINAL SINGLE-SIZED OR 10mm TO 5mm GRADED.
OVER 100 TO 150 dia	15	S	max 14mm NOMINAL SINGLE-SIZED OR 14mm TO 5mm GRADED.
OVER 150 TO 600dia	20	S	max 20mm NOMINAL SINGLE -SIZED OR 20mm TO 5mm GRADED.
OVER 600	40	S	max 40mm NOMINAL SINGLE-SIZED OR 40mm TO 5mm GRADED.

Compressible filler to consist of bitumen impregnated insulating board to BS 1142: part 3 or other equally compressible material. (for thickness of compressible filler see table above.)

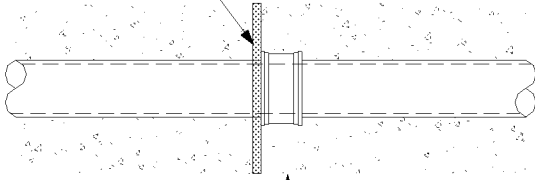

Movement joint to be formed with compressible board upstream of each socket or sleeve joint face. see table above for board thickness

Nominal DIA of pipe (mm)	Thickness of compressible filler (mm)
Less than 450	18
450-1200	36
Exceeding 1200	54



Typical concrete pipe surround detail class 'Z' bedding

NOTES WITH RESPECT TO GEO-CELLULAR SURFACE WATER ATTENUATION TANKS

All modular geo-cellular surface water drainage attenuation tanks shall be designed by a specialist contractor in accordance with:

- Eurocode 7 (BS EN 1997-1-2004)
- CIRIA report C680

Design shall include checks for:

- Flotation
- Dynamic and cyclic loading
- Creep
- Deformation

As well as the following vertical loads and associated surcharge (both on & adjacent to the tank)

- Surfacing - 500mm (includes 150mm tarmac surface and 350mm stone foundation.)
- Backfill underlying the surfacing, specification to be determined by manufacturer min 1100mm
- Distributed loads 10 kn/m²
- Concentrated loads 50kn (vehicles up to 16,000kg)

Deflection of the surfacing shall be limited to less than 1mm by design.


Installation is to be carried out to manufacturer's specific installation requirements including points listed below:

- Clean, firm level base
- No material stockpiles over unless this has been allowed for by design
- Dewater excavation until design cover against flotation has been placed
- Vents to be installed as required by tank manufacturer

Construction plant such as excavators can impose significant loads on any cellular storage the following guidelines should be followed:


- Care must be taken not to damage the units especially edges of the units
- Where ever possible machines placing back fill material should not load the tank. where this is not possible a minimum of 300mm thick layer of fill should be placed over the units. Only tracked excavators not exceeding 20 tonnes weight should be used.
- Compaction plant used over the units should not exceed 2300kg/metre width compaction should be done in accordance with the Specification for Highway Works.
- All site traffic should be prevented from trafficking the system even once finished unless site specific assessment demonstrates that it is acceptable.
- Under no circumstances are cranes or their outriggers to load the storage

Back fill under landscaped areas to be done with selected site won material free from large/sharp objects. Backfill under trafficked areas is to be selected granular material suitable for compaction with the plant available. Backfill materials needs to be suitable for end use and capable of being laid above the cells with compaction plant deemed appropriate by the manufacturer.

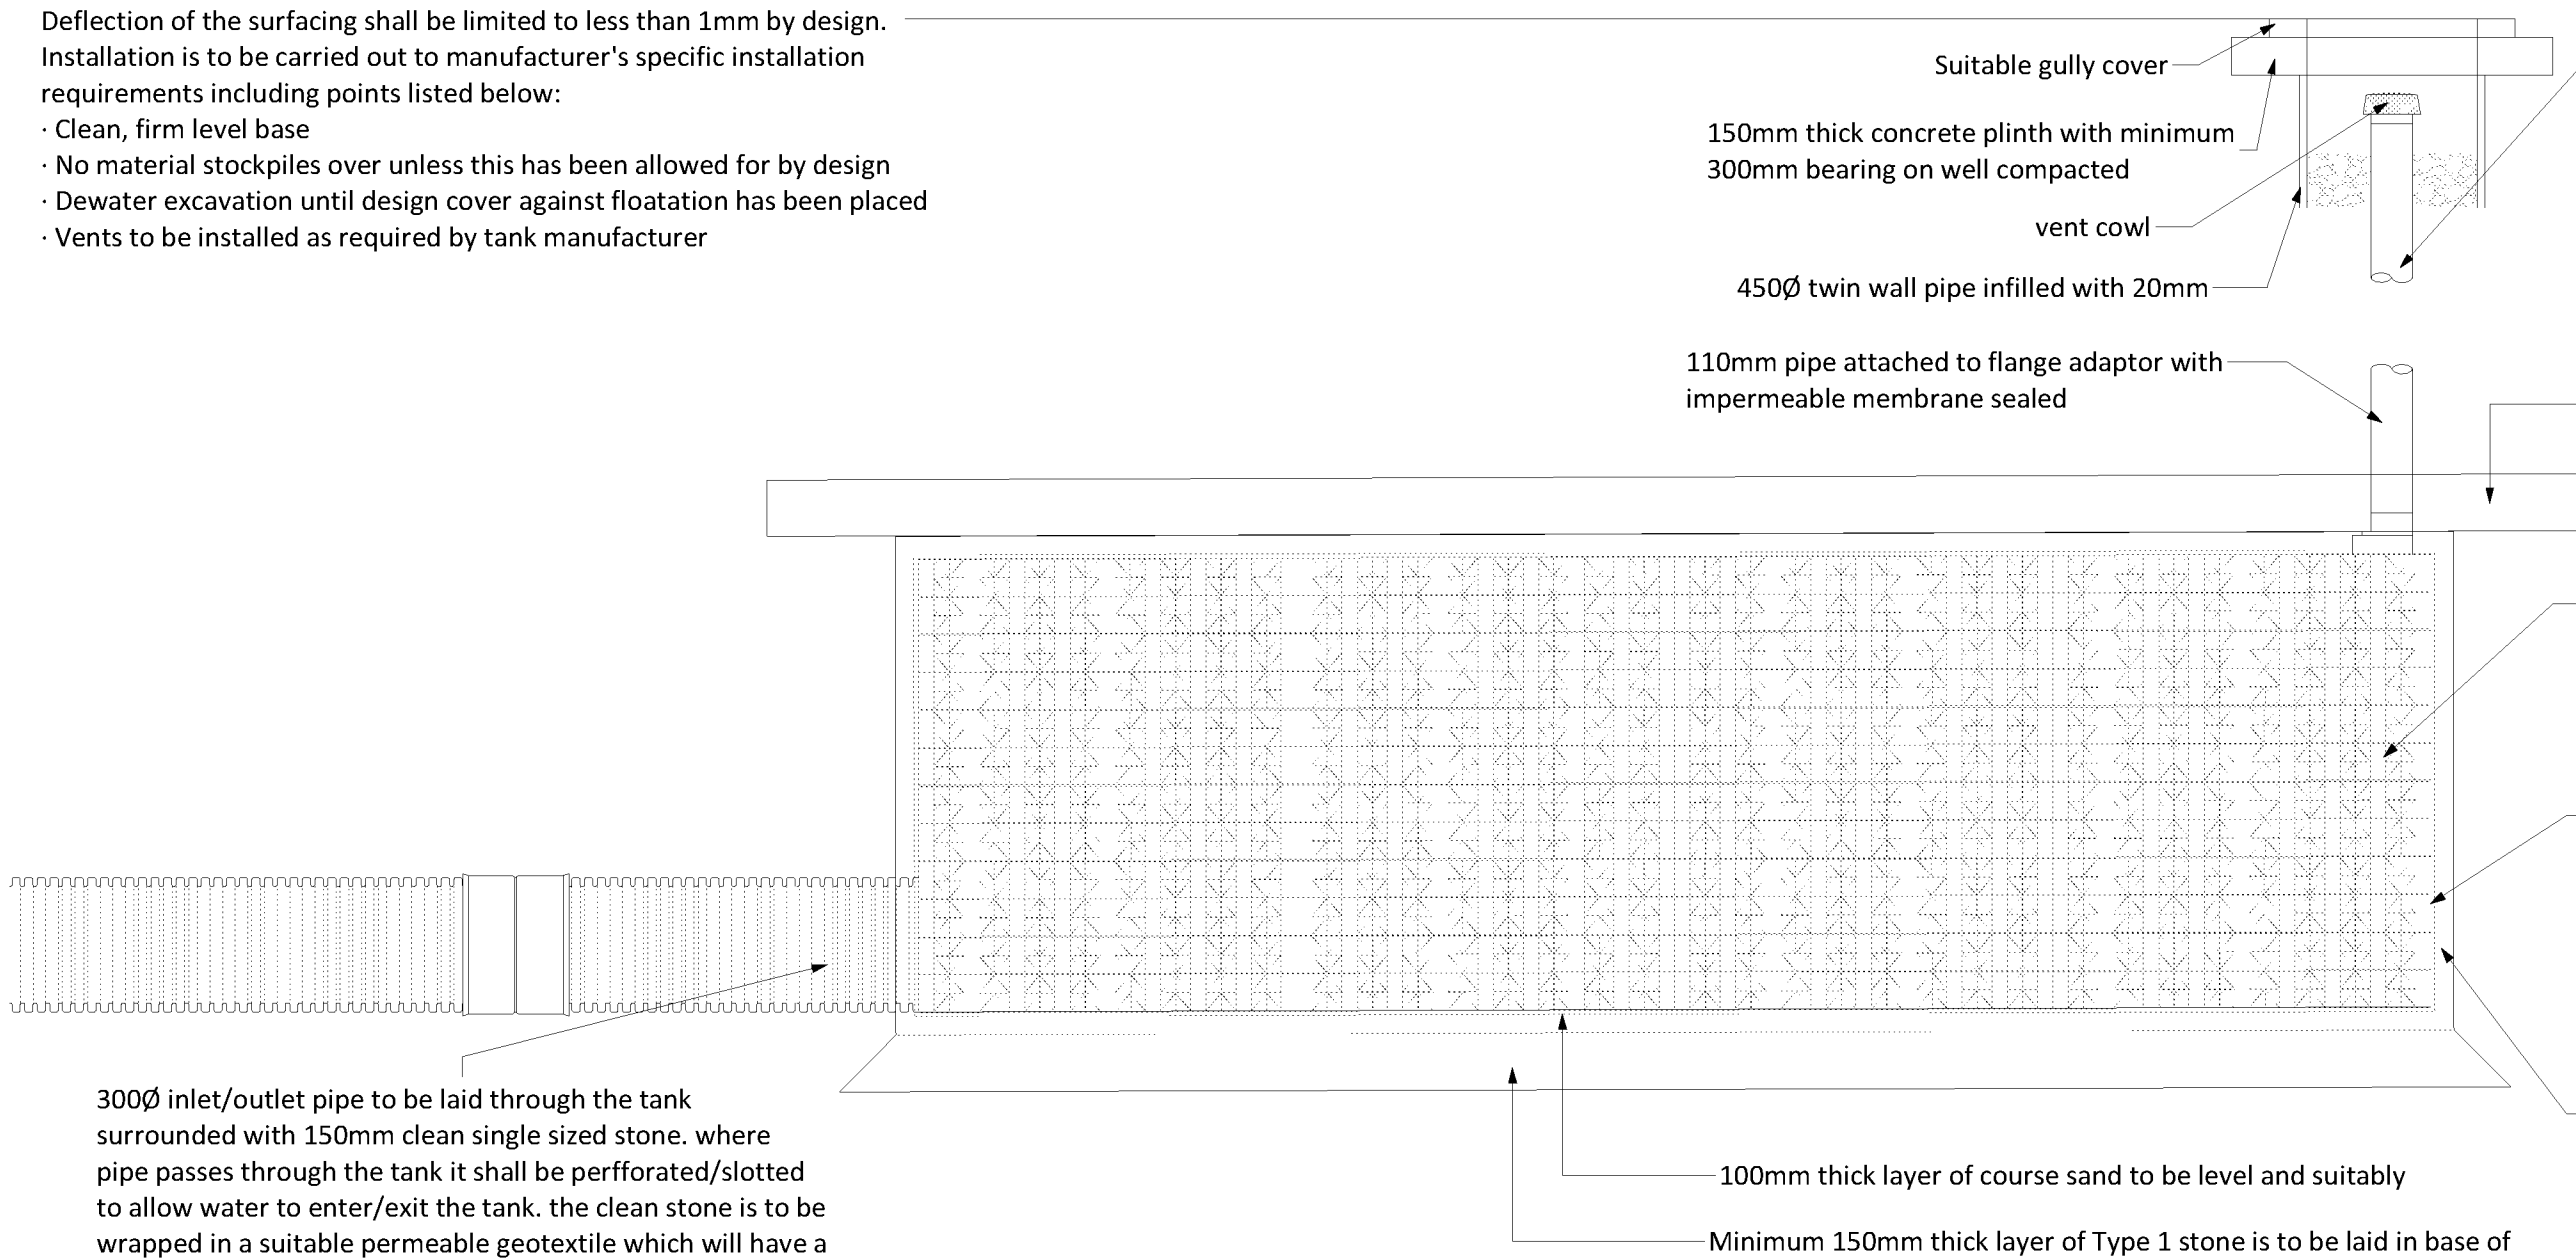


Typical detail cellular attenuation tank


Do Not Scale

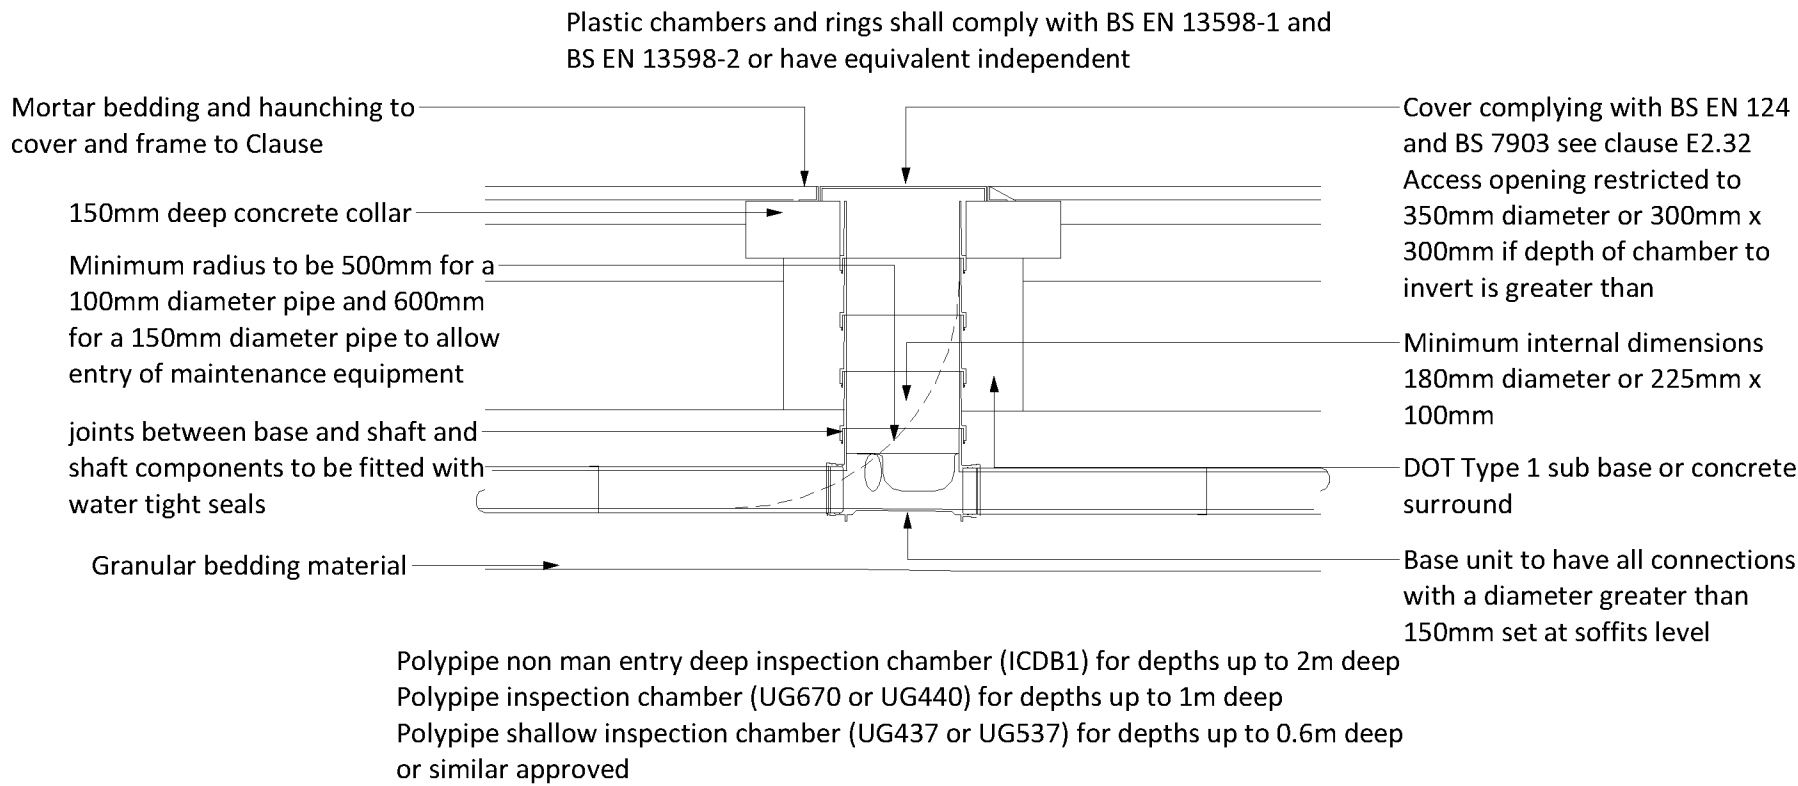


Typical inspection chamber detail

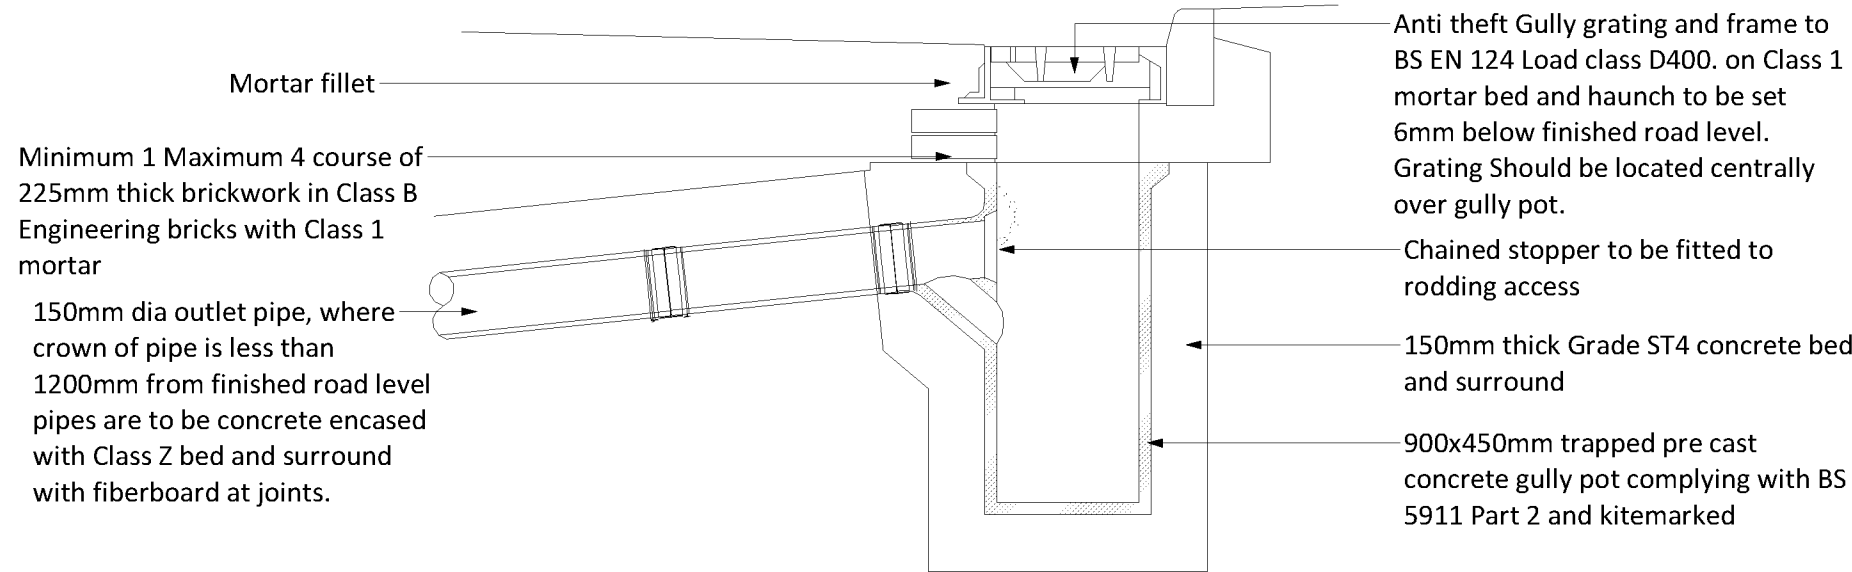

Typical detail showing road gully

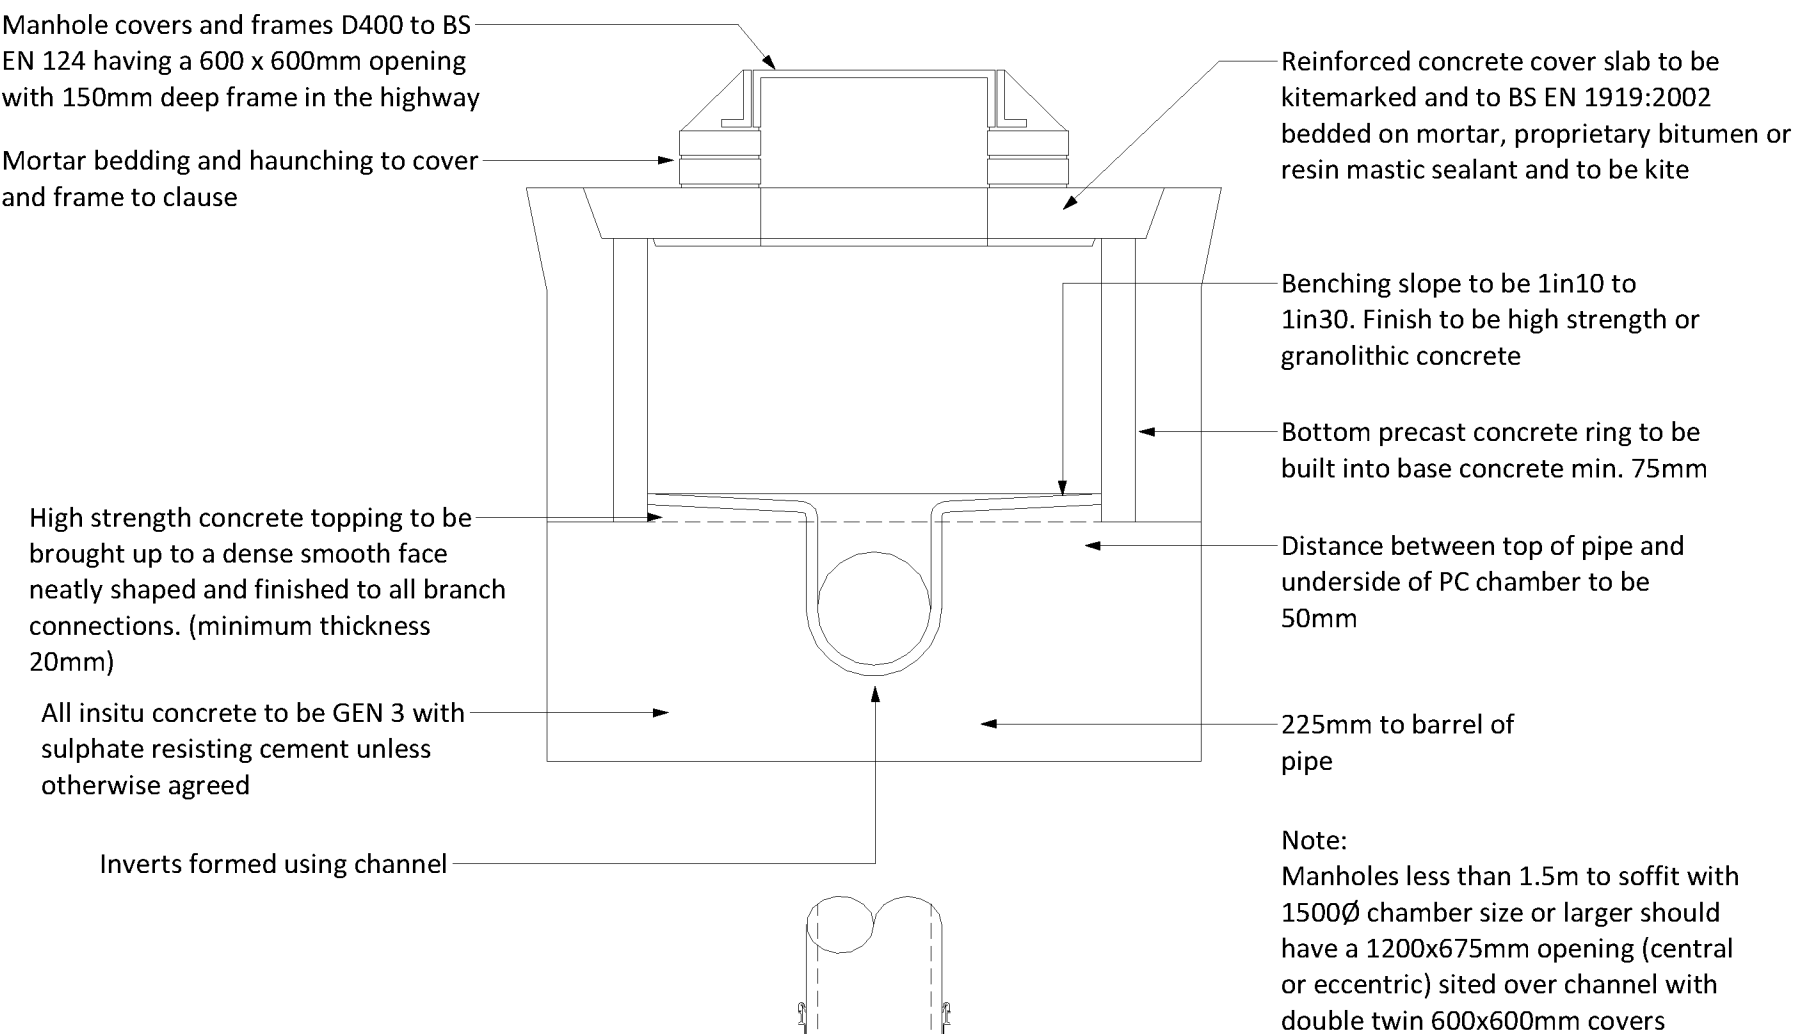

Typical manhole detail type B1/E

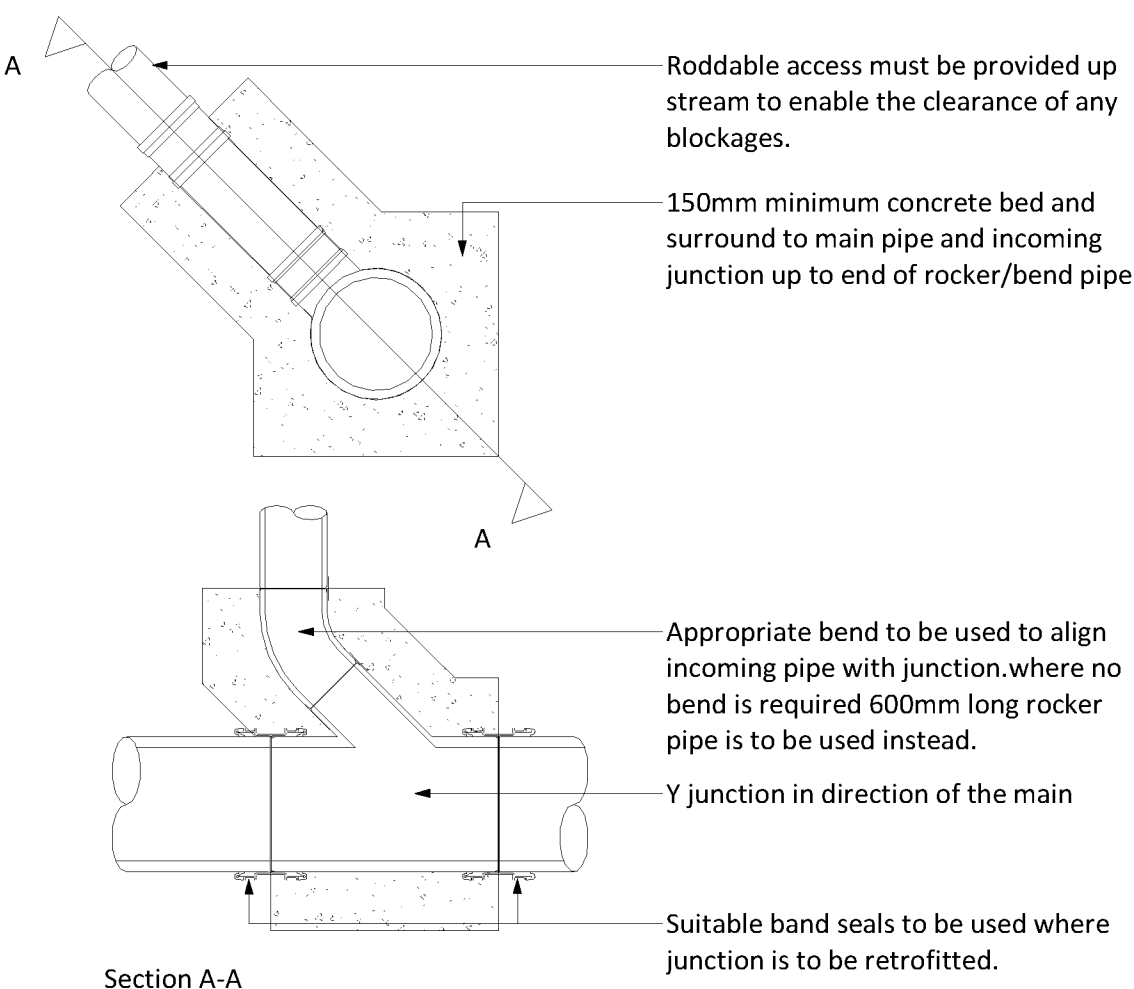

Typical detail junction pipe connection

DESIGN REVIEW

Design review by: Checked by:

Residual hazards:

DRAWING NOTES

09.02.18	Preliminary Issue	BB	PG	PO1
Date	Revision	By	Chkd	Rev

ADEPT Civil and Structural Consulting Engineers
Engineering Better Solutions Together
Web: www.adeptcsce.com
email: info@adeptcsce.com
14 Feltton Road, Sunny Bank, Millis, Farnley, Leeds LS28 5LJ
Tel: 0113 235 4518
Originating Office

Project
ASDA Ferring

Title
Proposed Drainage Details

Client
ASDA
Save money. Live better.

Scale @ A1 1 : 20	Drawn BB	Checked PG	Date Feb'18
Suitability S1	Purpose Preliminary		

UPPN: Originator Zone Level Type Role Class Dwg No. Rev.
05.16049-ACE-XX-ZZ-DR-D-50-0102-P01