ARUN DISTRICT COUNCIL FN/59/11/OHL

= SCHEDULED MONUMENT.

EDF Energy Networks Ltd

STANDARD PLOT

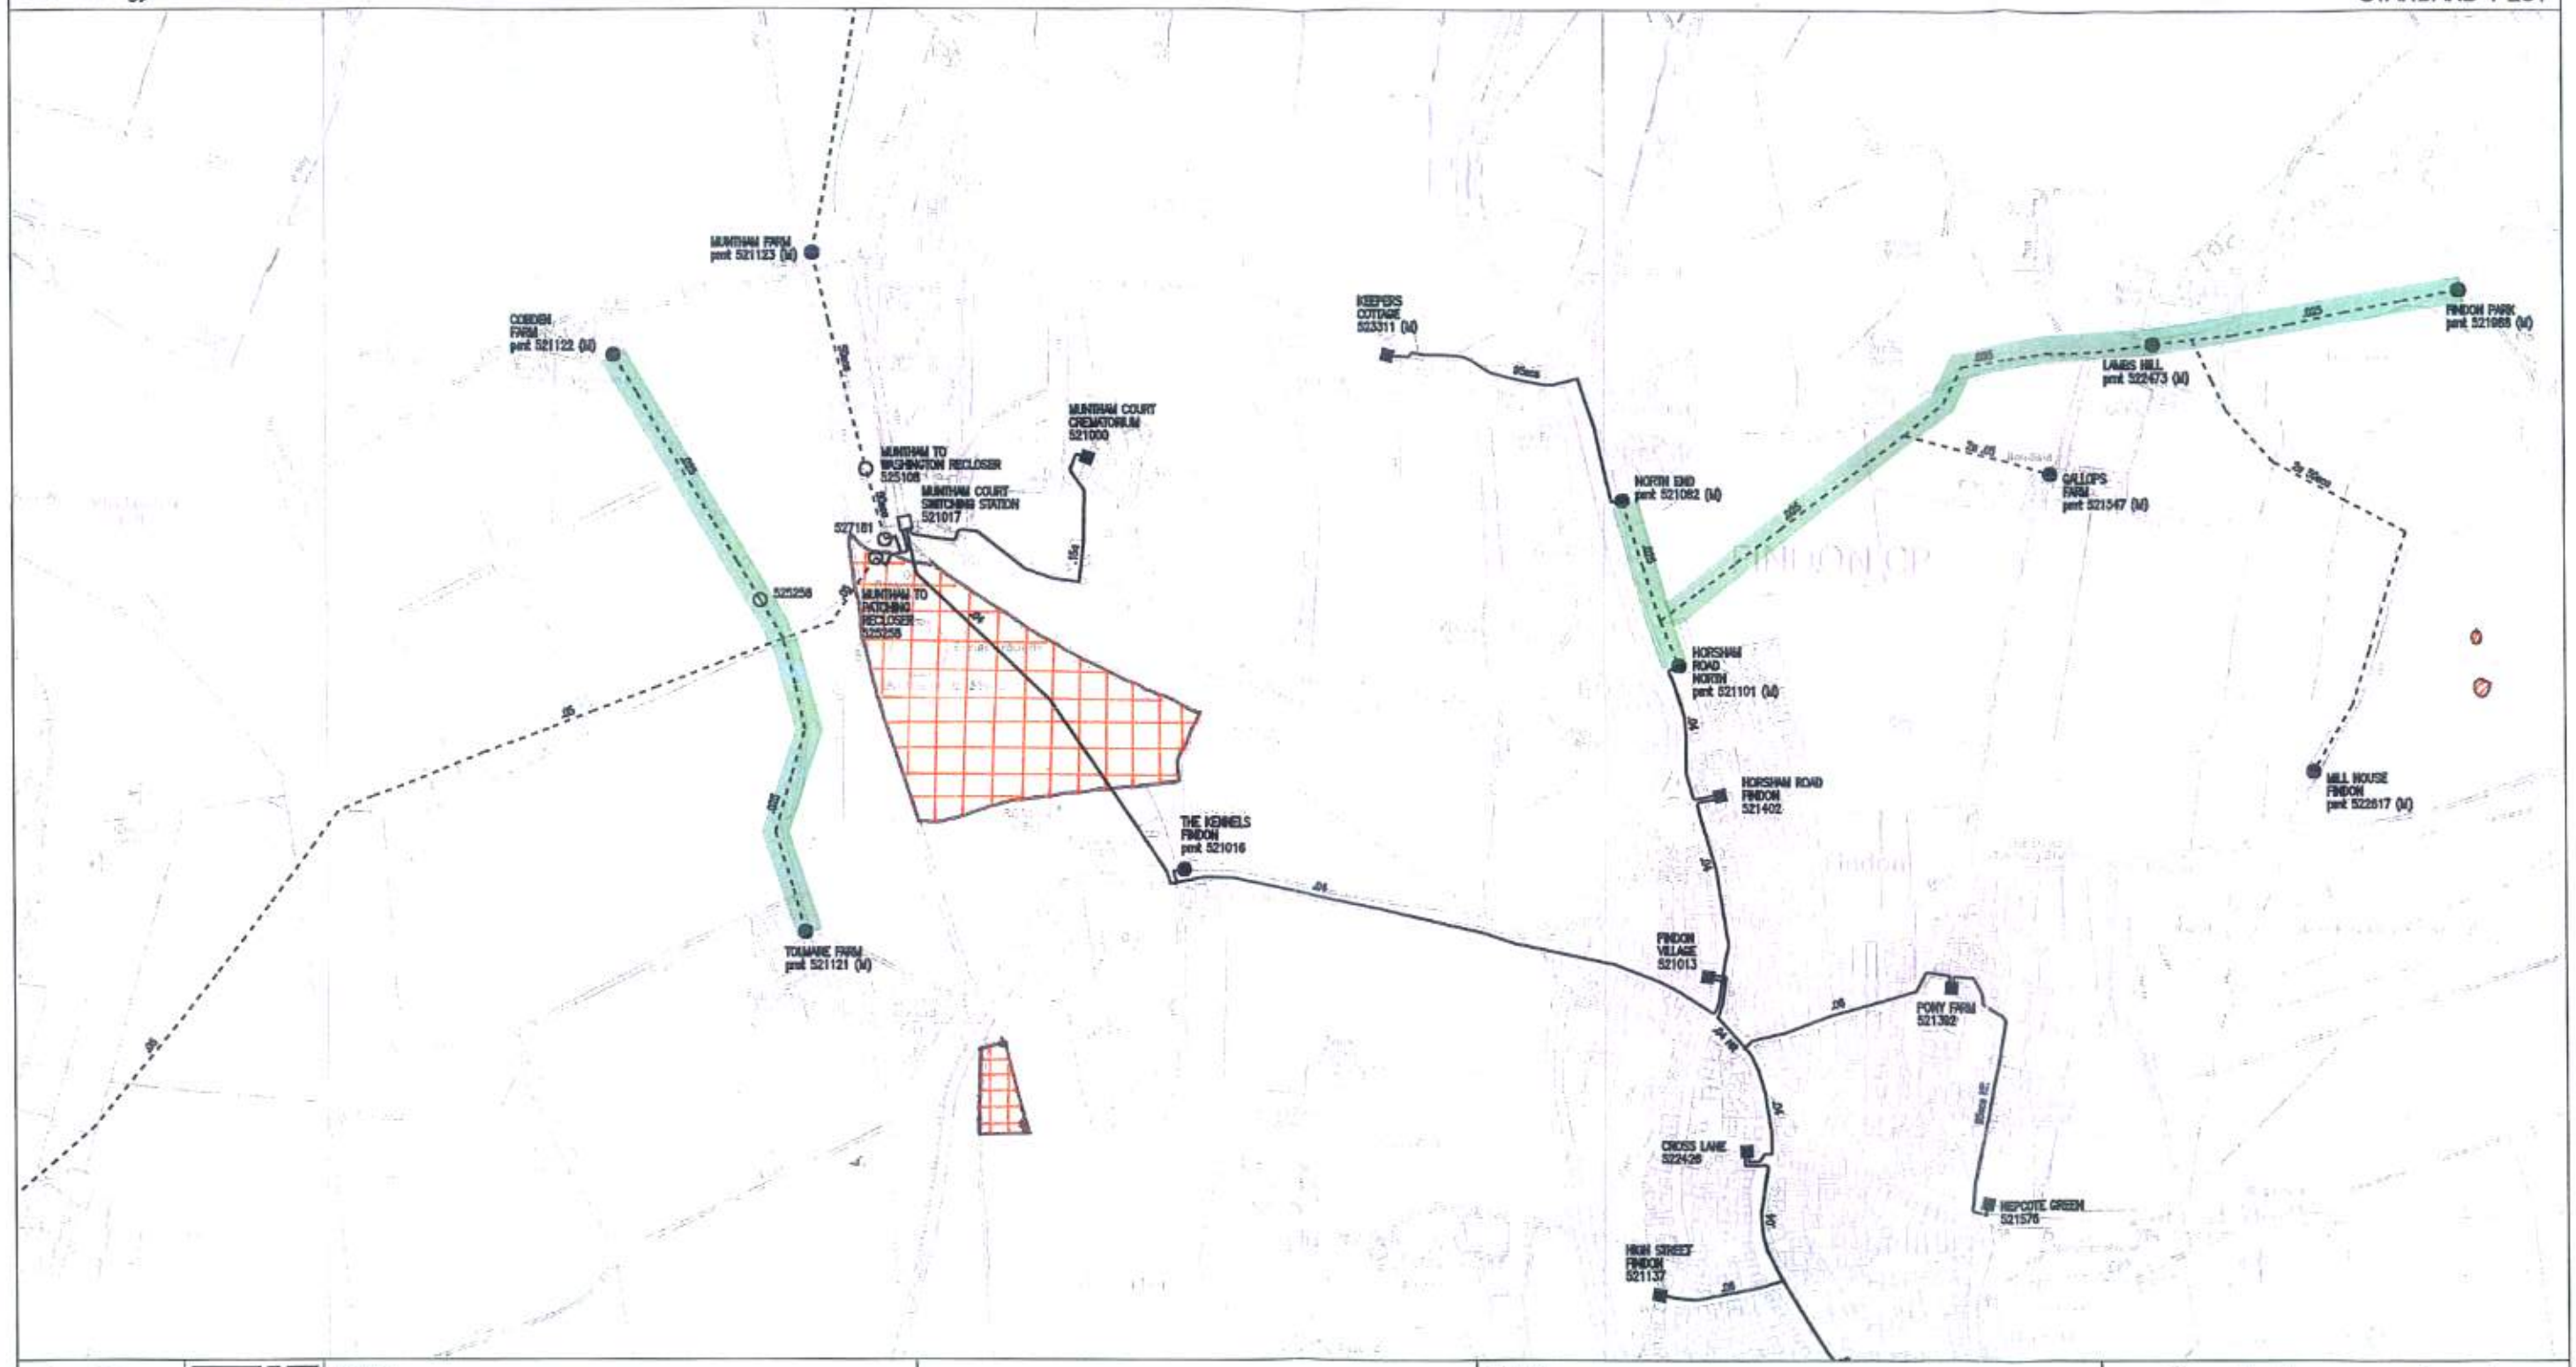

HV Line or Cable	
LV Line or Cable	
Assumed Route	NR
Ductline	[ ]
Pole positions	●
Lighting Columns	○
Substations	□
Distribution LB	▭
EHV (Extra High Voltage) Cable / Line routes shown	

WARNING
1. Please be aware that electric cables/lines belonging to other owners of licensed electricity distribution systems may be present and it is your responsibility to identify their location.
2. Use approved cable avoidance tools before starting site excavations.
3. Information given is the most accurate available.
4. Service cables shown only where known.
5. Excavate in the vicinity of cable by hand only.
6. It is essential that trial holes are carefully made avoiding the use of mechanical tools or picks until the exact location of all cables have been determined.
7. Attention is especially drawn to cables labelled NR (Not Recorded).

CABLE COVER – Approx. cover (unless otherwise stated) Carriage Way HV – 0.6m/LV – 0.5m Footpath HV – 0.55m to 0.7m/LV – 0.4m
Stated depths are as originally installed. Subsequent alterations to the surface may have altered the depth of cover.

EHV Routes approximate position only, for details of EHV records contact EDF Energy Networks Ltd, before commencing work.

TITLE: North Worthing 08

JOB NO: 362279

GRID REF : TQ1109SE

SCALE : 1:10000
(When Plotted at A3)

DATE : 16/08/2010

N

LEGAL NOTE
1. EDF Energy does not warrant that the information provided to you is correct. You rely upon it at your own risk.
2. EDF Energy does not exclude or limit its liability if it causes the death of a person or causes persons injury to a person where such death or personal injury is caused by its negligence.
3. Subject to paragraph 2, EDF Energy has no liability to you in contract, in tort (including negligence), for breach of statutory duty or otherwise howsoever for any loss, damage, costs, claims, demands or expenses that you or any third party may suffer or incur as a result of using the information provided whether for physical damage to property or for any economic loss (including without limitation loss of profit, loss of opportunity, loss of savings, loss of goodwill, loss of business, loss of use) or any special or consequential loss or damage whatsoever.

NOTE: Maps produced at 1:2500 scale are LV Geo-Schematics which show LV mains cables and overhead lines (in some cases all voltages). Prior to carrying out excavations you must refer to the 1:500 records to determine the location of all known underground plant and equipment.

VISITING AN OPEN POINT? Please mark on this plan all locations visited and open points as found, then return updated map to your Business Unit – Thank You.

Based upon the Ordnance Survey map by EDF Energy Plc with permission of Ordnance Survey on behalf of the Controller of Her Majesty's Stationary Office, (C) crown copyright EDF Energy Networks Ltd, 3870728. Data has been added; all propriety rights in such data are and shall remain exclusive property of (C) EDF Energy Networks (EPN) Plc or EDF Energy Networks (LPN) Plc or EDF Energy Networks (SPN) Plc each being a distribution licensee under section 6(1)(c) of the Electricity Act 1989 for the relevant distribution services area as that term is defined in such licensee's distribution licence. All rights in such data reserved.

Cablewatch

CHECK IT OUT BEFORE YOU DIG IT OUT
CALL 0800 0565866
EMERGENCY– If you damage a cable or line
Phone URGENTLY 0800 0963766 (24hrs)

LOOK OUT LOOK UP

ALWAYS LOOK UP BEFORE YOU START WORK
Refer to HSE Guidance note GS6

EDF ENERGY networks