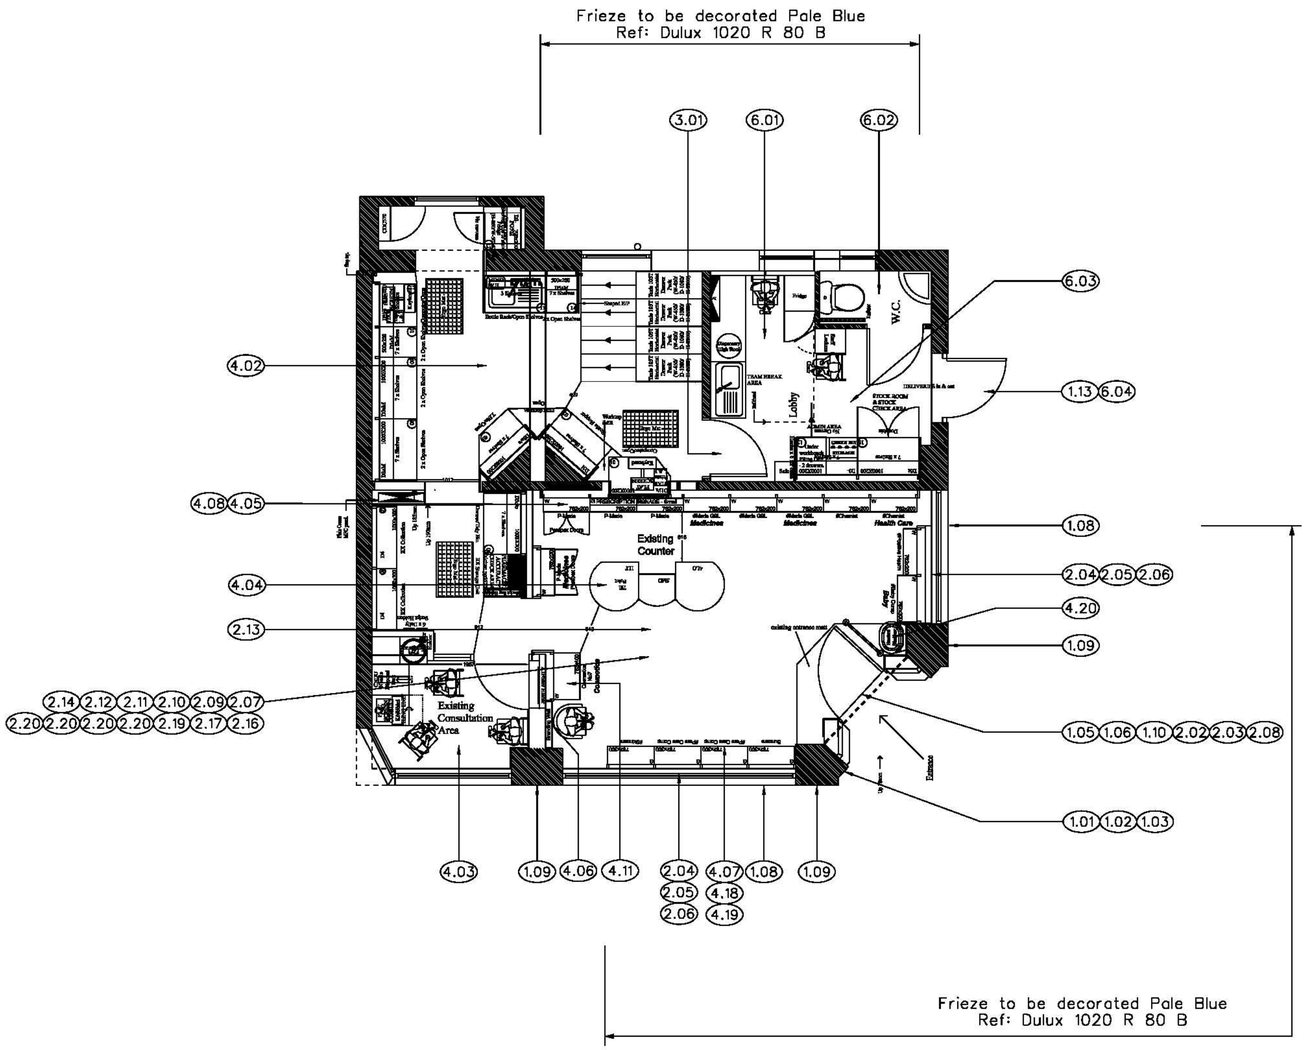

THIS DRAWING TO BE READ IN CONJUNCTION WITH THE FOLLOWING DOCUMENTS:
THE SIGNED OFF BRIEF,
SHOPFITTING SCHEDULE SUPPLIED BY CARDINAL
ALL OTHER MECHANICAL / ELECTRICAL AND STRUCTURAL DRAWINGS

0 10 20 30 40 50 100 200

NOTES
Do not scale this drawing

Adjust / New Fire Alarm System To Comply With BS5839 Part 1.

Adjust / New Smoke Detection System To Comply With BS5839 Part 1.

Adjust / New emergency Lighting System To Comply With BS2266 Part 1.

Relocate / Provide New Fire Appliances to Comply With BSEN3 & BS5306 Part 8.

Fire Signing To Be Of Adequate Size And Conform to BS5499 Part 1 And Sited To Comply With The Health And Safety (Safety Signs And Signals) Regulations 1996.

Electrical Works To Be Carried Out In Accordance With The IEE Regulations For Electrical Installations BS7671 : 2001 and to use energy efficient lighting and controls.

Class 1 Surface Spread Of Flame Finishes to Suspended Ceilings, Walls, Wall Linings And Wallfittings.

New Drains to be Connected into Existing Gravity Drains To BS 6700: 2006

New Pipework To Be Connected into Existing Systems To BS 6700: 2006

All Existing Gas Boilers and Water Heaters To Be Removed And The Gas Supply To The Premises Capped Off.

Energy efficient light fittings and controls only, to be used.

All existing plinth heaters are to be removed from the Sales Area and Dispensary and a new, single ceiling mounted Air Conditioning unit is to be fitted.

All works to comply with Part M of the Building Regulations.

AUTOMATIC DOORS
All automatic entrance doors are to fail safe in the open position upon activation of the fire alarm

NOTTINGHAM
NG90 1HQ
Tel No 0115 9506111

wates design
344 - 354 Gray's Inn Road
London,
WC1X 8BP
www.wates.co.uk
Tel 0207 164 2100
Fax 0207 164 2001

Project Name
AP Rebranding
Store 5423
Bognor Regis

Drawing Title
Ground Floor
Construction Layout

Group Wates Design

Drawn By BT Approved

Scale 1:50 Date 26:08:08

Drg No 5423/C39579/110 Rev

Original sheet size A1

$DATE$ $TIME$ $FILE$

...\5423110.ach.dwg 27/08/2008 17:18:47