



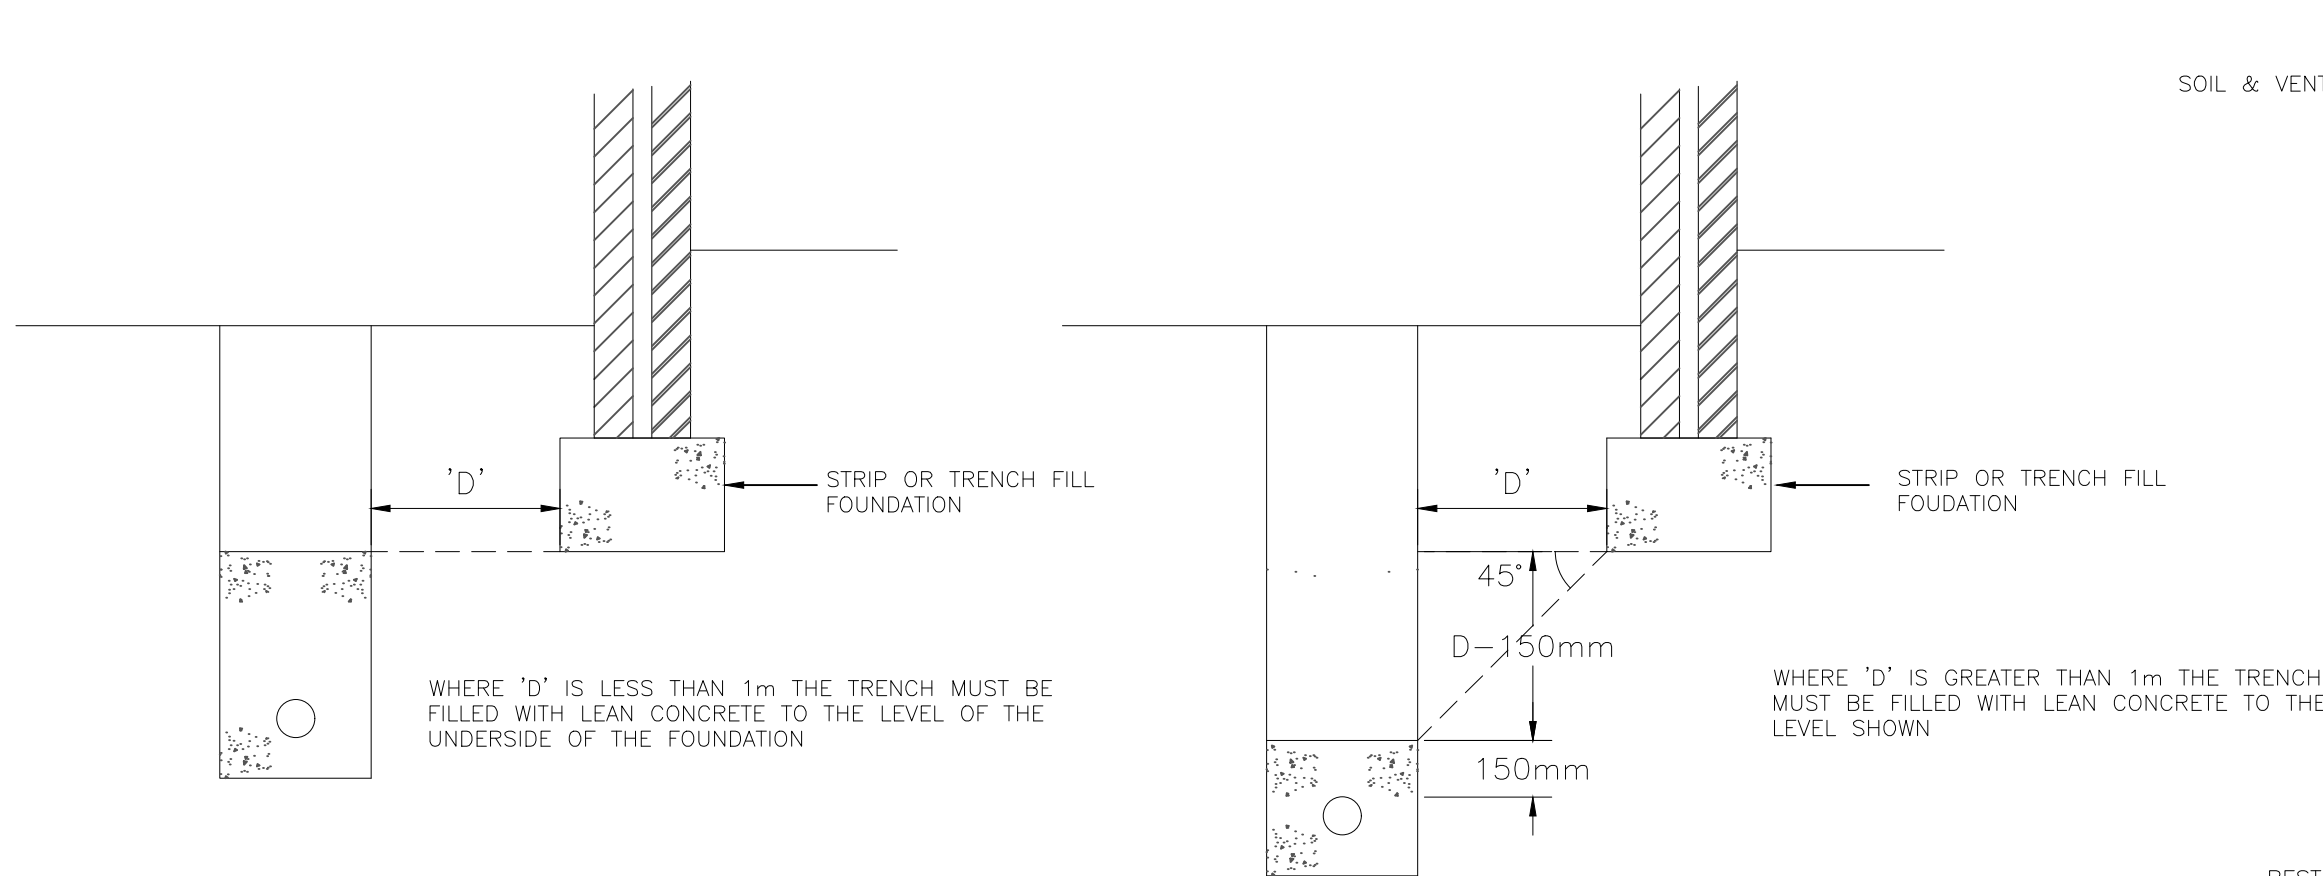


NOTE:
THE CONCRETE FILLING MUST HAVE MOVEMENT JOINTS AT A MAXIMUM OF 5m CENTRES, & PREFERABLY EVERY PIPE JOINT.

WHERE A TRENCH EXCAVATION IS LESS THAN ONE METER FROM A WALL FOUNDATION OR MORE THAN ONE METER BUT WITHIN A 45° SPREAD LINE, THEN A CONCRETE BED & SURROUND, & CONCRETE TRENCH BACKFILL WILL BE REQUIRED TO COMPLY WITH THE FOLLOWING DETAILS.


TRENCHES ADJACENT TO OR BELOW NEARBY FOUNDATION

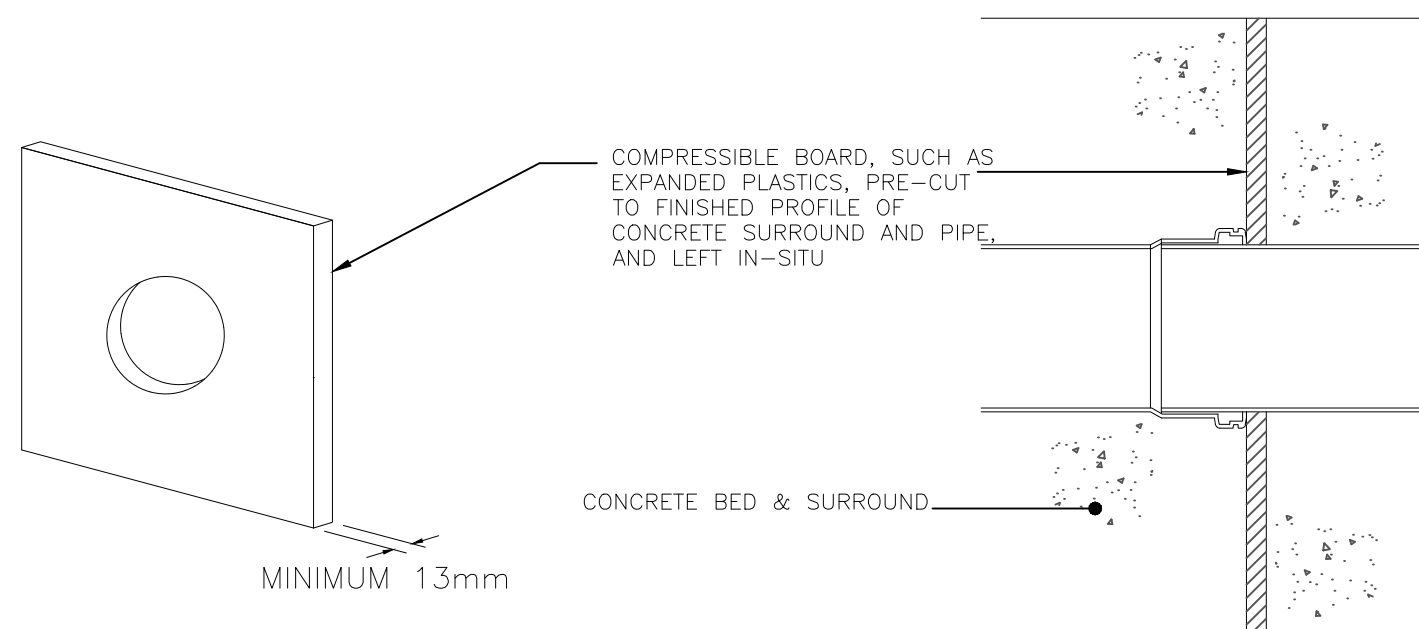


FLEXIBLE JOINT DETAIL

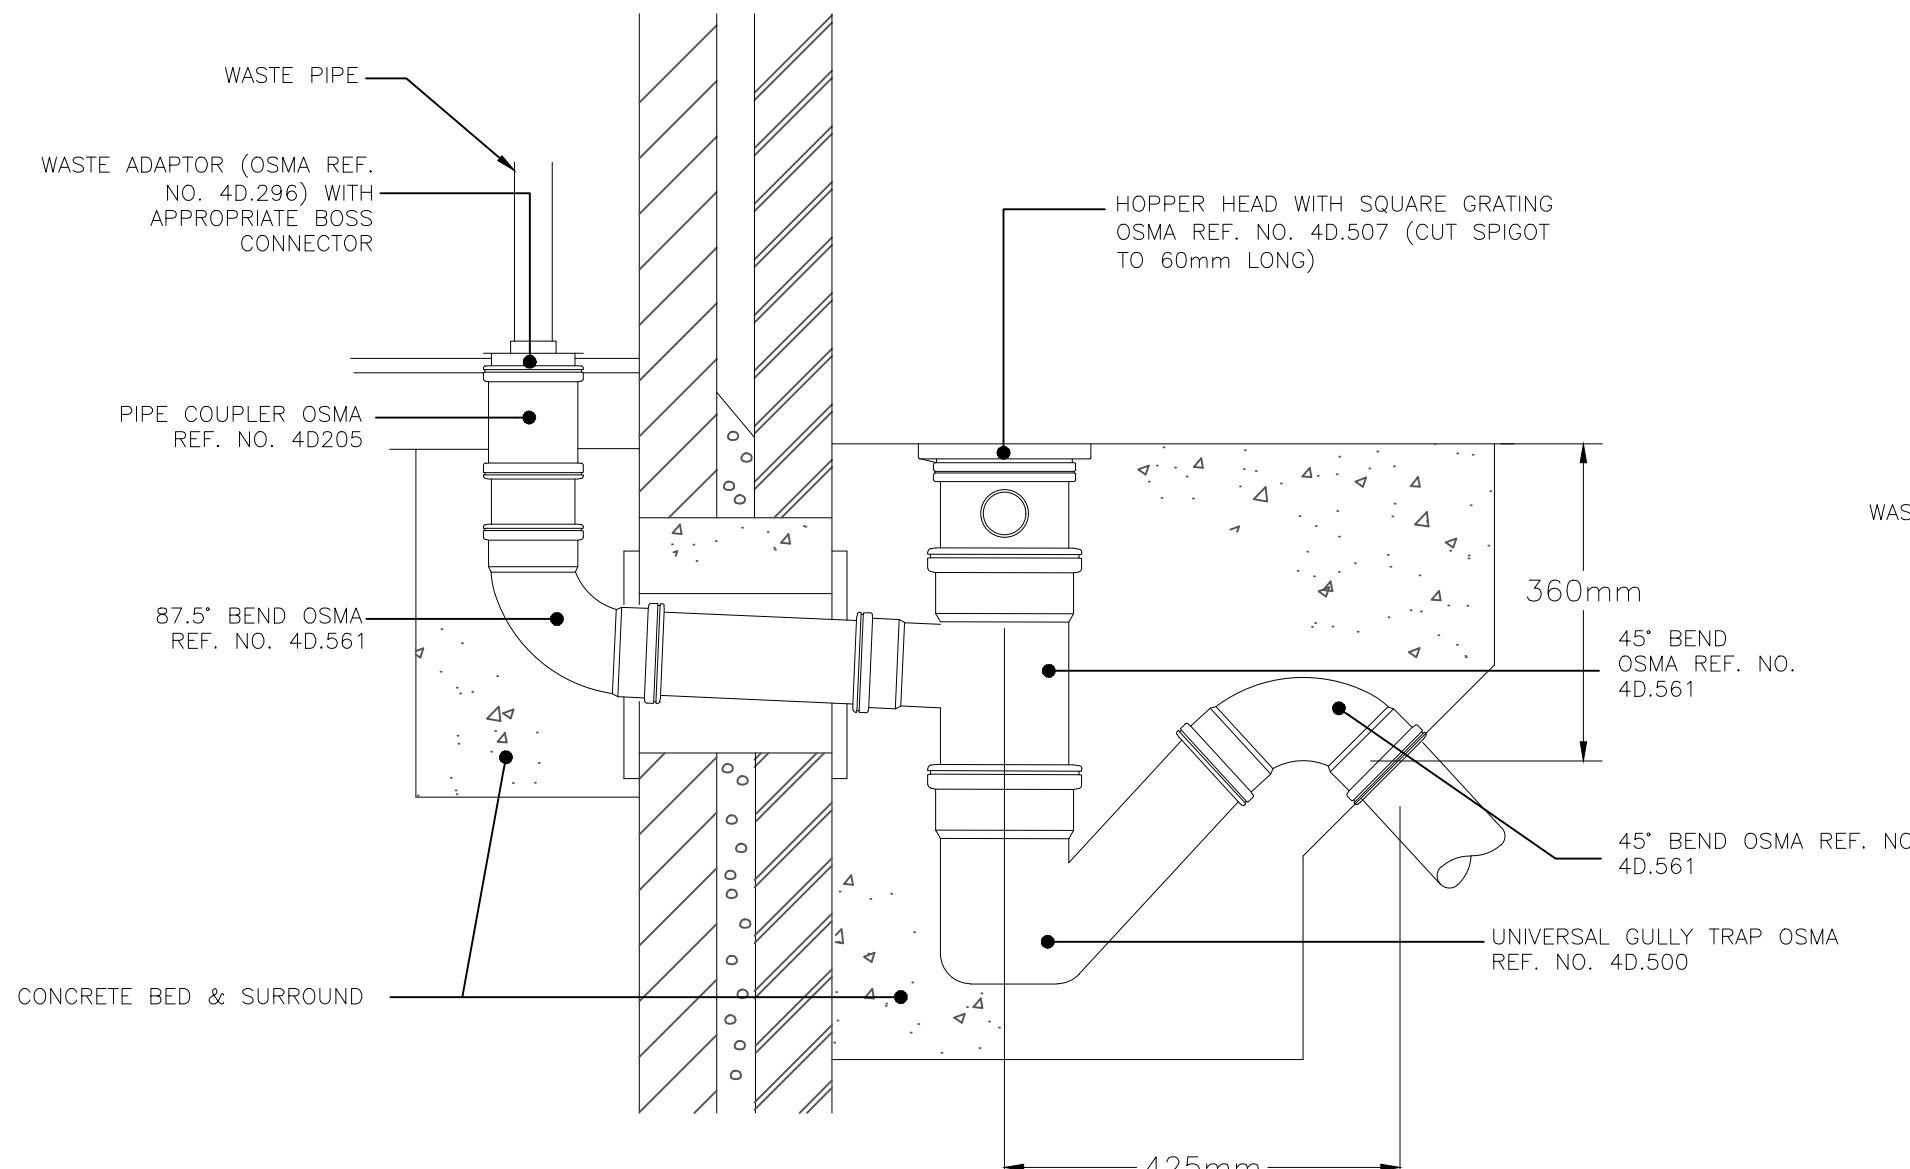


BACK INLET GULLY (UNIVERSAL TYPE)

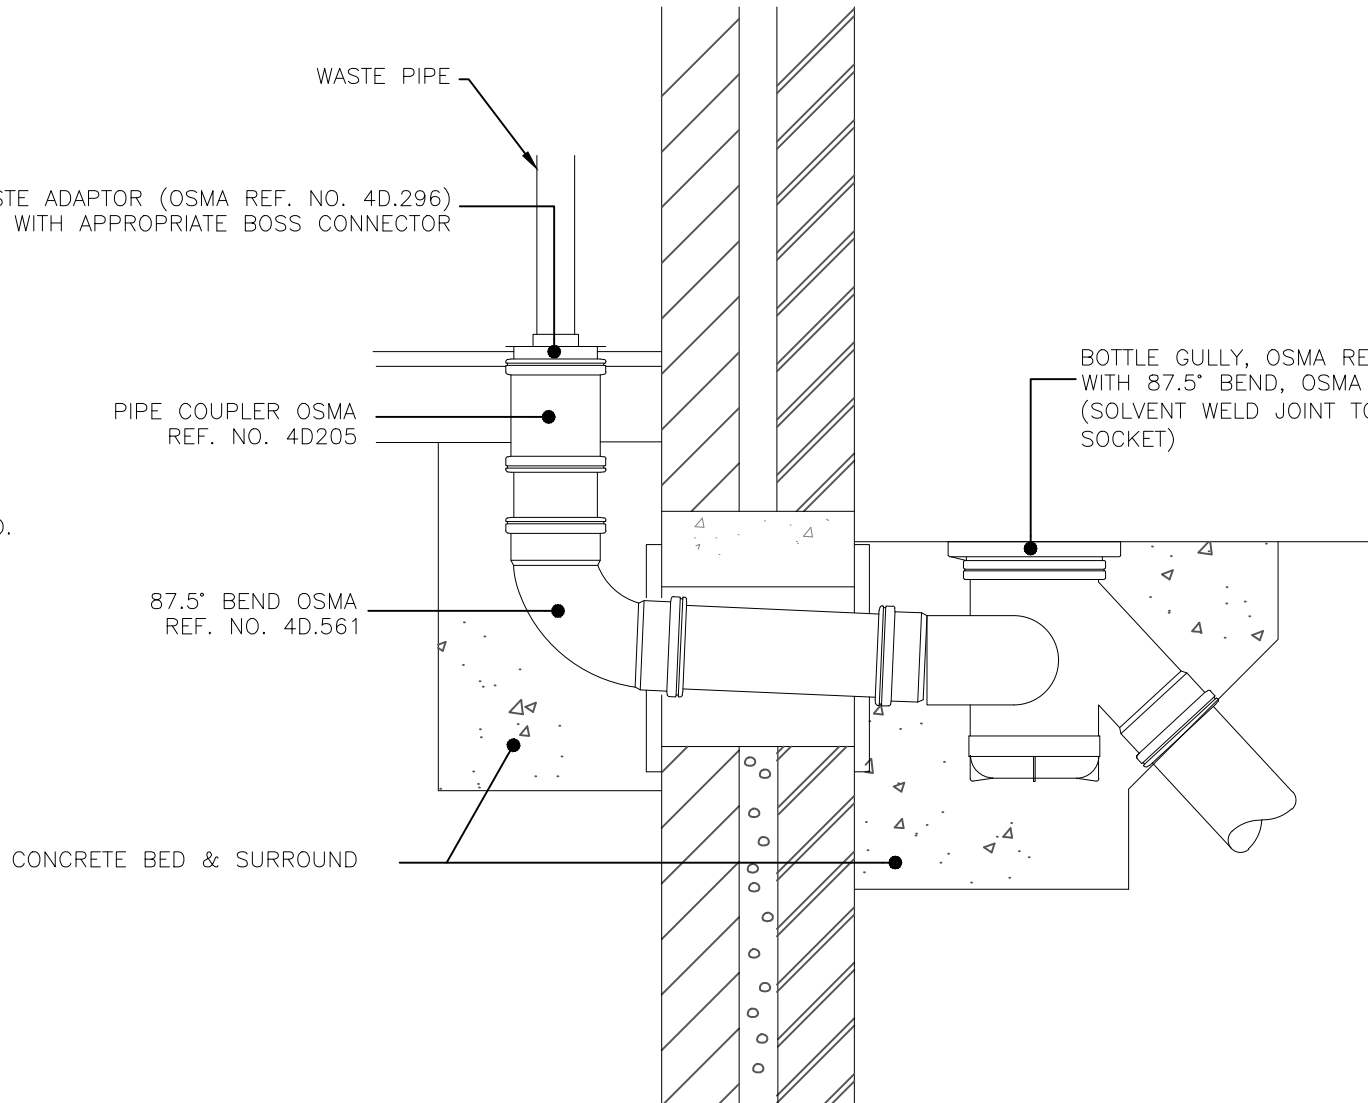

SIDE INLET GULLY (BOTTLE GULLY)

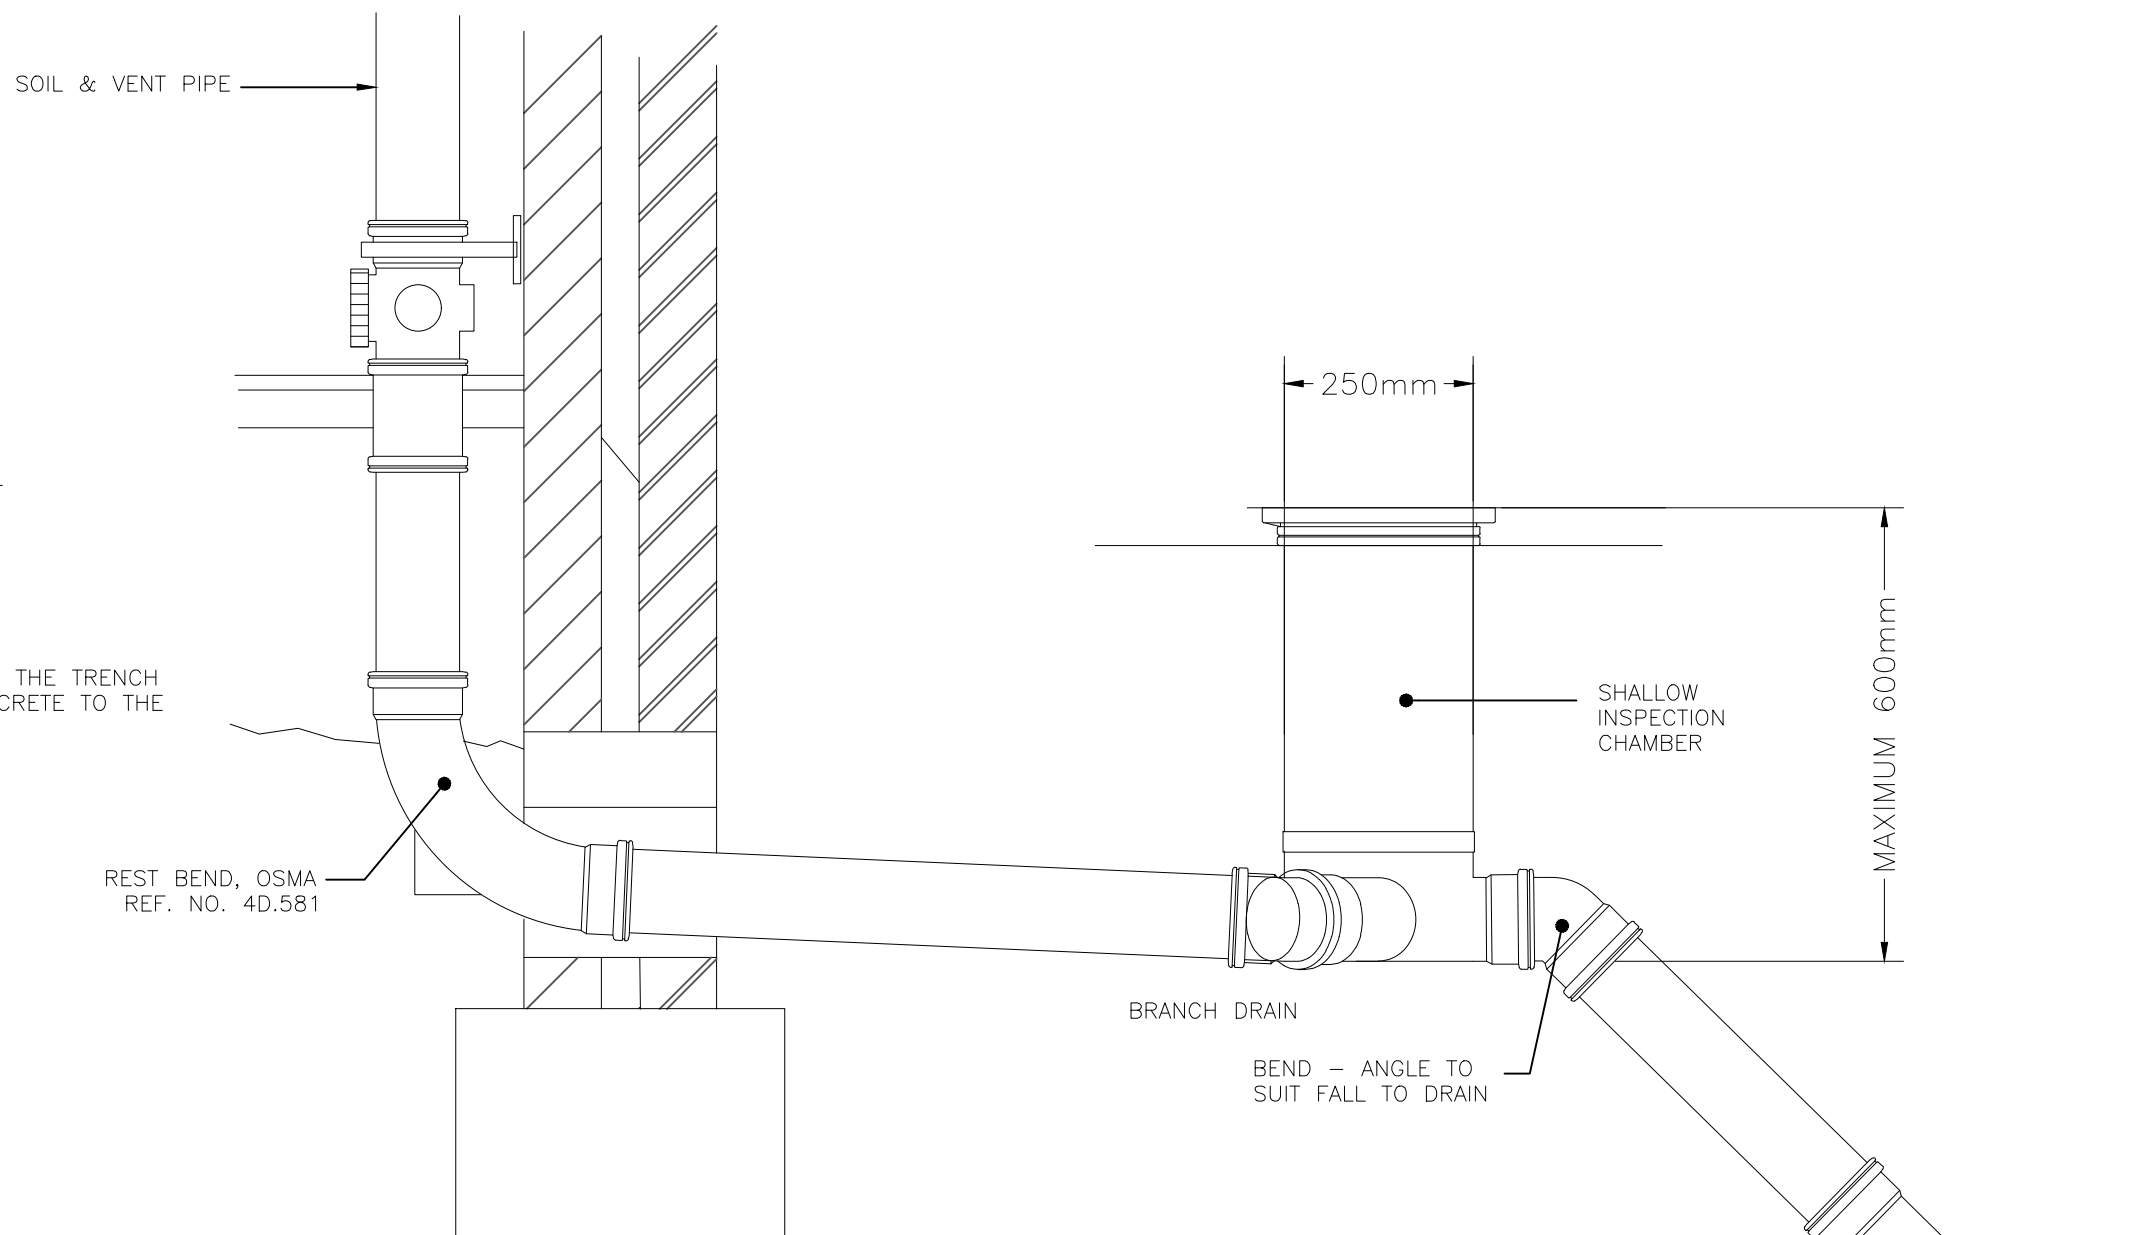

HOUSE DRAINAGE SHALLOW INSPECTION CHAMBER TYPICAL SECTION

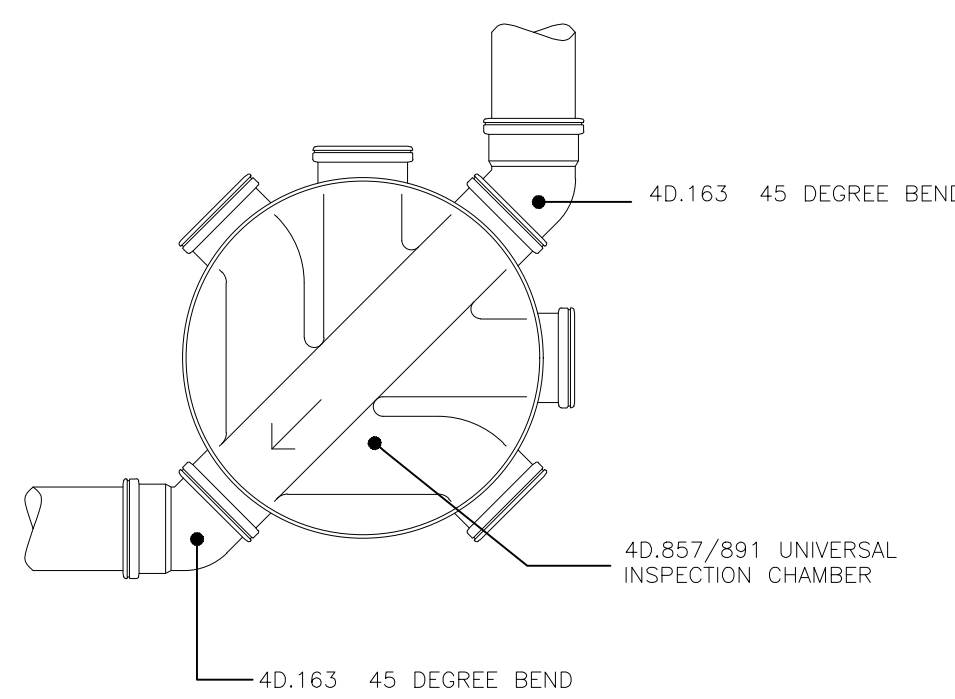


90° CHANGE OF DIRECTION USING UNIVERSAL INSPECTION CHAMBER


Pipe Bedding Backfill Key

- Selected Fill - should be free from stones larger than 40mm, lumps of clay over 100mm, timber, frozen material, vegetable matter.
- Granular material - for rigid pipes should conform to BS EN 1610 Annex B Table B.15 and should be single-size material from 5mm up to a maximum size of 10 mm for 100mm pipes, 14mm for 150mm pipes, 20mm for pipes from 150mm up to 600mm diameter and 40mm for pipes more than 600mm diameter. Compaction fraction maximum 0.3 for Class N or B and 0.15 for Class F.


- Notes:
- Provision may be required to prevent groundwater flow in trenches with Class N, F or B type bedding.
 - Where the pipe has sockets and Class D bedding is used, holes which should be as short as is practicable should be prepared in the trench bottom to give a clearance of 50mm beneath the socket.
 - Where the pipe has sockets and Class F or N bedding is used, the sockets should not be less than 50mm above the floor of the trench.
 - All dimensions are in mm.
 - The 45° angle (Class F diagram) refers to the angle of the joint that is within the granular material.

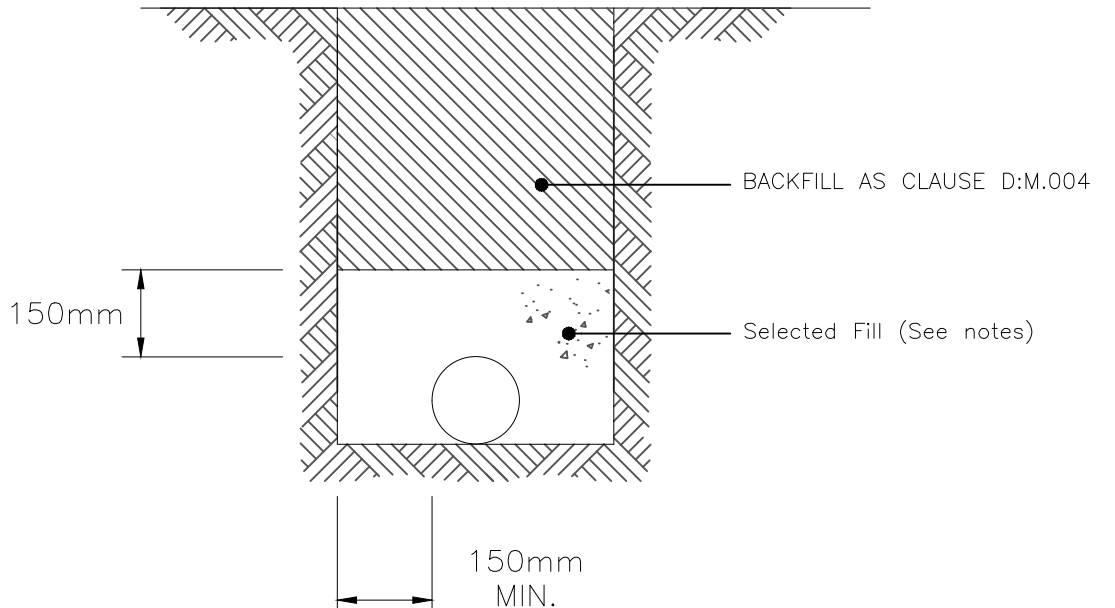


CLASS D: BEDDING FACTOR 1.1
High standard of workmanship required
Not to be used unless accurate hand trimmed by shovel is possible

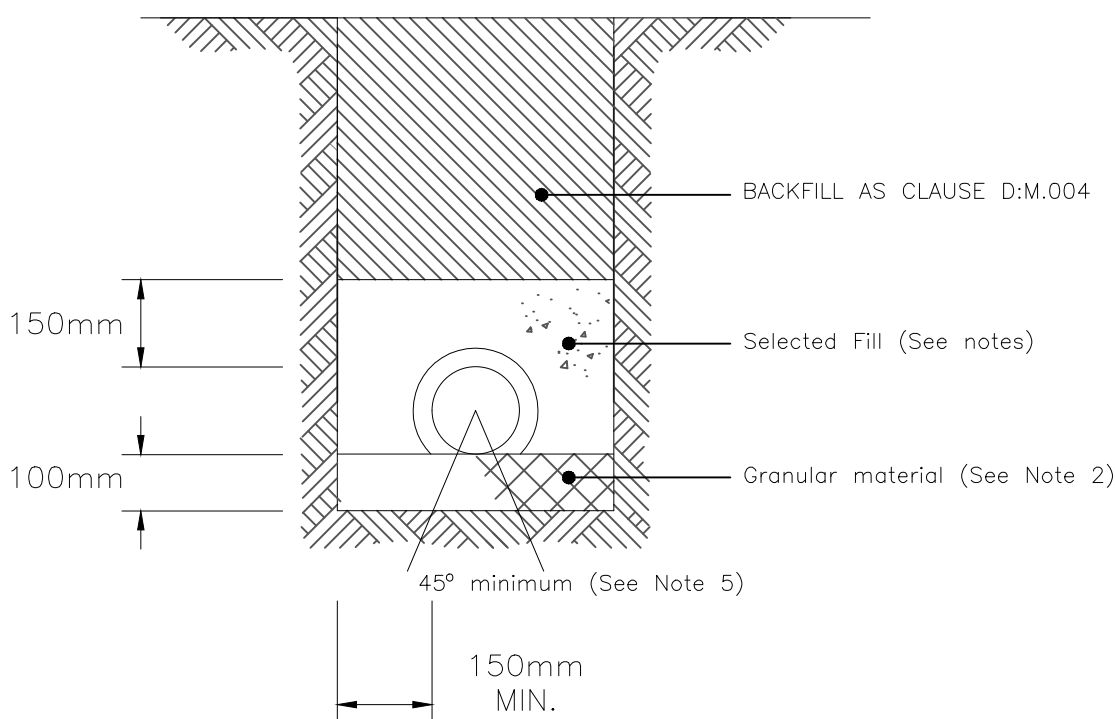

CLASS F: BEDDING FACTOR 1.5
Generally suitable for all soil conditions

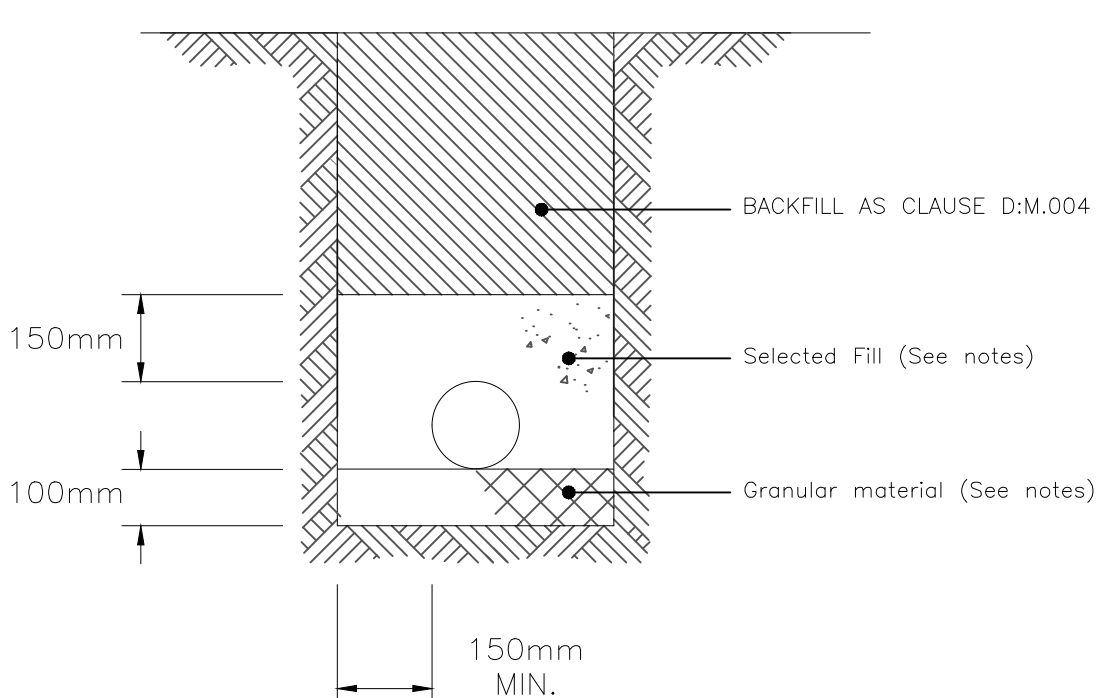

CLASS N: BEDDING FACTOR 1.1
Where accurate hand trimming is not possible, Class N is an alternative to class D

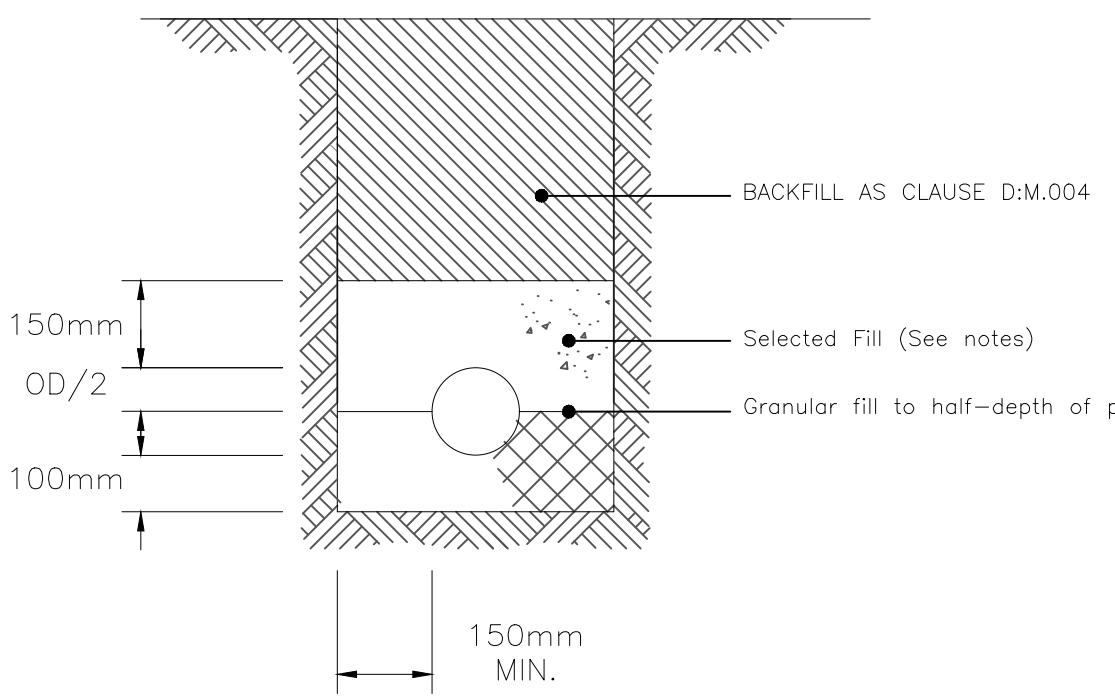

CLASS B: BEDDING FACTOR 1.9
Generall Suitable for all soil conditions

SECTION 106-APPROVED
ORDINARY WATERCOURSE LAND DRAINAGE CONSENT-APPROVED

CONSTRUCTION					
A	27.11.19	Application approval.			JW
REV. No.	DATE	DESCRIPTION			INITIALS
Client		Hampshire Homes			
Project		Felpham			
Title		Private Drainage Construction Details	Scale NTS@A1	Date Feb'19	Drawing No. 5782:22
		Checked KTG	Drawn JW		Rev A

MJA CONSULTING
CIVIL AND STRUCTURAL ENGINEERS
Monarch House, Barton Lane,
Abingdon, Oxon, OX14 3NB
Tel: 01235 555173
Fax: 01235 523226