

SPECIFICATION

FOUNDATIONS Building Regulation A1/A2
229 mm Walls, 2 x 7N solid concrete blocks minimum cover to foundations 1 m or to local authority requirements Cavities to be filled with lean mix concrete to ground level Foundations concrete 1 3 6 20 mm Premix 600mm wide x 225mm deep DPC to be 150mm above ground level If any trees are within 30m of the foundation the foundation depth will need to be increased as this may affect the design

SOLID GROUND FLOORS Building Regulation C4
75mm sand and cement screed on 100mm concrete 1 4 2 Pre-mix on 1200 polythene DPM on 65 mm GA3065Z Celotex floor insulation minimum U - Value of 0.25 W/m2k on 1200 polythene DPM on 25 mm sand blinding on 100 mm hard core, all voids and excavation to walls filled with hardcore Provide A142 mesh within the bottom of concrete slab over drainage runs

EXTERNAL WALLS Building Regulation A1/A2
Outer skin to be approved brick Inner skin to be 100mm Toplite GTI blocks with 30mmCW3030Z Celotex cavity insulation, minimum U - Value of 0.35 W/m2k in a minimum 50mm wide and a maximum of 80mm wide cavity including insulation Wall ties to be stainless steel type 750 x 450mm c/c 225mm vertical spacing at reveals, insulated to prevent cold bridging Fire stop to head of cavities

LINTELS
Reinforced concrete or steel to manufacturer's specification, 150 mm bearings either side All installed to manufacturer's detail

FLAT ROOF A1/A2/B4 and TRADA technology
Flat roof covering 3 layers of mineral felt with 12.5 depth bitumen bedded stone chippings Building Regulation Part B Table 5 Part iii or fibreglass by specialist supplier (fibreglass specialist to provide fire rating specification) on 19mm marine ply on 80mm TD3080 Celotex Minimum U - Value 0.25 W/m2k, on 200 x 50mm joist C16 table 36 @ 400 c/c on 50 x 100mm wall plates, hold down straps every 2m run

FLASHING Building Regulation C4
To be code 4 lead Cavity tray to be provided between garage roof and joining wall

JOINER
External to BS1186 preservation to L/A and NHBC requirements

PLUMBER Hot water and central heating Building Regulations G3/J and L
The hot water and central heating system will be extended to include the new extension and to comply with approved documents J & L, by a competent plumbing and heating engineer All gas installations will be installed by a qualified CORGI gas engineer Central Heating and Hot and Cold water in copper to BS864 RAIN WATER Building Regulation H3 Table 2 100mm Gutter, 75mm down pipes discharging into 100mm Osma drains into soakaways 4.5m from buildings All underground drains to be Osma below ground type surrounded with pea shingle All traps from sinks, baths and basins are to be deep seal 76 mm, showers 19 mm seal shower traps Bath, shower and sink waste pipe to be 40 mm dia basin waste to be 32 mm dia access plugs where necessary, 110 mm pipe soil and vent pipe Building Regulation H1

ELECTRICITY
To comply with Local supply authority regulations and Building Regulation F 11.3 Fit mechanical extractor to Bathrooms 15 l/s, Toilets 6 l/s, Kitchens 60 l/s, via cooker hood otherwise 60 l/s intermittent and Utility rooms 30 l/s All to outside of the dwelling Certificate to comply with BS7671 to be issued after completion of the work

Smoke alarms, mains operated and interconnected, to be fitted to ground floor hall and landings Building Regulation B 7 10 2 No low energy lights will be installed

PLASTERING
Ceilings to be boarded with 12.5mm plasterboard and skimmed with plaster Internal walls to receive 13mm Carlite plaster

GLAZING Building Regulations F1 Table 11 Ventilation, N1 Glazing
Windows and doors to be double glazed with 16 mm separation low emissive glass to give maximum 2 U-Value New windows ventilation not less than 1/20 of room floor area and fitted with a minimum 8000mm2 trickle ventilator to habitable rooms, all other rooms 4000mm2 All new external doors and joining windows to be glazed in safety glass in an area 1500mm high from bottom of glass and extend 300mm either side of door frame opening All internal glass doors and screens to be in safety glass All to BS6206 and supplied by FENSA approved installer

INSULATION SCHEDULE

Ground floors Concrete slab P/A = 6 = 70mm
GA3070 Celotex = 0.22 W/m2K, Celotex Tbreak
TB3020 between screed/concrete and outside walls


Cavity walls 90mm brick outside skin 100mm
Toplite GTI inside skin 45mm CW3045
Celotex = 0.3 W/m2K

Timber flat roof 116mm TD3116 Celotex = 0.2 W/m2K

EXTERNAL GARAGE WALL CONSTRUCTION 1 - 20

Existing external brick wall
3 coats Synthaproof
10mm minimum gap between external wall and frame
Wood framing
35mm minimum 10kg/3 mineral wool
50mm GA2050 Celotex
1 No. layer Fireline plasterboard and skimmed

PASSAGE OF SOUND Building Regulation E Resistance to passage of sound
Stud partition walls to include sound insulation to regulation E2 with 75mm minimum distance between 12mm plaster board linings 25mm wool batts or quilt, minimum density 10 kg/m, suspended in cavity Solid block walls type C minimum mass per unit area, excluding finish, 120 kg/m2 Sound insulation to first floor to be mineral wool a minimum 100mm thick, minimum density 10kg /m3 laid between joist

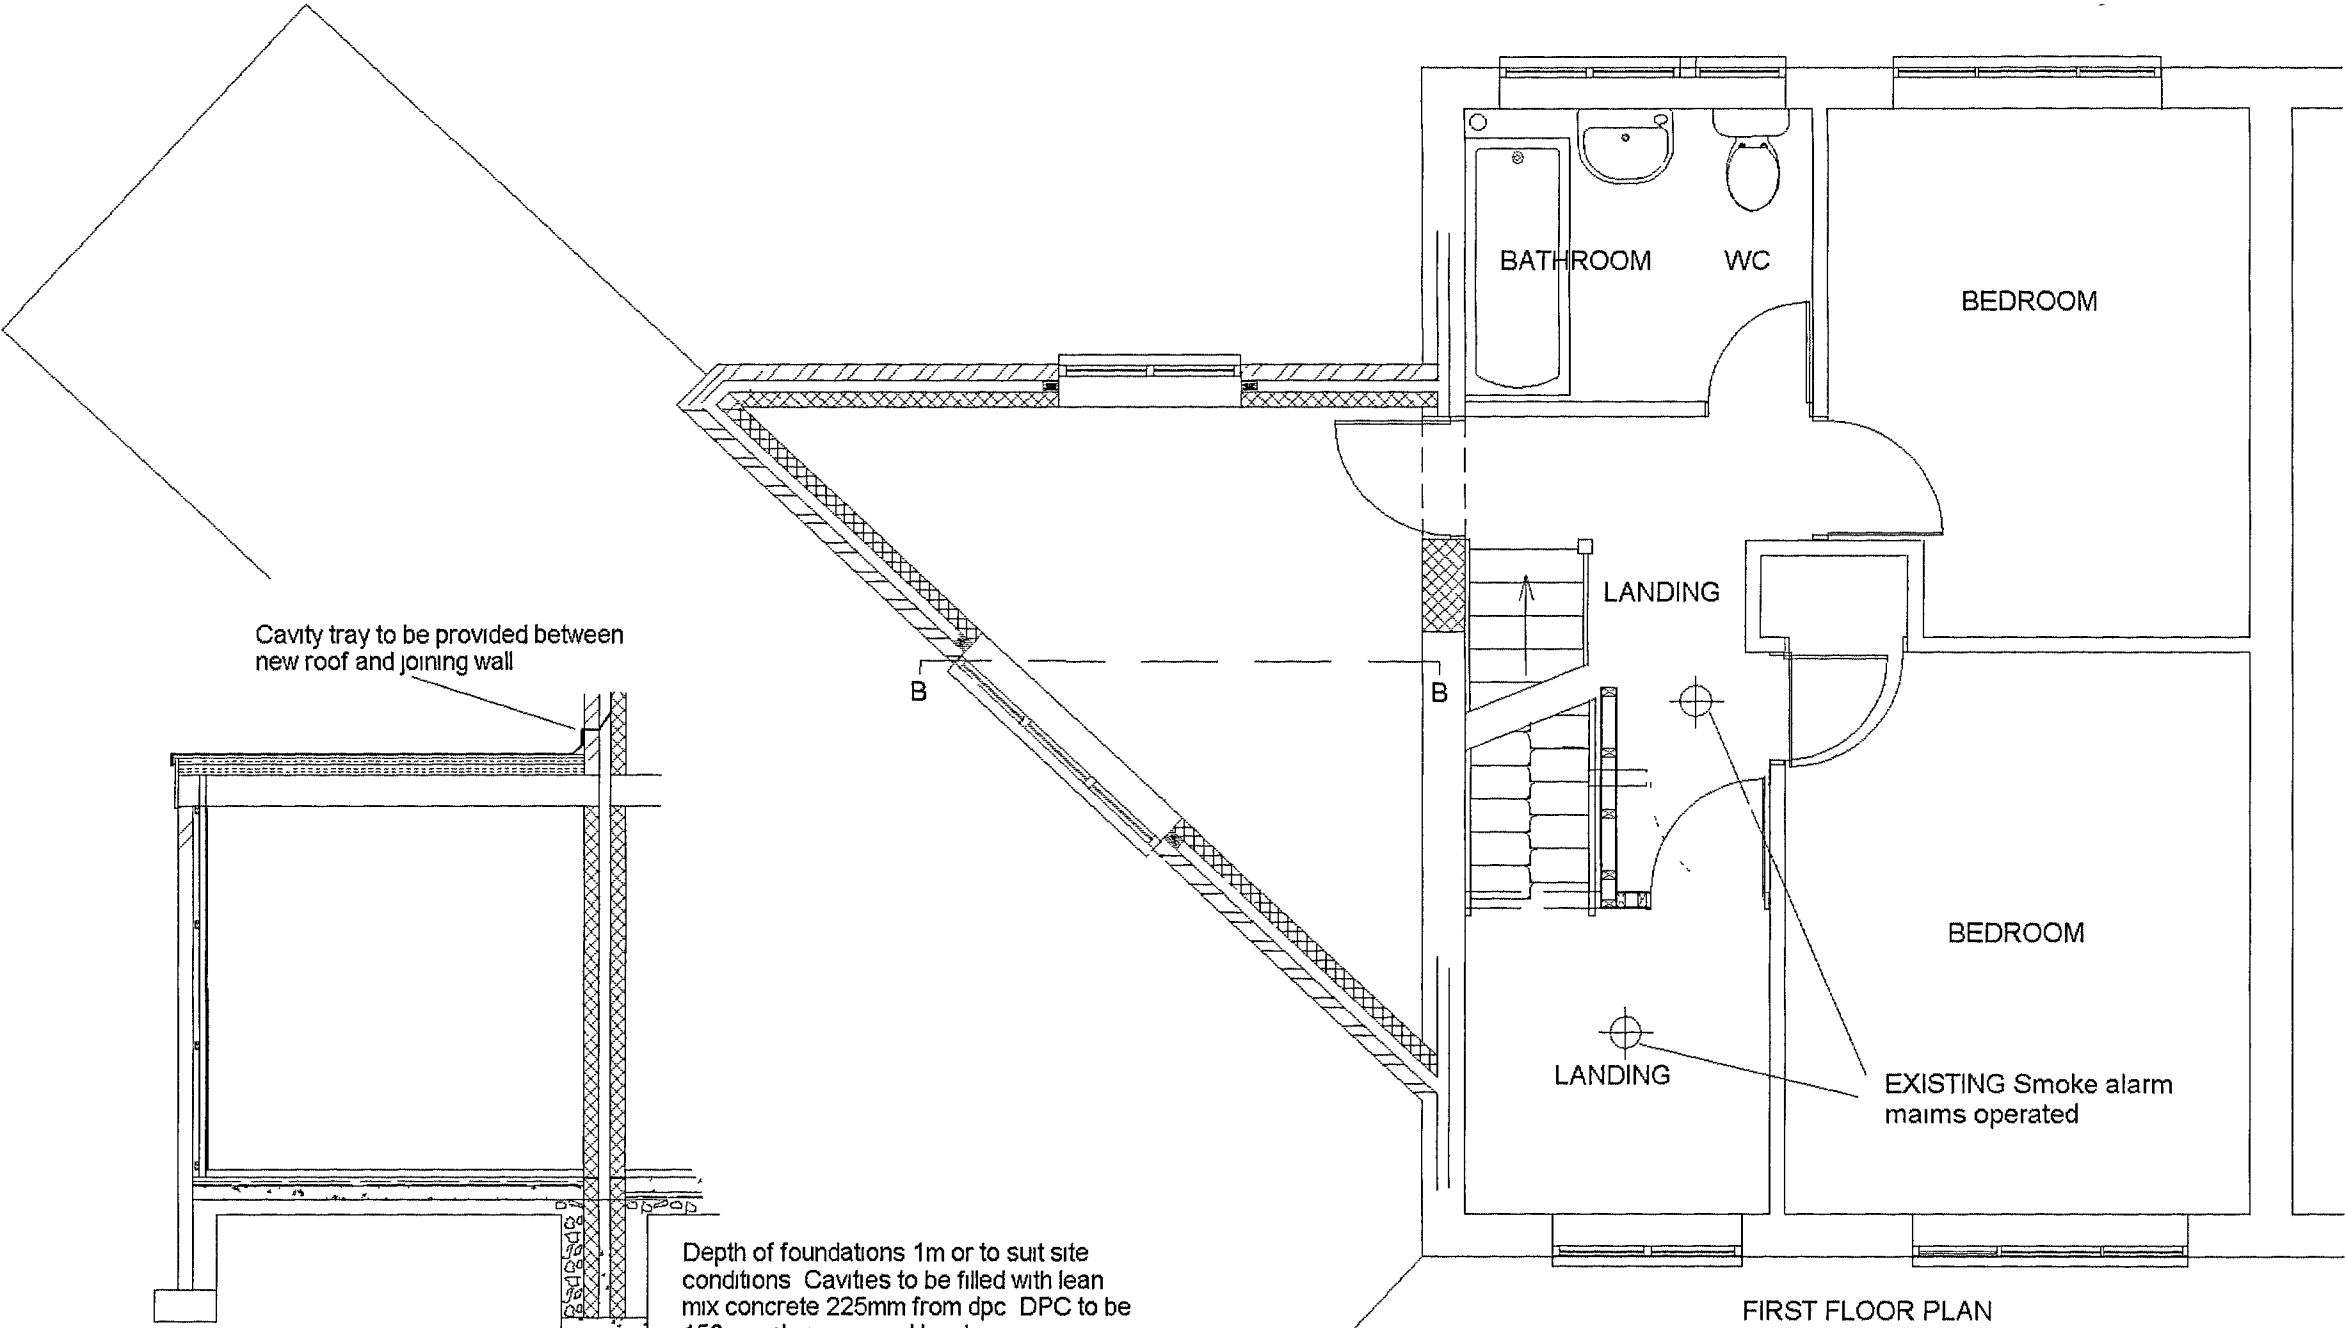

SECTION A - A

SECTION B - B

GROUND FLOOR PLAN

FIRST FLOOR PLAN

Do not scale from drawings
(excepting Local Authorities)
All dimensions to be checked on site

All work to comply with Building Regulations, British Standards, manufacturer's instructions /specifications and engineer's calculations at all times. Construction must also comply with all safety at work regulations. Additional work may be requested by the building inspector as work proceeds to ensure the new building complies with all building regulations

No	Change	Date	By

BKM PLANS
architectural
plans and
drawing
service

Title
Proposed Utility Room extension
27, Poulner Close,
Felpham

Scale	1:50
Date	9th April 2008
Drawn by	

Drawing 2 / 2

All drawings are copyright of BKM architectural plans and drawings service and may not be reproduced without prior permission