


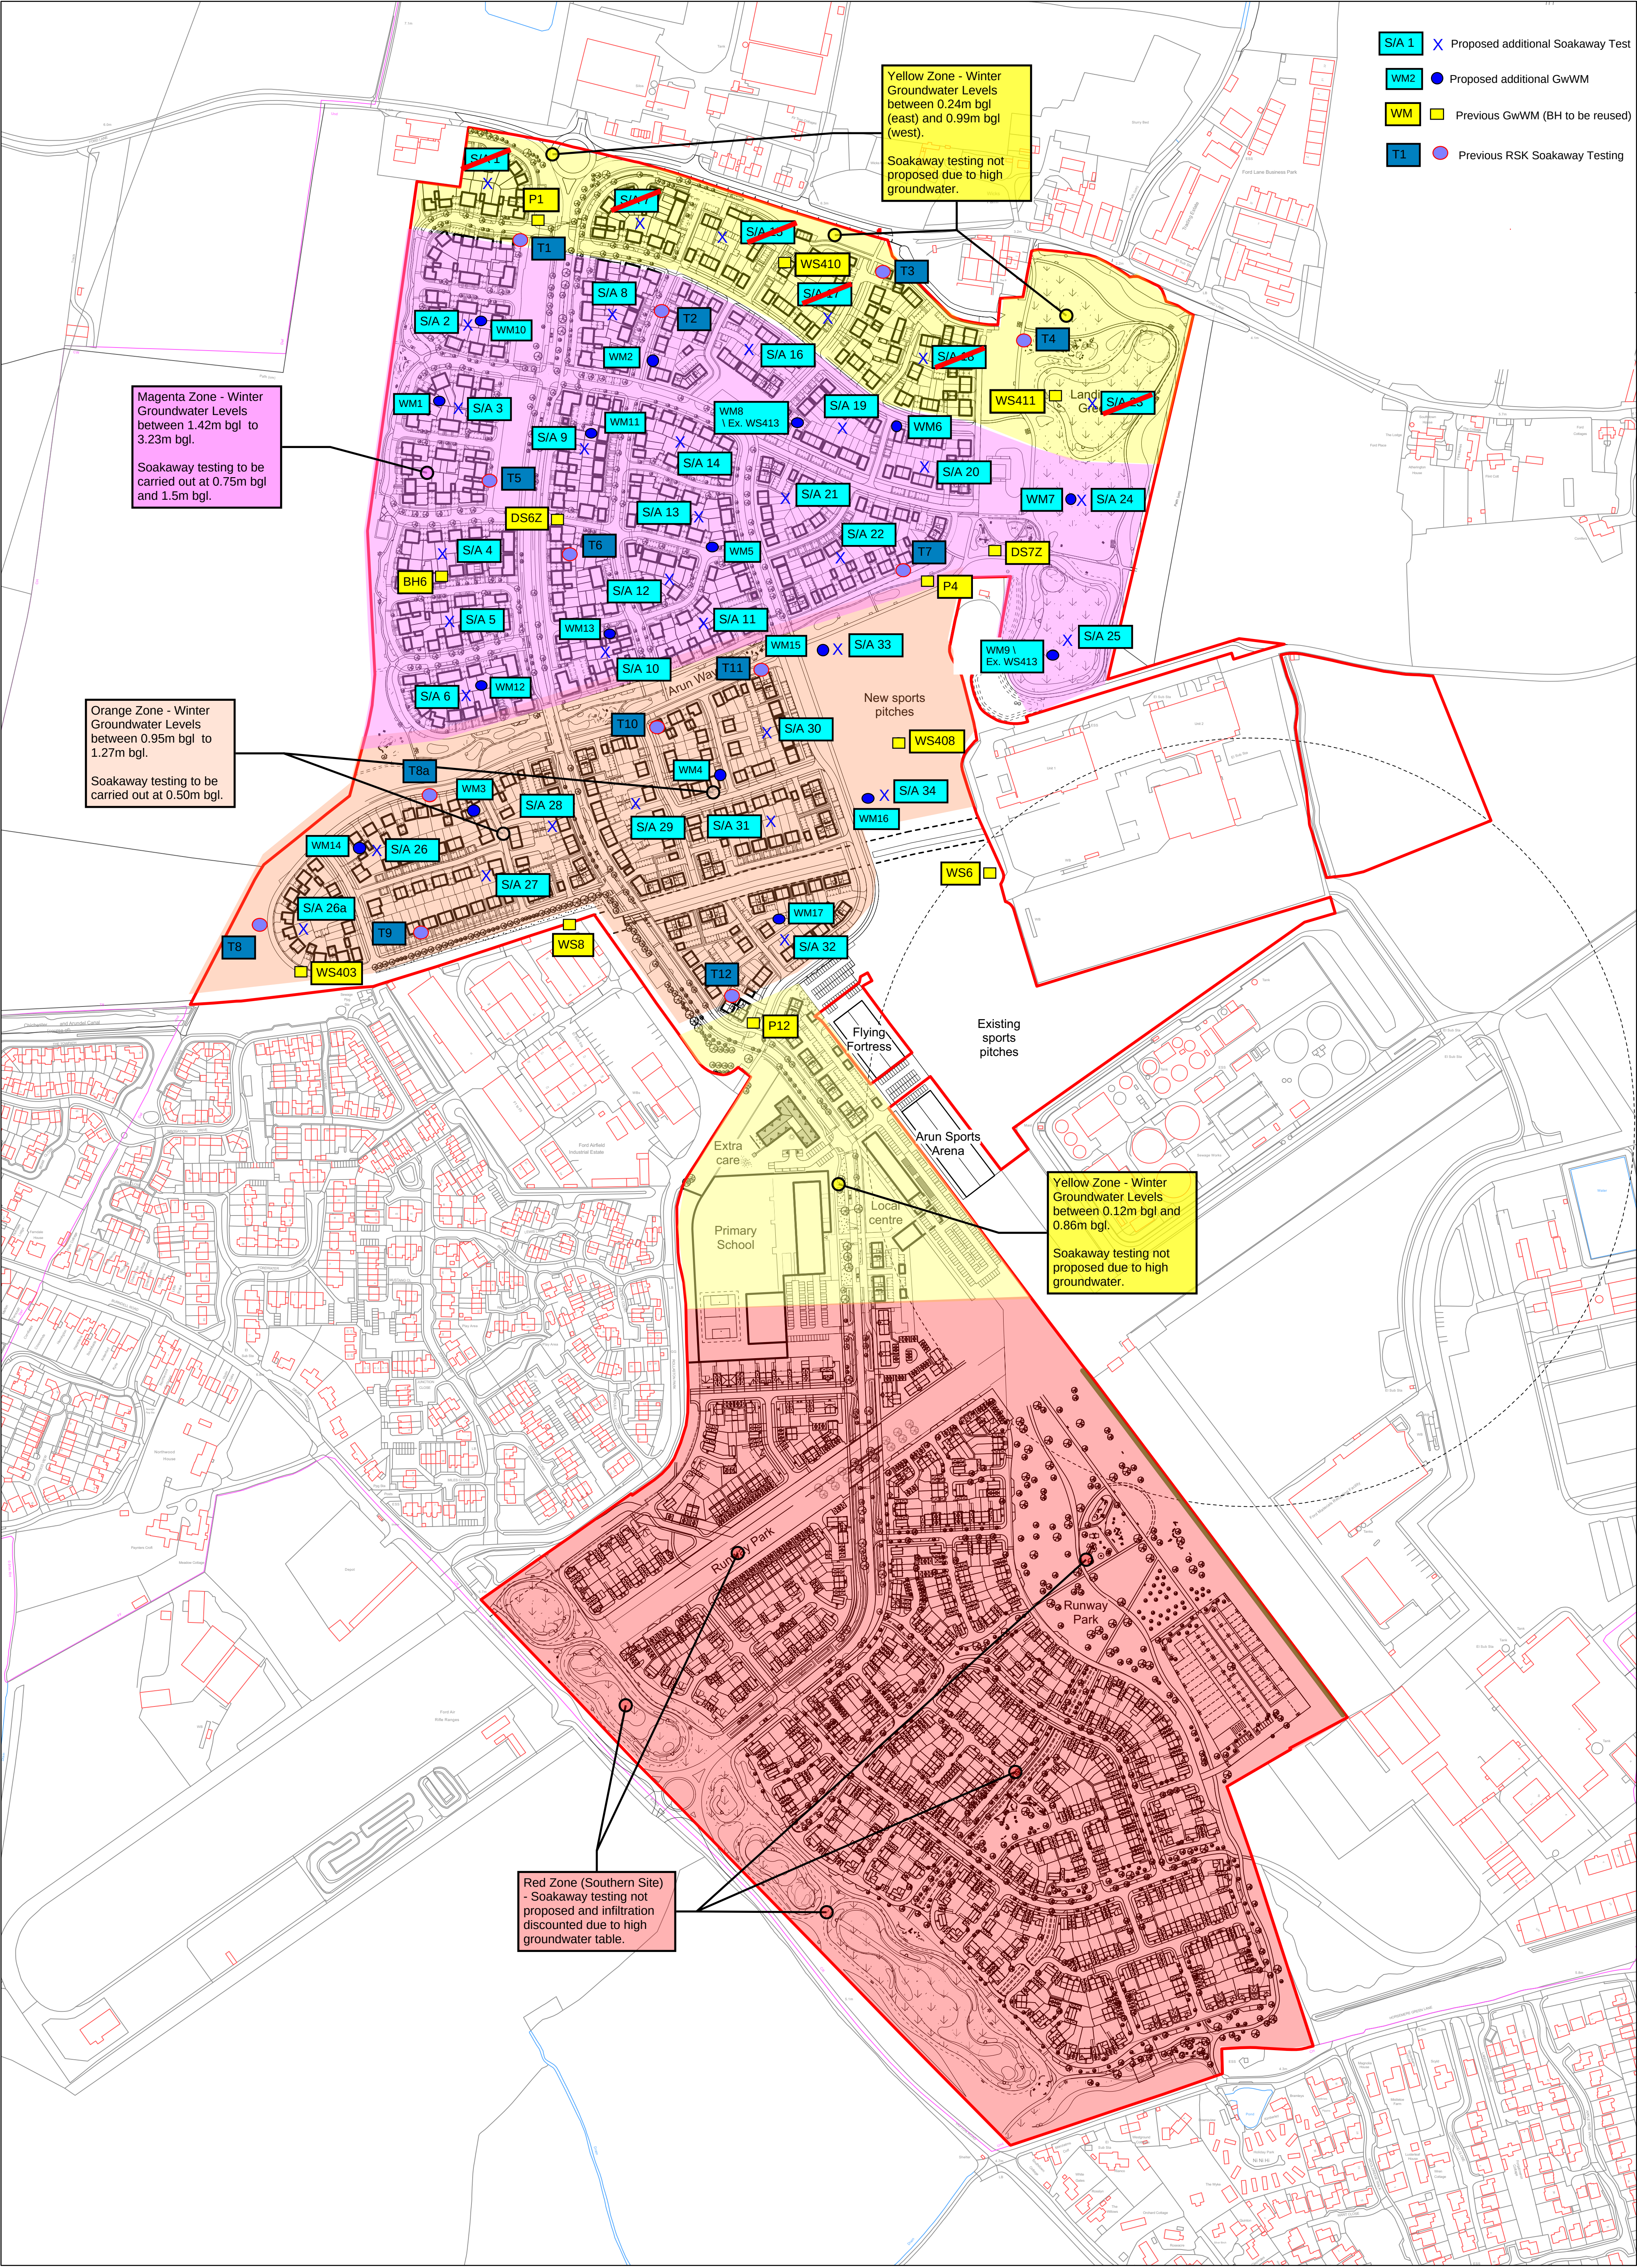

- S/A 1 X Proposed additional Soakaway Test
- WM2 ● Proposed additional GwWM
- WM ● Previous GwWM (BH to be reused)
- T1 ● Previous RSK Soakaway Testing

Magenta Zone - Winter Groundwater Levels
between 1.42m bgl to 3.23m bgl.
Soakaway testing to be carried out at 0.75m bgl and 1.5m bgl.

Orange Zone - Winter Groundwater Levels
between 0.95m bgl to 1.27m bgl.
Soakaway testing to be carried out at 0.50m bgl.

Yellow Zone - Winter Groundwater Levels
between 0.24m bgl (east) and 0.99m bgl (west).
Soakaway testing not proposed due to high groundwater.

Yellow Zone - Winter Groundwater Levels
between 0.12m bgl and 0.86m bgl.
Soakaway testing not proposed due to high groundwater.

Red Zone (Southern Site)
- Soakaway testing not proposed and infiltration discounted due to high groundwater table.