
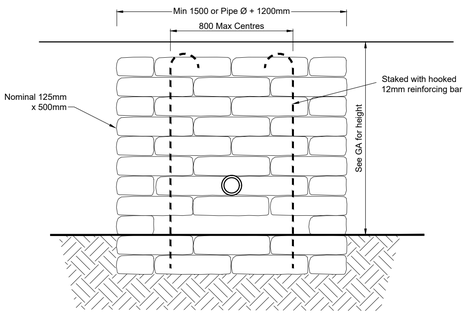



ELEVATION OF HEADWALL
OUTFALL TO SIDE OF EXISTING DITCH
(Scale 1:20)

Notes

1. Bags shall be Hessian or Canvas and shall be of a size to provide a wall thickness of 500mm
2. Concrete bagwork shall be to Clause 519 and be three quarterfilled with 25mm slump ST4 concrete immediately prior to placing with the end sewns
3. The bags shall be placed in a modified Flemish bond so as to 'break joint' with the mouths away from the surface and be tamped into position to form a rectangular block.
4. Extent of outlet protection to be the greater of 1500mm or pipe diameter + 1200mm spanning the outlet pipe.
5. All exposed pipework to be certified UV stable

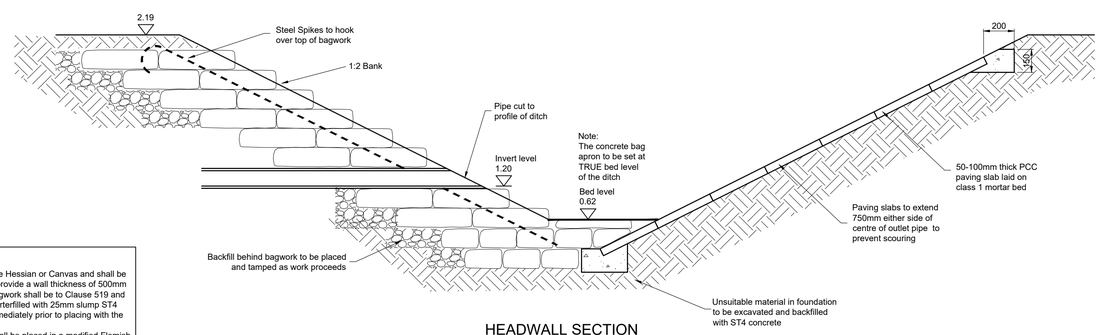

HEADWALL SECTION
OUTFALL TO SIDE OF EXISTING DITCH
(Scale 1:20)

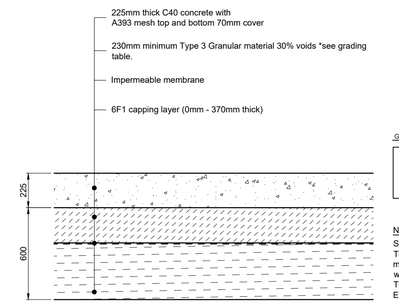


Grading of Sub-base stone


SIEVE SIZE	% PASSING
100mm	100
63mm	90-100
37.5mm	60-80
20mm	15-30
10mm	0-5

NOTES
Supplied by WTB Geotextiles or UGS
To be installed in accordance with the manufacturers instructions
www.geotechnics-uk.com
Tel: 0845 600 5505
Email: geotechnics@wtbgroup.com


CONCRETE YARD
CONSTRUCTION
(Scale 1:20)

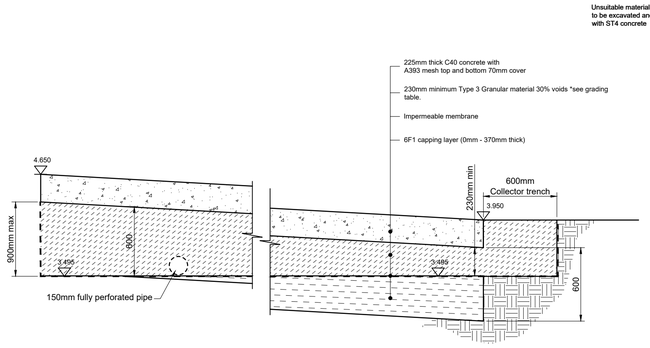

CONCRETE YARD SECTION
(Scale 1:20)

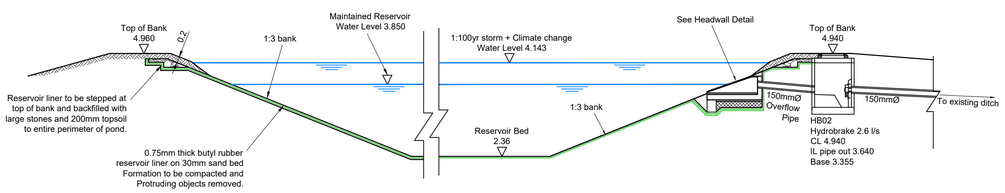



RESERVOIR SECTION
(Scale 1:100)

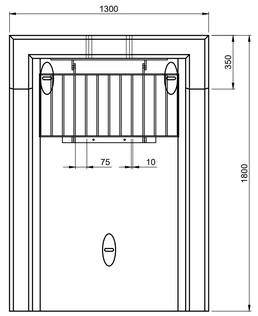

Grating manufactured from 40 x 10 flat. Unit fully welded then hot dip galvanised.

Note: Isometric drawing is for reference only, details may not accurately represent actual design - please see detailed views for technical information

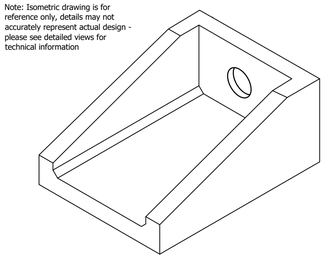

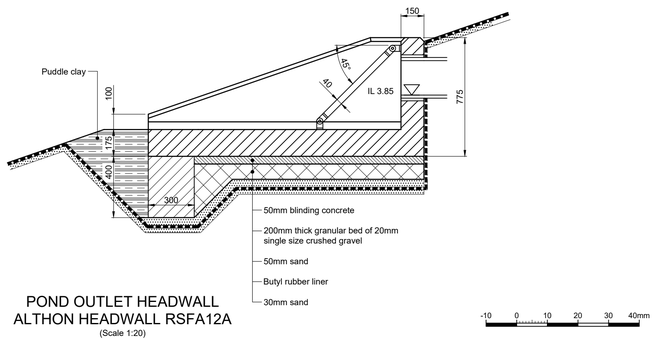

POND OUTLET HEADWALL
ALTHON HEADWALL RSFA12A
(Scale 1:20)

GENERAL NOTES:

1. All dimensions to be checked on site. All details and dimensions relating to sub-Contractors work must be checked and agreed between the sub-Contractor or supplier and the general Contractor.

2. This drawing is to be read in conjunction with all relevant Architect's and Engineer's drawings and specification.

3. The main Contractor is responsible for ensuring the stability of the structure whilst the works are in progress.

4. Any information given regarding existing underground services is given in good faith after consultation with the relevant authority. No liability is accepted by the Consultant and the main Contractor is responsible for obtaining and checking all information and taking due care and attention whilst undertaking the works.

DRAINAGE NOTES:

1. All adoptable pipes, bends and junctions shall be vitrified clay in accordance with the current version of BS EN 295-1, with flexible joints and kitemark certified.

2. All Adoptable sewers shall be in strict accordance with the SSG Appendix C - Design and Construction Guidance. Unless otherwise stated adoptable sewers shall be 150mm diameter and shall be laid in a class S bedding. Where the depth to soffit is less than 1.2m under a public highway or 0.9m elsewhere the pipe shall be laid with a class Z bedding.

3. All private building drainage shall be constructed in strict in accordance with the current version of BS EN 752:2017. Unless otherwise specified building drainage shall be 100mm diameter and shall be laid at a minimum gradient of 1 in 40 for foul drains and 1 in 80 for surface water drains. All building drains shall be laid in class B bedding unless otherwise specified.

4. Where a pipe is within 1m of a foundation the trench shall be filled with class GEN 3 concrete up to the lowest level of the foundation. Where the trench is further than 1m from the foundation, the trench shall be filled with class GEN 3 concrete to a level below the lowest level for the foundation equal to the distance from the foundation less 150mm. In both cases the pipe shall be bedded and surrounded in 150mm thick class GEN 3 concrete.

5. Where pipes, external to the structures, have a depth to soffit from ground level of less than 450mm they shall have a class GEN 3 concrete encasement (150mm thick). In all other cases the pipes shall be bedded and surrounded with 100mm thick granular material.

6. In any circumstances where pipes are bedded and surrounded in concrete flexible joints should be provided. Compressible boards (fibreboard or polystyrene) shall be provided at a maximum of 8m centres (coinciding with pipe joints). The boards shall be pre-cut to pipe diameter and to a height and width equal to the concrete cross section. A board thickness of 18mm for pipes up to 450mm nominal diameter and 36mm for pipes over 450mm nominal diameter.

7. All svps shall have rodding access plates fitted at their bases (ground floor level).

8. Where existing pipes are to be abandoned they shall be dug out together with any abandoned manholes.

9. Any discrepancy between the drawing and site should be reported immediately to the Engineer.

10. All manhole and chamber sizes are given as a minimum to meet the SSG Appendix C-Design and Construction Guidance

REV	DATE	INT	DESCRIPTION	CHK
B and 5	09.05.22	AJD	Updated to suit F/7/21/PL Planning Condition 3	SRM
A	17.03.22	AJD	Updated to suit Planning Condition 3	SRM

Issue Status: FOR APPROVAL

The Civil Engineering Practice
11 Tungsten Building
George Street
Fishersgate
Sussex
BN41 1RA

01273 424424
reception@civil.co.uk
www.civil.co.uk

CLIENT: DPS Limited
PROJECT: Wicks Farm - East, Ford Lane
TITLE: Construction Details

DRAWN	DATE	PROJECT NO.
A Davies	Feb 2022	23482
ENGINEER	CHECKED	DRG. No. / REV.
S Magowan	SRM	502 / B
SCALE: As Shown @ A1		

ARUN DISTRICT COUNCIL FS/02/DOC