



Remove existing plasterboard dry lining and battens and replace with 15 mm 'Gyproc SoundBloc' plasterboard on resilient bars on treated battens with minimum 25 mm 'Celotex' insulation inbetween.

- Manual call point.
- Smoke detector head.
- Heat detector head.
- Emergency lighting.

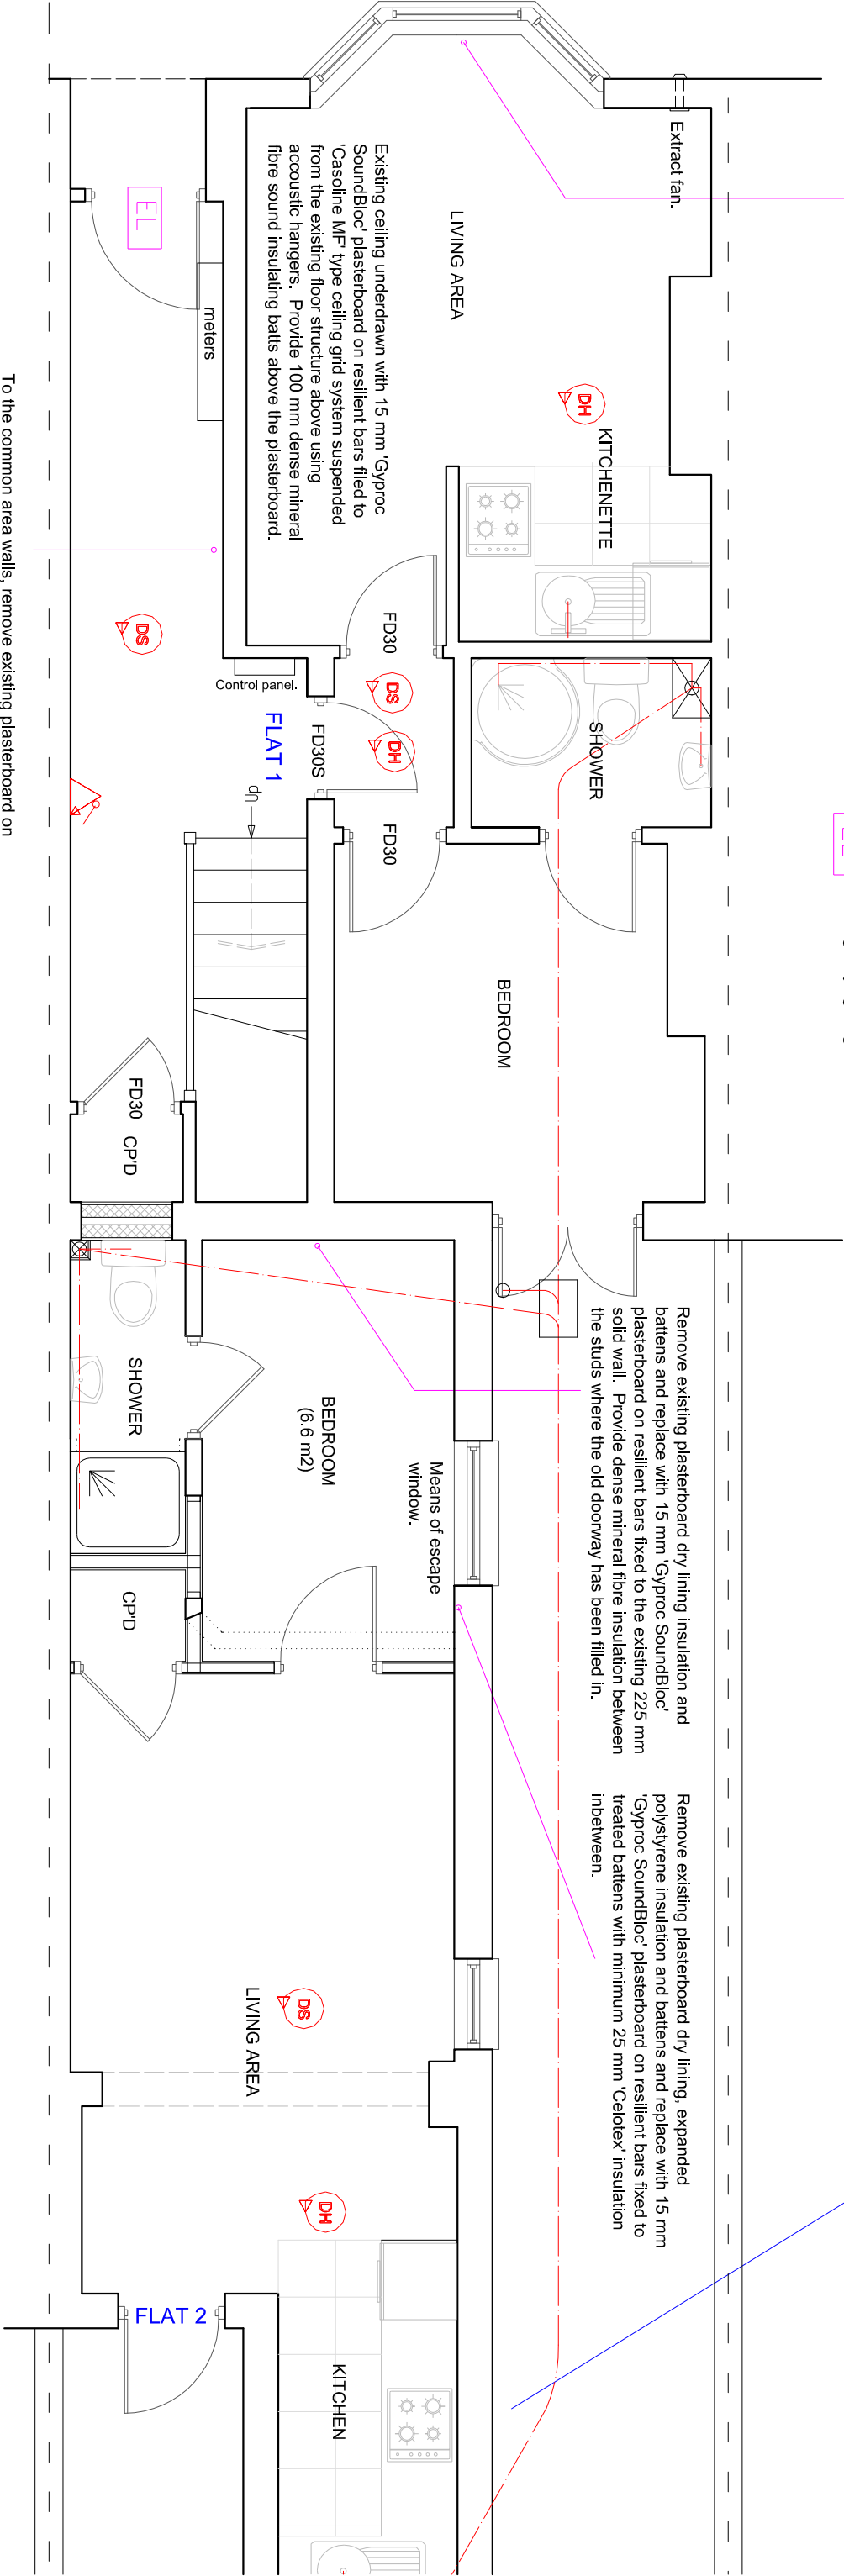

To the common area walls, remove existing plasterboard on laths and plater and replace with 15 mm 'Gyproc SoundBloc' plasterboard on resilient bars fixed to the existing stud wall with minimum 50 mm dense mineral fire bats between studs.

PROPOSED GROUND FLOOR PLAN



SUSSEX BUILDING CONSULTANCY LIMITED

4 ST AUGUSTINE ROAD, LITTLEHAMPTON,
WEST SUSSEX.

SCALE - 1/50 REV - E DATE - 07/05/2019

partner
LABC

3 NORTHCOTE ROAD
BOGNOR REGIS
PO21 5LZ

TEL/FAX - (01243) 861379