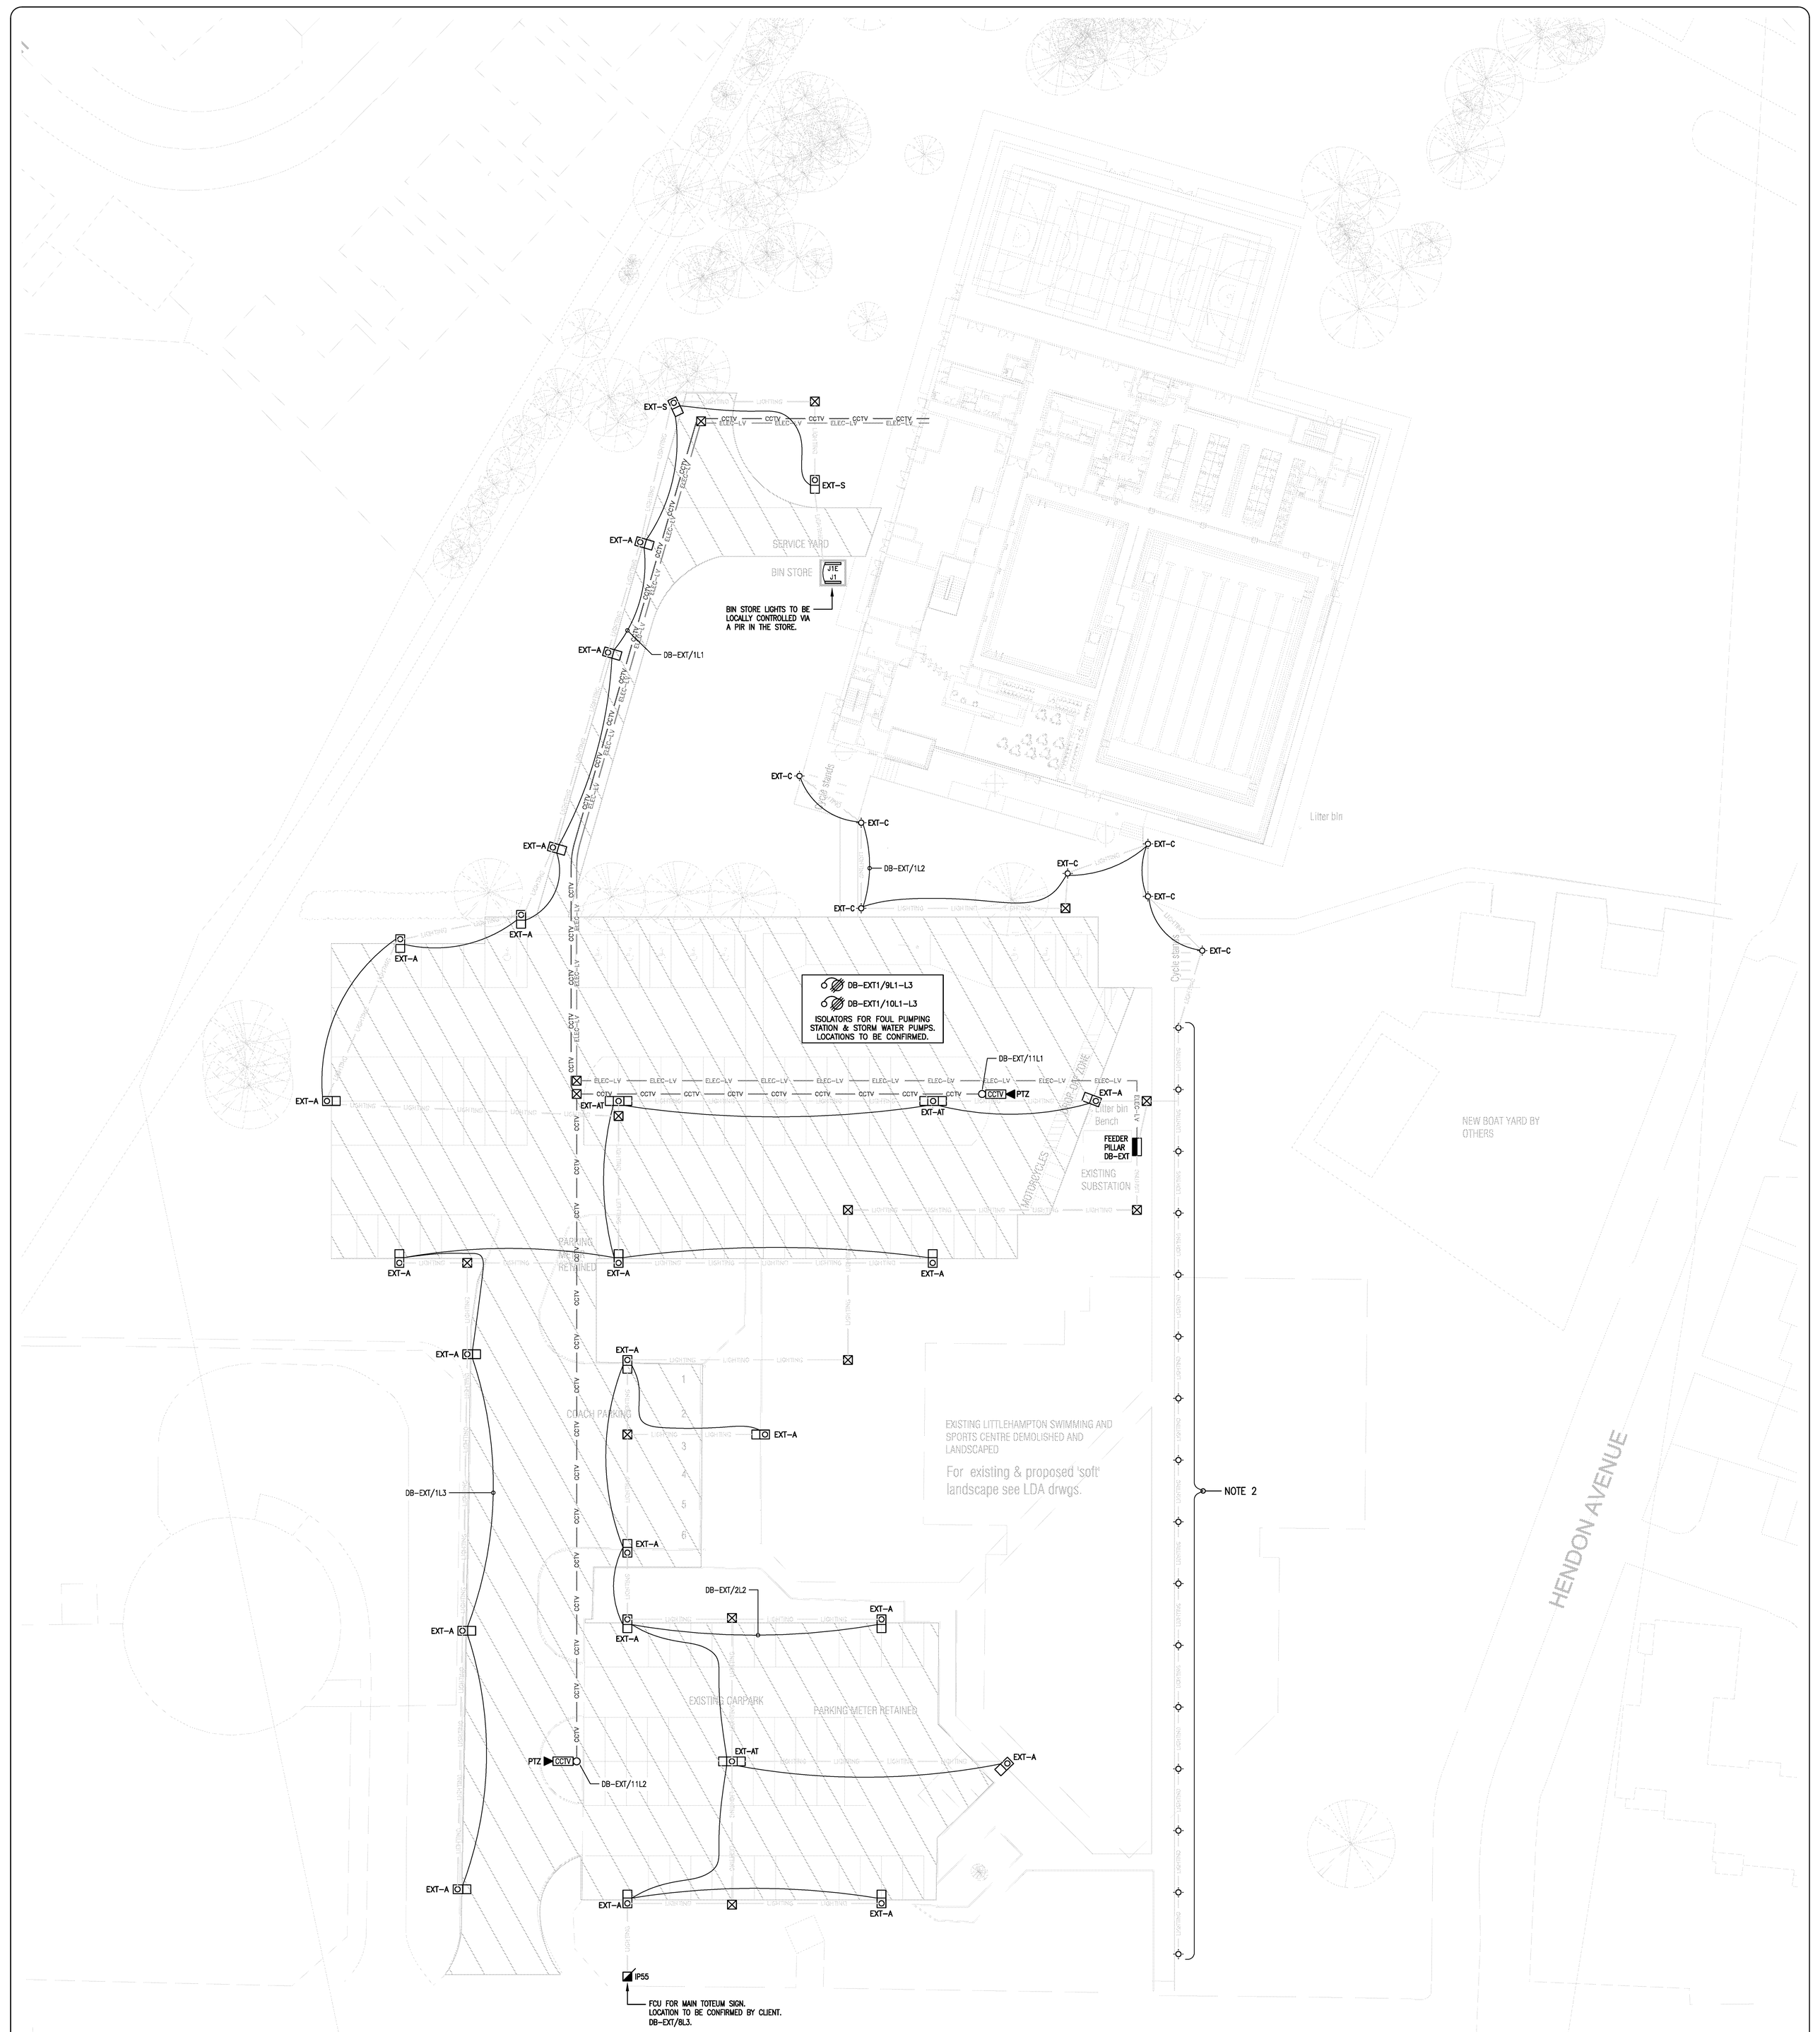


SYMBOL LEGEND & DESCRIPTION			
CCTV	EXTERNAL IP66 CCTV CAMERA		EXTERNAL FEEDER PILLAR (REFER TO M&E SPECIFICATION V90/500.031 FOR FEEDER PILLAR SPECIFICATION)
CCTV PTZ	PAN/TILT/ZOOM CAMERA MOUNTED ON 6M HIGH CCTV COLUMN		MANHOLE / DRAW PIT
	CCTV COVERAGE ZONES, NOTE 3		FUSED CONNECTION UNIT, IP55.
EXT-A	COLUMN MOUNTED SINGLE HEAD LUMINAIRE, REFER TO M&E SPECIFICATION FOR FURTHER DETAILS.		IP RATED THREE PHASE ISOLATOR.
EXT-AT	COLUMN MOUNTED TWIN HEAD LUMINAIRE, REFER TO M&E SPECIFICATION FOR FURTHER DETAILS.		
EXT-B	WALL MOUNTED BULKHEAD LUMINAIRE	ELEC-LV	100mmø DUCT
EXT-C	LED BOLLARD	LV	100mmø DUCT
		DATA	100mmø DUCT
OD	DOWNLIGHTER, IP66, MOUNTED IN SOFFIT	LIGHTING	100mmø DUCT FOR LIGHTING
EXT-S	COLUMN MOUNTED SINGLE HEAD LUMINAIRE, REFER TO M&E SPECIFICATION FOR FURTHER DETAILS.	CCTV	2x 100mmø DUCTS FOR CCTV, 1 FOR POWER & 1 FOR DATA

NOTES :

1. THIS DRAWING IS TO BE READ IN CONJUNCTION WITH VAN ZYL & DE VILLIERS STANDARD AND DETAILED ELECTRICAL/MECHANICAL SPECIFICATION.
2. AVENUE LIGHTING IS TO BE PROCURED UNDER THE REINSTATEMENT WORKS (BY OTHERS).
3. CCTV COVERAGE TO BSEN 50132-7 "IDENTIFY".
4. TESTING OF EMERGENCY LUMINAIRES VIA KEYSWITCH ADJACENT TO LOCAL DISTRIBUTION BOARD DB-GEN(G).

REVISIONS			
NO:	DATE:	DESCRIPTION	APPD.
P1	12/04/17	STAGE 4A DRAFT	PV

AFLS&P 3519(03)100 Rev I

CLIENT: WILLMOTT DIXON CONSTRUCTION

PROJECT: LITTLEHAMPTON LEISURE CENTRE

DESCRIPTION: EXTERNAL LIGHTING AND CCTV LAYOUT

van zyl & de villiers
CONSULTING ENGINEERS
6A PARKWAY, PORTERS WOOD, ST. ALBANS, HERTFORDSHIRE. AL3 6PA
TEL: +44 (0) 1727 731560
FAX: +44 (0) 1727 731561
WWW: www.vzdv.com

DRAWN:	DESIGN:	SCALE:	PAPER:
PFL	PF	1:250	A0

DRAWING NO: 1860-VZV-V4-00-DR-E-00001 REV: P1

ARUN DISTRICT COUNCIL LU177/17/DOC