






CANOPY WEIGHT: 120 KG (APPROX)

M + E BY OTHERS. LIGHTING VIA ROOM LIGHTING CIRCUIT
CONNECTION TO THE LIGHTING TO BE VIA A PRE-WIRED
4m FLEX WITH A "CLICK" PIN PLUG

Note: All dimensions at approval
stage are for reference only.
All dimensions are to be checked
on site by Shine before any
work is put to hand

NOTES:

- Constructed from 1mm 304 grade s/steel fully welded and polished construction satin finish
- Fixing method: Unistrut to be fixed via girder clamps to RSJ. If concrete ceiling then M8 anchor bolts to be used to secure Unistrut
- Final connections to spigots by main contractor
- Canopy dimensions and volume flowrates are calculated in accordance with DW172 to suit the equipment on layout
Dwg No. 1727-DR-00-001
Rev A

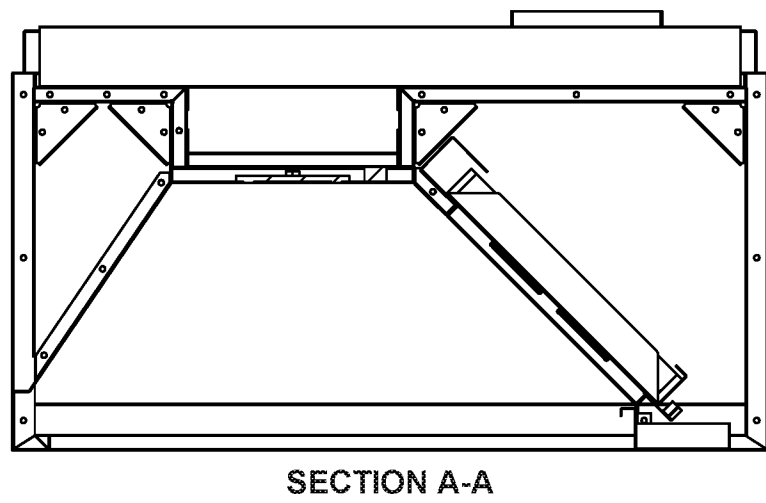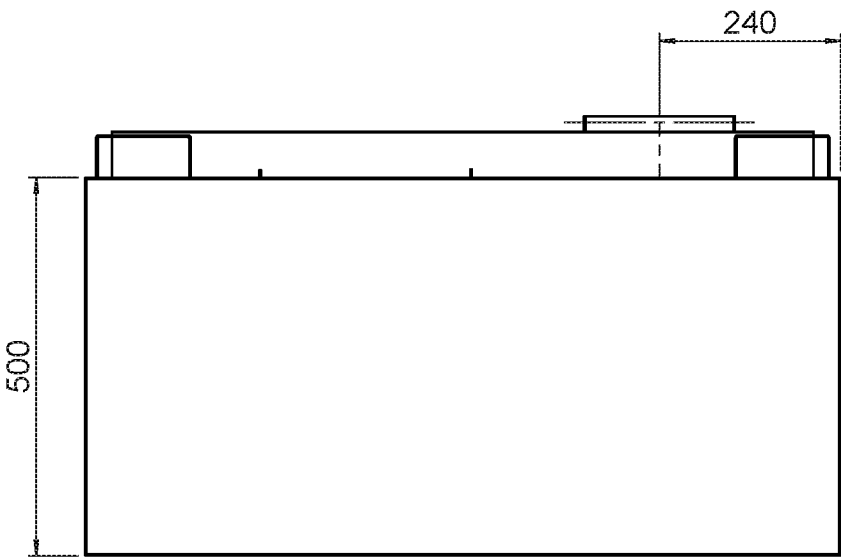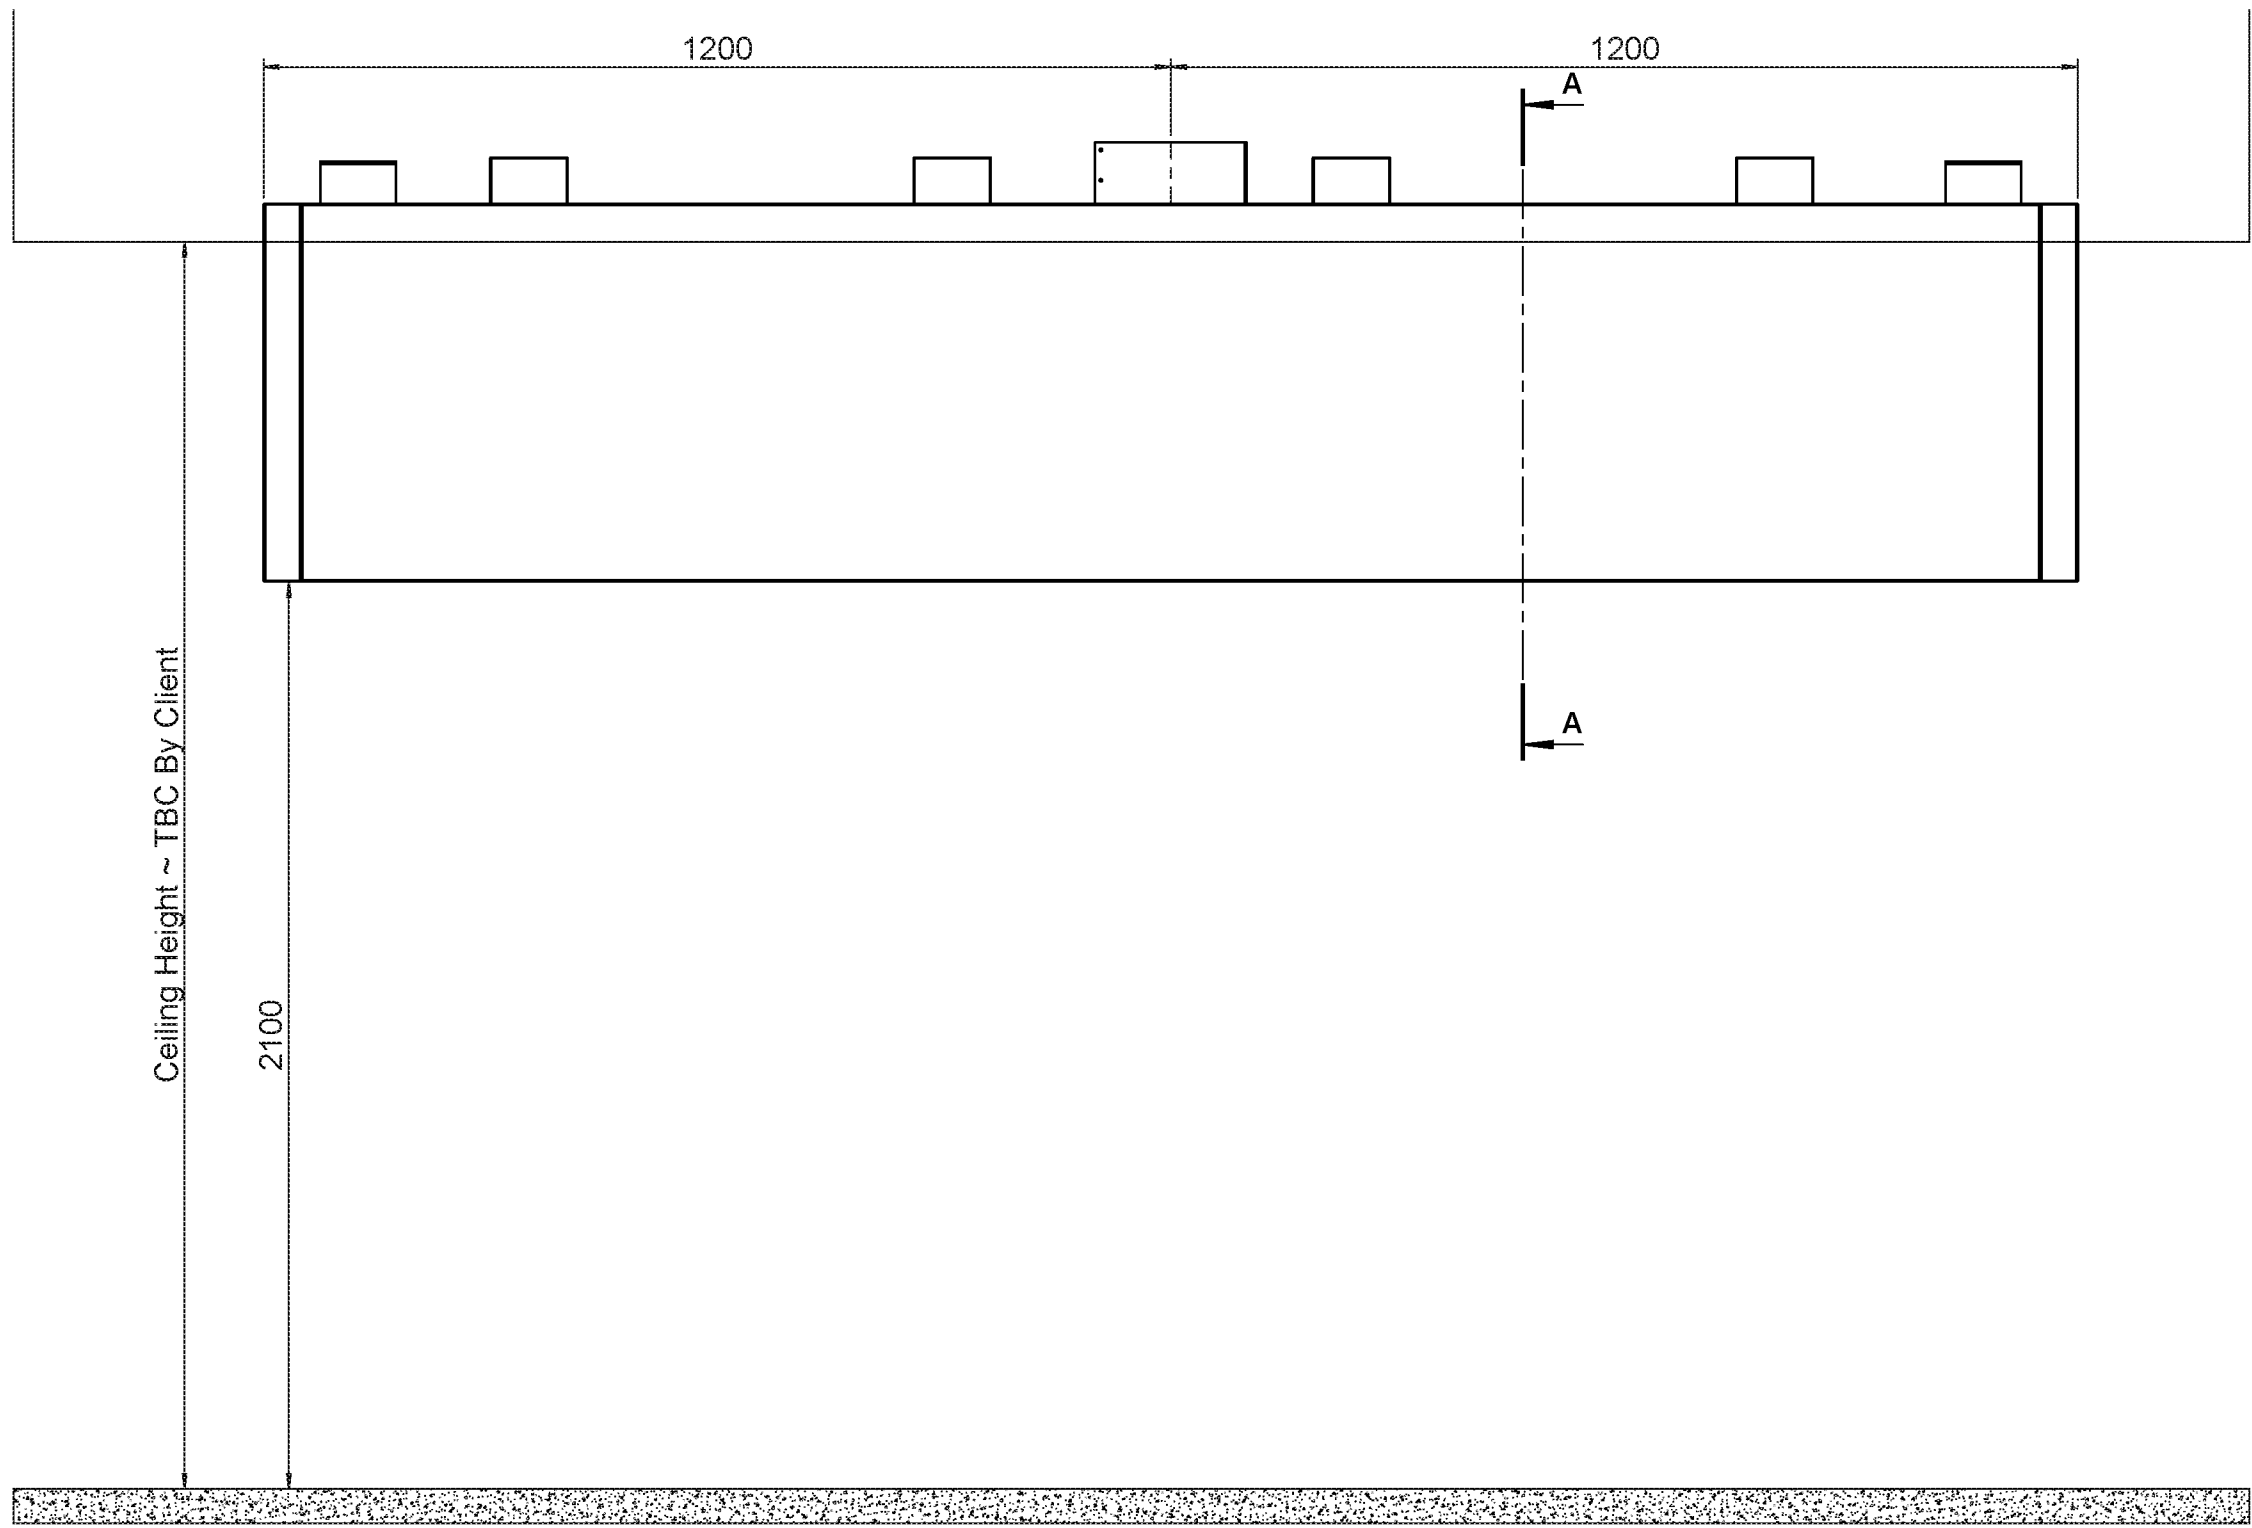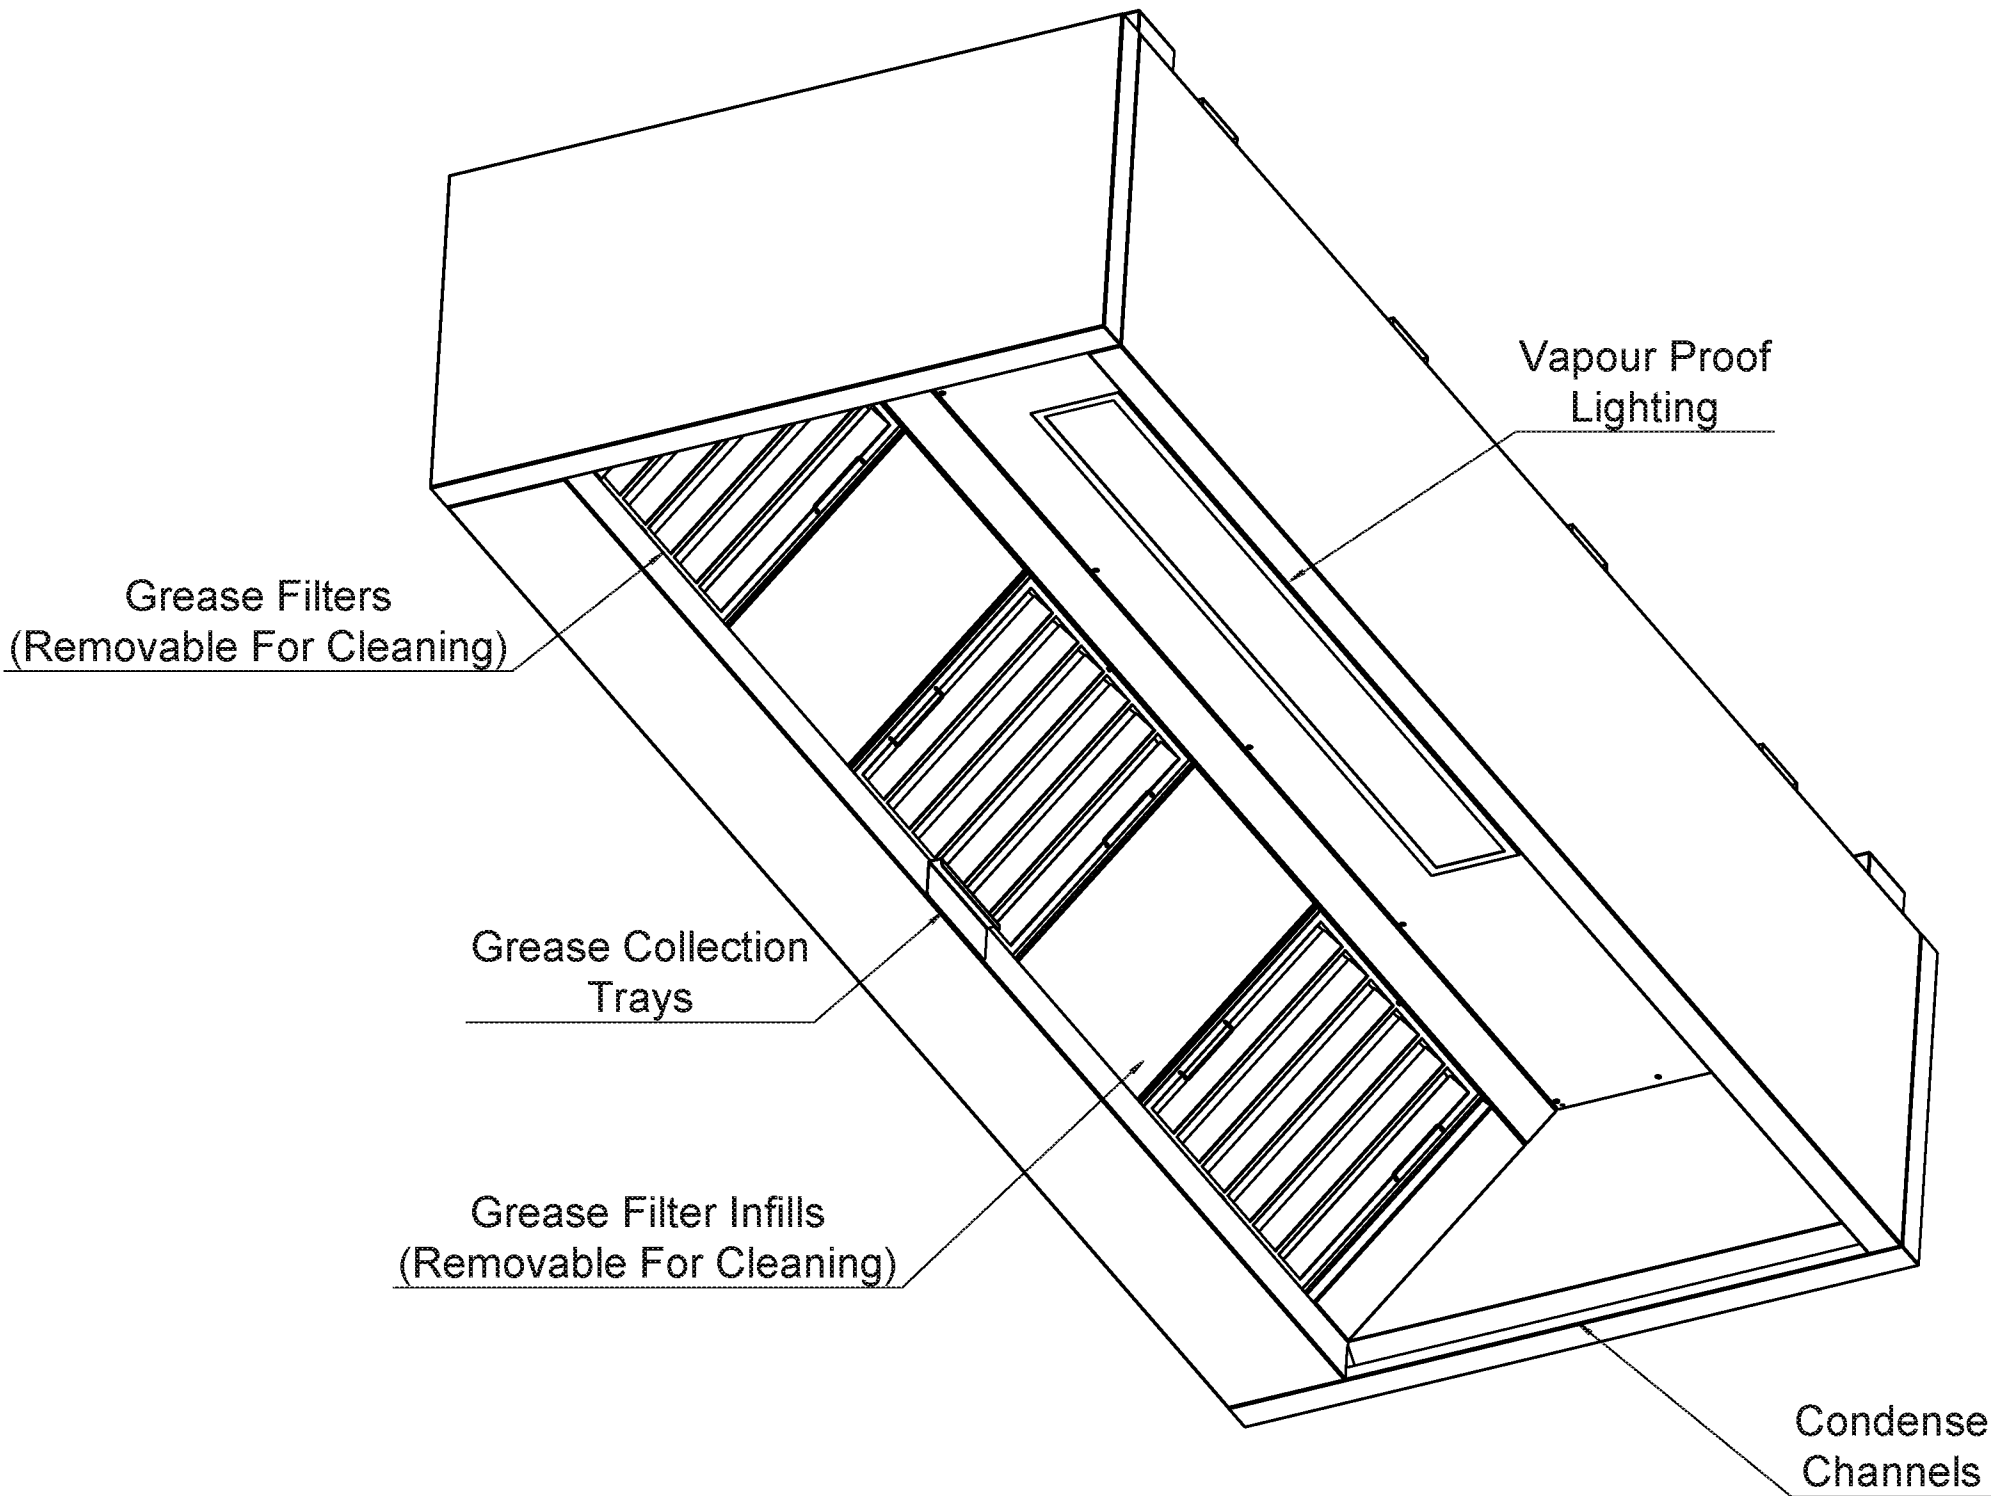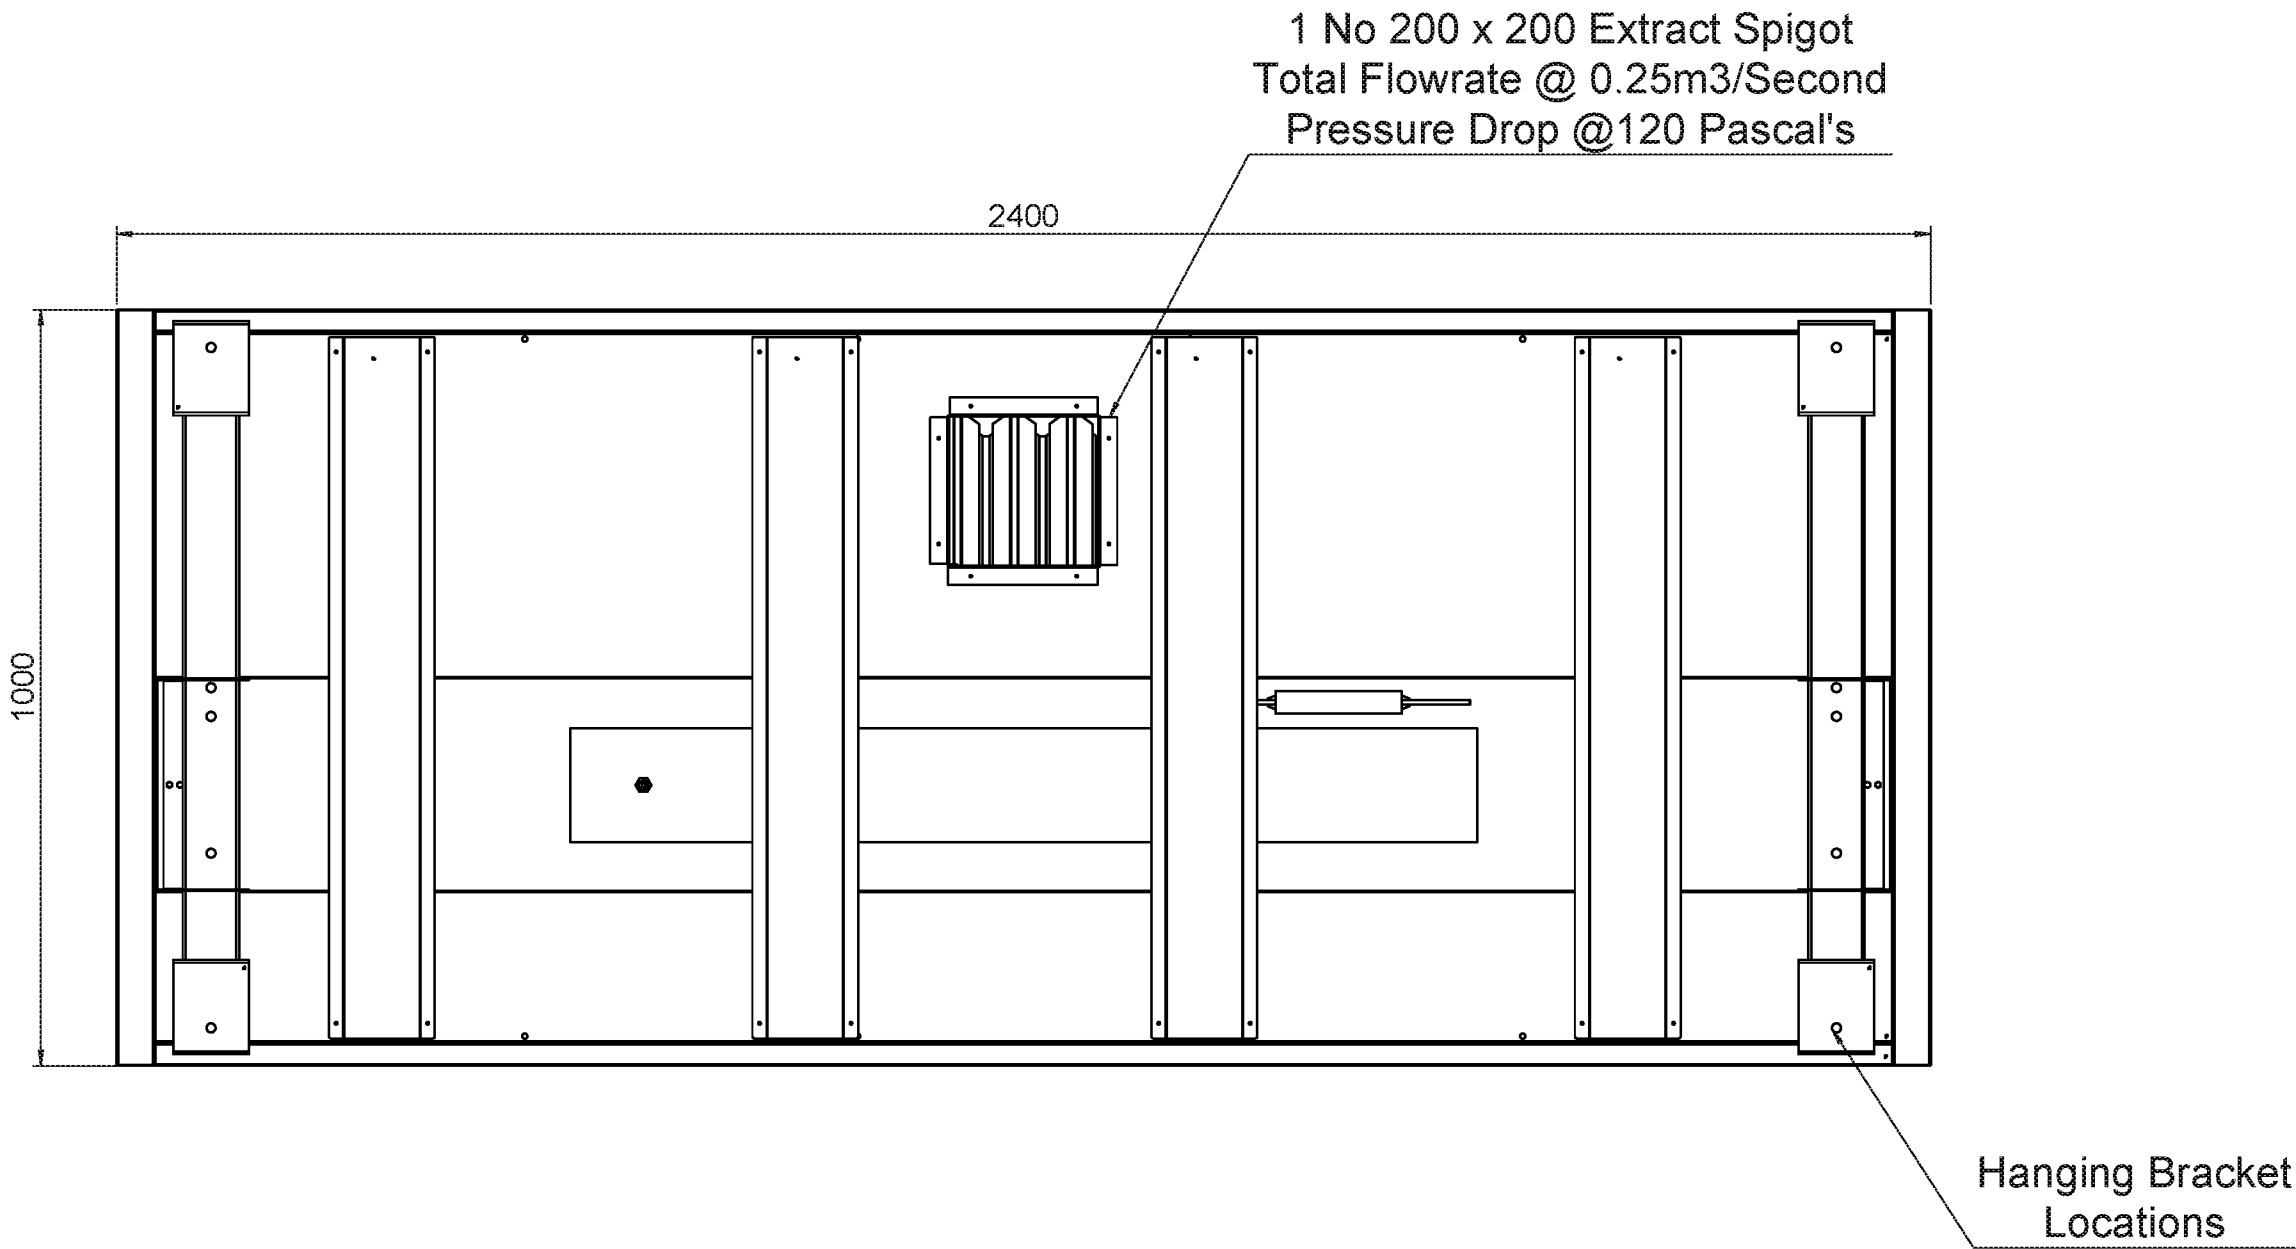

This drawing must NOT be reproduced
without the written permission of:
SHINE FOOD MACHINERY LTD.
Stephenson Ind. Est., Newport, Gwent.
In the event of this contract being
altered in any way, this drawing must be
revised without delay to the above
address.

PLEASE NOTE:
TO COMPLY WITH BS-6173-2001, MANDATORY GAS
INTERLOCKS ARE REQUIRED BETWEEN SUPPLY
AND MECHANICAL KITCHEN EXTRACTION SYSTEM.
PLEASE DETERMINE WHICH CONTRACTOR
IS TO SUPPLY THE ABOVE INTERLOCKS.

Please be aware there are minimum processing and
manufacturing timescales for fabricated items from receipt
of drawing approval and availability of site dimensions
these should be confirmed with your Shine contract Project
Manager. These are typically

	Manufacturing Lead Time (weeks)	
	From DWG Approval	From Site Dimension
General Fabrication	3	2
Dishwash Tabling	3	2
Counter style Fab	4	3
Canopies	3	2
SDU's	3	2
Servery Counters	6	4

DRAWING CHECKED/APPROVAL

	Initial	Date
Salesman		
Client		
Project Manager		

Rev A First issue 18/05/17

JOB TITLE

DRAWING TITLE

Standard Extract Canopy

FOR APPROVAL



NEW QUAY ROAD, STEPHENSON STREET IND. EST.
NEWPORT, GWENT NP15 4PL
TEL: 01633 204800

Drawing No.	Scale	Drawn By
Rev A	N/A	1: 10 @A1 NAT