


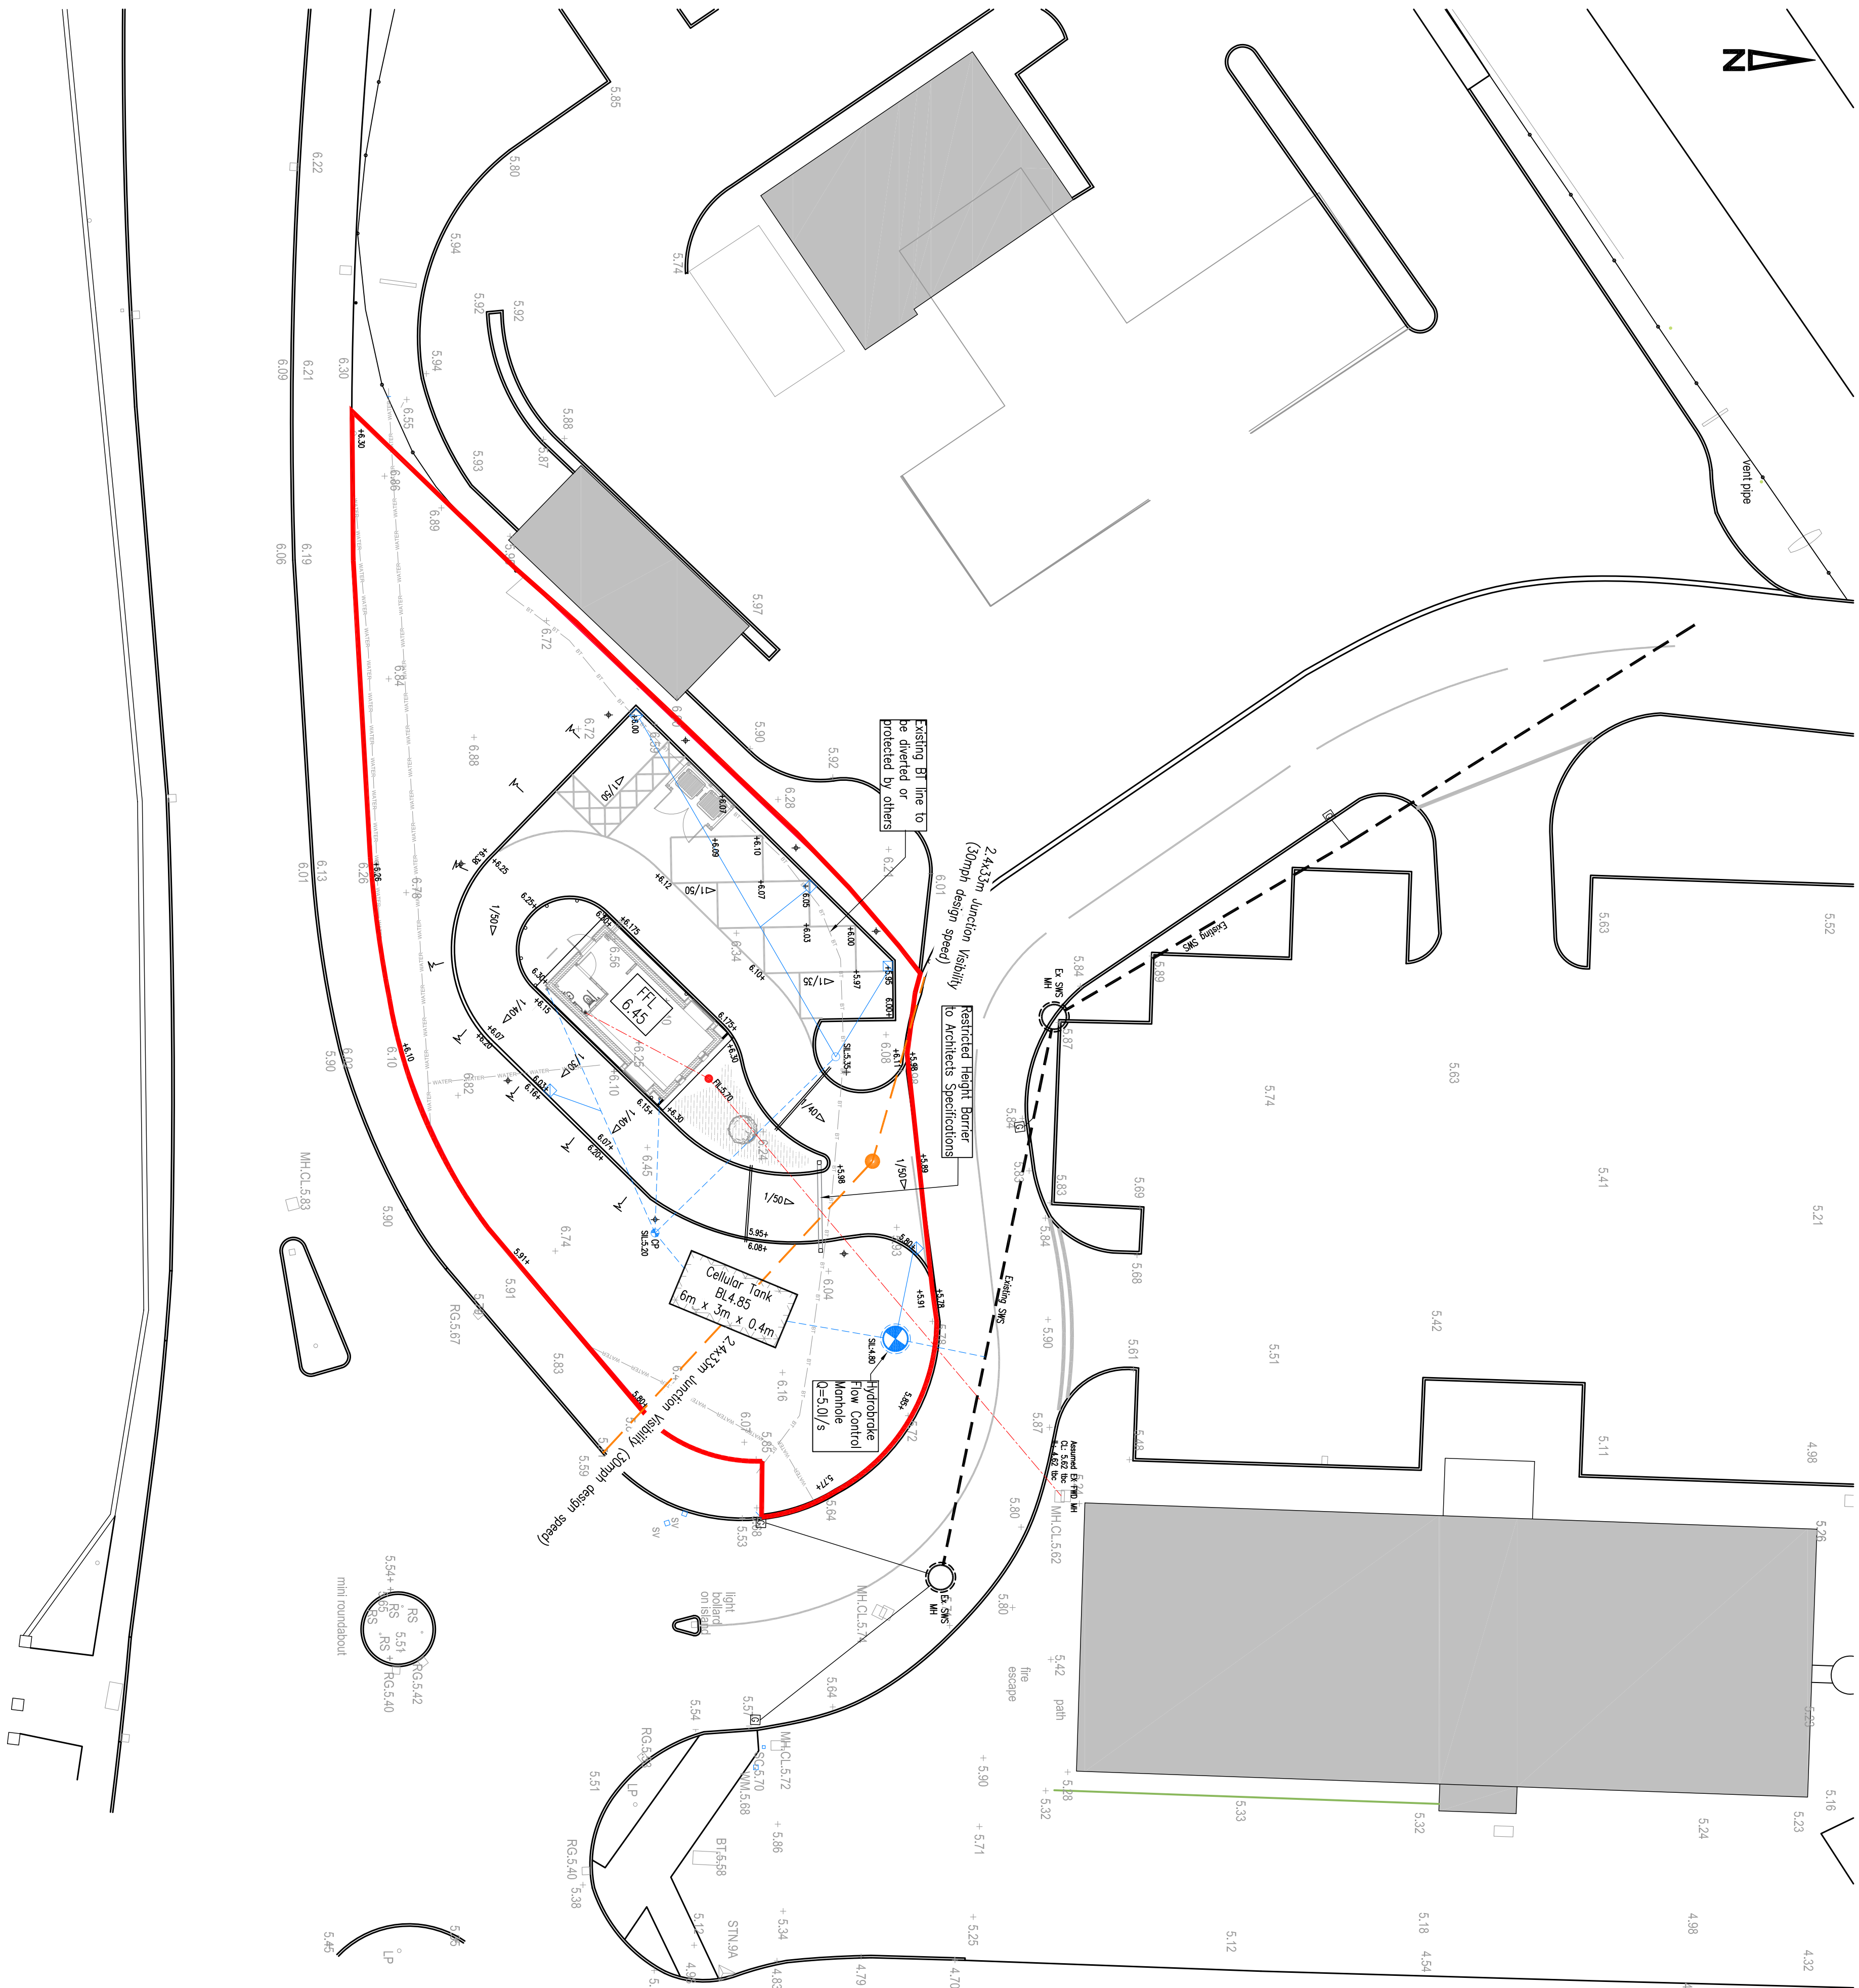

NOTES

1. ANY highway or drainage works constructed prior to issue of Technical Approval is entirely at the risk of the Contractor/Client.
2. At the commencement of works on site the contractor is to carry out trial pits and raise with Utility Companies in order to establish the exact position of all existing statutory utility plant in the vicinity of works and take adequate precautions for their protection.
3. All manhole covers/valves/inspection covers in existing carropways/verges to be adjusted where necessary to suit design levels.
4. Where the works involve the obstruction of a footway, the Contractor shall provide an alternative safe footway property signed, guarded and lit.
5. All excavation and backfilling work in the existing highway to be in accordance with the provisions of the New Street Works Act 1991 or that specified within the Working Drawings.
6. The Contractor is to comply fully with the CDM Regulations in the course of constructing the works.
7. The Contractor shall ascertain the CBR of the subgrade in order to determine the required sub-base/copping thickness.
8. Prior to laying any material the subgrade must be inspected and any soft spots removed and filled with 672 copping material.
9. Prior to construction of any drainage works, the Contractor is to confirm the invert levels of existing manholes and sewers. Any variations from the designed levels shown on the drawings shall be reported to the Engineer in advance of construction works commencing.
10. All adoptable foul sewer drainage works must comply with 'Sewers for Adoption 8th Edition' and to Southern Water Adendum and to the satisfaction of Southern Water.
11. All adoptable drainage pipes shall have 360° Class S granular bed and surround. However, any pipes below the adoptable carriageway with less than 1.2m of cover (900mm in verge and unclassified areas), shall be Class Z surrounded with 150mm of S14 concrete with tieable joints.
12. All drain and sewer pipes to be laid soffit to soffit, unless shown otherwise.
13. Contractor to refer to Health & Safety Executive Note 47-Avoiding Danger from Underground Services and 'Document G56 - Avoiding Danger from Overhead Electric Lines.
14. Where one-way traffic is unavoidable traffic shall be controlled by a proper system of vehicle actuated traffic signals or manual Stop/Go signs and during the hours of darkness by a proper system of vehicle-actuated traffic signals, all to the approval of the Highway Authority.
15. Traffic signs and carriageway markings shall comply with the Traffic Signs Regulations and General Directions (2002). Any poles removed as part of the works to be mounted on new poles where appropriate.
16. Where existing junctions and accesses remain in operation within the works during the construction process, the Contractor shall ensure that access to these units remains available at all times.
17. Highways in the vicinity of the works must be kept free from mud, debris and dust falling from vehicles or the wheels of vehicles connected with the works.
18. Where the deposits of debris and mud are unavoidable, warning signs must be exhibited whilst work is in progress and affected carriageway/footways must be regularly cleaned.
19. Do not scale from the drawing. Work only from stated dimensions or setting out details.
20. The Contractor shall be responsible for the traffic safety and management associated with the construction of the works. The Contractor shall not commence any works on the existing highway until the traffic management proposals have been agreed with West Sussex County Council.
21. Works on or adjacent to existing public highway shall be executed in accordance with the Traffic Safety Code for Roadworks and Chapter 8 of the Traffic Signs Manual.
22. All levels are in metres above Ordnance Datum.
23. All foul and storm water drains which are not subject to adoption as public sewers under a Section 104 Agreement must be constructed in accordance with the latest Building Regulations, BS8301, and, where appropriate, the relevant agreement certificates.
24. All private lateral connections to public sewers shall be 150mm unless shown otherwise.
25. Where grass service strips are present a requirement is to be placed on the owner/occupier to maintain the grassed areas and to ensure that no planting is carried out which is injurious to the underlying services. Vehicle crossings and permeable points to be constructed to adoptable standards.
26. There is to be no denotation of service strips for the grassed area.
27. Private drainage pipework to be 100mm unless shown otherwise on Engineering Layout Plans.
28. 100mm private foul water & storm water drainage shall be laid no flatter than 1 in 80. 150mm pipework shall be laid no flatter than 1 in 150.

KEY:

- Existing 360° EXISTING STORM WATER SEWER, MANHOLE & PIPE DETAILS
- 1:7.50 FALL ARROWS
- 47.733 PROPOSED SPOT LEVELS
- +6.50 EXISTING SPOT LEVELS
- 360° PRIVATE WARD GULLY & CONNECTION
- 100MM PRIVATE SW DRAIN, INSPECTION CHAMBER & INVERT LEVEL
- 100MM PRIVATE FW DRAIN, MH CHAMBER & INVERT LEVEL
- 6.4250 CATCHPIT
- 100.000 FINISHED FLOOR LEVELS
- SITE BOUNDARY

DATE: 31.07.17 Updated to suit new layout



COLE EASDON CONSULTANTS

Web Site: www.ColeEasdon.com
Email: cec@ColeEasdon.com

Store Property Investments Limited

Proposed Drive-Thru,
Worthington Road,
Rustington

Engineering Layout

Drawings Status	FOR COMMENT / FOR PLANNING / FOR TENDER	FOR APPROVAL	FOR CONSTRUCTION / AS BUILT
Drawn By:	AD	DJR	AD
Checked By:			
Drawn By:			

July 2017 1:200 @ A1

57/53/02

A