
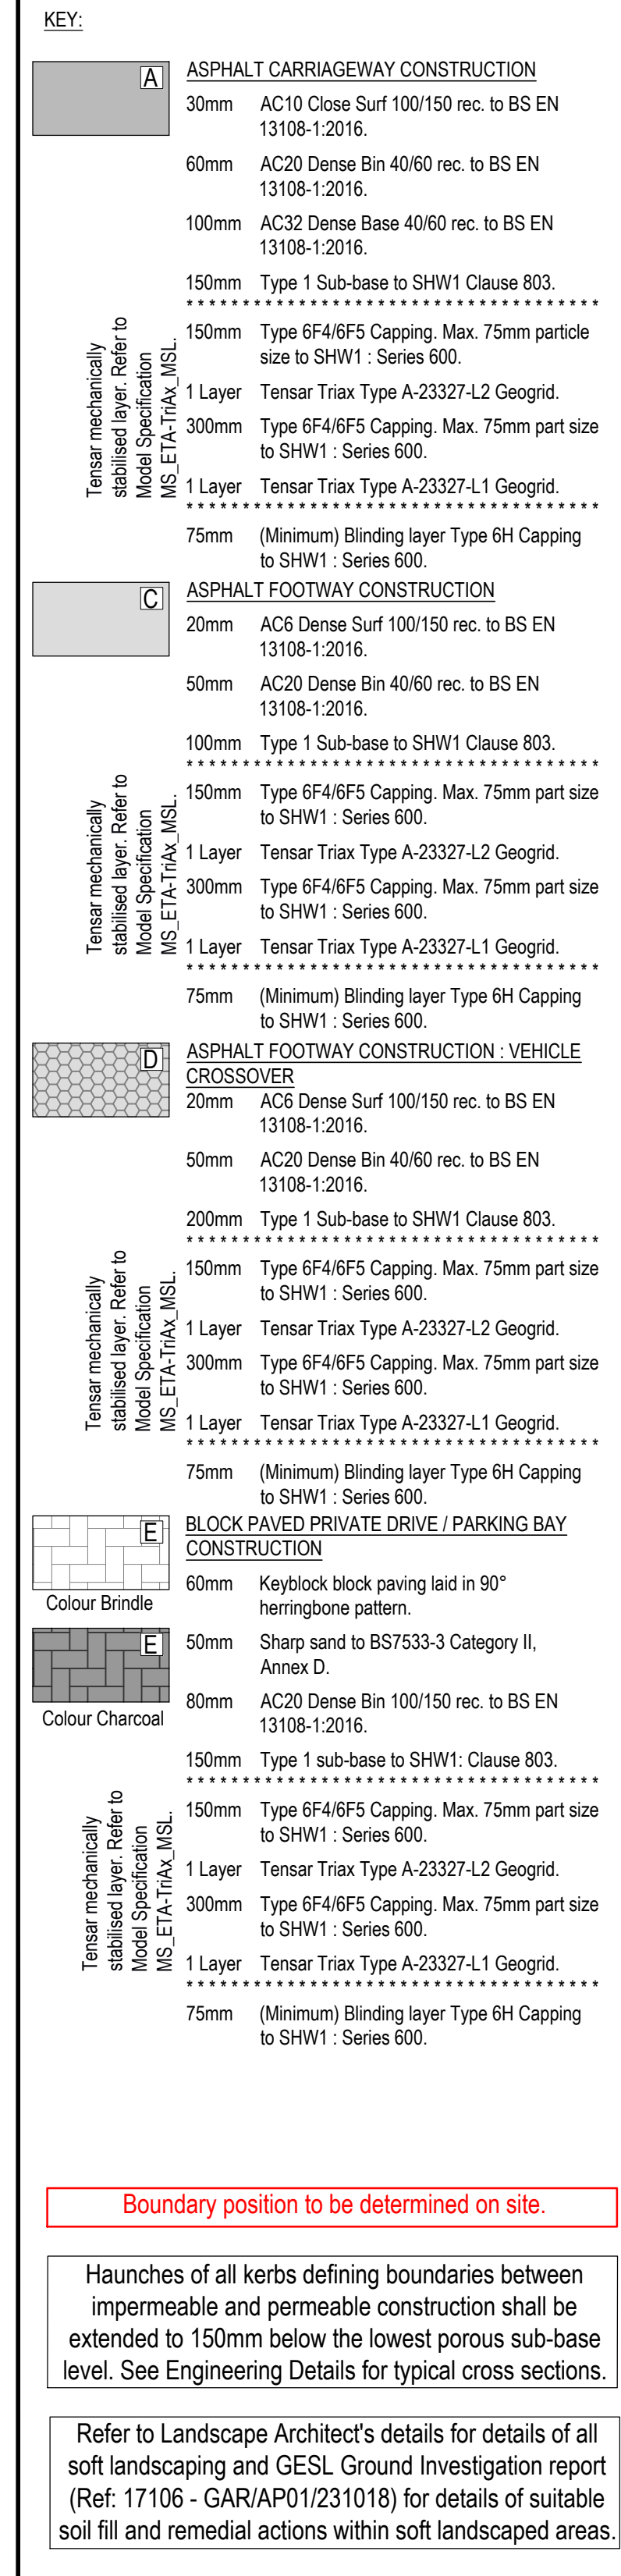




	PERMEABLE BLOCK PAVED PARKING BAY CONSTRUCTION
	60mm Marshalls Priora permeable block paving colour brindle, laid in 90° herringbone pattern.
	50mm 6mm Clean open graded crushed rock.
	80mm AC20 Dense Bin 100/150 rec. to BS EN 13108-1:2016 with 100mmØ holes at 750mm centres infilled with 6mm clean open graded crushed rock.
	240mm Type 3 open graded crushed rock, no fines to SHW1: Clause 803.
	1 Layer Marshalls MM380 tanking membrane or similar agreed with welded joints.
	150mm Type 6F4/F65 Capping, Max. 75mm part to SHW1 : Series 600.
	1 Layer Tensar Triax Type A-23327-L2 Geogrid.
	300mm Type 6F4/F65 Capping, Max. 75mm part to SHW1 : Series 600.
	1 Layer Tensar Triax Type A-23327-L1 Geogrid.
	75mm (Minimum) Blinding Layer Type 6H Capping to SHW1 : Series 600.

BLOCK PAVED FOOTWAY CONSTRUCTION	
60mm	Keyblock block paving laid in 90° herringbone pattern.
50mm	Sharp sand to BS7533-3 Category II, Annex D.
60mm	AC20 Dense Bin 100/150 rec. to BS EN 13108-1:2016
100mm	Type 1 sub-base to SHW1: Clause 803.
150mm	Type 6F4/6F5 Capping. Max. 75mm part size to SHW1 : Series 600.
1 Layer	Tensar Triax Type A-23327-L2 Geogrid.
300mm	Type 6F4/6F5 Capping. Max. 75mm part size to SHW1 : Series 600.
1 Layer	Tensar Triax Type A-23327-L1 Geogrid.
75mm	(Minimum) Binding layer Type 6H Capping to SHW1 : Series 600.

PRIVATE PATH / PATIO CONSTRUCTION (FRONT)	
50mm	600mm square concrete paving slab.
25mm	Sharp sand to BS 7533-3 Category II of Annex. D.
100mm	Clean well consolidated crushed rock, hardcore (max 40mm size) slag or concrete. Depth to be increased according to meet capping/geogrid levels extended as a continuous layer back from parking / driveway.
150mm	Type 6F4/6F5 Capping. Max. 75mm part size to SHW1 : Series 600.
1 Layer	Tensar Triax Type A-23327-L2 Geogrid.
300mm	Type 6F4/6F5 Capping. Max. 75mm part size to SHW1 : Series 600.
1 Layer	Tensar Triax Type A-23327-L1 Geogrid.
75mm	(Minimum) Blinding layer Type 6H Capping to SHW1 : Series 600.

	PRIVATE PATH / PATIO CONSTRUCTION (FRONT)
35mm	600mm square concrete paving slab.
25mm	Sharp sand to BS 7533-3 Category II of Annex D.
100mm	Clean well consolidated crushed rock, hardcore (max 40mm size) slag or concrete.
300mm	Type 6F4/6F5 Capping. Max. 75mm part size to SHW1 : Series 600.
1 Layer	Tensor Triax Type A-23327-L1 Geogrid.
75mm	(Minimum) Blinding layer type 6H Capping to SHW1 : Series 600.
Timber close boarded fence - 1.8m high Post and rail fence (to be stock proofed)	
	Part M 165mm step to finished floor level
	Part M flush to finished floor level
LP ○	Lighting column specification to be confirmed.
LB ○	Lighting bollard specification to be confirmed.

KEY:	
	Site boundary
1	Type 1 - Proposed 125x255mm precast concrete kerbs, Type HB2, laid with 125mm upstand unnoted otherwise.
2	Type 2 - Proposed 125x150mm precast concrete bullnosed kerb, Type BN25, laid with 25mm upstand unnoted otherwise.
3	Type 3 - Proposed 125x150mm precast concrete bullnosed kerb, Type BN6, laid with 6mm upstand unnoted otherwise.
4	Type 4 - Proposed 150x125mm precast concrete square edged kerb, Type CS2, laid flush with adjacent surfaces.
5	Type 5 - Proposed 50x150mm precast concrete edging, Type EF, laid flush with adjacent surface.
	Line of blocks in contrasting colour to parking bay blocks (brindle/charcoal) to delineate bays
HT C1	House type
Plot 38	Plot No.
	Location of private bin storage (Paving Type J)
	Location of private bike storage (Paving Type J)
	Proposed gate location

	<u>NOTES</u>
ate	1. Do not scale from this drawing.
less	2. This drawing is to be read in conjunction with all other relevant documents and specifications.
stand	3. Any discrepancies found between information shown on this or any other drawing shall be reported to the Engineer immediately and prior to work commencing on site.
end,	4. Refer to Architect's drawings for exact dimensions of buildings.
ete	5. Refer to the Engineer's drawings for extents and detail of all soft landscaping and unspecified hard landscaping areas.
	6. The Contractor shall arrange inspection by the relevant authority for all tie-in works to highway areas.
ces.	7. The generally expected ground conditions are Made Ground overlying River Terrace Deposits. This is underlain by Lewes Modular Chalk. CBR testing by GESL found values ranging between 1% and >30%. CBR testing for road construction is based on a minimum CBR value of 1%. CBR testing to be carried out in accordance with the Glanville/CBR Test Plan, GMSL Specification and in accordance with the requirements of DMRB, at MSL formation level and Sub-Base formation level pre- and post-MSL construction respectively.
(J)	8. All capping materials should meet the requirement of either 6F4 or 6F5 Table 6/1 of the Specification for Highway Works Series 600. Capping material shall be used as per details of the Tensar mechanically stabilised layers as shown on the parts. For tamped porous paved roads capping materials should be placed directly with the impervious liner (tanking membrane) and shall not be used as an alternative to Type 3 or to reduce the depth of the Type 3 sub-base above the impervious liner.
	9. Sub-base and capping depths are minimum required. Depth to be increased accordingly to avoid steps in Tensar geogrid placement. Refer

Glanville Project No: 8180814

10. The Made Ground is considered to be frost susceptible, therefore minimum pavement construction depth to be 450mm.
11. Soft spots to be removed and filled to a minimum depth of 600mm with Type 3 open graded crushed rock sub-base material and formation proof rolled prior to construction.
12. Proposed kerbs to comply with BS EN 1340.
13. Refer to the Architect's drawings and specifications for top-soiling, planting, planter and edging details to the planters.
14. Unless specifically noted otherwise, clauses and tables refer to The Specification for Highway Works (SFHW), Volume 1 of the Manual of Contract Documents for Highway Works.
15. Block paving to be installed strictly in accordance with the manufacturer's specification and guidance and BS 7533-3:2005 - Code of practice for laying precast concrete paving blocks and clay pavers for flexible pavements.
16. Prior to laying block paving the surface of the laying course shall be treated with a granular residual herbicide containing Dichlobenil. After laying of the blocks granular herbicide shall be brushed into the joints. Application must be in accordance with the manufacturer's recommendations and guidance.
17. Where base course is to be punched, it is to be thoroughly cleaned (mechanically) before.
18. All block paving to be laid in 90° herringbone pattern.
19. Patios formed using 600mm square slabs with 150 pea shingle strips to all abutments with buildings, fences & garden walls.
20. Concrete slabs to be laid in accordance with laying patterns shown on Engineering Construction Details drawing.
21. All service / utility covers to be paved in covers matching adjacent paving

The drawing is a detailed site plan for a residential development. It shows 39 numbered plots arranged in a grid-like fashion. Each plot contains a house type designation (e.g., HT A, HT B, HT C) and a plot number. The plan also indicates various surface finishes (e.g., permeable block paved parking bay, concrete, tarmac) and structural details (e.g., walls, doors, windows). A north arrow is located in the top right corner, and a scale bar (1:200) is in the bottom right corner. The title block in the bottom right corner provides project information:

C2 Permeable block paved parking bay specification revised.		28.08.19	CS
Rev.	Description	Date	Chkd
Glanville Cornerstone House 62 Foxhall Road, Didcot Oxon, OX11 7AD Tel: (01235) 515550 Fax: (01235) 817799 postbox@glanvillegroup.com www.glanvillegroup.com			
Client: THAKEHAM			
Project: Cornfield Close, Littlehampton			
Title: Surface Finishes Layout Sheet 2 of 3			
Project Engineer: C. Salt		Scale: 1:200 @ A1	
Project Director: J. Birch		Date: February 2019	
Status: CONSTRUCTION			
Drawing No. M637/14.002		Rev C2	