


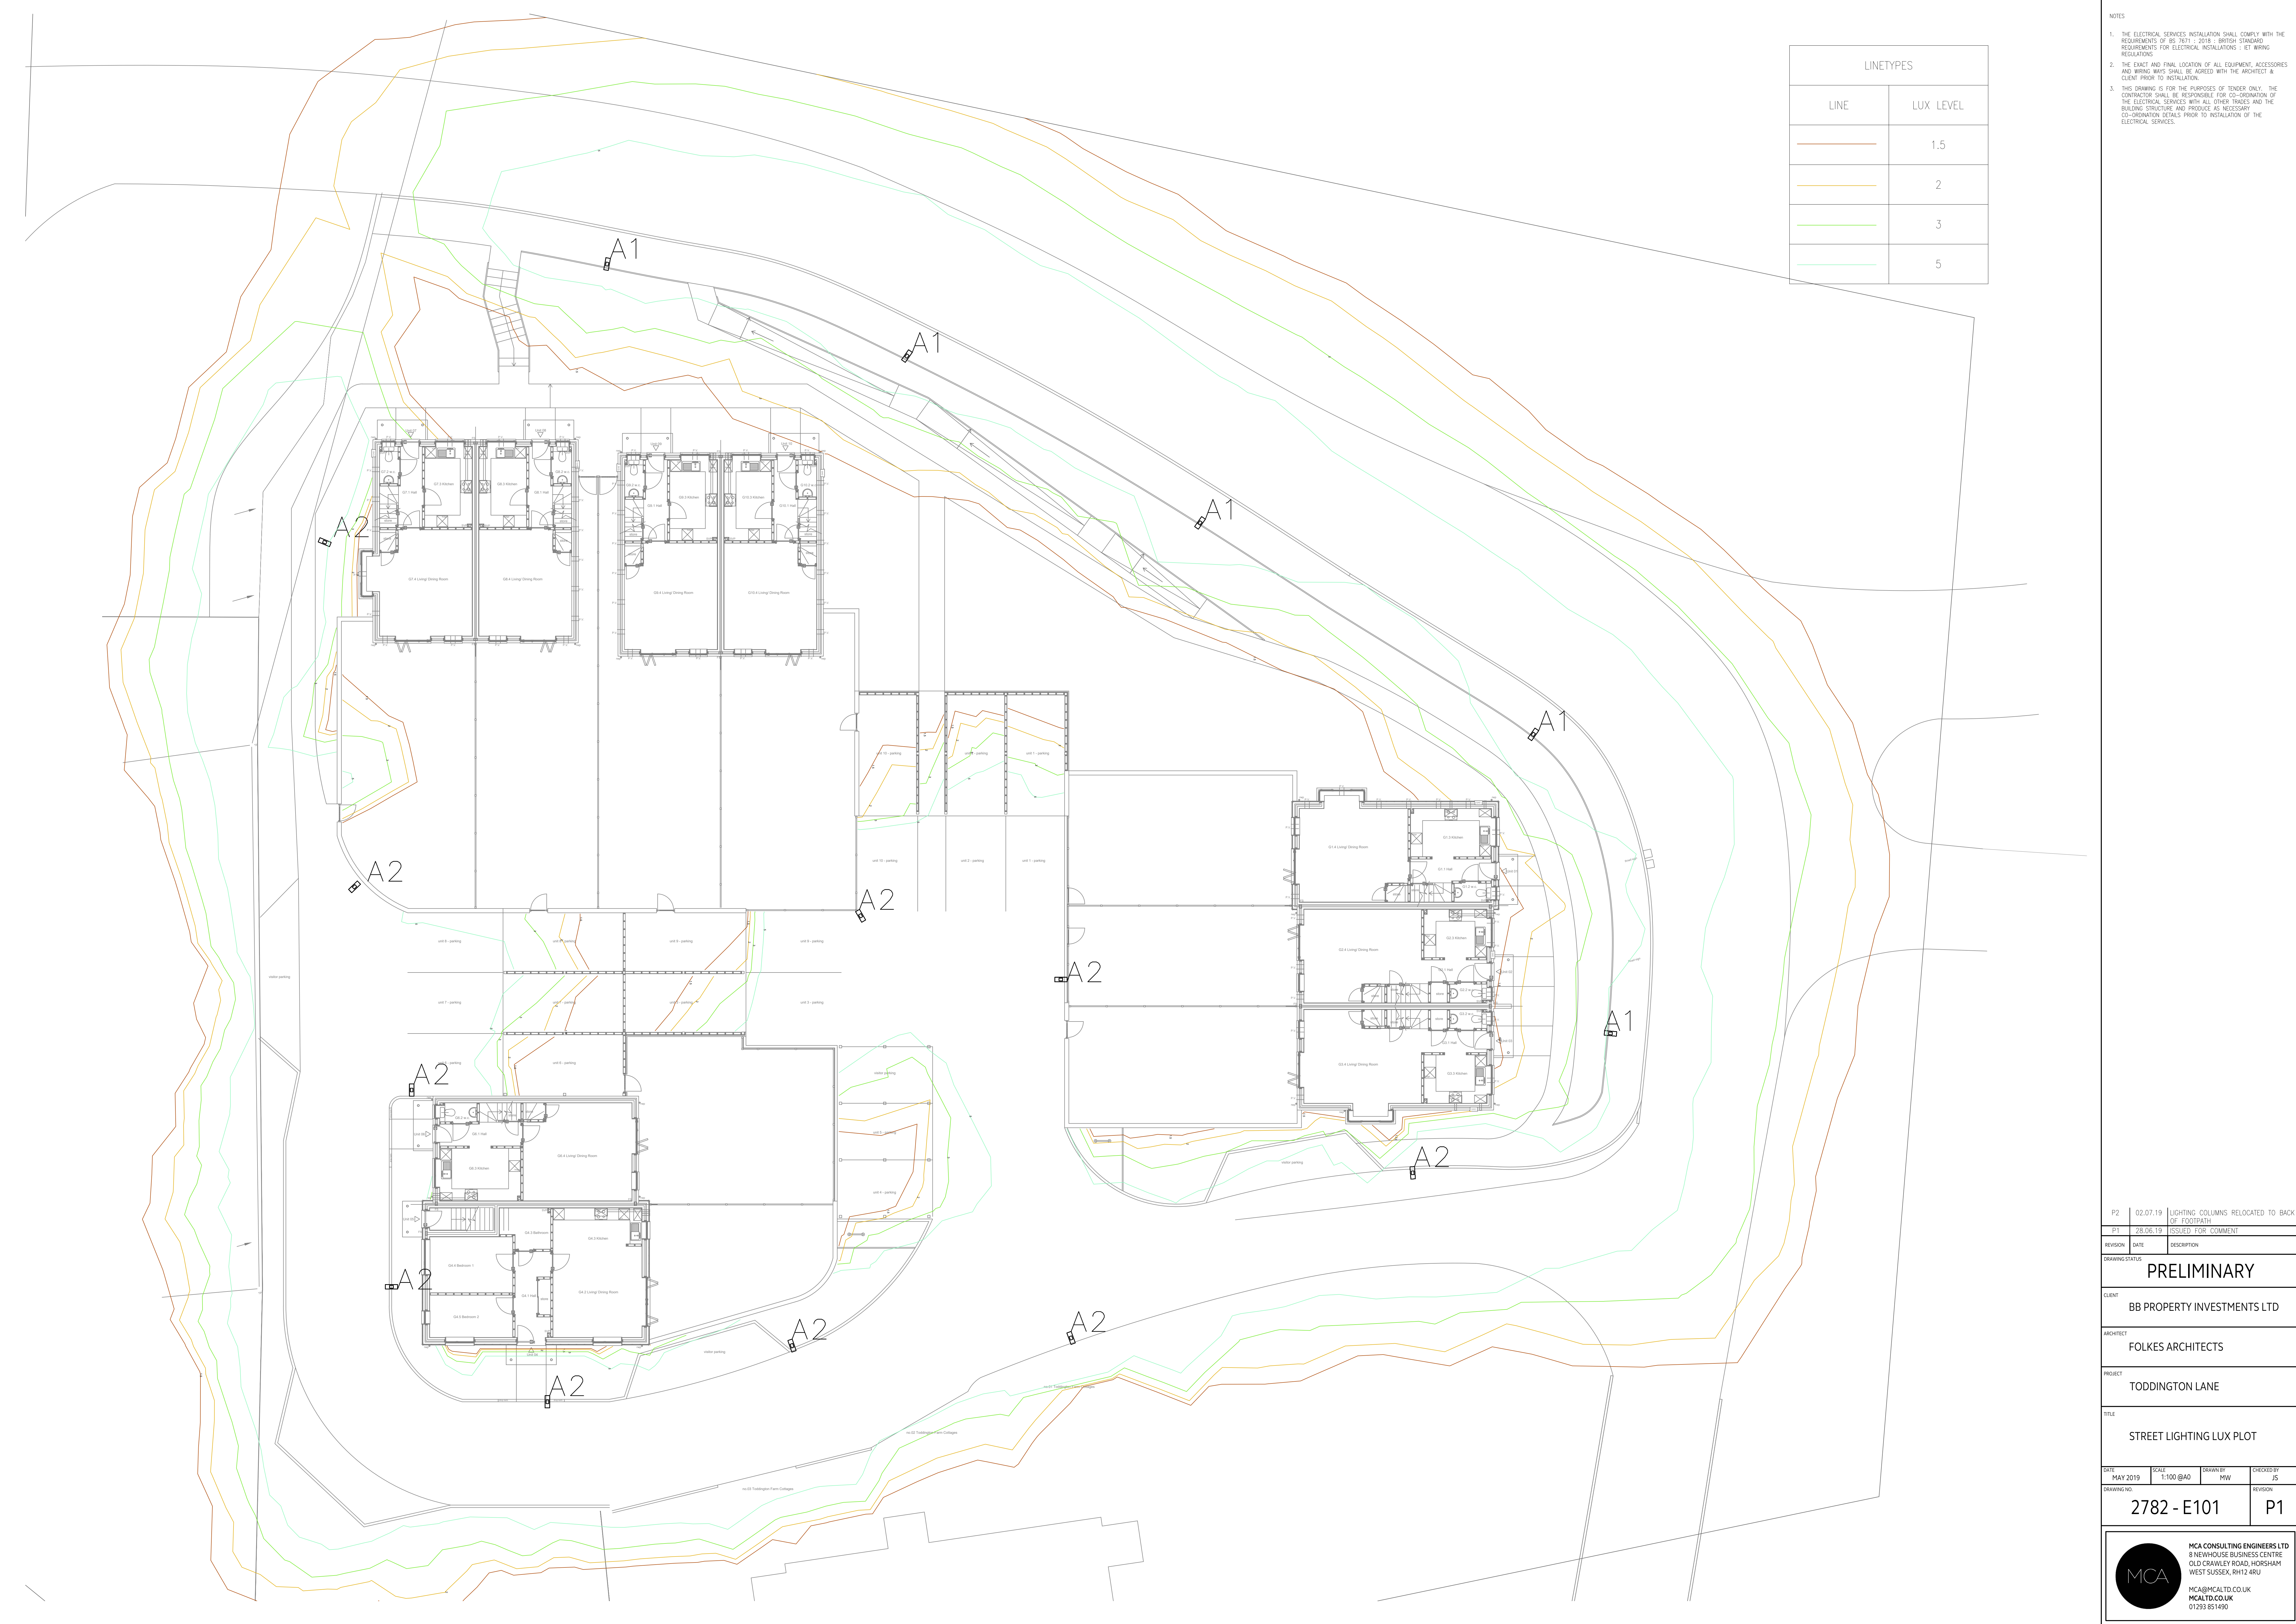

LINETYPES	
LINE	LUX LEVEL
	1.5
	2
	3
	5

- NOTES
1. THE ELECTRICAL SERVICES INSTALLATION SHALL COMPLY WITH THE REQUIREMENTS OF BS 7671 : 2018 : BRITISH STANDARD REQUIREMENTS FOR ELECTRICAL INSTALLATIONS : IET WIRING REGULATIONS.
 2. THE EXACT AND FINAL LOCATION OF ALL EQUIPMENT, ACCESSORIES AND WIRING MAYS SHALL BE AGREED WITH THE ARCHITECT & CLIENT PRIOR TO INSTALLATION.
 3. THIS DRAWING IS FOR THE PURPOSES OF TENDER ONLY. THE CONTRACTOR SHALL BE RESPONSIBLE FOR CO-ORDINATION OF THE ELECTRICAL SERVICES WITH ALL OTHER TRADES AND THE BUILDING STRUCTURE AND PROVIDE AS NECESSARY CO-ORDINATION DETAILS PRIOR TO INSTALLATION OF THE ELECTRICAL SERVICES.

P2	02.07.19	LIGHTING COLUMNS RELOCATED TO BACK OF FOOTPATH
P1	28.06.19	ISSUED FOR COMMENT
REVISION	DATE	DESCRIPTION

DRAWING STATUS			
PRELIMINARY			
CLIENT			
BB PROPERTY INVESTMENTS LTD			
ARCHITECT			
FOLKES ARCHITECTS			
PROJECT			
TODDINGTON LANE			
TITLE			
STREET LIGHTING LUX PLOT			
DATE	SCALE	DRAWN BY	CHECKED BY
MAY 2019	1:100 @A0	MW	JS
DRAWING NO.		REVISION	
2782 - E101		P1	

MCA CONSULTING ENGINEERS LTD
8 NEWHOUSE BUSINESS CENTRE
OLD CRAWLEY ROAD, HORSHAM
WEST SUSSEX RH12 4RU
MCA@MCALTD.CO.UK
MCALTD.CO.UK
01293 851490