

SOUTHERN WATER NOTES

1. ALL LEVELS RELATE TO OS DATUM
2. CLASS S GRANULAR BED AND SURROUND TO ALL SEWER PIPES WHERE COVER IS GREATER THAN 1.2m BELOW FINISHED LEVELS.
3. CLASS A CONCRETE BED AND SURROUND TO ALL SEWER PIPES WHERE COVER IS LESS THAN 1.2m BELOW FINISHED LEVELS.
4. REFER TO 'TYPICAL SEWER DETAILS' DRAWING FOR MATERIAL SPECIFICATION.
5. PIPES WITH A NOMINAL PIPE RANGE OF 150MM-300MM MAY BE CONSTRUCTED IN EITHER:


o) CLAY

OR

b) UPVC (ULTRA FORTIS) WHICH IS RESISTANT TO A JETTING PRESSURE OF 4000PSI. MINIMISE THE NUMBER OF JOINTS IN THE SYSTEM BY USING 3M PIPE LENGTH & DO NOT HAVE UP SEAL JOINTS HENCE PREVENTING ROOT INGRESS.
6. ALL PIPES GREATER THAN 300MM DIAMETER TO BE CONCRETE CLASS 120 TO BS EN 1916 & BS5911-1.
7. STRENGTH OF PIPE TO BE IN ACCORDANCE WITH THE MANUFACTURERS RECOMMENDATIONS FOR THE DEPTH OF WHICH THE PIPES ARE TO BE LAD & THE INTENDED IMPOSED LOAD.
8. ALL ADAPTABLE DRAINAGE WORKS TO BE CONSTRUCTED AS DETAILED IN THE WATER AUTHORITIES ASSOCIATION PUBLICATION 'SEWERS FOR ADOPTION 6TH EDITION'.

----- Existing Ground Line

----- Proposed Finished Level

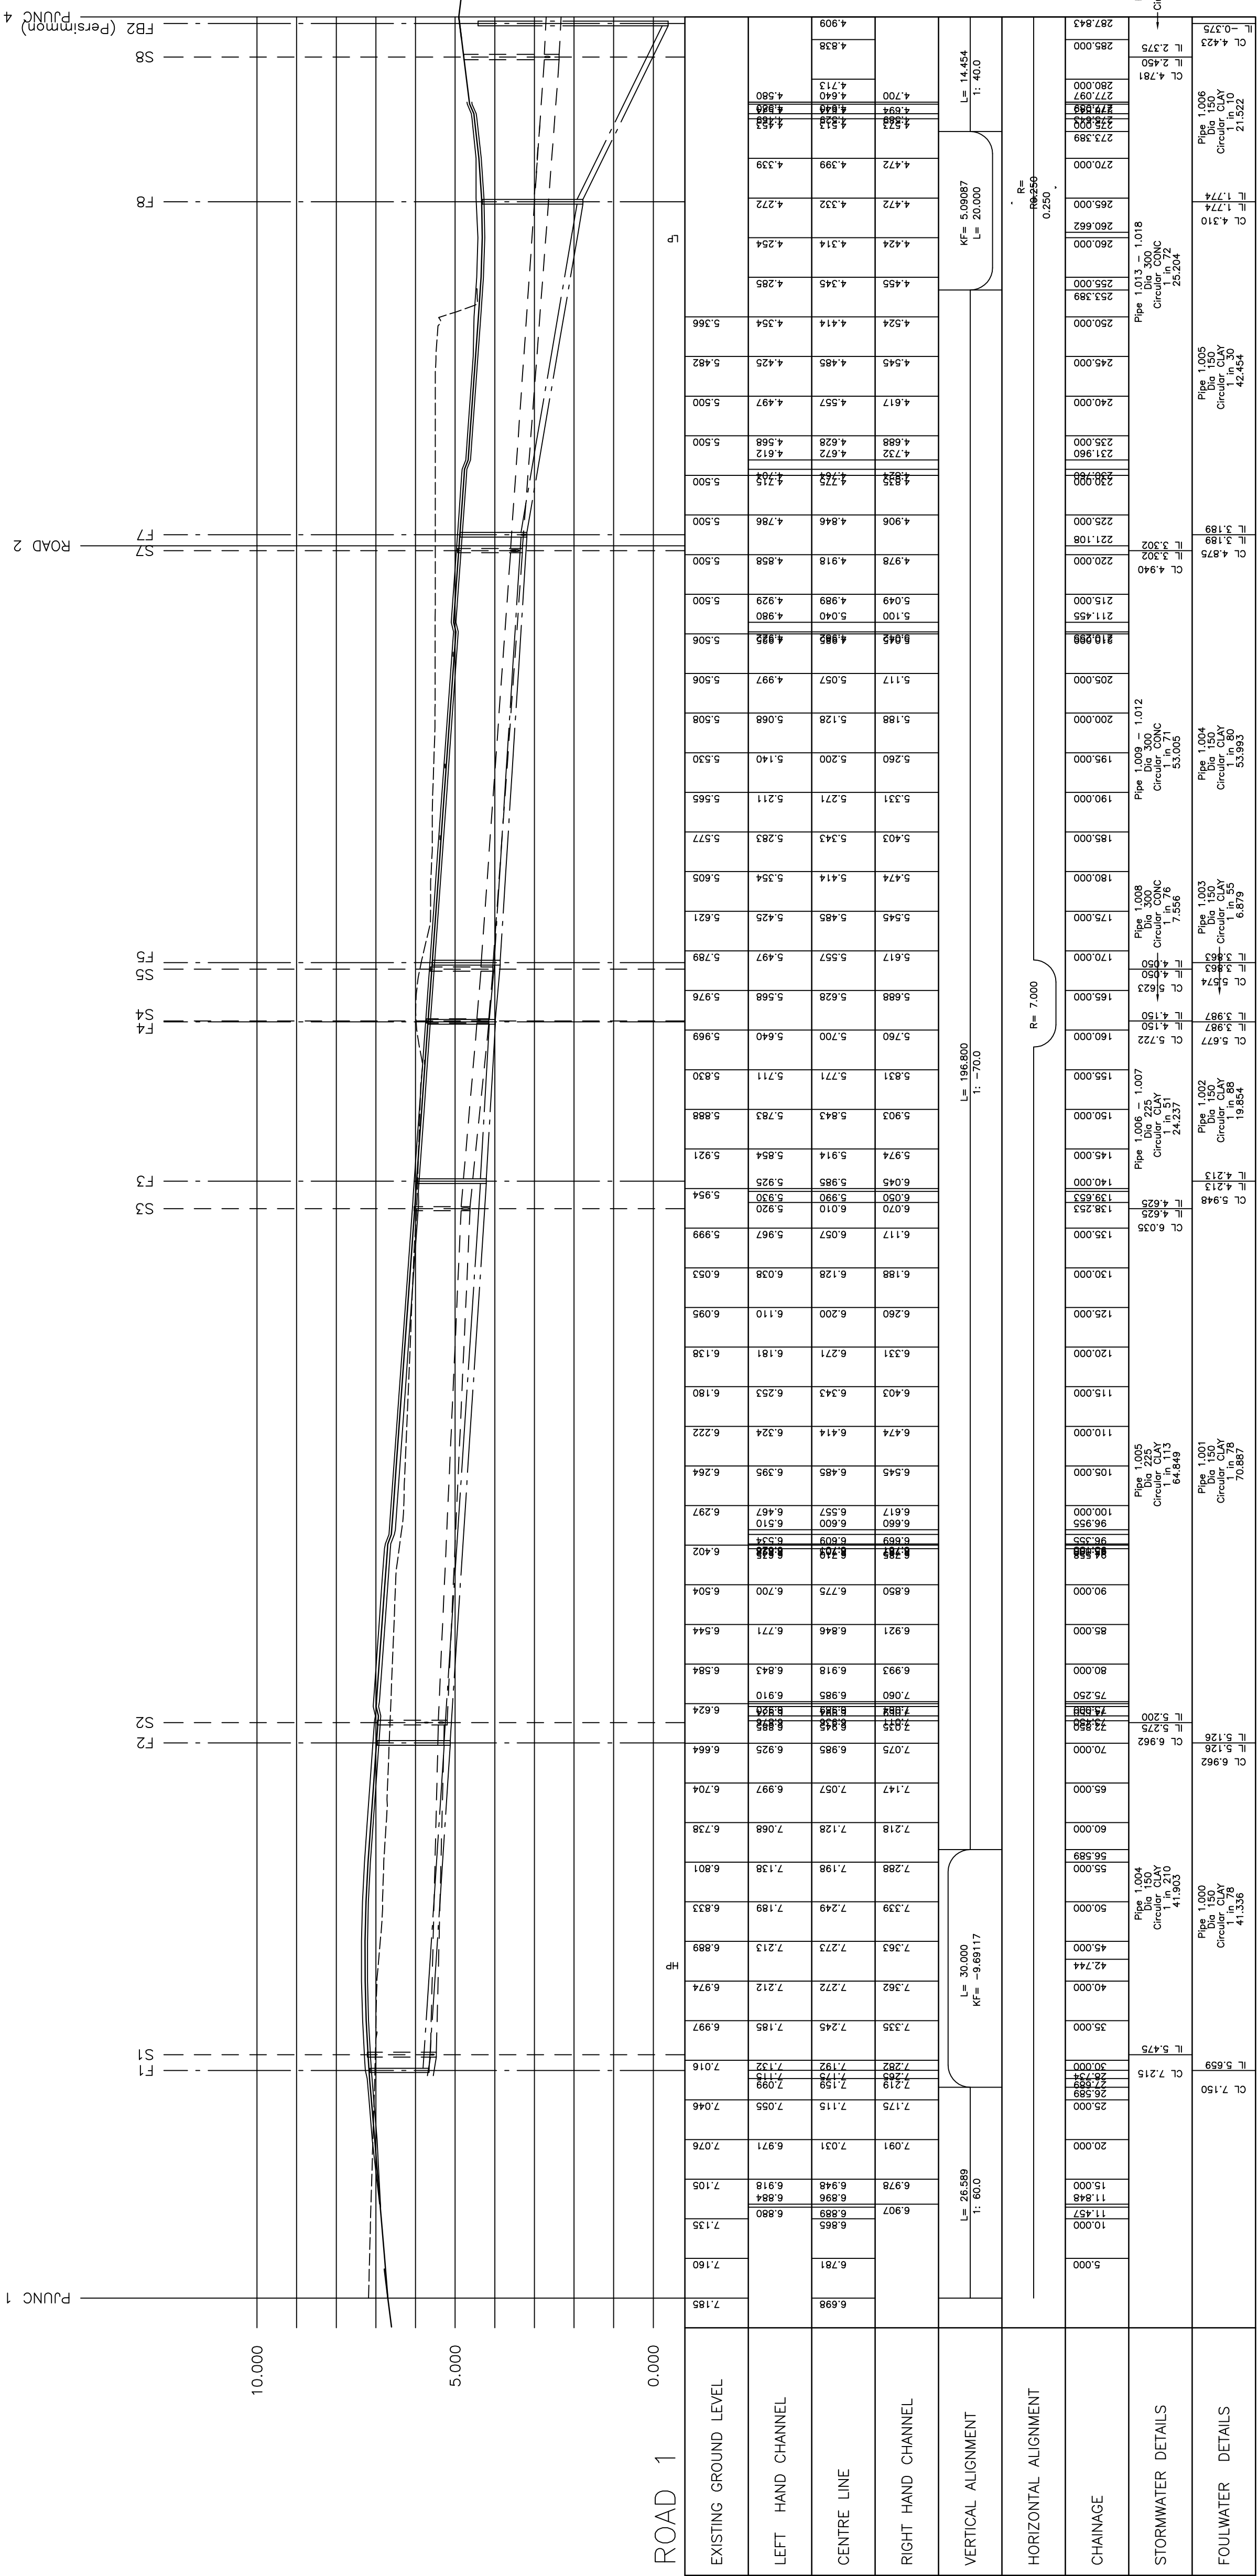

Do not scale from this drawing. Use written dimensions only. When shown relationship between dimensions, the dimension with the decimal point shall prevail in the event of any discrepancy or inconsistency between the dimension and the dimension with the decimal point.



Bovis Homes Limited
Southern Region.
The Manor House,
North Ash Road,
New Ash Green, Longfield,
Kent, DA3 8HQ.
Tel: 01474 876200
Fax: 01474 876323
DX: 41950 New Ash Green 2

SITE
HAMPTON PARK
LITTLEHAMPTON, WEST SUSSEX

DRAWING TITLE
ROAD & SEWER SECTIONS
SHEET 1

DRAWN BY	SY	DATE	NOV 2015	DRAWING NO.	REV
SCALE	1:100, 1H:1500	CHECKED/DAT		LITL-503/1	C


SOUTHERN WATER NOTES

1. ALL LEVELS RELATE TO OS DATUM
2. CLASS S GRANULAR BED AND SURROUND TO ALL SEWER PIPES WHERE COVER IS GREATER THAN 1.2m BELOW FINISHED LEVELS.
3. CLASS A CONCRETE BED AND SURROUND TO ALL SEWER PIPES WHERE COVER IS LESS THAN 1.2m BELOW FINISHED LEVELS.
4. REFER TO 'TYPICAL SEWER DETAILS' DRAWING FOR MATERIAL SPECIFICATION.
5. PIPES WITH A NOMINAL PIPE RANGE OF 150MM-300MM MAY BE CONSTRUCTED IN EITHER:

a) CLAY

OR

b) UPVC (ULTRA FORTIS) WHICH IS RESISTANT TO A JETTING PRESSURE OF 4000PSI. MINIMISE THE NUMBER OF JOINTS IN THE SYSTEM BY USING 3M PIPE LENGTH & DO NOT HAVE UP SEAL JOINTS HENCE PREVENTING ROOT INGRESS.
6. ALL PIPES GREATER THAN 300MM DIAMETER TO BE CONCRETE CLASS 120 TO BS EN 1916 & BS5911-1.
7. STRENGTH OF PIPE TO BE IN ACCORDANCE WITH THE MANUFACTURERS RECOMMENDATIONS FOR THE DEPTH OF WHICH THE PIPES ARE TO BE Laid & THE INTENDED IMPOSED LOAD.
8. ALL ADAPTABLE DRAINAGE WORKS TO BE CONSTRUCTED AS DETAILED IN THE WATER AUTHORITIES ASSOCIATION PUBLICATION 'SEWERS FOR ADOPTION 6TH EDITION'.

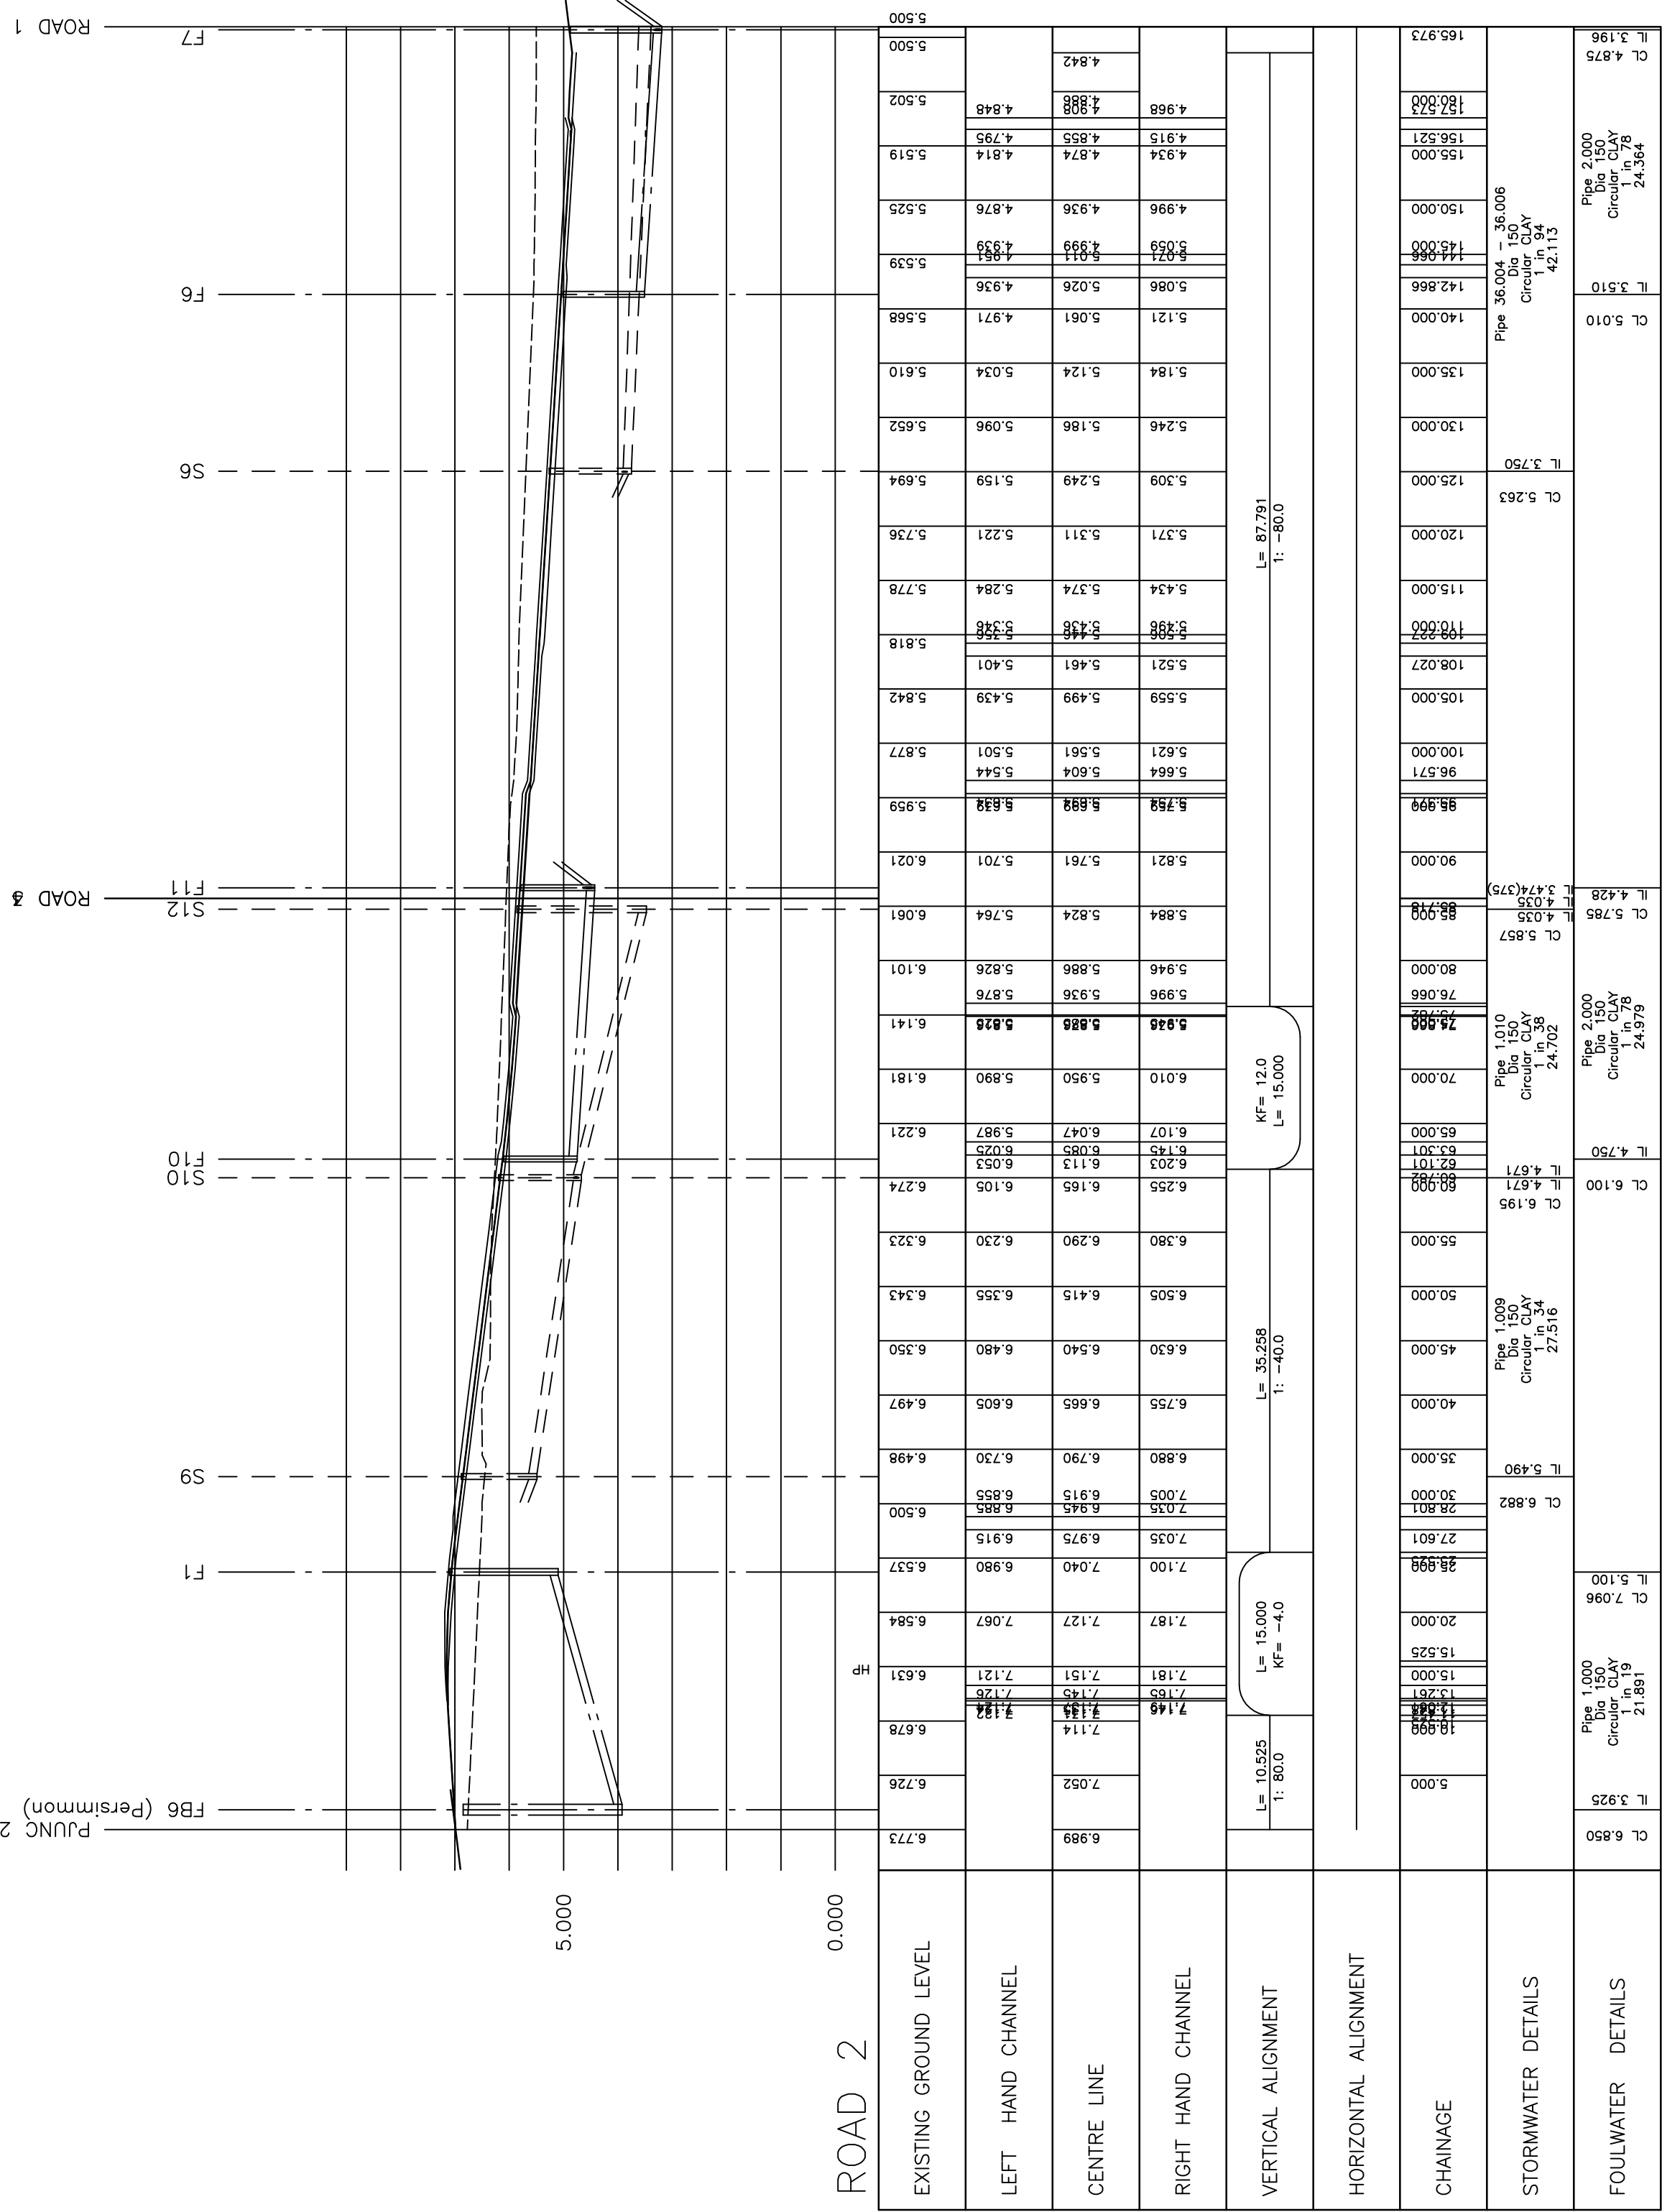

SOUTHERN WATER NOTES

1. ALL LEVELS RELATE TO OS DATUM
2. CLASS S GRANULAR BED AND SURROUND TO ALL SEWER PIPES WHERE COVER IS GREATER THAN 1.2m BELOW FINISHED LEVELS.
3. CLASS A CONCRETE BED AND SURROUND TO ALL SEWER PIPES WHERE COVER IS LESS THAN 1.2m BELOW FINISHED LEVELS.
4. REFER TO 'TYPICAL SEWER DETAILS' DRAWING FOR MATERIAL SPECIFICATION.
5. PIPES WITH A NOMINAL PIPE RANGE OF 150MM-300MM MAY BE CONSTRUCTED IN EITHER:

a) CLAY

OR

b) UPVC (ULTRA FORTIS) WHICH IS RESISTANT TO A JETTING PRESSURE OF 4000PSI. MINIMISE THE NUMBER OF JOINTS IN THE SYSTEM BY USING 3M PIPE LENGTH & DO NOT HAVE UP SEAL JOINTS HENCE PREVENTING ROOT INGRESS.
6. ALL PIPES GREATER THAN 300MM DIAMETER TO BE CONCRETE CLASS 120 TO BS EN 1916 & BS5911-1.
7. STRENGTH OF PIPE TO BE IN ACCORDANCE WITH THE MANUFACTURERS RECOMMENDATIONS FOR THE DEPTH OF WHICH THE PIPES ARE TO BE LAD & THE INTENDED IMPOSED LOAD.
8. ALL ADAPTABLE DRAINAGE WORKS TO BE CONSTRUCTED AS DETAILED IN THE WATER AUTHORITIES ASSOCIATION PUBLICATION 'SEWERS FOR ADOPTION 6TH EDITION'.

