

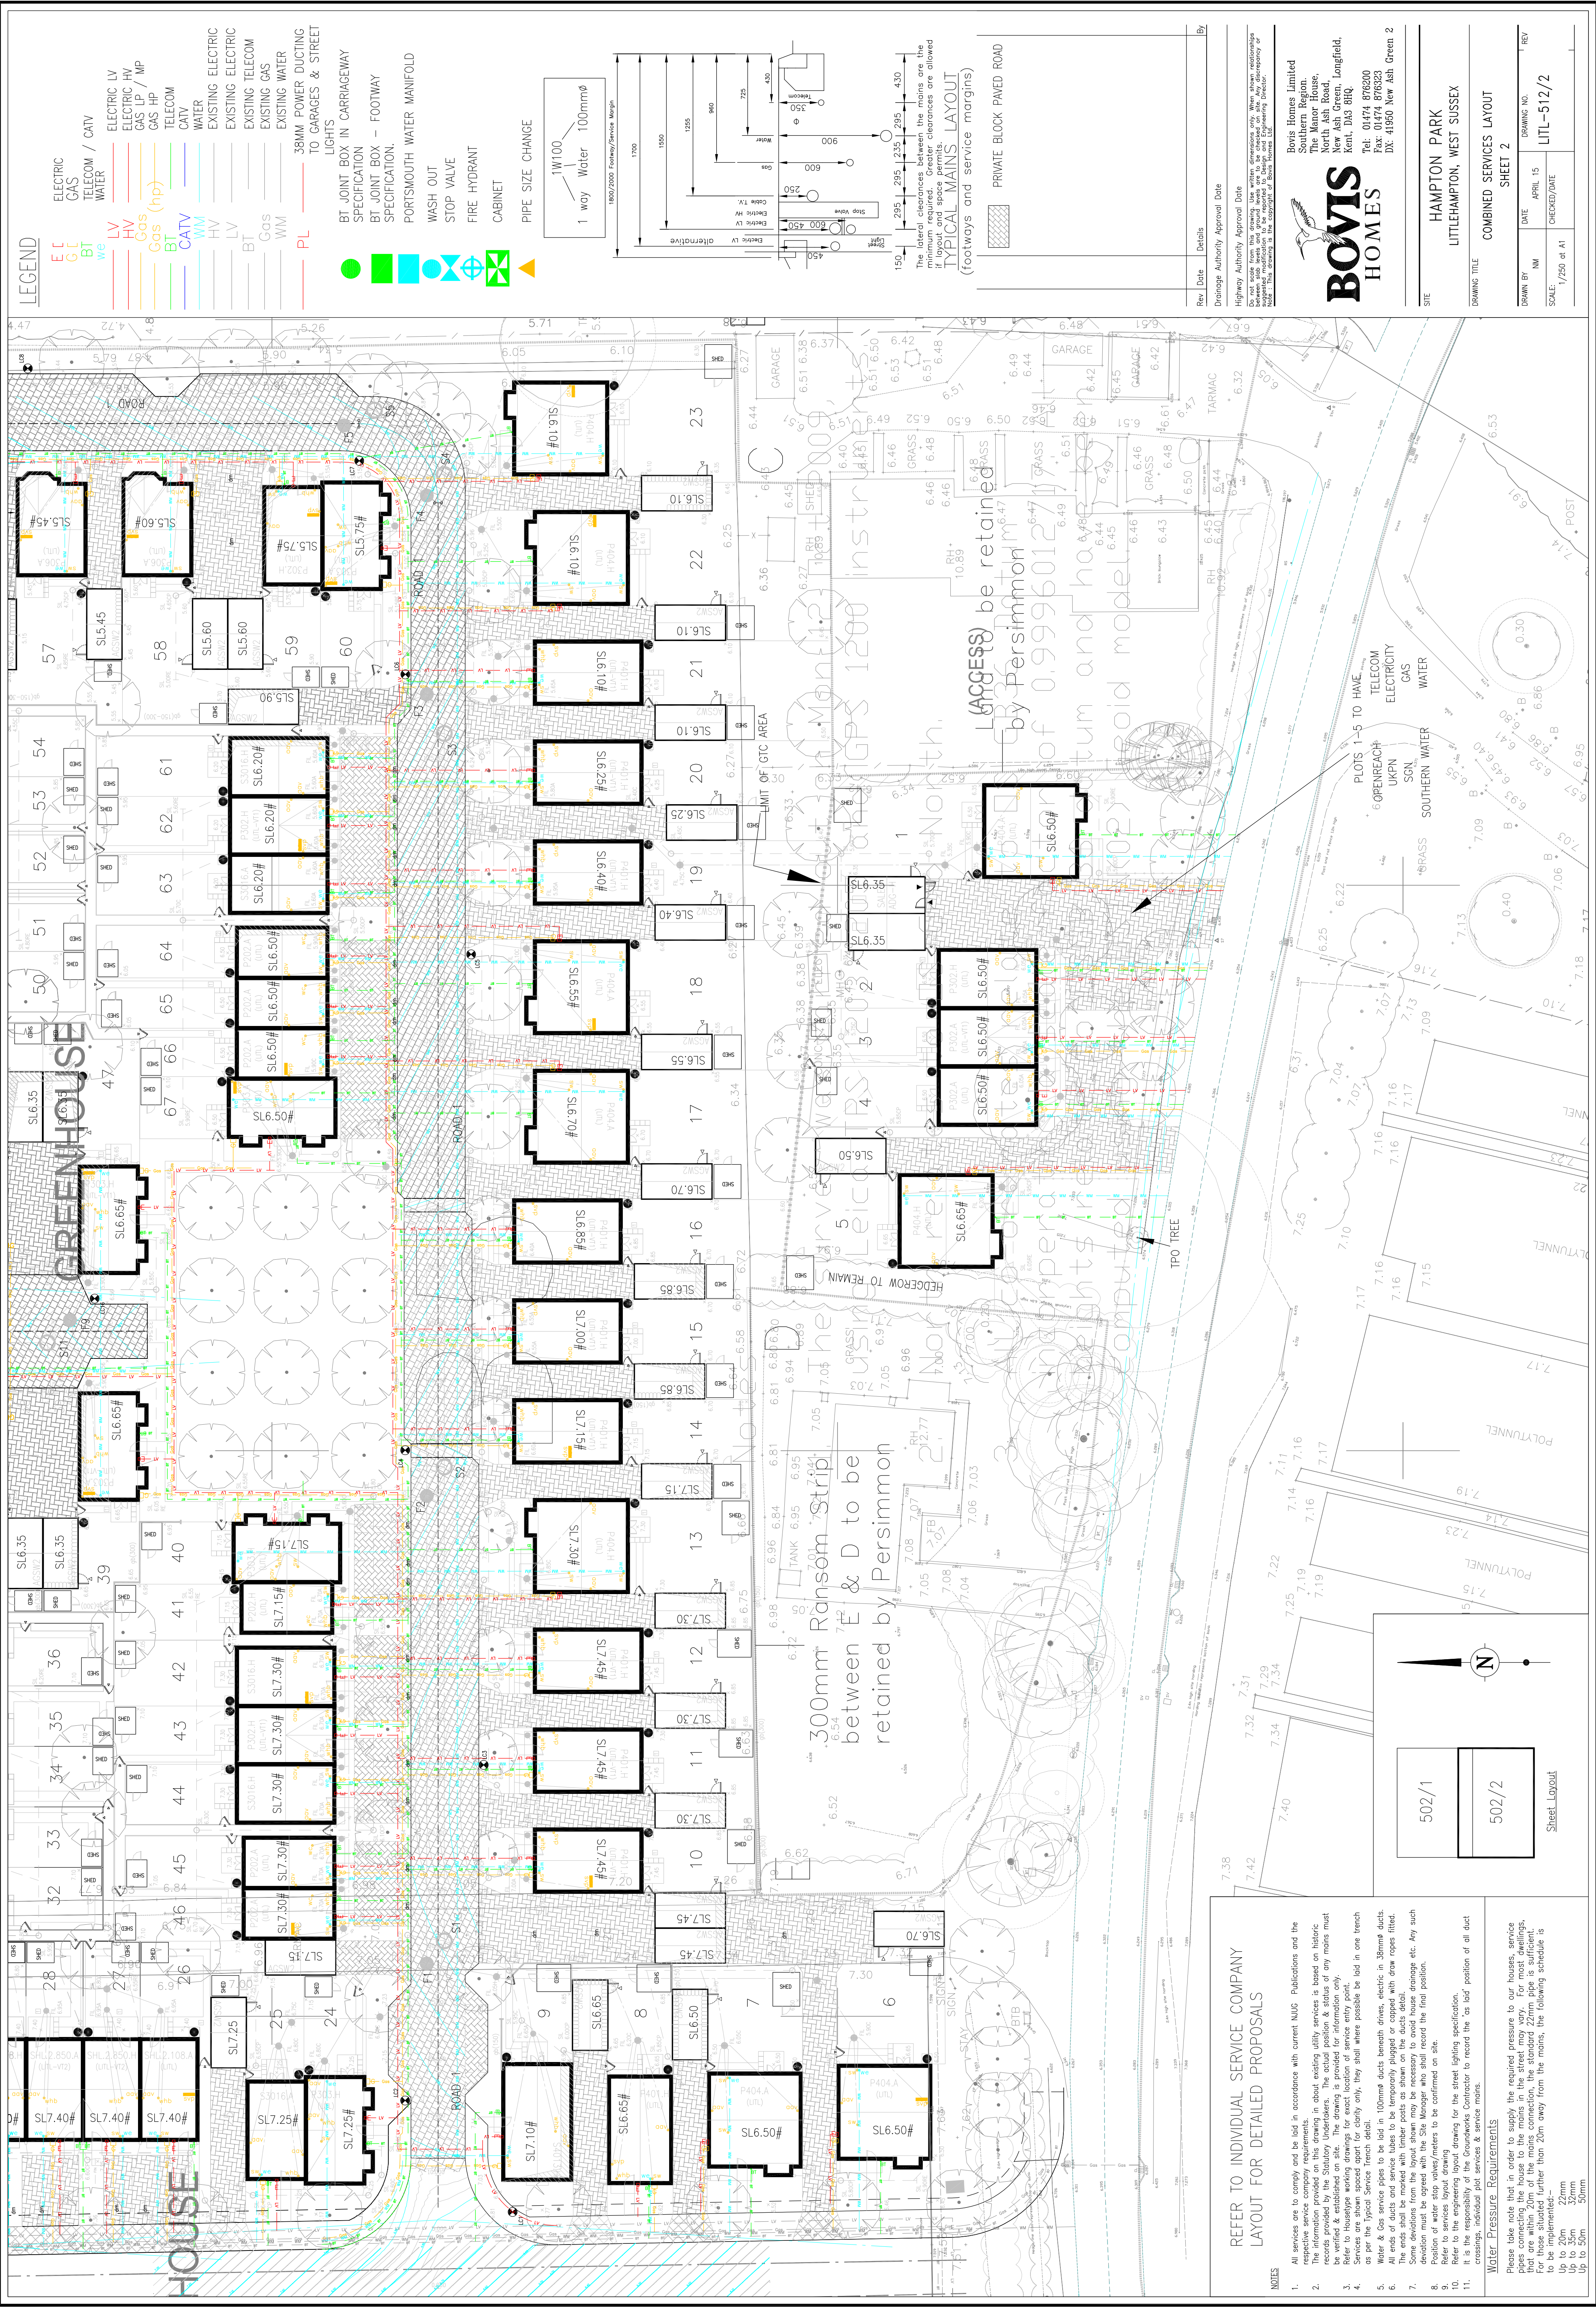


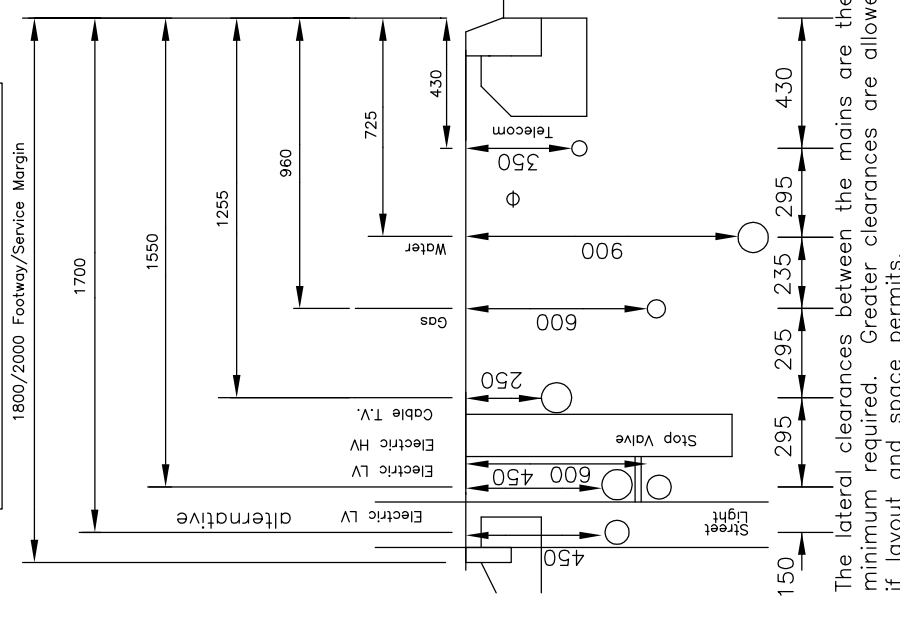

LEGEND

- ELECTRIC LV
- GAS
- TELECOM / CATV
- WATER
- ELECTRIC HV
- GAS LP / MP
- GAS HP
- TELECOM
- CATV
- WATER
- EXISTING ELECTRIC
- EXISTING TELECOM
- EXISTING GAS
- EXISTING WATER
- 38MM POWER DUCTING
- TO GARAGES & STREET
- LIGHTS
- BT JOINT BOX IN CARRIAGEWAY
- SPECIFICATION
- BT JOINT BOX - FOOTWAY
- SPECIFICATION
- PORTSMOUTH WATER MANIFOLD
- WASH OUT
- STOP VALVE
- FIRE HYDRANT
- CABINET
- PIPE SIZE CHANGE

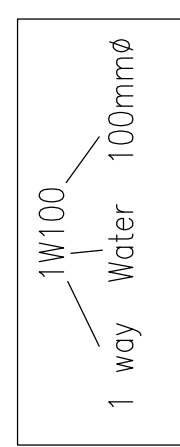

TYPICAL MAINS LAYOUT

(Footways and service margins)

PRIVATE BLOCK PAVED ROAD

Rev	Date	Details	By

Drainage Authority Approval Date	
Highway Authority Approval Date	

Do not scale from this drawing. Use written dimensions only. When shown relationships suggesting modification to be referred to Design and Engineering Director. Note: This drawing is the copyright of Bovis Homes Ltd.


- NOTES
- All services are to be supplied and laid in accordance with current NUGS. Prolifications and the respective service company requirements.
 - The information provided on this drawing in about existing utility services is based on historic records provided by the Statutory Undertakers. The actual position & status of any mains must be verified & established on site. The drawing is provided for information only.
 - Refer to house type working drawings for exact location of services entry points.
 - Refer to services layout drawing for any other details.
 - Water & Gas service pipes to be laid in 100mm ducts beneath drives, electric in 38mm ducts.
 - All ends of ducts and service tubes to be temporarily plugged or capped with draw ropes fitted.
 - The ends of ducts and service tubes to be permanently plugged or capped with draw ropes fitted.
 - Some deviations from the layout shown may be necessary to avoid house drainage etc. Any such deviation must be agreed with the Site Manager who shall record the final position.
 - Refer to services layout drawing for the street lighting specification.
 - It is the responsibility of the Groundworks Contractor to record the 'as laid' position of all duct crossings, individual pit services & service mains.

REFER TO INDIVIDUAL SERVICE COMPANY LAYOUT FOR DETAILED PROPOSALS

Water Pressure Requirements

Please take note that in order to supply the required pressure to our houses, service pipes connecting the house to the mains in the street may vary. For most dwellings that are within 20m of the mains connection, the standard 22mm pipe is sufficient. For those situated further than 20m away from the mains, the following schedule is to be implemented:-

Up to 35m	22mm
35m to 50m	50mm

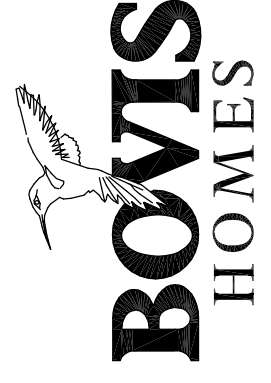

Bovis Homes Limited
Southern Region,
The Manor House,
North Ash Green, Longfield,
Kent, DA3 8BQ.
Tel: 01474 876200
Fax: 01474 876323
DX: 41950 New Ash Green 2

SITE
HAMPTON PARK
LITTLEHAMPTON, WEST SUSSEX

DRAWING TITLE
COMBINED SERVICES LAYOUT
SHEET 2

DRAWN BY	DATE	CHECKED/DATE	REV
NA	APRIL 15	LITL-512/2	

SCALE: 1/250 at A1